



# HIGHLANDS SUBDIVISION

OSSIPEE TRAIL  
STANDISH, MAINE

## FINAL SITE PLAN AND SUBDIVISION APPLICATION

PREPARED FOR:

LEAVITT-TOMPSON, LLC  
P.O. BOX 703  
STANDISH, ME 04084

PREPARED BY:

TERRADYN CONSULTANTS LLC  
41 CAMPUS DRIVE, SUITE 101  
NEW GLOUCESTER, ME 04260

JANUARY 21, 2020  
REVISED APRIL 15, 2020



**Pineland**

Cumberland Hall  
41 Campus Drive, Suite 101  
New Gloucester, ME 04260

**Portland**

565 Congress Street, Suite 201  
Portland, ME 04101

**Highlands Subdivision – Final Subdivision & Site Plan Application**

**CONTENTS**

Preliminary Application Cover Letter	November 13, 2018
Subdivision & Site Plan Application Forms	November 13, 2018
Revised Village Housing Cover Letter	January 22, 2019
Final Subdivision and Site Plan Application	January 21, 2020
Blasting Application	February 20, 2020
Peer Review Comment Response	March 26, 2020
Septic System Comment Response	April 13, 2020
Peer Review & Public Works Comment Response	April 15, 2020
Plan Set	April 15, 2020



**PRELIMINARY APPPLICATION COVER LETTER 11/13/2018**

November 13, 2018

Mr. Alton Benson, Town Planner  
Town of Standish Municipal Building  
175 Northeast Road  
Standish, ME 04085

**Preliminary Subdivision & Site Plan Application: Highlands Subdivision and Village Housing**

Dear Mr. Benson,

On behalf of Leavitt-Tompson, LLC we are pleased to submit the Preliminary Subdivision and Site Plan Application for the Highlands, an eighty (80) unit Village Housing Site Plan and 20-lot residential subdivision.

The development parcel is located on the north side of Route 25, approximately 1.2 miles west of Standish Corner, and extends northeasterly to Oak Hill Road. The property is shown as lots 11 and 19C on Town of Standish Tax Map #10. The 53.11-acre property is located within the Standish Corner District. The Standish Corner District (SCD) Regulating Plan requires a Town Residential (TR) street frontage type for the public right-of-way within the proposed development. A section of Town Avenue (TA) street is also proposed for the access onto Route 25.

Because the property is located within the Form Based Code Village District (FBCVD), we met with the Town Planner on April 18 and May 3, 2018 to review the required permitting process and standards for the FBCVD. We discussed the components of the FBCVD including the intent of mixed-use, interconnected and walkable neighborhoods as well as the requirements for a Connectivity Master Plan to reserve areas for future rights-of-way as potential connections to abutting developable land.

**Project History**

We submitted the Sketch Plan application on May 14, 2018, met with the Planning Board at the June 4, 2018 meeting, and discussed the project in a Planning Board workshop on June 13, 2018. The Sketch Plan included 80 two-bedroom multi-family units and 17 single family lots, with a new TR street extending from Leavitt Earthworks' existing entrance on Route 25 to Oak Hill Road. Two abutting property owners at the Planning Board meeting expressed concerns about providing buffers around the development. One of the abutters (Mrs. Jamison) expressed concern that existing private wells could be affected. At the workshop meeting, the Planning Board provided the following input:

- The roadway, subdivision and village housing layout generally appeared reasonable to proceed to a preliminary application.
- The connectivity plan for providing future rights-of-way to abutting properties appeared adequate, except that the plan should consider options to provide future road and water main access to the Jamison property (map 6, lot 31).
- The plan should include a community meeting building.

### **Current Development Plan**

The plan set included with this application incorporates the input received from the Sketch Plan process, as well as other significant changes and refinements as explained below.

The most significant change to the plan is the location of the proposed intersection of Highlands Drive and Route 25. The new plan establishes this entrance approximately 350 feet west of the existing Leavitt Earthworks driveway. This change resulted from consultations with Maine DOT and their determination that the proposed driveway could not be approved at the Leavitt Earthworks driveway because it does not meet minimum sight distance standards looking to the west (right). Route 25 is classified by Maine DOT as a mobility arterial and requires 840' sight distance for the posted 50 mph speed limit. As a result, Terradyn filed a Highway Entrance Permit Application and the applicant received an Entrance Permit for the revised location in September 2018. A copy of the approved entrance permit is included in Attachment 4.

The net residential density calculations show that the property can support 81 two-bedroom Village Housing dwelling units (at 1 unit/16,000 SF), 18 single-family lots (30,000 SF minimum lot size on TR Street) and four duplex units (20,000 SF minimum lot size on TA Street). Net residential calculations are shown on the enclosed Preliminary Subdivision Plan.

The Village Housing Standards (181-28.1) require a 100-foot continuous vegetative buffer to the front and 50-foot continuous vegetative buffer to the sides and rear of improved areas in the development.

### **Proposed Road Network**

Leavitt-Tompson, LLC proposes to construct Highlands Drive from Route 25 to Oak Hill Road, a total distance of approximately 4,720 feet. The first section from Route 25 to +/- station 9+40 is proposed as a TA Street. This section provides frontage for two (2) duplex residential lots. A TR Street is proposed from station 9+40 to Oak Hill Road. Five (5) private roads provide access to the 80 two-bedroom village housing units in the southwest portion of the site closer to Route 25. Vegetative buffers are required by the Ordinance to provide screening from abutting properties. The single family lots are proposed in the central and northeastern areas of the site with frontage on the new TR street.

### **Connectivity Master Plan**

The Subdivision Plan reserve future 50' rights-of-way to allow connection to abutting properties as required in the Standish Corner District. One of these is a range way that crosses the property in a northwest-southeast direction about 1200 feet northeast of Route 25. Other future ROW locations are reserved based on the block length requirements in the FBCVD. The Plan also provides future driveway easements to the rear of three lots on Oak Hill Road. Proposed future access connections are shown on the Connectivity Master Plan.

### **Project Utilities**

The development will be served by a 12" public water main extended from the existing Portland Water District main on Oak Hill Road. The applicant met with PWD on May 30 and October 4, 2018 to discuss the main extension, anticipated schedule and review detailed construction plans. PWD has indicated to the applicant that they intend to replace the 8" water main in Oak Hill Road with a new 12" main in early Spring 2019 if project approvals are on track. The Town of Standish

also agreed to defer new pavement on this section of Oak Hill Road until after the water main is replaced.

The Village Housing area will be served by on-site septic systems sized for either four (4) or eight (8) two-bedroom units. Mark Hampton Associates and Mark Cenci Associates provided soil test pits demonstrating suitable soils for subsurface wastewater disposal systems for the Village Housing area and on each of the single-family lots. Test pit logs are attached to the application and locations are shown on the plans. Electric power and telecommunications utilities will be installed underground within the development.

The project plans are based upon a boundary survey performed by Richard W. Hamilton, P.L.S. Topographic information was obtained from the State of Maine Office of GIS, and from ground topographic survey. The wetland delineation was completed by Mark Hampton Associates - wetlands are shown on the attached plan.

### **Project Team**

The applicant has hired the following project consultants:

Engineer:	Jeff Amos, P.E. #10167 Terradyn Consultants, LLC P.O. Box 339 New Gloucester, ME 04260 (207) 926-5111	Surveyor:	Richard W. Hamilton, P.L.S. #2336 Boundary Engineering Survey Technology 25 Tubros Lane Buxton, ME 04093 (207) 929-2378
Soil Survey & Wetlands:	Mark Hampton Mark Hampton Associates P.O. Box 1931 Portland, ME 04104 (207) 756-2900	Site Evaluator:	Mark Cenci Mark Cenci Geologic, Inc. 93 Mill Road Cumberland, ME 04021 (207) 329-3524

### **Waiver Request**

We are requesting a waiver of the requirement for sidewalk on both sides of the proposed TA and TR Streets on the basis that the Village Housing area is all on one side of the street and 13 of the 18 single family lots are located on one side of the street. Sidewalks on one side of the street will also reduce the total impervious area that requires phosphorus treatment in the Sebago Lake watershed.

### **Attachments -REFER TO ORIGINAL APPLICATION FOR ATTACHMENTS 3 THROUGH 17 BELOW**

~~The following items are attached to this application.~~

- Attachment 1 – Preliminary Subdivision Application
- Attachment 2 – Site Plan Application
- Attachment 3 – Property Deeds
- Attachment 4 – List of Required Permits & Copy of Maine DOT Entrance Permit
- Attachment 5 – Information for finding of fact Sections 181-90 to 181-99
- Attachment 6 – Information for finding of fact Title 30-A Section 4404



- Attachment 7 – High Intensity Soil Survey
- Attachment 8 – Portland Water District Ability to Serve
- Attachment 9 – Septic System Soil Test Pits
- Attachment 10 – Stormwater Management Plan
- Attachment 11 – Homeowners’ Association Documents
- Attachment 12 – Conformance to Section 181-73 Site Plan Standards
- Attachment 13 – Conformance to Article IV – General Standards
- Attachment 14 – Resource Agency Letters
- Attachment 15 – Financial Capacity
- Attachment 16 – Village Housing Floor Plan & Elevations
- Attachment 17 – Blasting Plan
- Check for Subdivision & Site Plan Application Fee and Peer Review Escrow Account
- Preliminary Plan Set (44 Sheets)

We are hopeful that this application can be placed on the agenda for the December 3, 2018 Planning Board Meeting. Thank you for your consideration, and please contact us if you have any questions as you review the enclosed plans and information.

Prepared by:  
Terradyn Consultants, LLC



Lawrence R. Bastian, P.E.

## SUBDIVISION & SITE PLAN APPLICATION FORMS

---

This section filled out by town.

Standish land use code may be found at "[www.Standish.org](http://www.Standish.org)

"Application # \_\_\_\_\_

Date filed: \_\_\_\_\_

Fee Paid: \_\_\_\_\_

**APPLICANT & OWNER INFORMATION**

1) Name of Applicant: Leavitt-Tompson, LLC

Address: P.O. Box 703

Standish, ME 04084

Phone: (207) 642-3675 Fax: (207) 642-2426 E-Mail: brian@leavittearthworks.com

Name of applicant's authorized agent: Larry Bastian, P.E., Terradyn Consultants, LLC

Address: 41 Campus Dr., Suite 101

New Gloucester, ME 04260

Telephone: ( 207 ) 926 - 5111

Name and registration # of Land Surveyor, Engineer, Architect or others preparing plan:

Larry Bastian, P.E. #4321

Address: same as above

Telephone: ( 207 ) 926 - 5111

Person and Address to which all correspondence regarding this application should be sent:

Larry Bastian, address same as above

Phone: \_\_\_\_\_ Fax: \_\_\_\_\_ E-Mail: \_\_\_\_\_

2) What legal interest does applicant have in this property? Submit copy of right title or interest . Attachment 3

Ownership  option  purchase and sales contract  other \_\_\_\_\_

2b) What interest does the applicant have in any abutting property? Leavitt Development LLC is record owner of Lot 11A, Map 10 (Leavitt Earthworks, Inc)

2c) Name of Property Owner: Leavitt Earthworks, Inc -map 10, lot 11; Tompson Development, Inc - map 10, lot 11

Address: same as above

Telephone: ( 207 ) 642 - 3675

**LAND INFORMATION**

3) Location of Property (Street Location) 191 Ossippee Trail, Standish, ME 04084

(From County Registry of Deeds): Book <sup>33450,</sup>33294, Page <sup>41,</sup>157 (from Tax Maps): Map 10 Lot(s) 11, 19C  
<sub>32929</sub> <sub>157</sub>

4a) Current zoning of property: Standish Corner District

Is any portion of the property within 250 feet of a great pond or river?  Yes  No

Is any portion of the property within the direct watershed of great pond?  Yes  No

4b) Total Acreage of Parcel: 53.1 Ac Acreage to be developed: 53.1 Ac

Has this land been part of a prior approved subdivision?  Yes  No

Or other divisions within the past 5 years?  Yes  No

Does parcel include waterbodies?  Yes  No - Does parcel include any wetlands?  Yes  No

Is any portion of the property within a special flood hazard area as identified by the Federal Emergency Management Agency?  Yes  No

**GENERAL INFORMATION**

4c) Proposed name of development: Highlands Subdivision

4d) Number of lots or units: 80 multifamily units Village Housing, 18 single family lots, 4 duplexes

Does this development propose the extension of public infrastructure?  Yes  No

roads  storm drainage  sidewalks  fire protection equipment  other

Estimated cost for infrastructure improvements \$ \*. Complete separate estimate with unit costs.  
<sup>\*from Leavitt Earthworks under separate cover</sup>

Power/telephone/cable placement:  Underground  Overhead

Type of structures proposed  single-family residential  duplex  other 4-unit multifamily

Type(s) of Waste Disposal: On-site septic systems

Solid Waste Disposal Method(s): Licensed private haulers

Water supply Source(s): Portland Water District main extension

Identify method of fire protection for the proposed development per § 142-10:

Hydrants from public water main  Dry hydrants located on an existing pond or water body

Existing fire pond  other, please state alternative.

5) Does applicant intend to request waivers of any subdivision submission requirements?  Yes  No

If yes, list them and state reasons for the request per code § 181-108. \_\_\_\_\_

6) Nonconformities present in the proposal, if any: None known



7). List all local, state and federal approvals required: See Attachment 4

Previously obtained MDOT Entrance Permit  not yet obtained Maine DEP & US Army Corps

**Information needed per PART 3 Standish subdivision regulations**

8) Submitted 12 copies of Subdivision plan with information per §181-78 & §181-80  yes  no

9) Please provide the following:

- Check list of information to accompany plan
- Development review escrow account established 181-81 B) Amount: \$ 6,000 Date:    /   /     
 Established at application \$200/lot  not yet established to be determined by Board Initial amount per Town Planner
- infrastructure improvements Performance Bond estimate included per 181-83 A) Total  
Amount: \$                      see attached cost estimate spreadsheet form  
 Spreadsheet estimate submitted w/ unit costs  not yet submitted                      @ Final
- Subdivision improvements inspection escrow account (3% of performance bond)
- Impact fees estimates submitted per §181-121: @ Final  
 roads  streetlight  fire protection equipment  other

10) Standish town code is available at [www.standish.org](http://www.standish.org). Provide adequate information such that the Planning Board is able to make a positive finding of fact for the following sections of town code: **See Attachment 5**

- §181-90 Conformance to comprehensive plan
- §181-91 Preservation of natural and historic features
- §181-92 Land not suitable for development
- §181-93 Lots
- §181-94 Easements for natural drainage ways
- §181-95 Utilities
- §181-96 Street trees esplanades and open spaces
- §181-97 required improvements
- §181-97.1 Interior roads items A, B and C
- §181-98 Separate sewerage disposal sites
- §181-99 Municipal consultant fees

11) Provide adequate information such that the Planning Board is able to make a positive finding of fact for the following State subdivision law review criteria title 30-A §4404. Please refer to the “Standish finding of fact form” (NoticeofDecisionform2.doc) for a more complete description of following items: See Attachment 6

- §4404 review criteria 1. Pollution
- §4404 review criteria 2. Sufficient water
- §4404 review criteria 3. Municipal water supply
- §4404 review criteria 4. Erosion
- §4404 review criteria 5. Traffic
- §4404 review criteria 6. Sewerage disposal
- §4404 review criteria 7. Municipal solid waste disposal
- §4404 review criteria 8. aesthetic, cultural and natural values
- §4404 review criteria 9. Conformity with local ordinances
- §4404 review criteria 10. Financial and technical capacity
- §4404 review criteria 11. Surface water; outstanding river segments
- §4404 review criteria 12. Ground water
- §4404 review criteria 13. Flood areas
- §4404 review criteria 14. Freshwater wetlands
- §4404 review criteria 15. River, stream or brook
- §4404 review criteria 16. Storm water
- §4404 review criteria 17. Spaghetti-lots prohibited
- §4404 review criteria 18. Lake phosphorus concentration
- §4404 review criteria 19. Impact on adjoining municipality

To the best of my knowledge, all the above stated information submitted in this application is correct.



Terradyn Consultants, Larry Bastian- Agent Nov. 13, 2018

(Signature and

printed name of applicant)

(Date)

**APPLICATION GUIDELINES**

Application fee is non-refundable.

Submissions shall comply with the provisions of Standish Land Use Code Subdivision Regulations part 3 §181-74 thru §181-99. § 181-82.

A. The subdivider shall, within six months after the preliminary approval of the preliminary plan, file with the Planning Board an application for approval of the final subdivision plan in the form described herein. If the final plan is not submitted to the Planning Board within six months after the approval of the preliminary plan, the Planning Board may refuse without prejudice to act on the final plan and require resubmission of the preliminary plan. All applications for final plan approval for subdivision shall be accompanied by a fee set by the Town of Standish, payable by check to the Town of Standish.

**B. If the proposed subdivision in any way is subject to review by the State of Maine, Department of Environmental Protection, then the approval of the State of Maine, Department of Environmental Protection, shall be secured in writing before official submission of the final plan.**



**Town of Standish**  
**175 Northeast Road Standish, ME - 04084**  
 Phone: (207)642-3461 – Fax: (207) 642-5181

Highlands Subdivision / Development / Plan

## AGENT AUTHORIZATION

<b>PROPERTY DESCRIPTION</b>	<b>Physical Address</b>	191 OSSIPPEE TRAIL STANDISH, ME 04084		<b>Tax Map</b>	10
				<b>Lot</b>	11 & 19C
<b>OWNERS INFORMATION</b>	<b>Name</b>	Brian Leavitt, Jamie Thompson	<b>Name of Business</b>	LEAVITT-THOMPSON, LLC	
	<b>Phone</b>	207-642-3675	<b>Mailing Address</b>	P.O. Box 703 Standish, ME 04084	
	<b>Fax</b>				
	<b>Email</b>	brian@leavittearthworks.com			
<b>APPLICANT'S AGENT INFORMATION</b>	<b>Name</b>	Jeffrey D. Amos, PE	<b>Name of Business</b>	TERRADYN CONSULTANTS, LLC	
	<b>Phone</b>	207-926-5111	<b>Mailing Address</b>	41 CAMPUS DRIVE, SUITE 101 NEW GLOUCESTER, ME 04260	
	<b>Fax</b>	N/A			
	<b>Email</b>	jeff@terradyconsultants.com			

I / we being the owners of the property described above do hereby appoint the above mentioned firm or individual as an agent on my / our behalf as the owners of proposed land development plan. The agent(s) for the above plan may represent me/us before the Standish Town Officers and Planning Board to expedite and complete the approval of the proposed development for this parcel.

SIGNED BY:	SIGNATURE / TYPE OR PRINT NAME	DATE
OWNER #1	_____ / Brian Leavitt	_____
OWNER #2	/ Jamie Thompson	5-14-18
APPLICANT	_____ / _____	_____
CO-APPLICANT	/ _____	_____
APPLICANT'S AGENT	Jeffrey D. Amos, Terradyn Consultants, LLC	5-14-2018

PLEASE INCLUDE COPY OF CURRENT DEED.

## Larry Bastian

---

**From:** Brian Leavitt <brian@leavittearthworks.com>  
**Sent:** Monday, May 14, 2018 9:16 AM  
**To:** Larry Bastian  
**Cc:** Jamie Thompson (jtompson18227@roadrunner.com); Jeff Amos  
**Subject:** Re: Highlands Project Sketch Plan Submittal - Authorization

I am good with that.

Sent from my iPhone

On May 14, 2018, at 8:38 AM, Larry Bastian <[larry@terradync consultants.com](mailto:larry@terradync consultants.com)> wrote:

Brian and Jamie,  
We are submitting the sketch plan application the Town today.

Please reply to this e-mail to authorize Terradyn Consultants, LLC to sign the attached Agent Authorization form on your behalf.

Thank you,

Larry Bastian, PE  
**Terradyn Consultants, LLC**  
41 Campus Drive, Suite 101  
New Gloucester, ME 04260  
Ph. 207-926-5111  
Cell 207-838-6882  
Fax 207-221-1317

<1804\_pb-agentauthorization.doc>

## Subdivision Application Appendix #1 Preliminary Subdivision Application Checklist

This checklist has been prepared to assist applicants in developing their applications. It should be used as a guide in assembling the information necessary for a complete application. However, the checklist does not substitute for the requirements of the Subdivision Regulations (or Ordinance). The Planning Board also will be using the checklist to make sure that your application is complete. Indicate if the information has been submitted or if it is requested to be waived.

Note that this checklist only covers the submission requirements for a preliminary plan for major subdivision. It does not address the standards that the preliminary plan must meet. There are two other checklists which address the performance standards and the design guidelines which the applicant may find of assistance.

### Information to accompany plan - Section 181-80

*The preliminary subdivision shall be submitted in 12 copies of one or more maps or drawings which may be printed or reproduced on paper, with all dimensions shown in feet or decimals of a foot, drawn to a scale of 50 feet to the inch, except that if the subdivision includes 20 acres or more, the scale shall be 100 feet to the inch, showing or accompanied by the following information:*

Shaded boxes indicate that the action is not recommended to be taken by the Applicant.

SUBDIVISION REGULATIONS		Submitted by Applicant	Not Applicable	Applicant Requests to be Waived	Received by Planning Board	Waived by Planning Board
<b>7.2.A.</b>	<b>Twelve copies of application plus accompanying information</b>	X				
<b>181-79</b>	<b>LOCATION MAP</b>					
A	Map showing all adjacent properties & owners within (1000 ft.) of proposed subdivision property lines.	X				
B	Locations and names of existing and proposed streets, easements & building lines both adjacent & within subdivision.	X				
C	Zoning boundaries, parks, public spaces and designations	X				
D	Outline of proposed subdivision and owner's remaining contiguous land	X				
<b>181-80</b>	<b>PRELIMINARY PLAN @ 50'=1" or 1"=100' if over 20 ac</b>					
A	Twelve copies of all maps and/or drawings showing: Name of subdivision, name of town and assessor's Map and Lot Number(s) all dimensions in decimal feet showing subdivision & street names	X				
B	Name & address record owner, subdivider and designer	X				
C	Total acres in subdivision, proposed lot lines, gross and net lot areas within each subdivision lot excluding undevelopable areas per 181-92, property lines easements, buildings, watercourses and other essential physical features.	X				
D.	Names of adjacent subdivisions and names of owners of record of adjacent acreage.	X				
E.	Zoning district boundaries and provisions of applicable zoning ordinance.	X				
F.	Location and size of sewers and water mains, culverts & drains.	X				
G.	Location, names and widths of existing and proposed streets, easements, building lines, alleys, parks and other public open spaces.	X				
H.	Location of any streets within area to be subdivided and the width, location, grades and street profiles of all streets or other public ways proposed.	X				
I	Contour lines at intervals of five feet or at such intervals as the Planning Board may require, based on United States Geological Survey datum.	X				
J	Soils report identifying; all wetlands, soils boundaries and names in the proposed development with the soils info. superimposed upon plot plan in accord with USDA -SCS National Cooperative Soil Classification. For Cluster subdivisions a High intensity soil survey by Soil Scientist	X		Attachment 7		



## Subdivision Application Appendix #1

SUBDIVISION REGULATIONS		Submitted by Applicant	Not Applicable	Applicant Requests to be Waived	Received by Planning Board	Waived by Planning Board
K	Typical cross sections of the proposed grading for roadways and sidewalks.	X				
L	Date plan prepared and date of any revision, true North point and graphic scale.	X				
M	Deed description and map of survey of tract boundary made and certified by a registered land surveyor, tied into Standish GIS parcel base map.	X				
N	Connection with the existing water supply or an alternative means of providing water supply to the proposed subdivision. Water Company letter of capacity	X		Attachment 8		
O	Location and results of tests to ascertain subsurface soil and groundwater conditions for sewage disposal systems.	X		Attachment 9		
P	Provisions for collecting and discharging storm drainage, in the form of a drainage plan.	X		Attachment 10		
Q	Preliminary designs of required culverts.	X				
R	Proposed lot lines with dimensions and suggested locations of buildings.	X				
S	Location of temporary markers adequate to enable the Board to locate readily and appraise the basic layout in the field. Copies of the plans and drawings on 8.5" x 11" or 11" x 17" sheets					
T	All parcels of land proposed to be dedicated to public use and the conditions of such dedication	X				
U	Location of all natural features or site elements to be preserved.	X				
V	A grading plan as may be required for any or all lots as determined by the Planning Board.					
W	The preliminary layout of any bridges required.	N/A				
X	Full extent of floodplain(s) as shown on the most current version of the FEMA maps. 100-year flood elevations	N/A				
Y	Any areas within the proposed subdivision that may be used for a stump dump or for gravel or fill removal. The size of these areas and the expected extent of time these areas will be utilized shall be included with the application.	X				
	Planning Board may require additional information where it is determined necessary by the Board to meet criteria of the State Subdivision Statute Title 30-A M.R.S.A., §4404.					
<b>181</b>	<b>ADDITIONAL INFORMATION</b>					
	Legal review information including Agent authorization form, Deed restrictions on proposed new lots or dwellings, homeowners association documents and incorporation.	X		Attachment 11		
	Verification of right, title or interest in property, Copy of most recently recorded deed; all restrictions, easements, rights-of-way and other encumbrances	X				
181-81	Professional review fees (peer review escrow account)	X				



# Town of Standish

175 Northeast Road Standish, ME - 04084  
Phone: (207)642-3461 – Fax: (207) 642-5181

## Application for Site Plan Review & Approval

### APPLICANT OWNER INFORMATION

1) Name of Applicant:

Address:

E-mail:  Telephone:

Name and address of owner's authorized agent:

e-mail:  Telephone:

Name address and registration # of Land Surveyor, Engineer, Architect or others preparing plan:

e-mail:  Telephone:

Person and address to which all correspondence regarding this application should be sent:

E-Mail:  Telephone:

### LAND INFORMATION

2) What legal interest does applicant have in this property? Submit copy of right title or interest. Ownership option purchase and sales contract other:

3) Property Location (Street address)

[Deed recorded at County Registry of Deeds (CCRD)] - [From Standish Tax Maps]

CCRD - Book #  Page  Tax Map  Lot

4a) Property zoned:  Street Frontage Type

Is any portion of property within 250' of a pond or river?  Yes  No

Is any portion of the property within the direct watershed of great pond?  Yes  No

4b) Total Acreage of Parcel:  Acreage to be developed:  Does parcel include water bodies?  Yes  No

Has this land been part of a subdivision?  Yes  No Has lot been divided or split within the past 5 years?  Yes  No

Does parcel include any wetlands?  Yes  No Is any portion of the property within a flood hazard area identified by Federal Emergency Management Agency?  Yes  No

**GENERAL INFORMATION**

4c) Proposed name of business:

4d) Proposed land use as defined in Standish Land Use Code 181-3 and confirmed with town CEO.

Does this development propose the extension of public infrastructure?

Yes  No

If yes then complete a separate estimate with unit costs for roads, storm drainage, sidewalks, water main, Fire protection equipment or other estimated cost for infrastructure improvements.

Power/telephone/cable placement: Underground Overhead

Structures proposed:

Waste Disposal type:

Water supply Source:

Identify method of fire protection for the proposed development per § 142-10. Hydrants from public water main, Dry hydrants located on an existing pond or water body, Existing fire pond other, please state alternative.:

5) Does applicant intend to request waivers of any site plan submission requirements?

Yes  No

If yes, list and state reasons for the request per code 181-108.



6) Non-conformities present in the proposal, if any:

None known

7). List all local, state and federal approvals required if any:

See Attachment 4

Previously obtained  not yet obtained:

8) Submit 12 copies of the site plan with all plan element and information per §181-69 - §181-73.4

9) Please provide the following per consultation with the Town Planner:

Development review escrow account 181-70 F&G)

Amount:  Date:

Impact fees estimates submitted per §181-70 E roads ,streetlight, fire protection equipment, other

10) On a separate attachments please provide adequate information such that the Planning Board is able to make a judgment that the applicant has proven that the site plan meets all standards outlined in § 181-73 "Site plan standards and conditions of approval" or in Article IV "General Standards" or Towers. See Attachments 12 & 13

The application fee is non-refundable. The time limit on this application is 90 days from the first meeting. No extensions will be given unless the delay is caused by a governmental agency. Pursuant to Standish Land Use Code, § 181-70.1, Following the issuance of site plan approval for a specified use by the Planning Board, the applicant shall make a substantial start, as defined in Part 1, § 181-3, and determined by the Code Enforcement Officer, on the approved use within three years from the original date of approval. If no such substantial start is made, the Planning Board approval shall lapse and become void. Standish Land Use Code, § 181-3 defines substantial start as completion of 30% of a permitted structure or use, measured as a percentage of total estimated value to complete.

By either typing or signing your name below the applicant / applicant's agent is declaring that the information submitted for this application is true and accurate to the best of his / her knowledge.

Printed Name:  Date Signed   
Lawrence Bastian, PE



11/13/2018

Signature /

Date Signed

The above pages with a site plan constitute a complete site plan or site plan amendment application. An agent authorization form must be completed if the property owner has others representing them at the Planning Board meetings. The site plan should contain all elements outlined in §181-71 Site Plan elements checklist included in site plan appendix. When necessary attach separate sheets proving the application meets the standards outlined in §181-73 listed below or other relevant sections listed under general standards.

### APPLICATION GUIDELINES

Please fill out the above application using the guidelines as listed in the site plan appendix. Return the completed application with site plan and relevant additional information requested to the Planning Department at least 21 days prior the scheduled Planning Board business meeting at which you wish to be reviewed. If you need assistance or have any questions please contact the Planning Department at 642-3661. To expedite your application through the Planning Board process, please read the following pages

REVISED VILLAGE HOUSING COVER LETTER – 1/22/1019

January 22, 2019

Mr. Zach Mosher, Town Planner  
Town of Standish Municipal Building  
175 Northeast Road  
Standish, ME 04085

**Highlands Preliminary Subdivision & Site Plan – Revised Village Housing Plan**

Dear Zach,

On behalf of Leavitt-Tompson, LLC we are pleased to submit the revised Preliminary Subdivision and Site Plan Application for the Highlands, an 84-unit Village Housing Site Plan and 18-lot residential subdivision. We revised the Village Housing portion of the project based on discussions at the Planning Board meeting on December 3, 2018 and at the Planning Board site walk and workshop on December 20, 2018.

The development parcel is located on the north side of Route 25, approximately 1.2 miles west of Standish Corner, and extends northeasterly to Oak Hill Road. The property is shown as lots 11 and 19C on Town of Standish Tax Map #10. The 53.11-acre property is located within the Standish Corner District. The Standish Corner District (SCD) Regulating Plan requires a Town Residential (TR) street frontage type for the public right-of-way within the proposed development. A section of Town Avenue (TA) street is also proposed for the access onto Route 25.

**Village Housing Revisions**

The project configuration discussed at the December 3 and December 20 meetings with the Planning Board included 80 two-story Village Housing condo units and four duplex units on two 40,000 SF lots along Highland Drive. That layout was based on 4-unit, 88-ft. long buildings. There was a general consensus that the unit size (22 ft. wide) seemed tight. Jamie Tompson and Brian Leavitt also stated their intention to include some single-story buildings in the development to offer a variety of housing options and appeal to a wider range of homeowners. In that context, there was discussion of Section 181-28.1.C (7)(a) Village Housing Standards that requires a 100-ft. vegetated buffer for two-story buildings and a 50-ft. vegetated buffer for one-story buildings along Highlands Drive. It was the general consensus of the Board and the Town Planner that a 50-ft. vegetated buffer is required for any one-story buildings and that two-story buildings require a 100-ft. buffer.

Based on guidance from the workshop, we revised the Village Housing plan to include ten (10) single-story, two-bedroom units and eleven (11) two-story, two-bedroom units. We also enlarged the two-story buildings to 96 ft. long, making each unit 24 ft. wide. The single-story buildings all have at least a 50-ft. vegetated buffer along Highlands Drive. The two duplex lots shown on the previous site plan have been eliminated and their associated land area assigned to the Village Housing development. Preliminary floor plans for the proposed single-story buildings are attached.

The net residential density calculations show that the property can support 87 two-bedroom Village Housing dwelling units (at 1 unit/16,000 SF) and 18 single-family lots (30,000 SF minimum lot size on Town Residential Street). Updated net residential calculations are provided on the enclosed Preliminary Subdivision Plan.

The Town Planner's memo for the December 3 meeting also recommended that the clubhouse be relocated because it fell within the Village Housing vegetated buffer. The revised plans show the clubhouse on the right (east) side of Highlands Drive between the first two Village Housing pods.

Other plan revisions made in conjunction with the changes to the buildings include the following:

- The section of Town Avenue Street on Highlands Drive extends from Route 25 to station 5+50, just past the driveway to the future self-storage facility on Leavitt Earthworks property. This driveway also provides access to the clubhouse.
- The Town Avenue Street cross section has been revised to conform to the Ordinance (44' pavement width, including parking).
- Septic systems have been resized to smaller footprints using Elgin In-Drain infiltrators. System locations use the previous soil test pits.
- Site grading, storm drains and utilities have been revised based on the revised building footprints.
- The tree line has been adjusted based on the revised grading plan.
- Frontage on Highlands Drive is provided for Leavitt Earthworks property at +/- station 8+50 for service by Portland Water District.

The above changes are shown on the enclosed plan set.


**Attachments - REFER TO 1/22/2019 SUBMITTAL FOR THE FOLLOWING ATTACHMENTS**

~~The following items are attached to this letter:~~

- Single-Story Building Preliminary Floor Plan
- Traffic Impact Study
- Revised Preliminary Plan Set (44 Sheets)

I believe that this information addresses the comments provided to date on the project. We are hopeful that this application can be placed on the agenda for the February 4, 2019 Planning Board meeting. Thank you for your consideration, and please contact us if you have any questions as you review the enclosed plans and information.

Prepared by:  
Terradyn Consultants, LLC

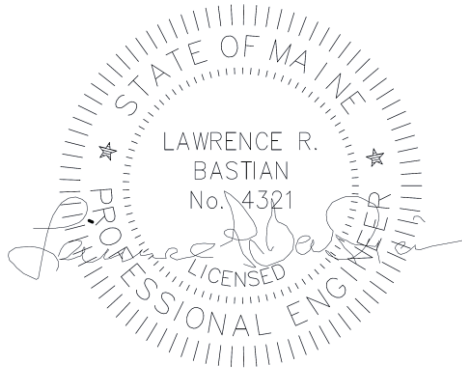

Lawrence R. Bastian, P.E.

# ATTACHMENT 1

---

FINAL SUBDIVISION AND SITE PLAN APPLICATION  
JANUARY 21, 2020



**Pineland**

Cumberland Hall  
41 Campus Drive, Suite 101  
New Gloucester, ME 04260

**Portland**

565 Congress Street, Suite 310  
Portland, ME 04101

January 21, 2020

JN 1804

Mr. Zach Mosher Planner  
Town of Standish  
175 Northeast Road  
Standish, Maine 04085

**Subject: Highlands Subdivision – Final Subdivision & Site Plan Application and Response to Peer Review Comments**

Dear Zach:

On behalf of Leavitt-Tompson, LLC, we are pleased to submit the Final Subdivision & Site Plan Application for the Highlands Subdivision, a residential development with 84 Village Housing units and 18 single-family lots. The development parcel is located on the north side of Route 25, approximately 1.2 miles west of Standish Corner, and extends northeasterly to Oak Hill Road. The property is shown as lots 11 and 19C on Town of Standish Tax Map #10. The 53.11-acre property is located within the Standish Corner District.

The project received preliminary Subdivision and Site Plan approval with conditions on March 4, 2019. Terradyn Consultants submitted the Site Location and NRPA Tier 1 wetland alteration permit applications to the Maine DEP and U.S. Army Corps of Engineers following preliminary approval. The Maine General Permit approval has been received from the Corps and DEP staff has informed us that they expect to issue the Stormwater and NRPA permits in the next few weeks.

This submission includes our response to Town Engineer peer review comments as well as revisions resulting from the Maine DEP permitting review process. Notable revisions from the DEP engineering review were to re-configure Filter Basins #1, #2 and #3 with two treatment cells vs. one cell as shown on the preliminary plans. The DEP geology review resulted in updated soils maps, additional test pits, and nitrate-nitrogen analyses for the single-family lots as well as the Village Housing condominiums.

Updated plans and revised information as noted above are included as attachments to this submission.

## **RESPONSE TO TOWN ENGINEER REVIEW COMMENTS**

Our office received peer review comments for the above referenced project from Peter B. Tubbs at P.B. Tubbs Consulting dated February 6, 2019. We have reviewed the comments and have prepared the responses presented below. For clarity, each comment is repeated below, followed by our response in italics.

### **Sheet C-1.0 – Subdivision and Site Plan for Village Housing**

- There appears to be a metes and bounds missing on the boundary with Parcel 6-31A, refer to the Boundary Survey plans.

*Response: Revised Plan*

### **Sheet C-1.2 – Subdivision and Site Plan for Village Housing**

- The symbol for the 30' drainage easement is for the future Right of Way easement.

*Response: Revised symbol*

### **Sheet C-2.0 – Highlands Drive Layout Plan**

- The sight distance along Route 25, both ways from the intersection should be shown.

*Response: Added sight distance at Route 25 and Oak Hill Road*

- The 6' sidewalk, 5' wide esplanade, and sloped curb for the Town Ave. Street Section should be noted as "both sides".

*Response: Sidewalk on both sides was waived in Preliminary approval – now shown on left (northwest) side only.*

- The street widths should be noted.

*Response: Noted as typical*

- Notes to clarify the extent of different street types and the taper would be helpful.

*Response: Noted on plan*

- We question if the 20' radius at the subdivision entrances are adequate for service vehicles.

*Response: The 20' radii are adequate with the 44' wide roadway.*

### **Sheet C-2.1 – Highlands Drive Layout Plan**

- Why does the driveway and paved shoulder widths of the access drives vary?

*Response: Driveways are now all the same (12' and 24' wide) and paved shoulder is 5'.*



### **Sheet C-2.3 – Highlands Drive Layout Plan**

- The traffic report recommends minor re-shaping of the Oak Hill road ditch to the left of the intersection (in front of 130 Oak Hill Road) to improve sight distance. That re-grading should be shown on Sheet C-3.3.

*Response: Noted on plan*

### **Sheet C-3.0 – Highlands Drive Grading Plan**

- The grading over the 15" storm drain westerly of the entrance should be shown.

*Response: Revised plan*

- Ditto the 15" outlet to the level spreader left of Sta. 2+50

*Response: Revised plan*

- Underdrain as shown on the Typical Road Sections (sheet C- 6.0) should be shown on all the Grading Plans, (sheets C-3.0 through C-3.7).

*Response: Notes requiring Type B 6" underdrain and Type C underdrain are added to Sheet C-3.0.*

- The finish Floor elevation of the buildings and access points should be shown.

*Response: Walks and porches are now shown at all units. Elevations are provided on the 20 scale plans for clarity.*

### **Sheet C-3.1 – Highlands Drive Grading Plan**

- The comments concerning drainage and the buildings apply here also.

*Response: Revised as noted above*

- There does not appear to be appropriate cover over the west end of the 24" stormdrain out letting easterly of units 53-56.

*Response: Revised pipe elevations and grading*

- The leader for the invert elevation at the westerly end of the same pipe does not point to the end of the pipe.

*Response: Revised plan*

### **Sheet C-3.3 – Highlands Drive Grading Plan**

- A 20' section of the 18" entrance culvert will be exposed, it might be better to shorten the pipe and ditch out to elevation 381.5.

*Response: Revised plan and shortened pipe*

- See note on S C-2.3 for grading to the left of the intersection.

*Response: Note on ditch and backslope grading added to plan*

### Sheet C-3.5 – Highlands Drive Grading Plan

- We believe the “Gravel Wetland” shown is now Treatment Cell # 2.  
*Response: Gravel wetland is labeled on plan.*
- A portion of the outlet end of the 18” stormdrain from CB-G-1 will be exposed. The pipe should be shortened to a point where there is at least 1.0’ of cover over the pipe, and the outlet ditch and riprap extended back to the end of the pipe.  
*Response: Revised pipe inverts and grading*
- Ditto for the 15” pipe outlet from CB-L-2.  
*Response: Revised inverts and grading*

### Sheet C-3.6 – Highlands Drive Grading Plan

- The 24” SD from CB-G-3 does not extend to the outlet invert shown.  
*Response: Revised pipe inverts and grading*
- A note is needed to define the abbreviations FFE, BFE, & GFE.  
*Response: Legend added to plan*
- The second note on Sheet 3.5 applies to the 18’ SD from CB-G-1 and the 24”SD from CB-G-3 (when extended) also.  
*Response: Revised plan*

### Sheet C-3.7 – Highlands Drive Grading Plan

- The Stormdrain north of units 57 to 68 needs to be defined.  
*Response: This pipe is detailed on sheet C-3.2.*
- The piping in and out of Filter Basin #2 should be defined, or a note added referencing the drainage information on Sheet C-3.1.  
*Response: Piping is defined on the detail sheet C-6.4.*

### Sheet C-4.0 through C 4.3 – Highlands Drive Utility Plans

- Specify the offset of the water line from the centerline of Highlands Drive.  
*Response: Noted as “typical”*
- Ditto the offset in the Units drives  
*Response: Noted as “typical”*
- Call out the symbol for the septic tanks, force mains, transformers as (Typ.)  
*Response: Septic tank noted as typical. Force main and transformer symbol is in legend.*

### **Sheet C-5.0 through C 5.4 – Highlands Drive and Village Housing Roadway Profiles**

The storm drain piping needs to be checked to insure there is 3.9' of cover over the top of the pipe in the Town Residential Street section and 4.2' of cover over the top of the pipe in the Town Avenue Street section. These depths provide for 1.0' of cover between subgrade and the top of the pipes

*Response: Revised plans to provide 1' separation at all water main crossings as required by Portland Water District. This results in top of storm drain pipe at depth of 0.5' to 1.0' below roadway subgrade. Also, the 24" storm drain pipe to Filter Basin #2 is controlled by the elevations in the filter basin and could not be lowered; top of pipe is at least 0.5' below subgrade.*

### **Sheet C- 6.2 Gravel Wetland Details and Notes**

- The 391 contours should connect on either side of the primary spillways on the interior berms.

*Response: Revised plan.*

- Ditto the 393 contours on either side of the Cell 2 spillway.

*Response: Revised plan*

- The detail for the outlet control structure shows the 6" underdrain outlet at elevation 387.33 while the plan note specifies elevation 386.33

*Response: Revised to elevation 386.33.*

- A manufacturer should be specified for the P-300 LW Turf Reinforcement Mat.

*Response: North American Green (mfr.) noted on plan*

### **Sheet C- 6.3 Filter Basin # 1 Details and Notes**

- Won't the 4" underdrain outlet pipe with 2' of cover, and the 1" diameter hole in the end cap be subject to freezing?

*Response: Added underdrain outlet MH to plan.*

- Bullet note 4 above applies here also.

*Response: Changed spillway to riprap.*

### **Sheet C- 6.4 Filter Basin # 2 Details and Notes**

- The note in the section specifies the HDPE liner extend up to elevation 392 which is lower than the bottom of the basin.

*Response: Revised plan*

- There are two leaders pointing to the outlet structure with conflicting information.

*Response: Revised to eliminate conflict*

## Sheet C- 6.5 Filter Basin # 3 & 4 Details and Notes

### Filter Basin #3

- The section of the Filter Basin shows the underdrain pipe to be 6" vs. the 4" shown in plan.

*Response: Revised to 4"*

- The 382 contours should connect on the west side of the emergency spillway.

*Response: Revised plan*

- The 382 through 386 contours should connect to the existing contours on the easterly side of the spillway.

*Response: Revised plan*

### Filter Basin # 4

- Bullet note 1 on sheet C- 6.3 applies here also

*Response: Added underdrain outlet MH to plan.*

- Based on the Basin Section the underdrain inverts shown are not at the specified depth below the basin floor.

*Response: The required depth is provided at the upstream-most end of the UD pipe within the basin.*

## Sheets C- 6.7 through C- 6.9

- These sheets reflect standard details of the various components of site construction. As standard details they are accepted /approved by most municipalities, and are acceptable here.

*Response: Acknowledged*

- The drive culvert shown on sheet C- 6.6 should be a minimum of 15" diameter.

*Response: Revised detail*

## Sheets L-1.1 and L-1.2

These sheets reflect street trees along the length of the project. The species of trees, planting details and specifications, landscaping along the drives and around to the residential Units, and treatment of adjacent areas should specified.

*Response: The landscape plans are revised to note species.*

We trust that the above responses and attached materials address the comments. Please contact me directly if you have additional questions or comments.

## **ATTACHMENTS**

- Revised Plan Set
- 1. Army Corps Maine General Permit, Wetlands
- 2. Updated Stormwater Report as reviewed by Maine DEP
- 3. Correspondence with Portland Water District re. Ability to Serve
- 4. Nitrate-Nitrogen Assessment for Multi-Family Housing Units
- 5. Response to Maine DEP Site Location Application Geology Review. Includes:
  - Form E (Soil Conditions Summary Table) & Form F (Soil Profile / Classification) – Test Pits TP-99 to TP-138
  - Form E (Soil Conditions Summary Table) & Form F (Soil Profile / Classification) – Probes P-1 to P-20
  - HHE-200 Forms for Condominiums
  - Nitrate-Nitrogen Assessment for Single-Family Lots
  - 500' Blasting Radius Diagram
- 6. Soil Survey Map (Revised 11/26/2019)
- 7. Nitrate Analysis Map (Revised 11/26/2019)

Zach Mosher  
January 21, 2020


1804

## CLOSING

As noted above, we expect to receive Maine DEP permits within the next few weeks and will provide copies of permits when received.

We are hopeful that this application can be placed on the agenda for the February 3, 2020 Planning Board meeting. Thank you for your consideration, and please call us if you have any questions as you review the enclosed plans and information.

Sincerely,  
**TERRADYN CONSULTANTS, LLC**

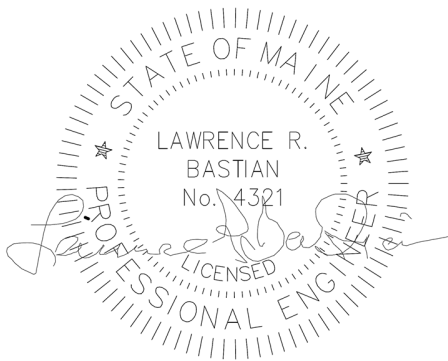

Larry Bastian, P.E.  
Civil Engineer

Attachments: As noted above

cc. Brian Leavitt  
Jamie Tompson



REPLY TO  
ATTENTION OF

DEPARTMENT OF THE ARMY  
NEW ENGLAND DISTRICT, CORPS OF ENGINEERS  
696 VIRGINIA ROAD  
CONCORD, MASSACHUSETTS 01742-2751

MAINE GENERAL PERMIT (GP)  
AUTHORIZATION LETTER AND SCREENING SUMMARY

BRIAN LEAVITT & JAMIE TOMPSON  
LEAVITT-TOMPSON, LLC  
P.O. BOX 703  
STANDISH, MAINE 04084

CORPS PERMIT # NAE-2019-02253  
CORPS GP ID# non-screen  
STATE ID# L-28172-TB-N

DESCRIPTION OF WORK:

Place permanent fill in 7,192 s.f. of freshwater wetland off Route 25 (Ossipee Trail) and Oak Hill Road at Standish, Maine in order to construct associated infrastructure for a residential subdivision with 21 condominium buildings containing a total of 84 units, a clubhouse and 18 single family residences. This work is shown on the attached plans entitled "U.S.G.S. QUADRANGLE MAP" in one sheet dated "1/29/2019", "HIGHLANDS DRIVE GRADING PLAN" in four sheets dated "3/29/2019" and "A.C.O.E. WETLANDS ALTERATION MAP" in four sheets dated "4/01/2019". See ADDITIONAL CONDITIONS attached.

LAT/LONG COORDINATES: 43.737533° N -70.570178° W USGS QUAD: STANDISH, ME

I. CORPS DETERMINATION:

Based on our review of the information you provided, we have determined that your project will have only minimal individual and cumulative impacts on waters and wetlands of the United States. Your work is therefore authorized by the U.S. Army Corps of Engineers under the Federal Permit, the Maine General Permit which can be found at: <https://www.nae.usace.army.mil/Missions/Regulatory/State-General-Permits/> Accordingly, we do not plan to take any further action on this project.

You must perform the activity authorized herein in compliance with all the terms and conditions of the GP [including any attached Additional Conditions and any conditions placed on the State 401 Water Quality Certification including any required mitigation]. Please review the enclosed GP carefully, including the GP conditions beginning on page 5, to familiarize yourself with its contents. You are responsible for complying with all of the GP requirements; therefore you should be certain that whoever does the work fully understands all of the conditions. You may wish to discuss the conditions of this authorization with your contractor to ensure the contractor can accomplish the work in a manner that conforms to all requirements.

If you change the plans or construction methods for work within our jurisdiction, please contact us immediately to discuss modification of this authorization. This office must approve any changes before you undertake them.

Condition 37 of the GP (page 16) provides one year for completion of work that has commenced or is under contract to commence prior to the expiration of the GP on October 13, 2020. You will need to apply for reauthorization for any work within Corps jurisdiction that is not completed by October 13, 2021.

This authorization presumes the work shown on your plans noted above is in waters of the U.S. Should you desire to appeal our jurisdiction, please submit a request for an approved jurisdictional determination in writing to the undersigned.

No work may be started unless and until all other required local, State and Federal licenses and permits have been obtained. This includes but is not limited to a Flood Hazard Development Permit issued by the town if necessary.

II. STATE ACTIONS: PENDING [X], ISSUED [ ], DENIED [ ] DATE \_\_\_\_\_

APPLICATION TYPE: PBR: \_\_\_\_\_, TIER 1: X, TIER 2: \_\_\_\_\_, TIER 3: \_\_\_\_\_, LURC: \_\_\_\_\_, DMR LEASE: \_\_\_\_\_, NA: \_\_\_\_\_

III. FEDERAL ACTIONS:

JOINT PROCESSING MEETING: non-screen LEVEL OF REVIEW: CATEGORY 1: \_\_\_\_\_, CATEGORY 2: X

AUTHORITY (Based on a review of plans and/or State/Federal applications): SEC 10 \_\_\_\_\_, 404 X, 10/404 \_\_\_\_\_, 103 \_\_\_\_\_

EXCLUSIONS: The exclusionary criteria identified in the general permit do not apply to this project.

FEDERAL RESOURCE AGENCY OBJECTIONS: EPA n/a, USF&WS n/a, NMFS n/a

If you have any questions on this matter, please contact my staff at 978-318-8676 at our Augusta, Maine Project Office. In order for us to better serve you, we would appreciate your completing our Customer Service Survey located at [http://corpsmapu.usace.army.mil/cm\\_apex/f?p=136:4:0](http://corpsmapu.usace.army.mil/cm_apex/f?p=136:4:0)

COLIN M. GREENAN  
PROJECT MANAGER  
MAINE PROJECT OFFICE

FRANK J. DEL GIUDICE  
CHIEF, PERMITS & ENFORCEMENT BRANCH  
REGULATORY DIVISION  
DATE 12/4/19




**US Army Corps  
of Engineers** ®  
New England District

**PLEASE NOTE THE FOLLOWING ADDITIONAL CONDITIONS FOR  
DEPARTMENT OF THE ARMY  
GENERAL PERMIT  
NO. NAE-2019-02253**

1. This authorization requires you to 1) notify us before beginning work so we may inspect the project, and 2) submit a Compliance Certification Form. You must complete and return the enclosed Work Start Notification Form to this office at least two weeks before the anticipated starting date. You must complete and return the enclosed Compliance Certification Form within one month following the completion of the authorized work. **These forms are attached after the plans.**
2. The permittee shall assure that a copy of this permit is at the work site whenever work is being performed and that all personnel performing work at the site of the work authorized by this permit are fully aware of the terms and conditions of the permit. This permit, including its drawings and any appendices and other attachments, shall be made a part of any and all contracts and sub-contracts for work which affects areas of Corps of Engineers' jurisdiction at the site of the work authorized by this permit. This shall be done by including the entire permit in the specifications for the work. If the permit is issued after construction specifications but before receipt of bids or quotes, the entire permit shall be included as an addendum to the specifications. The term "entire permit" includes permit amendments. Although the permittee may assign various aspects of the work to different contractors or sub-contractors, all contractors and sub-contractors shall be obligated by contract to comply with all environmental protection provisions of the entire permit, and no contract or sub-contract shall require or allow unauthorized work in areas of Corps of Engineers jurisdiction.
3. Adequate sedimentation and erosion control devices, such as geotextile silt fences or other devices capable of filtering the fines involved, shall be installed and properly maintained to minimize impacts during construction. These devices must be removed upon completion of work and stabilization of disturbed areas. The sediment collected by these devices shall be removed and placed upland, in a manner that will prevent its later erosion and transport to a waterway or wetland.
4. All exposed soils resulting from the construction shall be promptly seeded and mulched in order to achieve vegetative stabilization.
5. This permit authorizes impacts to only those areas of wetlands/waterway shown on the attached plans. No other filling, clearing or other disturbance in waters of the United States shall occur without the necessary authorization from the Corps.
6. In the event additional wetland/waterway fill is authorized and the cumulative impacts exceed the more than minimal threshold of the Maine General Permit, the permittee may be responsible to provide appropriate compensatory mitigation to compensate for these impacts.
7. No tree cutting shall occur between June 1<sup>st</sup> and July 31<sup>st</sup> of any year and to the maximum extent practicable, tree cutting shall occur between October 16<sup>th</sup> and April 9<sup>th</sup> of any year in order to minimize potential impacts to federally threatened northern long-eared bats.



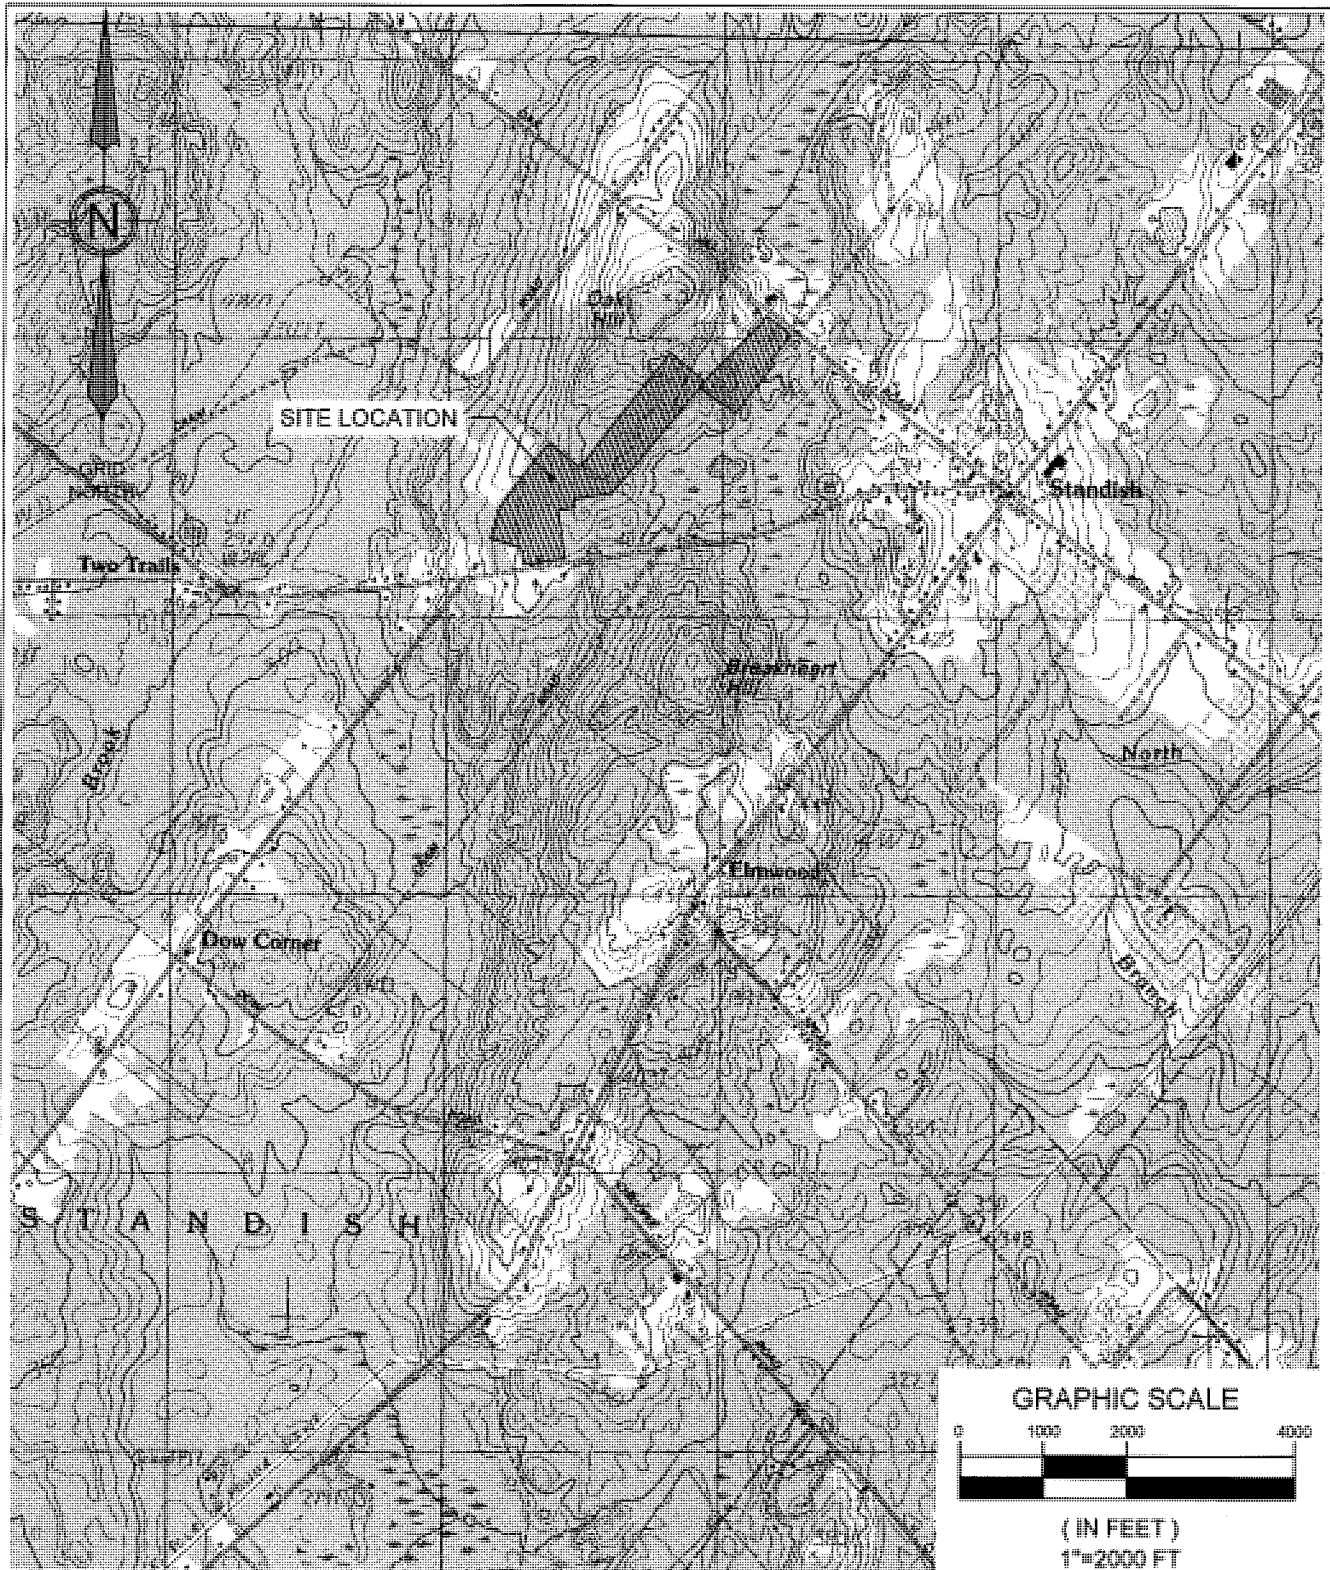

**SHEET DESCRIPTION**  
**U.S.G.S. QUADRANGLE MAP**  
**HIGHLANDS SUBDIVISION**

**PREPARED FOR**  
**LEAVITT-TOMPSON, LLC.**  
 P.O. BOX 703  
 STANDISH, MAINE 04084



40 Campen Drive, Suite 101  
 New Gloucester, ME 04260  
 Office: (207) 828-5111  
 Fax: (207) 821-1317  
[www.terradynconsultants.com](http://www.terradynconsultants.com)

Civil Engineering - Land Planning - Computer Aided Design - Environmental Planning

**JOB NO.**

1804

**DATE**

1/29/2019

**SCALE**

1"=2,000'


**SHEET**

1

**OF**

1

PRELIMINARY

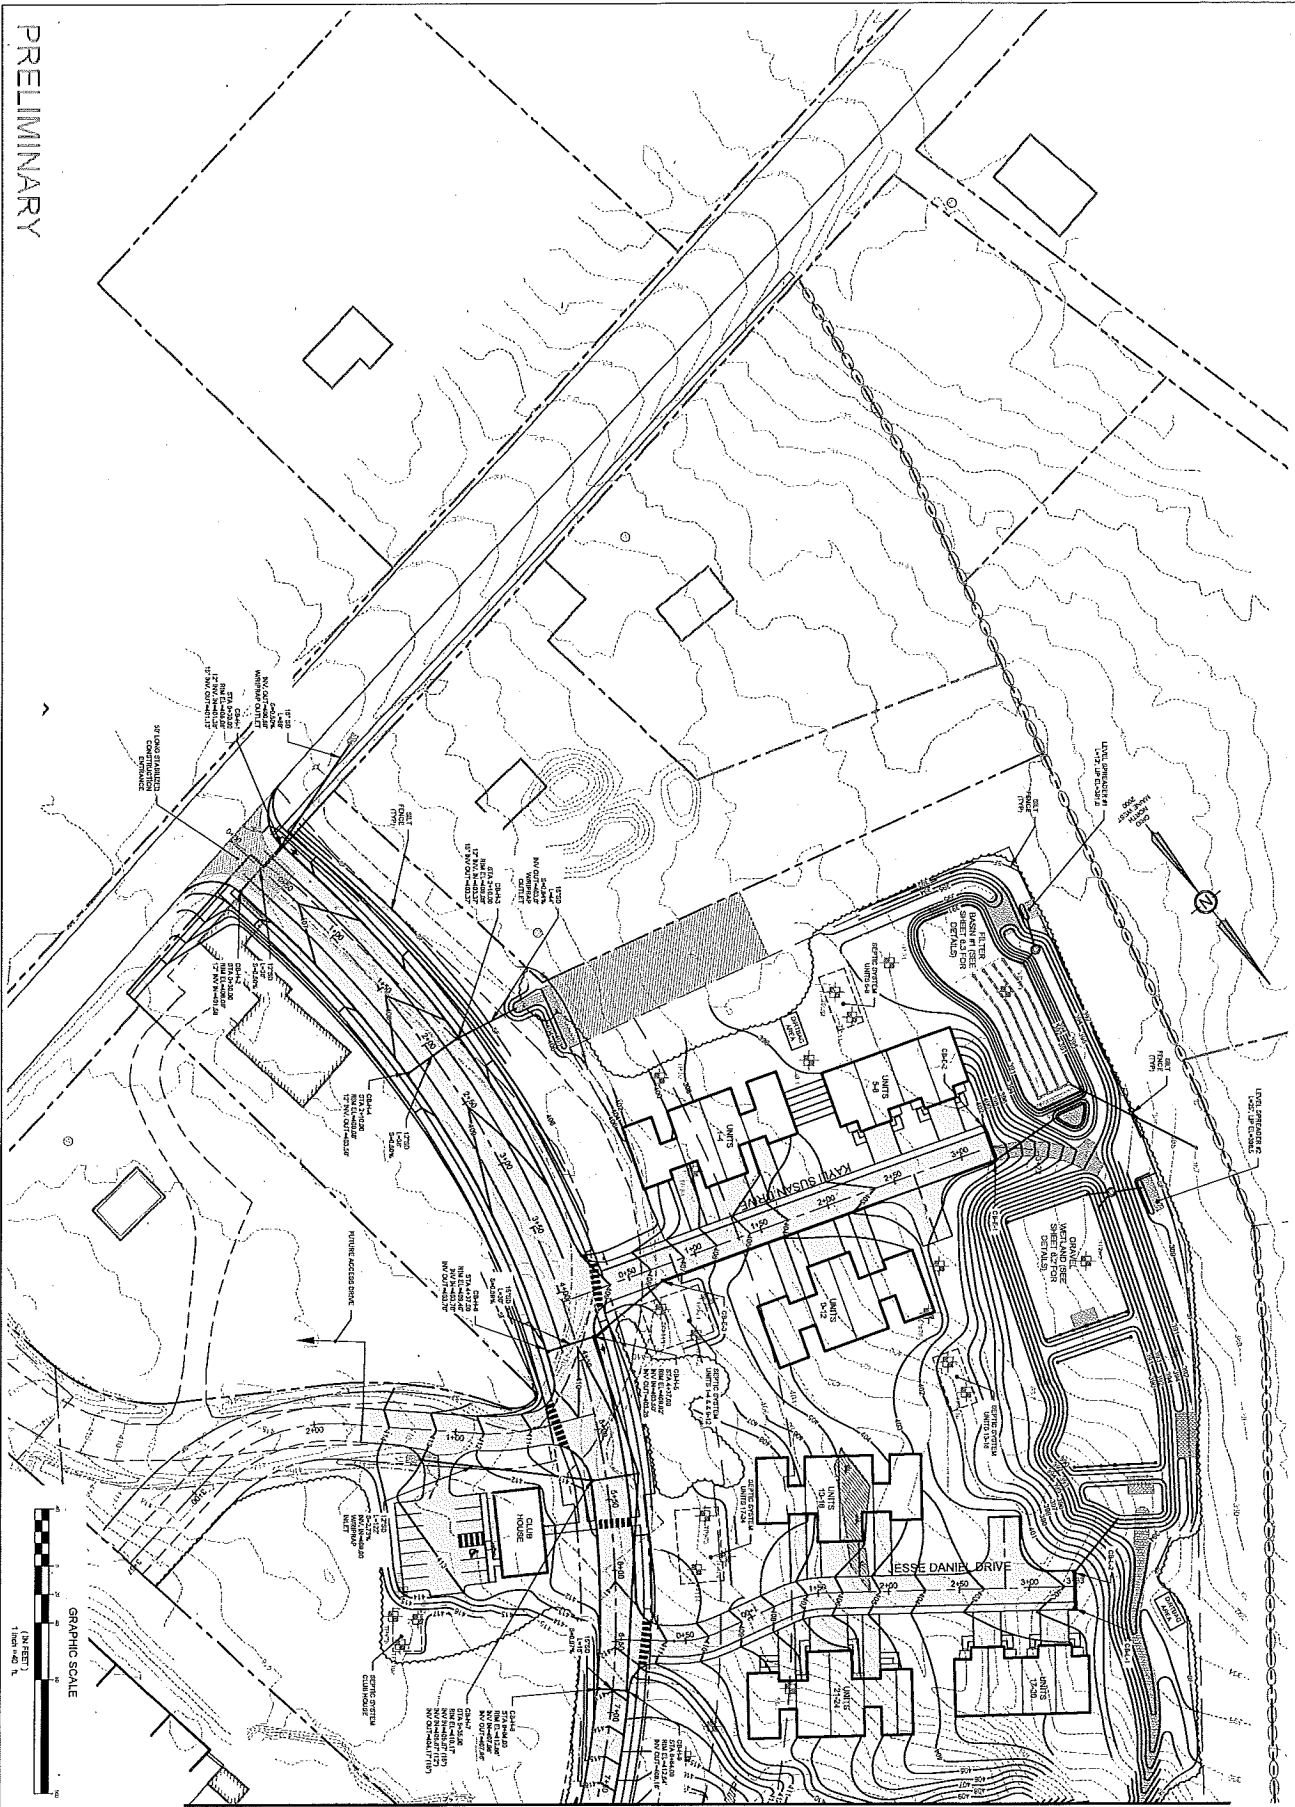

MATCH LINE - SEE SHEET C-3.1

MATCH LINE - SEE SHEET C-3.1

SHEET <b>C-3.0</b>	DATE	11/13/2018
	SCALE	AS SHOWN
	DESIGNED BY	TKA
	FILED / CHECKED BY	TKA

SHEET DESCRIPTION  
**HIGHLANDS SUBDIVISION  
 STANDISH, MAINE  
 HIGHLANDS DRIVE GRADING PLAN**

PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
 P.O. BOX 703  
 STANDISH, MAINE 04084

**TERRADYN**  
 CONSULTANTS, LLC

41 CAMPUS DRIVE  
 SUITE 102  
 NEW GUILFORD, ME 04260


585 CONGRESS STREET  
 SUITE 201  
 PORTLAND, ME 04102

OFFICE: (207) 926-5111 FAX: (207) 221-1317  
 www.terradynconsultants.com

NO.	DATE	REVISIONS
3	5/29/2019	150'P SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

APPROVED BY: [Signature]




DATE: 11/13/2018



PRELIMINARY

MATCH LINE - SEE SHEET C-3.0

MATCH LINE - SEE SHEET C-3.0

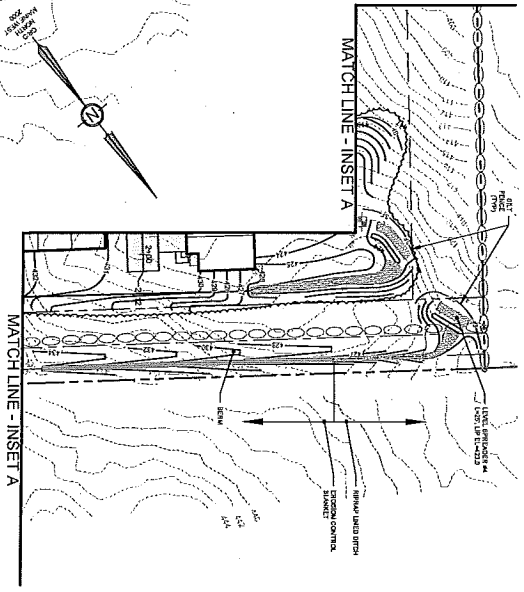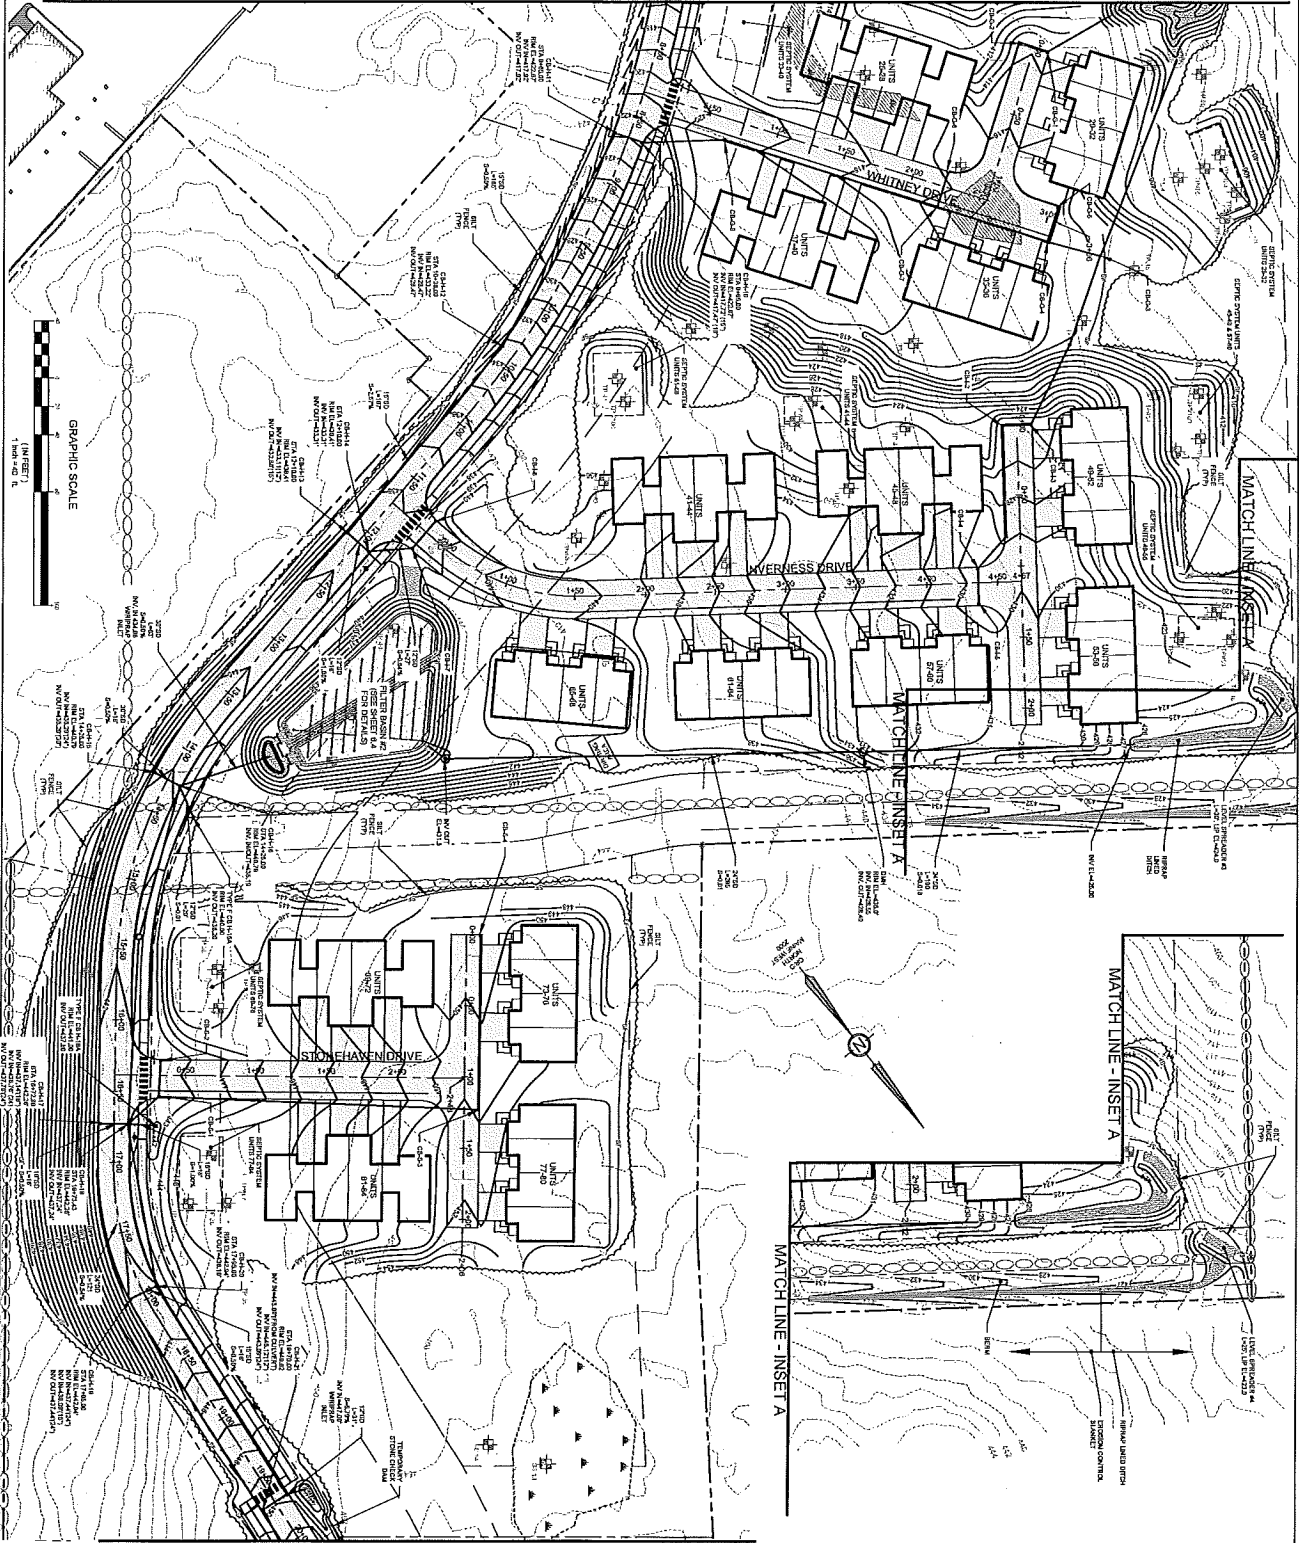

MATCH LINE - SEE SHEET C-3.2

MATCH LINE - SEE SHEET C-3.2

SHEET	C3.1
DATE	3/20/2019
DESIGNED BY	JK
CHECKED BY	JK
DATE	3/20/2019
PROJECT	HIGHLANDS SUBDIVISION STANDISH, MAINE HIGHLANDS DRIVE GRADING PLAN
PREPARED FOR	LEAVITT-TOMPSON, LLC P.O. BOX 703 STANDISH, MAINE 04084


**TERRADYN**  
CONSULTANTS, LLC

41 CAMPUS DRIVE  
SUITE 101  
NEW GLouceSTER, ME 04260

555 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

OFFICE: (207) 926-5111 FAX: (207) 221-1317  
www.terradynconsultants.com


NO.	DATE	REVISIONS
3	3/26/2019	1/CEP SITE LOCATION APPLICATION
2	1/27/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	1/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN



PRELIMINARY

MATCH LINE - SEE SHEET C-3.1

MATCH LINE - SEE SHEET C-3.1

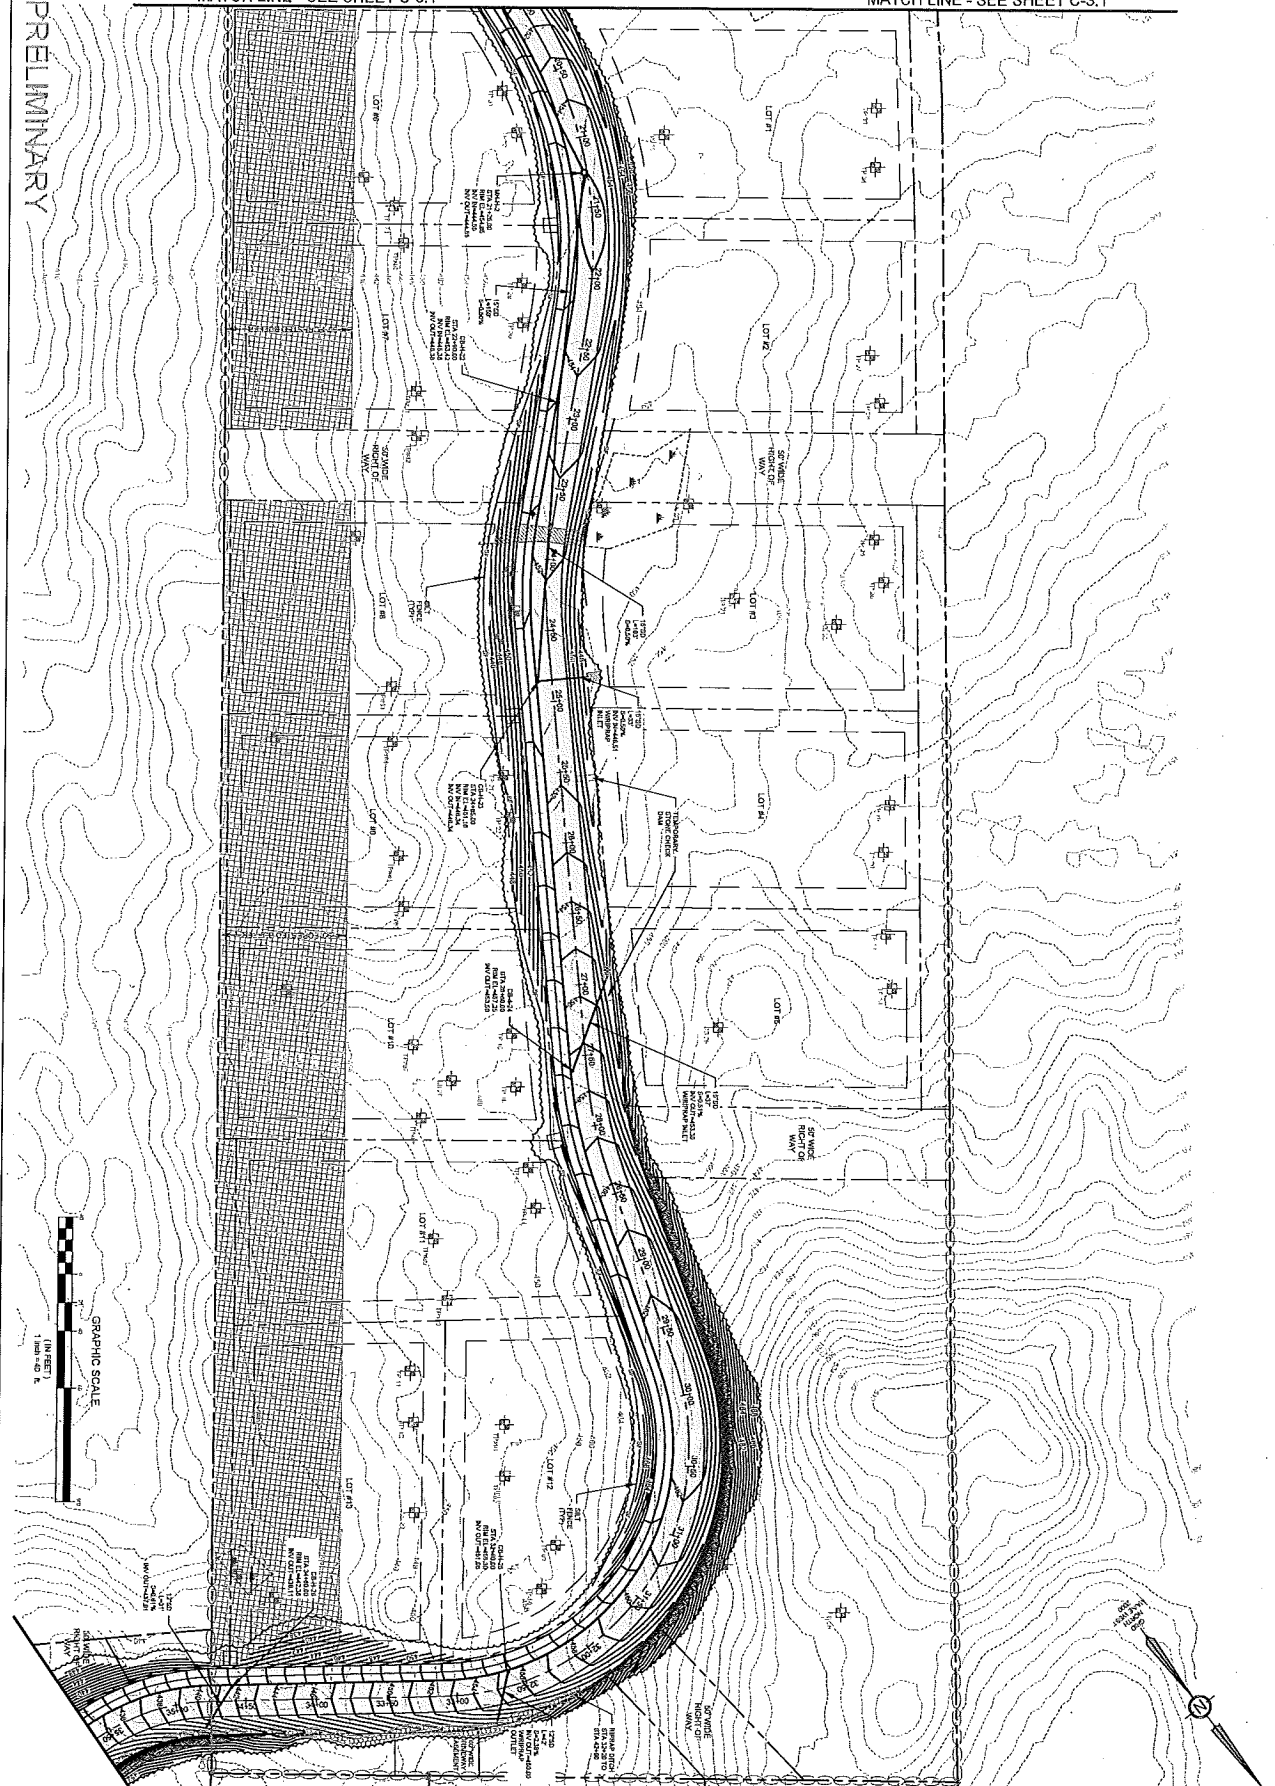

MATCH LINE - SEE SHEET C-3.3


MATCH LINE - SEE SHEET C-3.3

DATE	1/25/2016	SHEET DESCRIPTION	HIGHLANDS SUBDIVISION
SCALE	1"=40'		STANDISH, MAINE
CONTR.	TEC		HIGHLANDS DRIVE GRADING PLAN
DATE	1/25/2016	PREPARED FOR	LEAVITT-TOMPSON, LLC
SHEET	C-3.2	PLG. NO.	173
		STANDISH, MAINE	03034



41 CAIPLUS DRIVE  
SUITE 201  
NEW GLOUCESTER, ME 04959  
OFFICE: (207) 926-5111 FAX: (207) 221-1317  
www.terradynconsultants.com

NO.	DATE	REVISIONS
3	3/25/2016	LEISP SITE LOCATION APPLICATION
2	1/27/2016	PRELIMINARY SUBDIVISION & SITE PLAN
1	1/13/2016	PRELIMINARY SUBDIVISION & SITE PLAN







PRELIMINARY

MATCH LINE - SEE SHEET C-3.2

MATCH LINE - SEE SHEET C-3.2

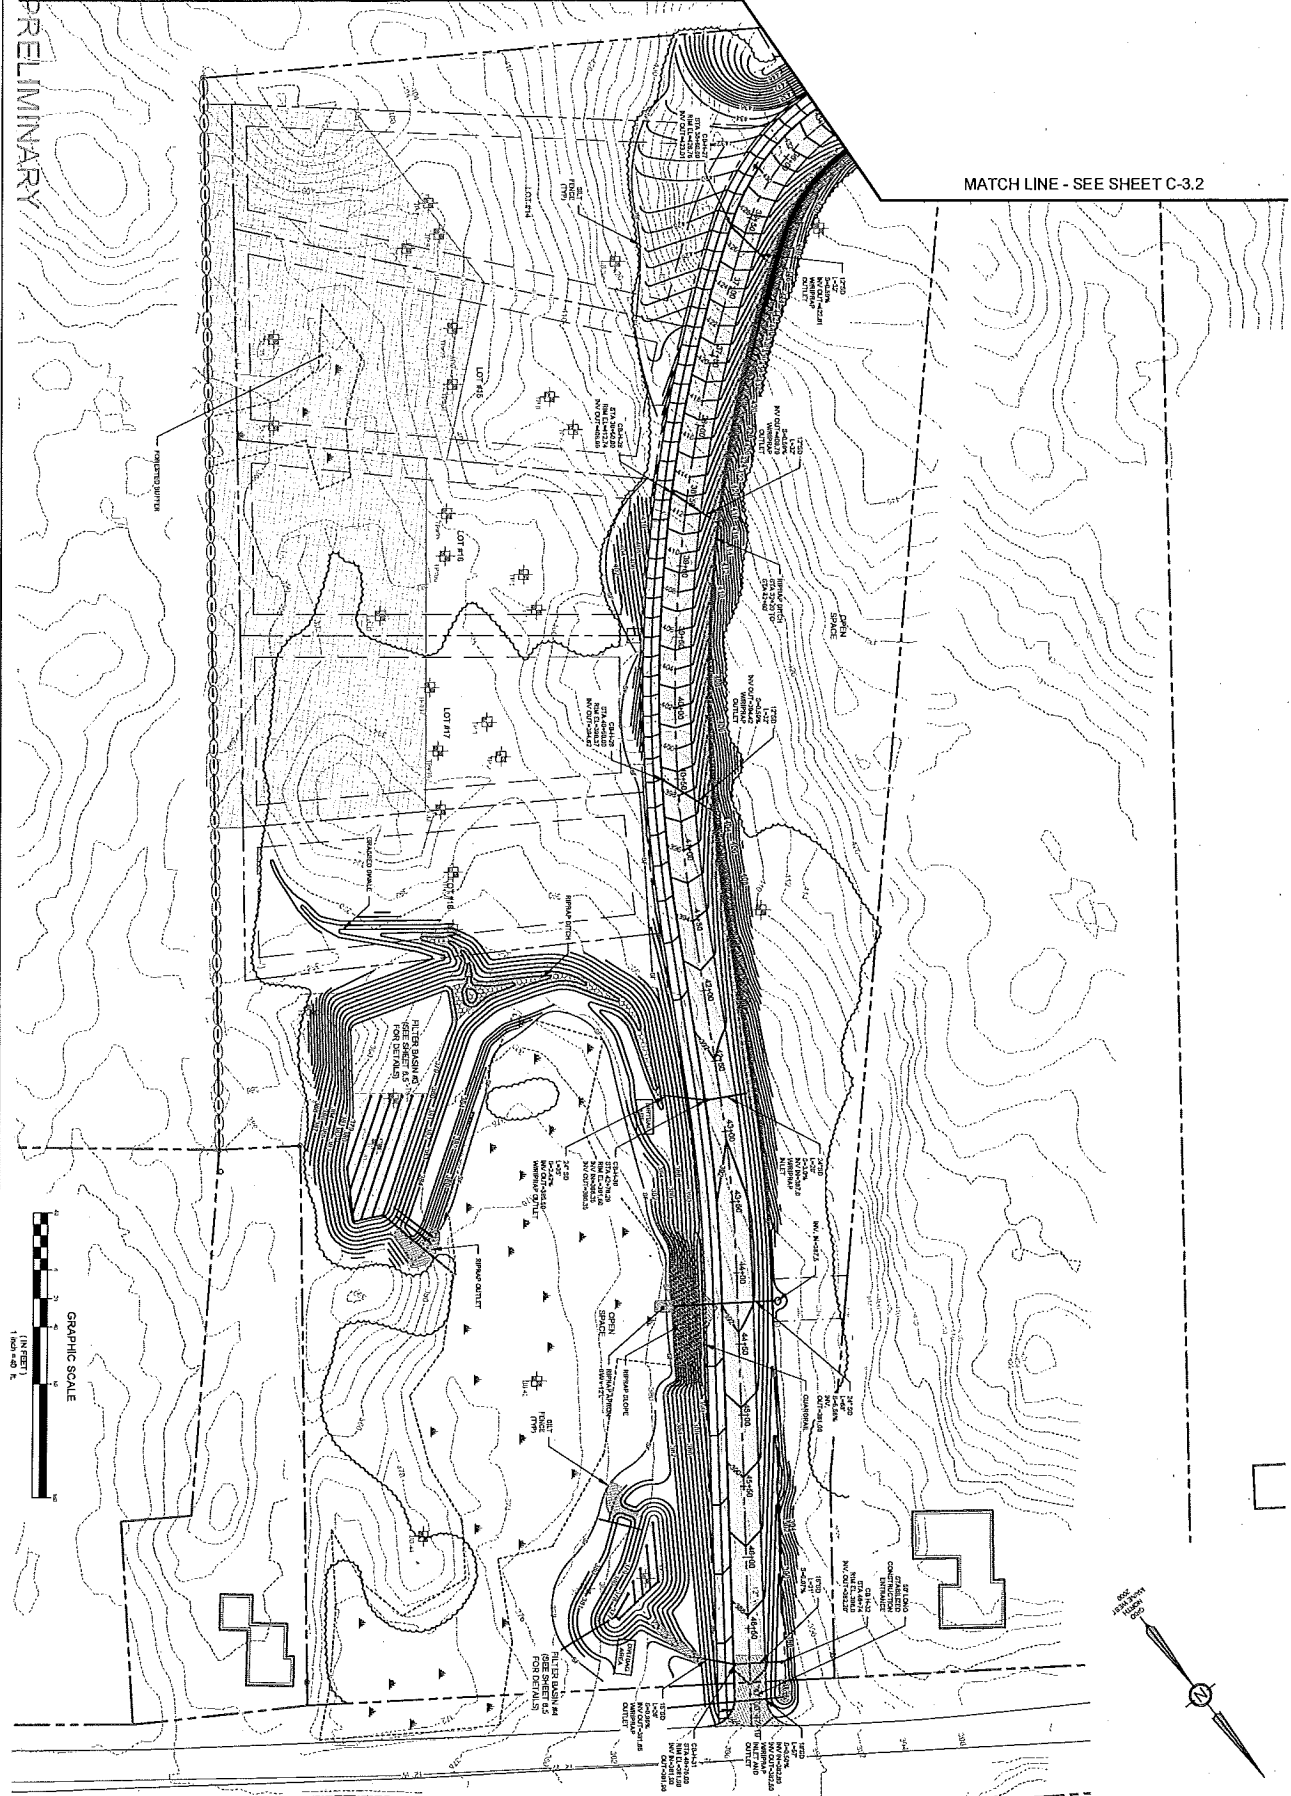

**SHEET DESCRIPTION**  
**HIGHLANDS SUBDIVISION**  
**STANDISH, MAINE**  
**HIGHLANDS DRIVE GRADING PLAN**

**PREPARED FOR**  
**LEAVITT-TOMPSON, LLC**  
 P.O. BOX 703  
 STANDISH, MAINE 04384




41 CAMPUS DRIVE  
 SUITE 103  
 NEW GLoucester, ME 04260


559 CONGRESS STREET  
 SUITE 201  
 PORTLAND, ME 04102

OFFICE: (207) 608-5111 FAX: (207) 221-1317  
 www.terradyn.com

Civil Engineering | Land Planning | Stormwater Design | Environmental Permitting

NO.	DATE	REVISIONS
3	3/25/2019	MEEP SITE LOCATION APPLICATION
2	1/27/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	1/13/2019	PRELIMINARY SUBDIVISION & SITE PLAN



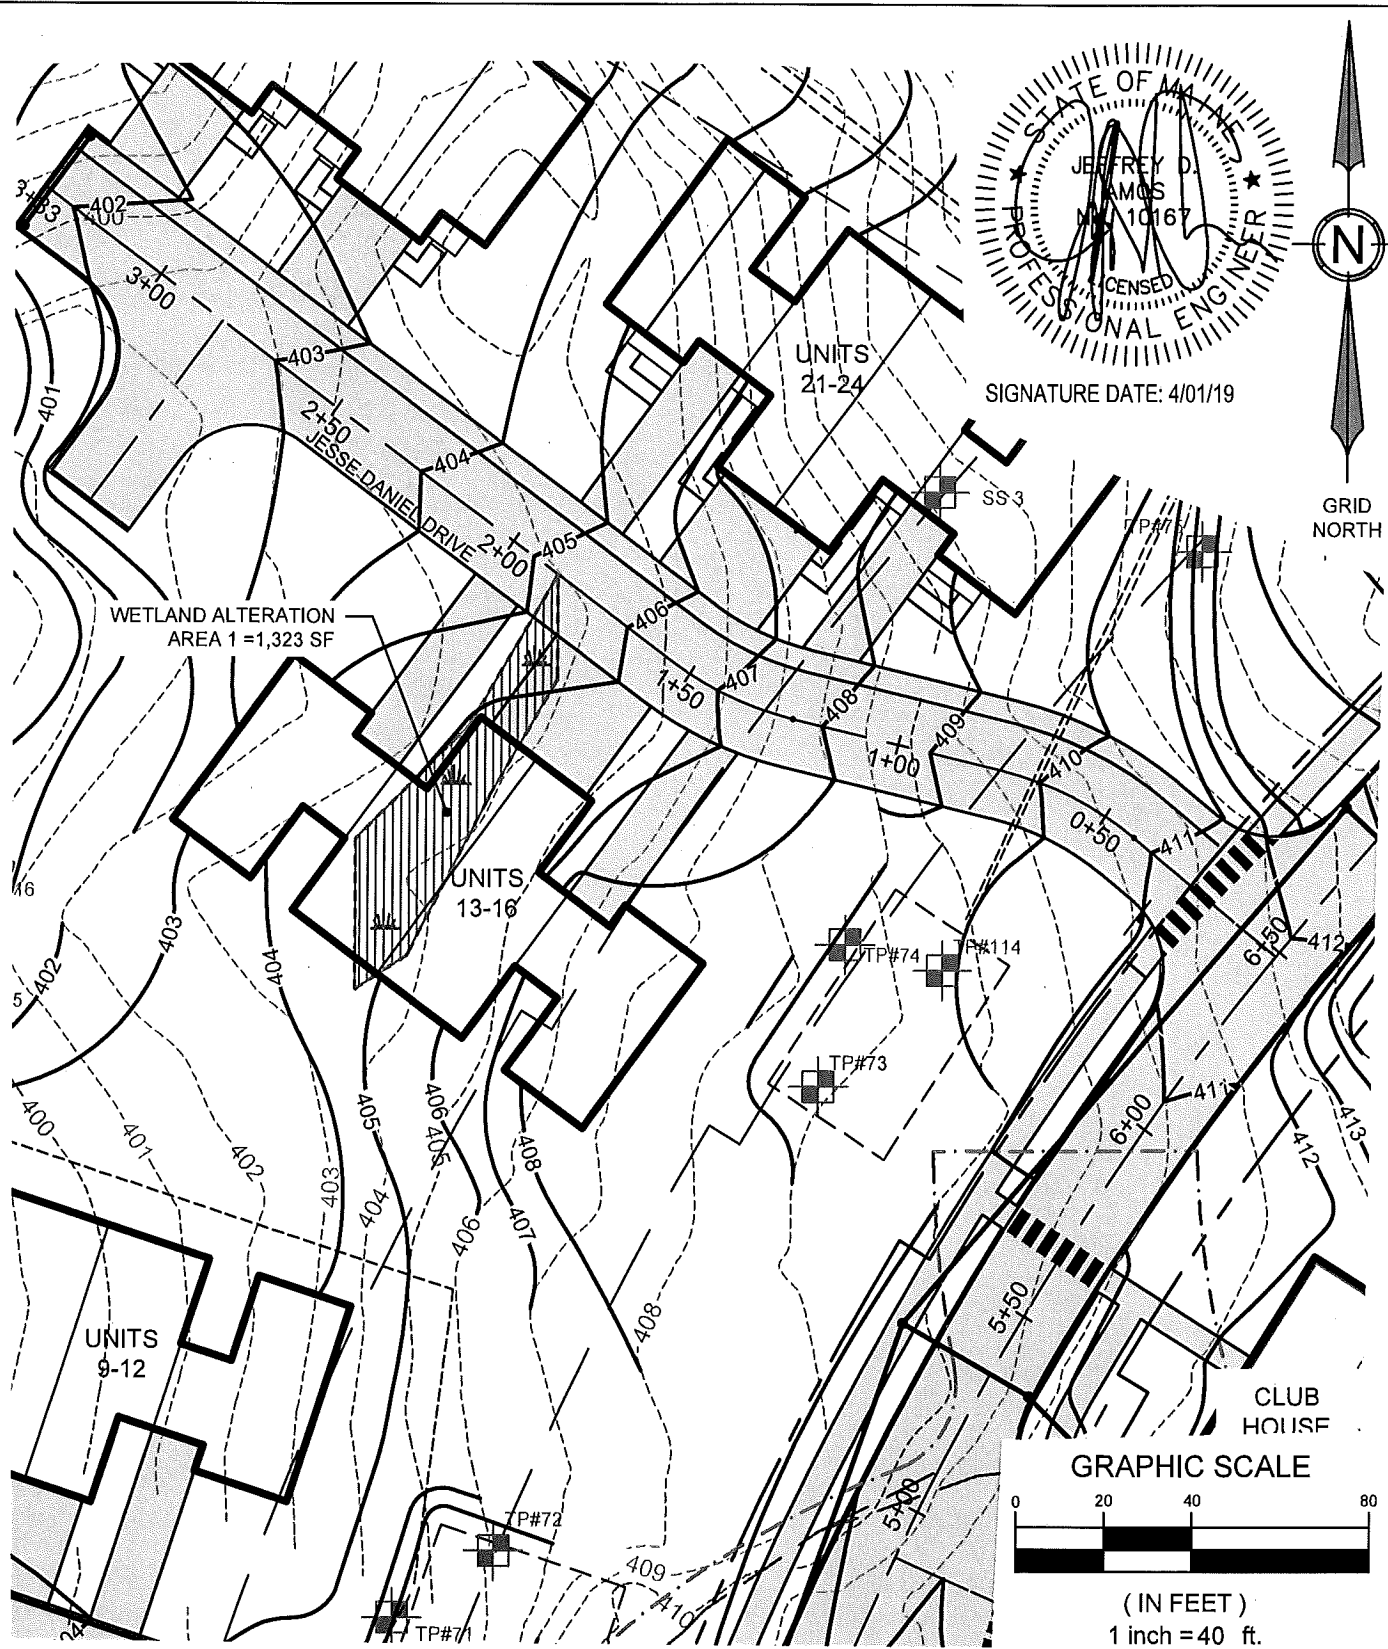

**SHEET DESCRIPTION**  
 A.C.O.E. WETLANDS ALTERATION MAP  
 HIGHLANDS SUBDIVISION

PREPARED FOR  
 LEAVITT - TOMPSON, LLC.  
 P.O. BOX 703  
 STANDISH, MAINE 04084






**TERRADYN**  
 CONSULTANTS, LLC

Civil Engineering - Land Planning - Stormwater Design - Environmental Permitting



41 Campus Drive, Suite 101  
 New Gloucester, ME 04260  
 Office: (207) 926-5111  
 Fax: (207) 221-1317  
 www.terradyconsultants.com

JOB NO.	1804	SHEET	1
DATE	4/01/2019	OF	4
SCALE	1"=40'		

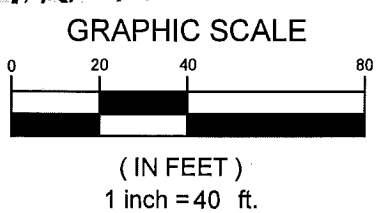

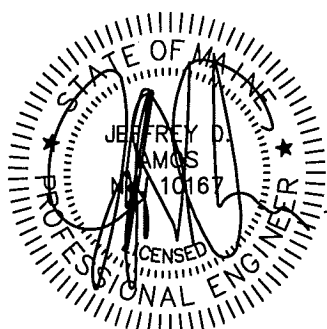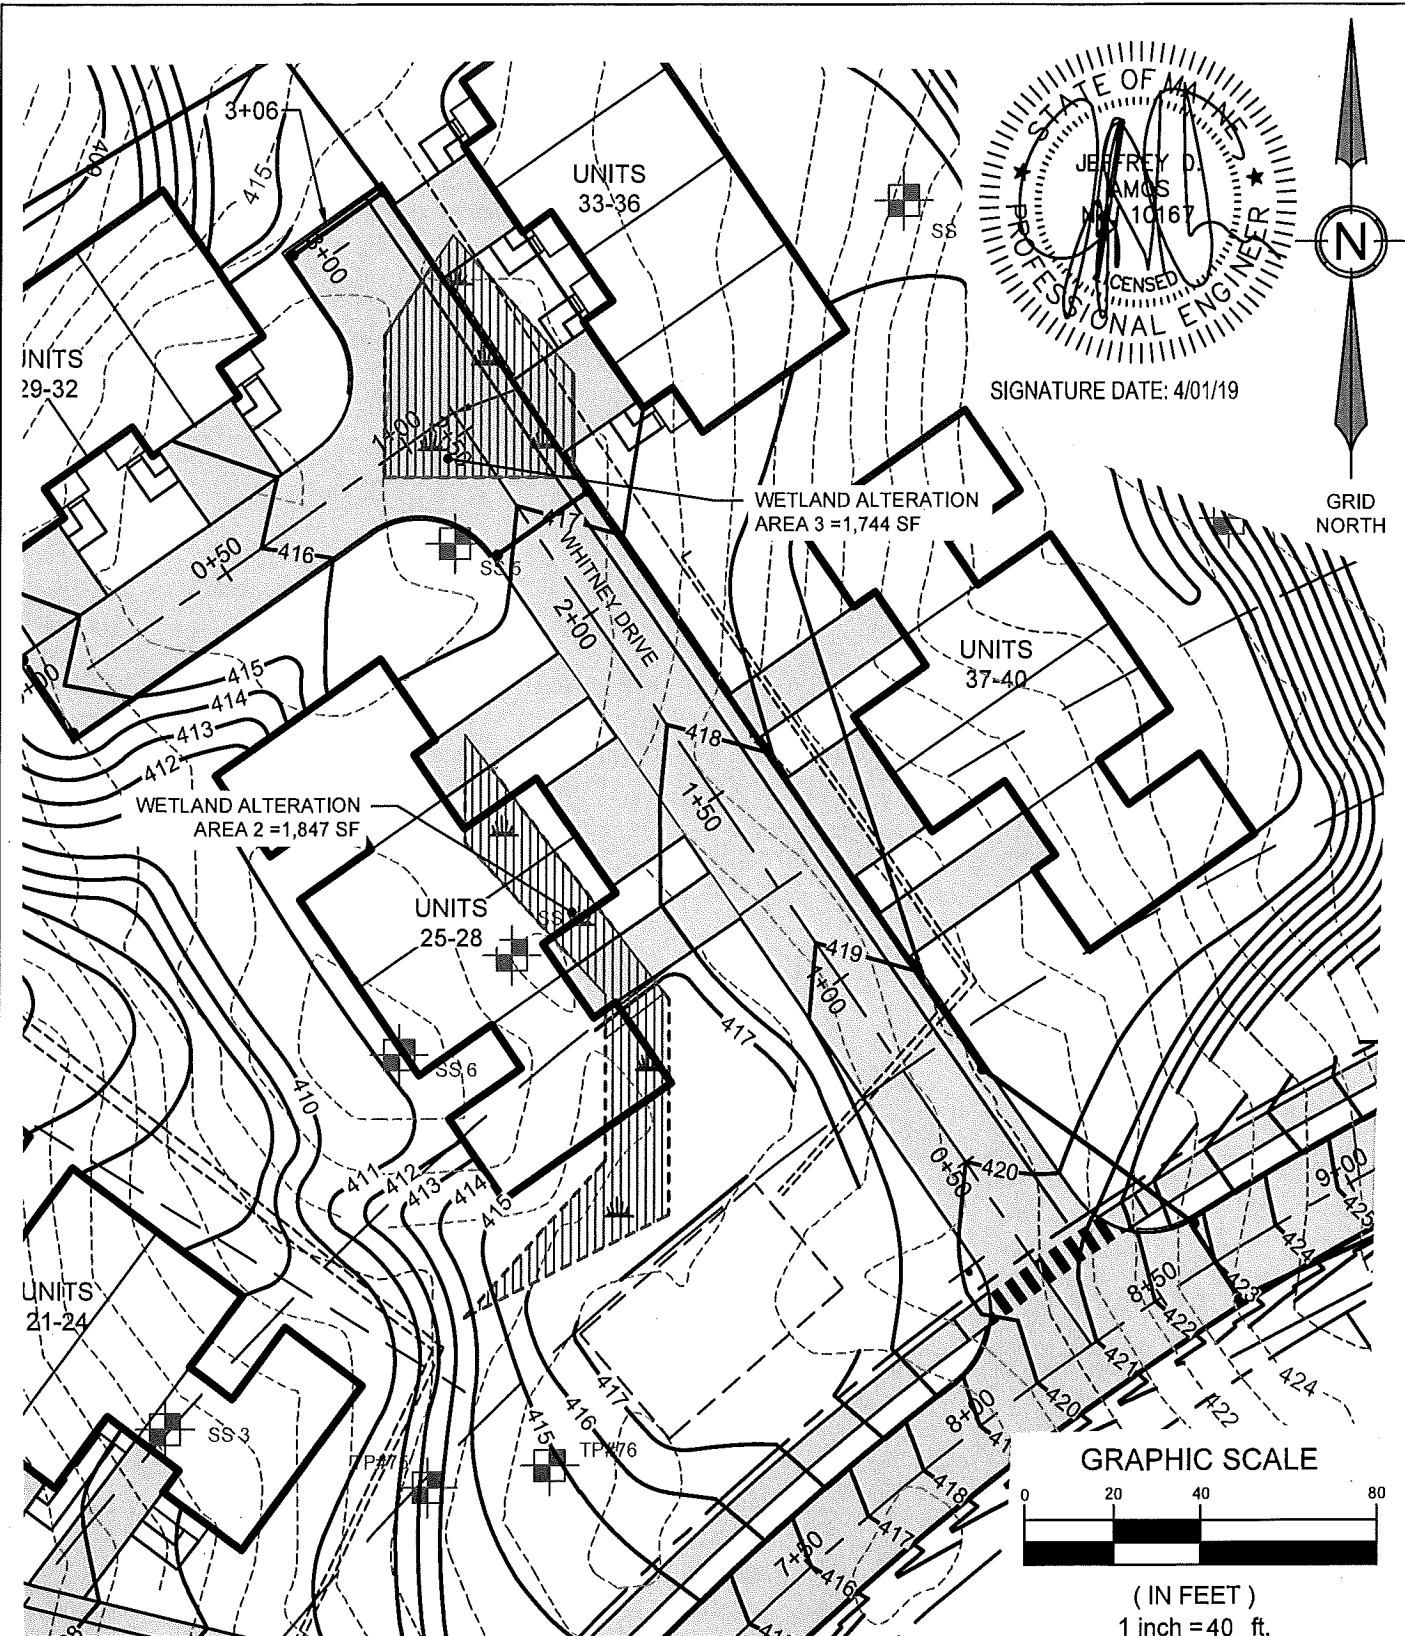

SIGNATURE DATE: 4/01/19

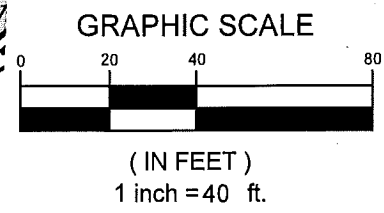

**SHEET DESCRIPTION**  
**A.C.O.E. WETLANDS ALTERATION MAP**  
**HIGHLANDS SUBDIVISION**



PREPARED FOR  
**LEAVITT - TOMPSON, LLC.**  
 P.O. BOX 703  
 STANDISH, MAINE 04084



41 Campus Drive, Suite 101  
 New Gloucester, ME 04260  
 Office: (207) 926-5111  
 Fax: (207) 221-1317  
 www.terradynconsultants.com

Civil Engineering - Land Planning - Stormwater Design - Environmental Permitting

JOB NO.	1804	SHEET	2
DATE	4/01/2019	OF	4
SCALE	1"=40'		

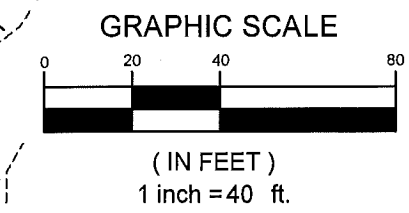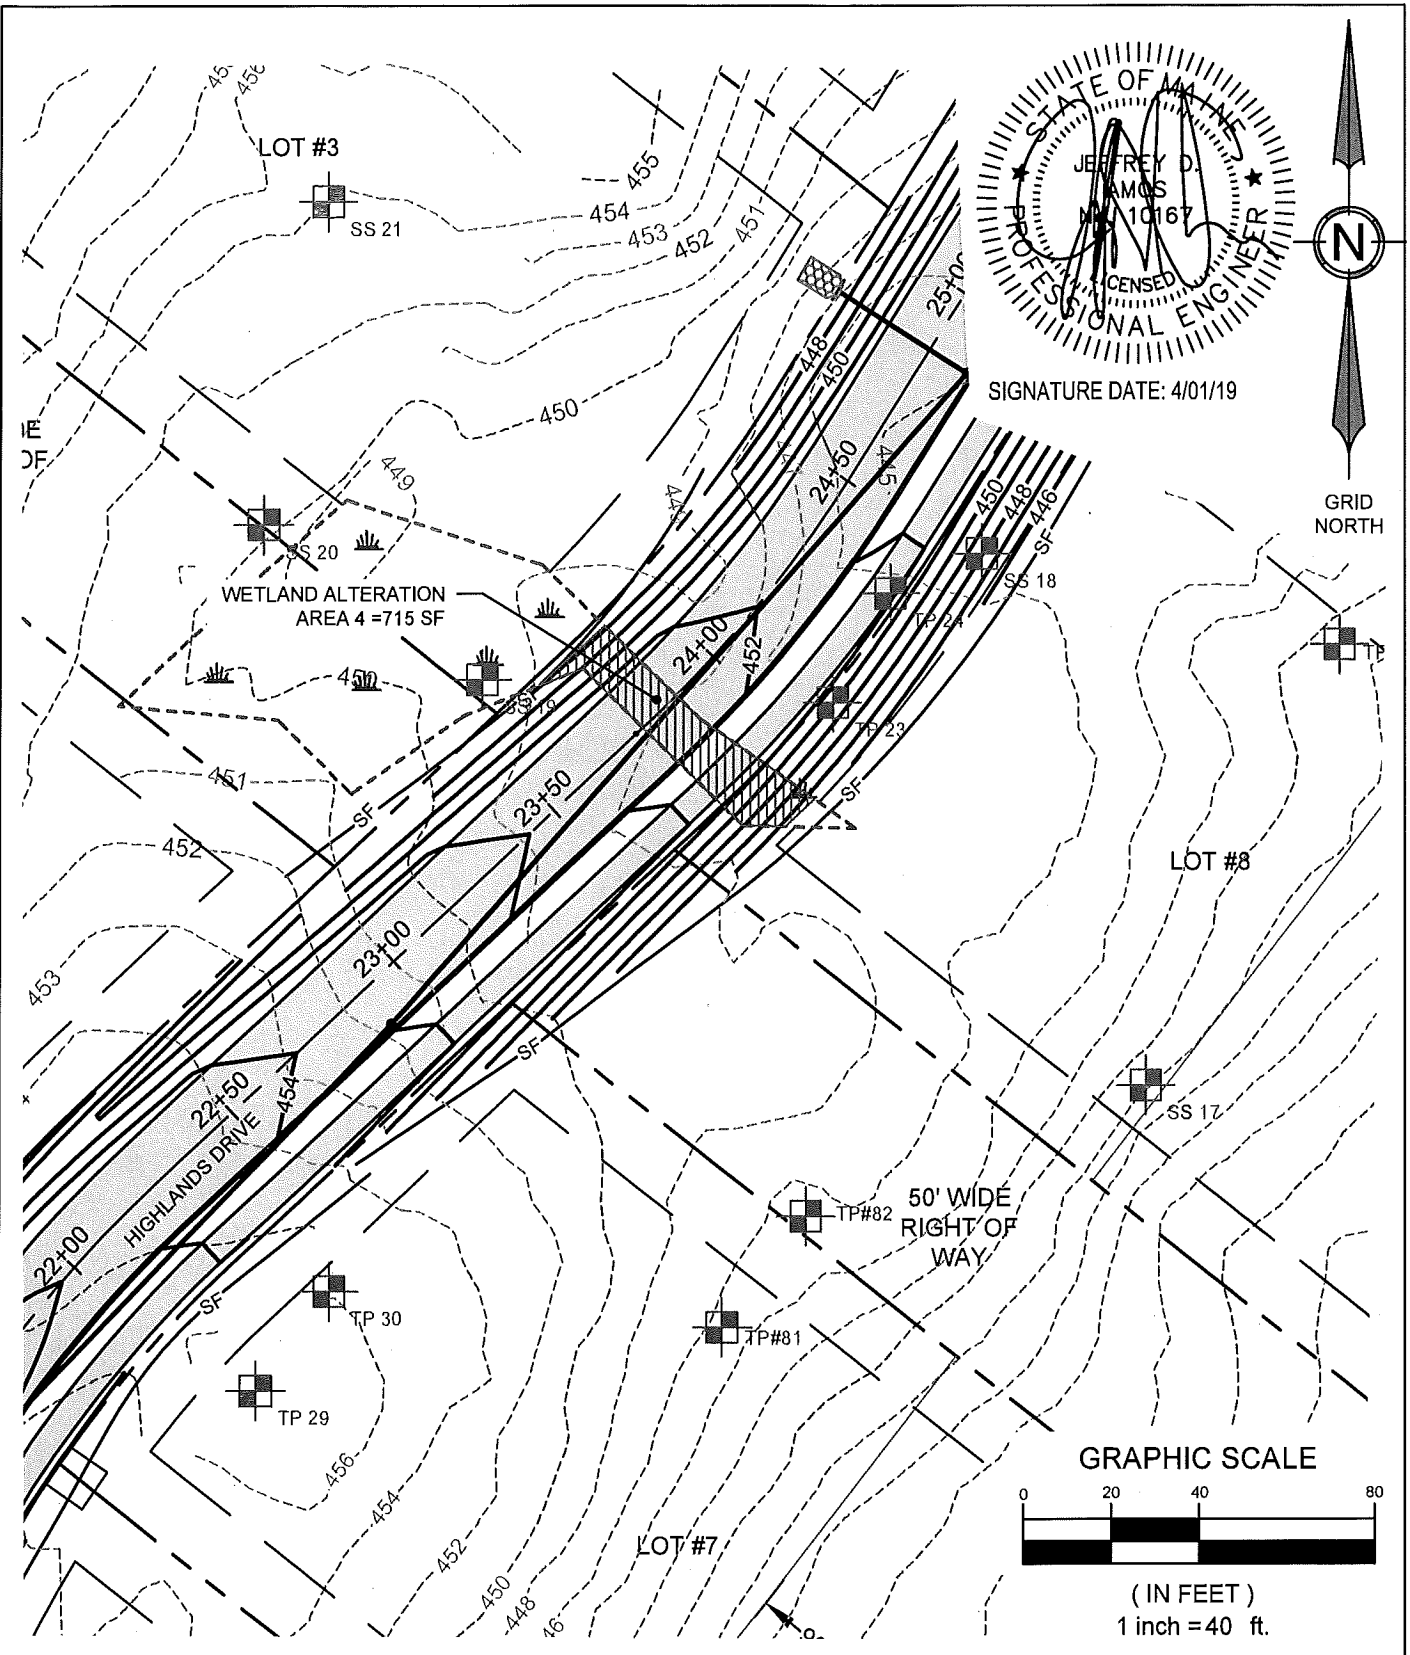

**SHEET DESCRIPTION**  
**A.C.O.E. WETLANDS ALTERATION MAP**  
**HIGHLANDS SUBDIVISION**

PREPARED FOR  
**LEAVITT - TOMPSON, LLC.**  
 P.O. BOX 703  
 STANDISH, MAINE 04084




**TERRADYN**  
 CONSULTANTS, LLC

Civil Engineering - Land Planning - Stormwater Design - Environmental Permitting



41 Campus Drive, Suite 101  
 New Gloucester, ME 04260  
 Office: (207) 926-5111  
 Fax: (207) 221-1317  
 www.terradynconsultants.com

JOB NO.	1804	SHEET	3
DATE	4/01/2019	OF	
SCALE	1"=40'		4



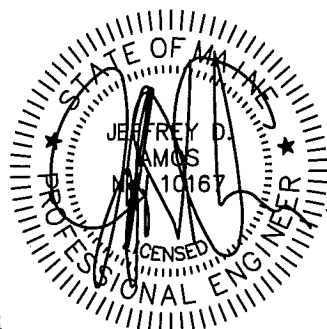

SIGNATURE DATE: 4/01/19

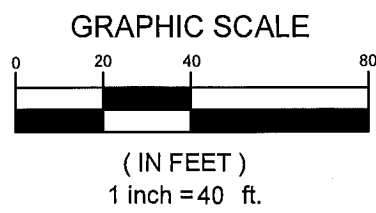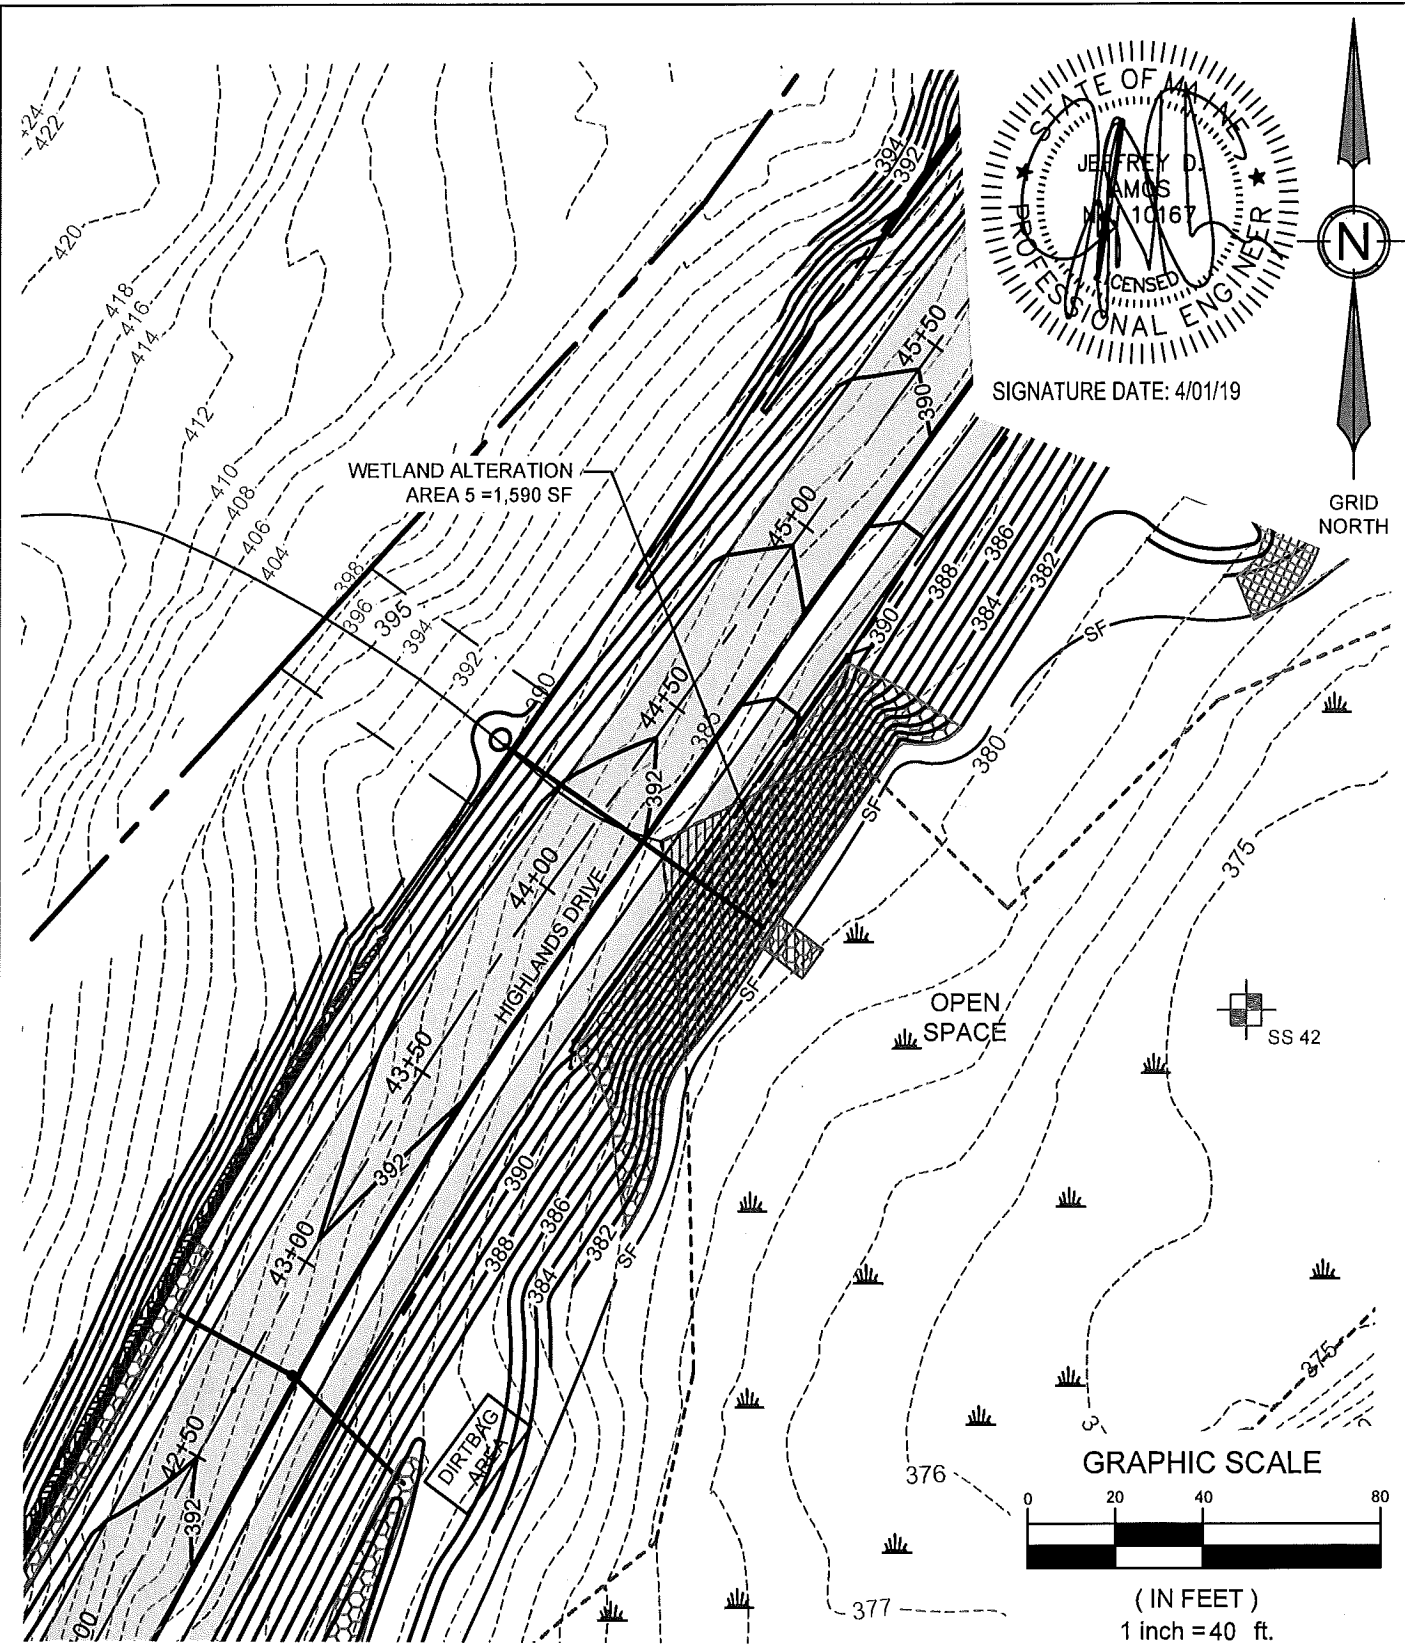


**SHEET DESCRIPTION**  
**A.C.O.E. WETLANDS ALTERATION MAP**  
**HIGHLANDS SUBDIVISION**  
 PREPARED FOR  
**LEAVITT - TOMPSON, LLC.**  
 P.O. BOX 703  
 STANDISH, MAINE 04084



**TERRADYN**  
 CONSULTANTS, LLC  
 Civil Engineering - Land Planning - Stormwater Design - Environmental Permitting

41 Campus Drive, Suite 101  
 New Gloucester, ME 04260  
 Office: (207) 926-5111  
 Fax: (207) 221-1317  
 www.terradynconsultants.com

JOB NO.	1804	SHEET	4
DATE	4/01/2019	OF	4
SCALE	1"=40'		



**US Army Corps  
of Engineers®**  
New England District

**GENERAL PERMIT  
WORK-START NOTIFICATION FORM**  
(Minimum Notice: Two weeks before work begins)

**MAIL TO:** Colin M. Greenan  
U.S. Army Corps of Engineers, New England District  
Maine Project Office  
442 Civic Center Drive, Suite 350  
Augusta, Maine 04330

A Corps of Engineers Permit (No. NAE-2019-02253) was issued to Brian Leavitt & Jamie Tompson, Tompson-Leavitt, LLC. The permit authorized the permittee to place permanent fill in 7,192 s.f. of freshwater wetland off Route 25 (Ossipee Trail) and Oak Hill Road at Standish, Maine in order to construct associated infrastructure for a residential subdivision with 21 condominium buildings containing a total of 84 units, a clubhouse and 18 single family residences.

The people (e.g., contractor) listed below will do the work, and they understand the permit's conditions and limitations.

PLEASE PRINT OR TYPE

Name of Person/Firm: \_\_\_\_\_  
\_\_\_\_\_

Business Address: \_\_\_\_\_  
\_\_\_\_\_

Telephone: (     ) \_\_\_\_\_ (     ) \_\_\_\_\_

Proposed Work Dates: Start: \_\_\_\_\_

Finish: \_\_\_\_\_

PERMITTEE'S SIGNATURE: \_\_\_\_\_ DATE: \_\_\_\_\_

PRINTED NAME: \_\_\_\_\_ TITLE: \_\_\_\_\_

*FOR USE BY THE CORPS OF ENGINEERS*

Project Manager: GREENAN Submittals Required: No

Inspection Recommendation: random Maine General Permit compliance



**US Army Corps  
of Engineers**®  
New England District

(Minimum Notice: Permittee must sign and return notification  
within one month of the completion of work.)

**COMPLIANCE CERTIFICATION FORM**

**Corps of Engineers Permit No:** NAE-2019-02253

**Name of Permittee:** Brian Leavitt & Jamie Tompson, Tompson-Leavitt, LLC

**Permit Issuance Date:** 12/4/2019

Please sign this certification and return it to the following address upon completion of the activity and any mitigation required by the permit. You must submit this after the mitigation is complete, but not the mitigation monitoring, which requires separate submittals.

\*\*\*\*\*  
 \* MAIL TO: U.S. Army Corps of Engineers, New England District \*  
 \* Policy & Technical Support Branch \*  
 \* Regulatory Division \*  
 \* 696 Virginia Road \*  
 \* Concord, Massachusetts 01742-2751 \*  
 \*\*\*\*\*

Please note that your permitted activity is subject to a compliance inspection by an U.S. Army Corps of Engineers representative. If you fail to comply with this permit you are subject to permit suspension, modification, or revocation.

**I hereby certify that the work authorized by the above referenced permit was completed in accordance with the terms and conditions of the above referenced permit, and any required mitigation was completed in accordance with the permit conditions.**

\_\_\_\_\_  
Signature of Permittee

\_\_\_\_\_  
Date

\_\_\_\_\_  
Printed Name

\_\_\_\_\_  
Date of Work Completion

( ) \_\_\_\_\_  
Telephone Number

( ) \_\_\_\_\_  
Telephone Number

---

## STORMWATER MANAGEMENT PLAN

### Highlands Subdivision

### Standish, Maine

*Revised November 27, 2019*

The following Stormwater Management Plan has been prepared for the Highlands Subdivision and Village Housing Project to evaluate stormwater runoff and erosion control for the proposed eighty-four (84) unit Village Housing Site Plan and 18-lot residential subdivision.

#### **Site Calculations**

Total Property Area	53.11 Ac (+/-)
Total New Impervious Area	9.70 Ac
Landscaped Area	19.10 Ac
Total Developed Area	28.80 Ac

#### **Existing Conditions**

The development parcel is located on the north side of Route 25, approximately 1.2 miles west of Standish Corner, and extends northeasterly to Oak Hill Road. Existing structures on the property include an existing farmhouse and barn just west of Leavitt Earthworks, Inc. on Route 25. The farmhouse existed prior to 1970. There is an existing gravel road on the property west of Leavitt Earthworks as well as a +/- 0.4-acre area being used for occasional construction stockpile activity. The boundaries of the development site are shown on the attached USGS 7.5-minute topographic map.

The majority of the property is wooded, with a meadow area at the easterly end near Oak Hill Road. The westerly portion of the site (+/-23.6 ac.) drains to Josie's Brook in the Saco River watershed. The easterly portion of the site (+/-29.5 ac.) drains to the Stickey River in the Sebago Lake watershed. Existing freshwater wetlands with a total area of +/- 1.81 acres have been delineated on the property.

#### **Proposed Development**

The project includes 84 two-bedroom condominium units in 21 buildings ("Village Housing" per the Standish Ordinance), and an 18-lot residential subdivision. All 18 lots have frontage on the proposed subdivision road (Highlands Drive) while the condominium buildings are accessed by five proposed driveways. The single-family lots range in size from approximately 30,100 SF to 40,100 SF. Future street rights-of-way are included to connect the subdivision with developable land on neighboring parcels, as required by the Town of Standish. Highlands Drive, the Village Housing access drives and single-family lots #1 through #5 will drain to a piped storm drain system draining to a gravel wetland and two underdrained soil filters. The single-family lots (#6 - #18) within the Sebago Lake watershed will be treated by a combination of underdrained soil filters, roof drain filter strips and forested buffers.

**Flooding**

The development area is not located within an area of flood hazard according to the Federal Insurance Rate Map 230207 0040 B. See attached map.

**Modeling Assumptions**

The onsite stormwater facilities were sized utilizing the USDA Soil Conservation Service (SCS) TR-20 Runoff Simulation Model, as contained in the HydroCAD computer software program (Version 10.00). Runoff curve numbers were determined for each direct watershed by measuring the area of each hydrologic soil group within each type of land cover. Weighted curve numbers were then calculated using curve numbers for various cover types and hydrologic soil groups, assuming “good” conditions as defined in U.S Soil Conservation Service (SCS) publications. Times of concentration and travel times were determined from site topographic maps in accordance with SCS procedures. A maximum length of 150 feet was used for sheet flow.

All of the watersheds’ peak runoff rates were analyzed for the 2, 10, and 25-year frequency, 24-hour duration storm events. A Type III rainfall distribution was applied to these storms. The rainfall amounts for this area of Cumberland County are as follows:

<b>Storm Frequency Precipitation (in./24 hr)</b>	
2-year	3.1
10-year	4.6
25-year	5.8

**Soil Delineation**

The onsite soils were delineated from a Class A High Intensity Soil Survey that was conducted by Mark Hampton Associates, Inc. The offsite soils were found from the Cumberland County Medium Intensity Soil Survey as shown on the Soil Data Viewer on the NRCS website (See attached map). The soil survey reports that the watershed soils are generally hydrologic group C and D soils. Since the High Intensity Soil Survey showed only HSG C and HSG C/D soils, the analysis models all non-wetland soils as HSG C soils and all wetland soil as HSG D. Soils boundaries are delineated on the attached pre- and post-development watershed maps.

### **Water Quantity (Flooding Standard)**

The following table summarizes the results of stormwater calculations for the design storm events for the project areas. HydroCAD calculations are provided as an appendix to this report.

<b>Table 1 - Stormwater Runoff Summary Table Pre-Development vs. Post-Development</b>						
<b>Study Point #</b>	<b>2Yr/24Hr (cfs)</b>		<b>10Yr/24Hr (cfs)</b>		<b>25Yr/24Hr (cfs)</b>	
	<b>Pre</b>	<b>Post</b>	<b>Pre</b>	<b>Post</b>	<b>Pre</b>	<b>Post</b>
1	1.9	1.2	3.9	3.5	5.6	5.2
2	8.2	7.5	19.7	19.5	30.1	29.1
3	7.9	7.3	19.5	15.2	30.2	22.0
4	0.7	0.7	1.8	1.8	2.8	2.8
5	5.4	5.0	13.1	13.1	20.2	20.0
6	3.0	3.0	7.5	6.6	11.6	9.9
7	2.6	1.6	5.3	3.1	7.6	4.4
8	0.9	0.9	2.0	1.9	3.0	2.8

As shown in the above table, the post-development peak flow rates for the 2, 10, and 25-year/24 hour design storm events do not exceed the pre-development peak flow rates at points of discharge from the site, except for the 2-year storm at study point #6. This is considered an insignificant increase because actual post-development flows at this study point will be lower than calculated in HydroCAD due to the use of forested buffers on lots #14 through #17.

### **Water Quality (BMP Standard)**

The water quality requirements will be met by the construction of a gravel wetland and four underdrained soil filter basins. Additionally, roof drain filter strips will be used on lots #12 and #13 in the subdivision to meet the phosphorus standard. For the water quality calculations, all single-family residential lots were assumed to have 5,000 SF of impervious area and 15,000 SF of landscaped area. The Subdivision Plan notes that lots #1 to #5 in the Saco River watershed are deed-restricted to a maximum of 5,000 SF impervious area and 15,000 SF landscaped area; lots #6 to #18 in the Sebago Lake watershed are deed-restricted to 4,000 SF impervious area and 12,000 SF landscaped area to reduce phosphorus export, so the treatment percentages noted below are conservative.

The impervious and developed treatment percentages are summarized below:

New Impervious Area: The project will result in the creation of approximately 422,694 SF of impervious area in the form of roadway, walkways, driveways & roof. A combination

of different BMPs will result in the treatment of approximately 404,469 SF of impervious area resulting in a treatment percentage of  $(404,469/422,694) \times 100\% = 95.69\%$ .

**Percentage of Treatment of the Impervious Area = 95.6% (95% req'd)**

Project Developed Area: The project will result in the creation of approximately 1,254,742 SF of developed area. The combination of BMPs will result in the treatment of approximately 1,096,172 SF of the developed area resulting in a treatment percentage of  $(1,096,172/1,254,742) \times 100\% = 87.36\%$ .

**Percentage of Treatment of the Developed Area = 87.4% (80% required)**

Water quality percentage treatment calculations are detailed in Attachment A.

### **Water Quality (Phosphorus Export Calculations)**

Best Management Practices (BMPs) will be implemented to reduce the impacts of site development on downstream water quality. The northeasterly portion of the property is located in the Sebago Lake Watershed. Sebago Lake is identified by the MDEP as a lake most at risk from development.

#### Sebago Lake Watershed

The allowable per acre allocation of phosphorus export for the portion of the site that is within the Sebago Lake Watershed is 0.061 lbs/acre/year of developable land. There are approximately 28.53 developable acres on the site within the Sebago Lake watershed for a total Project Phosphorus Budget of 1.74 lb./year (See Attachment B, Worksheet 1).

Phosphorus export calculations are provided on Worksheet 2 in Attachment B. Forested buffers, two underdrained soil filter basins, and roof drain filter strips on two house lots are used to reduce the total predicted phosphorus export to 1.71 lbs/year. This value is less than total Phosphorus Budget of 1.74 lb./year, as summarized on Worksheet 4 in Attachment B.

### **BMP Sizing**

#### *Roof Dripline Filter Bed*

We propose to provide treatment for some of the development roof runoff on two lots (Lots 12 & 13). The bed is required to provide volume for 1" of runoff from the contributing area and store it within a reservoir bed. The bed sizing per foot of roof length is as follows:

Area of Watershed: = 15 SF (assuming 15' to ridge line)

Treatment Volume Required: Area x runoff depth: 15 SF x 1/12 FT = 1.25 CF

Bed Sizing:

Porosity = 40%                      Bed Length = 1'    Bed Width = 3'                      Bed Depth = 1.5

Available Volume= 1' x 3' x 1.5' x 0.40 = 1.8 CF.

Proposed Filter Beds will be 3' wide x 1.5' deep.

#### *Level Spreaders #1, #2, #3 and #4*

These level spreaders are sized based on the Redistribution of Stormwater Discharges Standard from Chapter 500, which requires the flow rate from a 10-year, 24-hour storm to be less than 0.25 cfs per foot length of level spreader lip.

#### *Level Spreader #1*

Level spreader receives flow from the Filter Basin #1 primary outlet pipe. Q10 peak flow rate = 1.5 cfs.

Standard Sizing: Length =  $1.5 \text{ cfs} / (0.25 \text{ cfs} / \text{ft}) = 6 \text{ ft}$ .

Proposed Length = 12 ft.

#### *Level Spreader #2*

Level spreader receives flow from the gravel wetland primary outlet pipe. Q10 peak flow rate = 5.4 cfs.

Standard Sizing: Length =  $5.4 \text{ cfs} / (0.25 \text{ cfs} / \text{ft}) = 22 \text{ ft}$ .

Proposed Length = 25 ft.

#### *Level Spreader #3*

Level spreader receives flow from the Filter Basin #2 and subcatchment S2-1C, which contains the rear roof and yards of four 4-unit condo buildings. Q10 peak flow rate = 7.0 cfs.

Standard Sizing: Length =  $7.0 \text{ cfs} / (0.25 \text{ cfs} / \text{ft}) = 28 \text{ ft}$ .

Proposed Length = 30 ft.

#### *Level Spreader #4*

Level spreader receives flow from a swale constructed to divert off-site runoff from subcatchment S2-1A around the development site. Q10 peak flow rate = 6.0 cfs.

Standard Sizing: Length =  $6.0 \text{ cfs} / (0.25 \text{ cfs} / \text{ft}) = 24 \text{ ft}$ .

Proposed Length = 25 ft.

#### *Level Spreader #5*

The buffer contains soils that are consistent with hydrologic soil group C sandy loam or loamy sand soils. Table 5.5 in the BMP Manual, *Berm and Flow Path Length Per Acre of Impervious Area* shows that standard sizing for a forested buffer with 150' flow path over slopes of 6% must be 75' per acre of impervious area and 25' per acre of lawn. Evaluation of the watershed shows the following:

Impervious Area = 0.292 Ac

Lawn Area = 0.864 Ac.

Standard Sizing:  $75(0.292) + 25(0.864) = 44 \text{ ft}$

Proposed Length = 45 ft.



Gravel Wetland

WATERSHED IMPERVIOUS AREA= 130201 SF  
 WATERSHED LANDSCAPED AREA= 189922 SF  
 REQUIRED WQV= 17181 CF  
 PROVIDED WQV= 17664 CF  
 REQUIRED FILTER AREA= 10308 SF  
 PROVIDED FILTER AREA= 11724 SF

Forebay	STAGE (FT)	AREA (SF)	STORAGE (CF)
	390	1007	0
	391	1469	1238
WQV	391.25	1585	1620
	391.5	1700	2030

Cell #1	STAGE (FT)	AREA (SF)	STORAGE (CF)
	390	5863	0
	391	6828	6345
WQV	391.25	7069	8082
	391.5	7310	9880

Cell #2	STAGE (FT)	AREA (SF)	STORAGE (CF)
	390	5863	0
	391	6674	6268
WQV	391.25	6876	7962
	391.5	7079	9707

45%

Total Pond	STAGE (FT)	AREA (SF)	STORAGE (CF)
	390	12733	0
	391	14970	13852
WQV	391.25	15530	17664
	391.5	16089	21617
	392	17209	29941
	393	19450	48270
	394	21690	68842

Filter Basin #1

WATERSHED IMPERVIOUS AREA= 56280 SF  
 WATERSHED LANDSCAPED AREA= 65166 SF  
 REQUIRED WQV= 6862 CF  
 PROVIDED WQV= 7091 CF  
 REQUIRED FILTER AREA= 4117 SF  
 PROVIDED FILTER AREA= 4139 SF

Forebay	STAGE (FT)	AREA (SF)	STORAGE (CF)
	390.4	115	0
	391	196	93
	391.9	324	327

Cell #1 west	STAGE (FT)	AREA (SF)	STORAGE (CF)
	390.4	2519	0
	391	2932	1635
WQV	391.55	3506	3406
	391.9	3872	4697

Cell #2 east	STAGE (FT)	AREA (SF)	STORAGE (CF)
	390.4	2702	0
	391	3124	1748
WQV	391.55	3581	3592
	391.9	3872	4896

Total Pond	STAGE (FT)	AREA (SF)	STORAGE (CF)
	390.4	5221	0
	391	6056	3476
WQV	391.55	7088	7091
	391.9	7744	9920
	392	7744	10695
	393	9241	19187
	394	10477	28276

Filter Basin #2

WATERSHED IMPERVIOUS  
 AREA= 97269 SF  
 WATERSHED LANDSCAPED  
 AREA= 86031 SF  
 REQUIRED WQV= 10973 CF  
 PROVIDED WQV= 11278 CF  
 MINIMUM REQ'D FILTER  
 SURFACE AREA= 6584 SF  
 PROVIDED FILTER SURFACE  
 AREA= 6613 SF

Forebay	STAGE (FT)	AREA (SF)	STORAGE (CF)
	434.5	100	0
	435	121	55
	436	196	214

Cell #1	STAGE (FT)	AREA (SF)	STORAGE (CF)
north	434.5	3307	0
	435	3718	1756
WQV	435.95	4354	5591
	436	4388	5809

Cell #2	STAGE (FT)	AREA (SF)	STORAGE (CF)
south	434.5	3306	0
	435	3773	1770
WQV	435.95	4357	5632
	436	4388	5850

Total Pond	STAGE (FT)	AREA (SF)	STORAGE (CF)
	434.5	6613	0
	435	7491	3581
WQV	435.95	8712	11278
	436	8776	11873
	436.01	9395	11964
	437	11340	22228
	438	12659	34227

Filter Basin #3

WATERSHED IMPERVIOUS  
 AREA= 42898 SF  
 WATERSHED LANDSCAPED  
 AREA= 79105 SF  
 REQUIRED WQV= 6212 CF  
 PROVIDED WQV= 6267 CF  
 REQUIRED FILTER AREA= 3727 SF  
 PROVIDED FILTER AREA= 4133 SF

Forebay	STAGE (FT)	AREA (SF)	STORAGE (CF)
	379.5	60	0
	380	230	73
	380.5	400	230

Cell #1 west	STAGE (FT)	AREA (SF)	STORAGE (CF)
	379.2	2066	0
	380	4362	2571
WQV	380.1	4532	3016
	380.5	5210	4964

Cell #2 east	STAGE (FT)	AREA (SF)	STORAGE (CF)
	379.2	2472	0
	380	4362	2734
WQV	380.1	4532	3178
	380.5	5210	5127

Total Pond	STAGE (FT)	AREA (SF)	STORAGE (CF)
	379.2	4538	0
	380	8724	5377
WQV	380.1	9063	6267
	380.5	10420	10321
	382	12670	27638
	383	14630	41288
	384	16806	57006
	384.25	17367	60821

Filter Basin #4

WATERSHED IMPERVIOUS AREA=	8233	SF
WATERSHED LANDSCAPED AREA=	32626	SF
REQUIRED WQV=	1774	CF
PROVIDED WQV=	1959	CF
MINIMUM REQ'D FILTER SURFACE AREA=	1064	SF
PROVIDED FILTER SURFACE AREA=	1245	SF

STAGE (FT)	AREA (SF)	STORAGE (CF)
377	1245	0
378	1891	1568
378.2	2020	1959
379	2537	3782
380	3183	6642

WQV

The required water quality volume for the gravel wetland and filter basins was calculated by multiplying the impervious area by 1.0" and the landscaped area by 0.4". BMP Sizing calculations are provided in Attachment C.

A soil test pit was excavated within each of the four filter basins and within the gravel wetland to identify soil conditions and depth to groundwater. Test pit logs are provided in Attachment D; test pit locations are shown on the Post-Development Watershed Maps and on the Grading Plans.

### **Summary**

Based on the results of this evaluation, the proposed stormwater design is not expected to cause flooding, erosion or other significant adverse effects downstream of the site.

Submitted by:

Terradyn Consultants, LLC



Lawrence Bastian, P.E.


### **Attachments:**

U.S.G.S. Quadrangle Map  
FEMA Flood Hazard Map  
NRCS Medium Intensity Soil Map  
Attachment A – Water Quality Percentage Treatment Calculations  
Attachment B – Phosphorus Export Calculations  
Attachment C – BMP Sizing Calculations  
Attachment D – Stormwater BMP Soil Test Pit Logs  
Housekeeping Plan  
Maintenance & Inspection of Stormwater Facilities  
Forested Buffer Deed Restrictions  
Pre Development Watershed Map  
Post Development Watershed Map

### **Appendix:**

HydroCAD Stormwater Calculations  
Pre-Development HydroCAD Calculations  
Post Development Hydrocad Calculations  
Spillway Calculations – 25 & 100 year storms  
Storm Drain Sizing Calculations – 10-year Storm



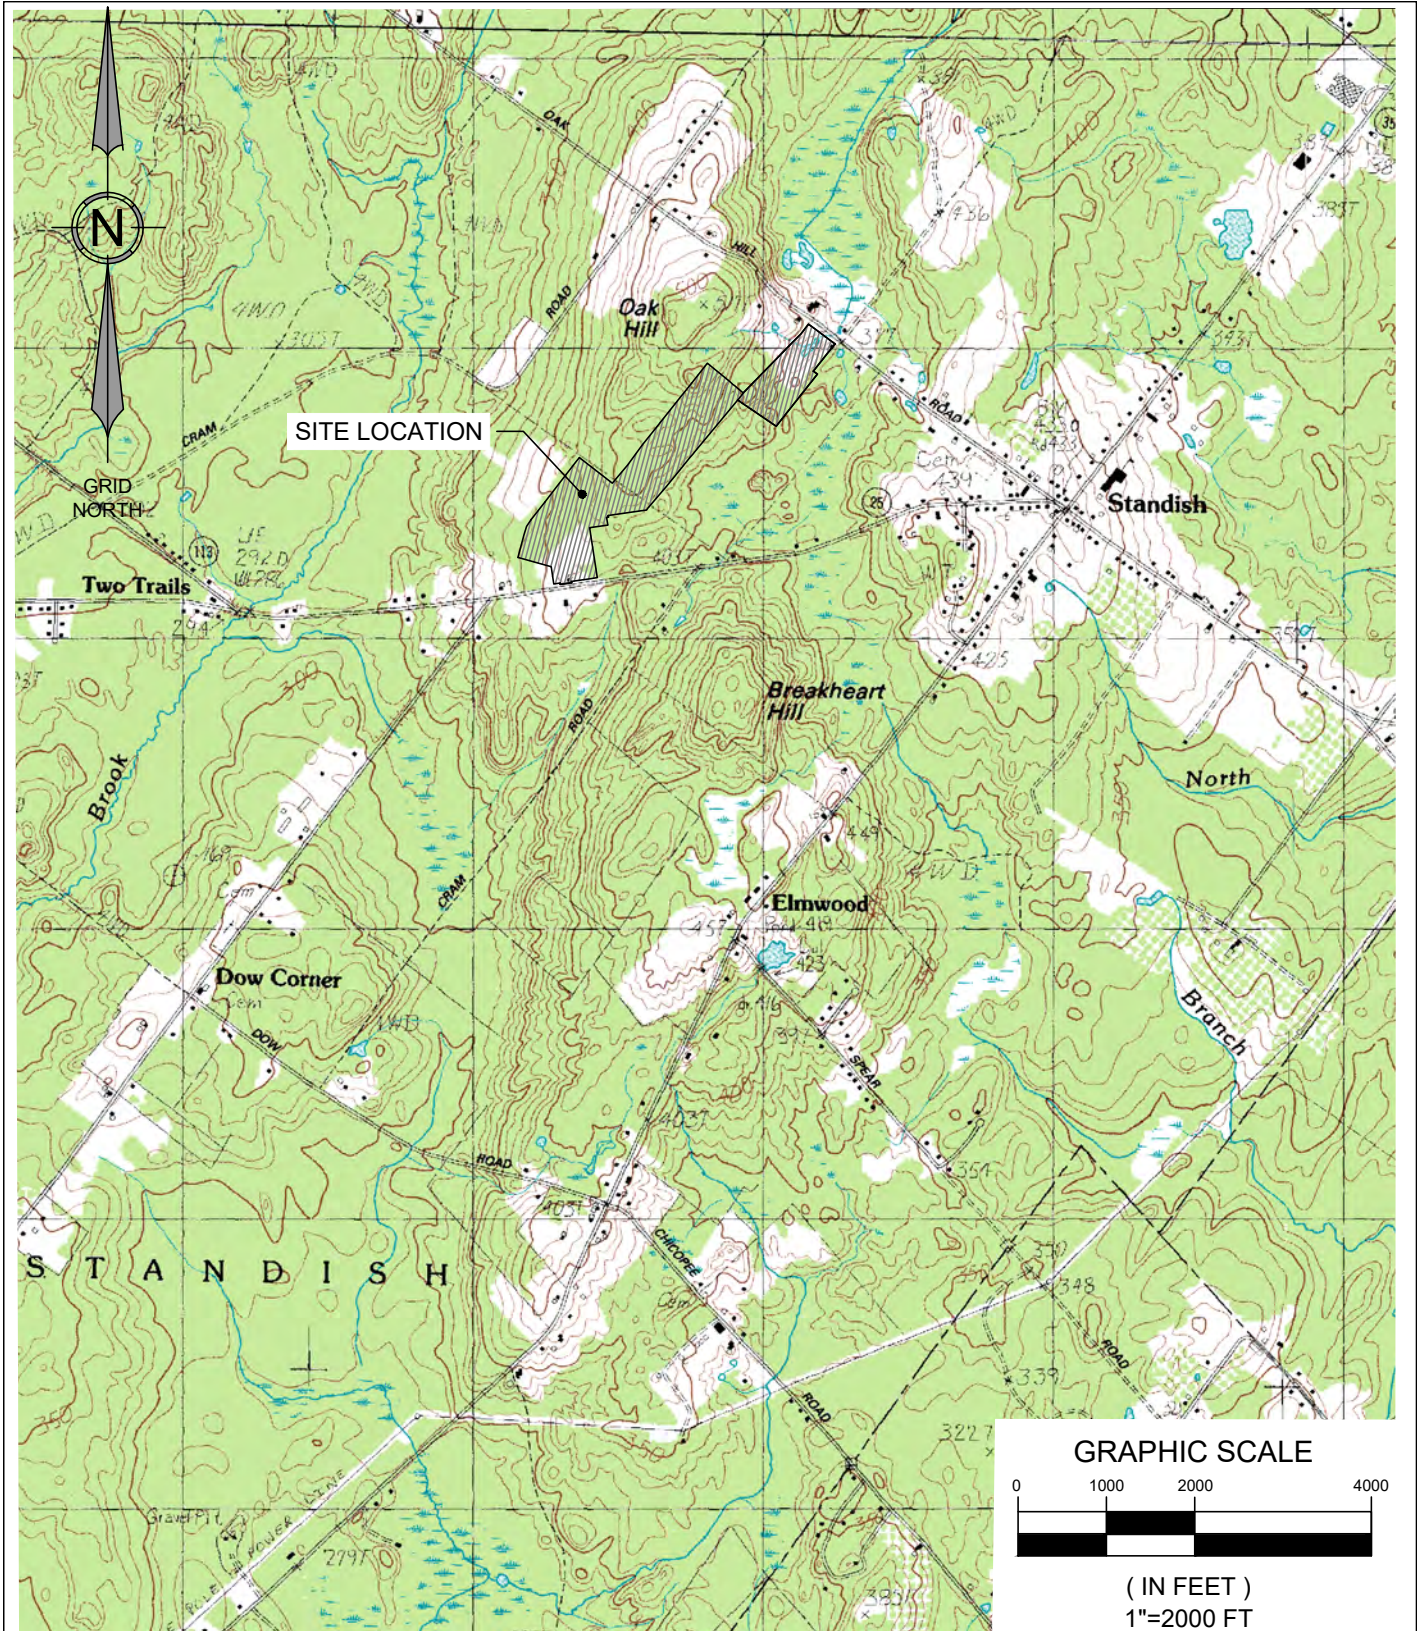

SHEET DESCRIPTION  
 U.S.G.S. QUADRANGLE MAP  
 HIGHLANDS SUBDIVISION  
 PREPARED FOR  
 LEAVITT-THOMPSON, LLC.  
 P.O. BOX 703  
 STANDISH, MAINE 04084




41 Campus Drive, Suite 101  
 New Gloucester, ME 04260  
 Office: (207) 926-5111  
 Fax: (207) 221-1317  
 www.terradyndesign.com

Civil Engineering - Land Planning - Stormwater Design - Environmental Permitting

JOB NO. 1804	SHEET 1
DATE 1/29/2019	OF
SCALE 1"=2,000'	1



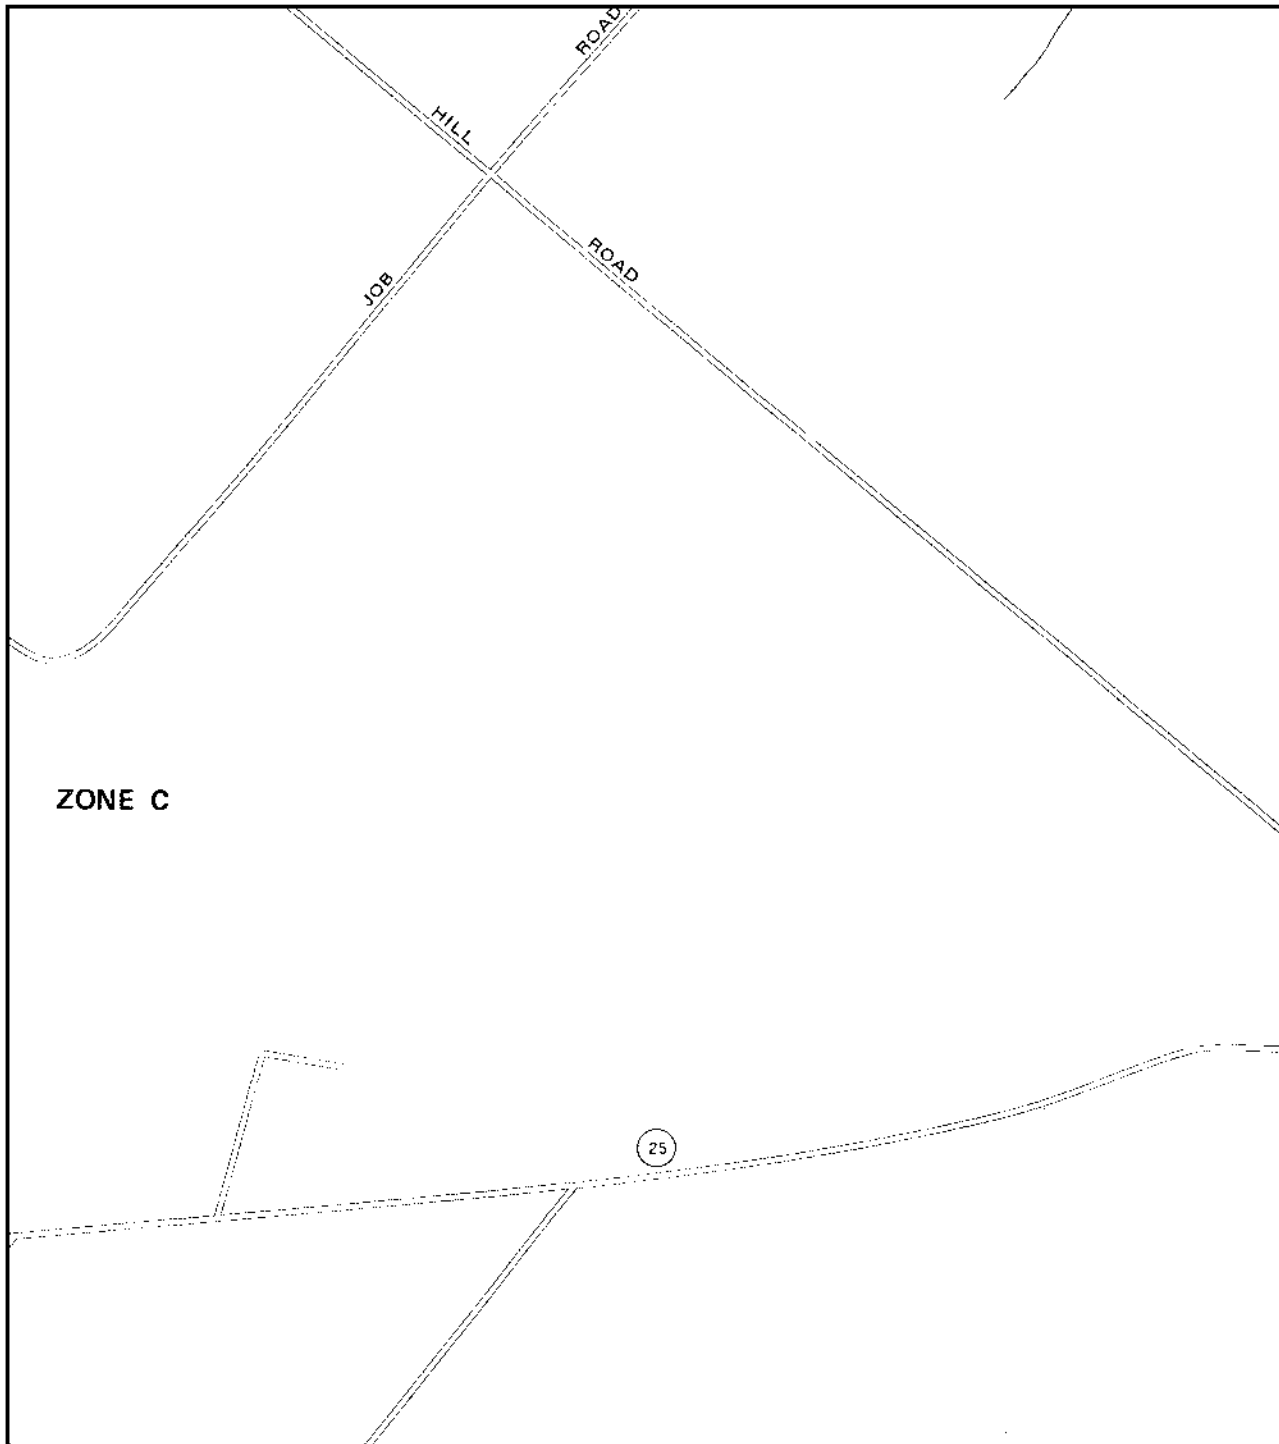

APPROXIMATE SCALE

800 0 800 FEET

NATIONAL FLOOD INSURANCE PROGRAM

**FIRM**  
FLOOD INSURANCE RATE MAP

TOWN OF  
STANDISH, MAINE  
CUMBERLAND COUNTY

PANEL 40 OF 45  
(SEE MAP INDEX FOR PANELS NOT PRINTED)

COMMUNITY-PANEL NUMBER  
230207 0040 B

EFFECTIVE DATE:  
MAY 19, 1981




federal emergency management agency  
federal insurance administration


This is an official copy of a portion of the above referenced flood map. It was extracted using F-MIT On-Line. This map does not reflect changes or amendments which may have been made subsequent to the date on the title block. For the latest product information about National Flood Insurance Program flood maps check the FEMA Flood Map Store at [www.msc.fema.gov](http://www.msc.fema.gov)



Hydrologic Soil Group—Cumberland County and Part of Oxford County, Maine

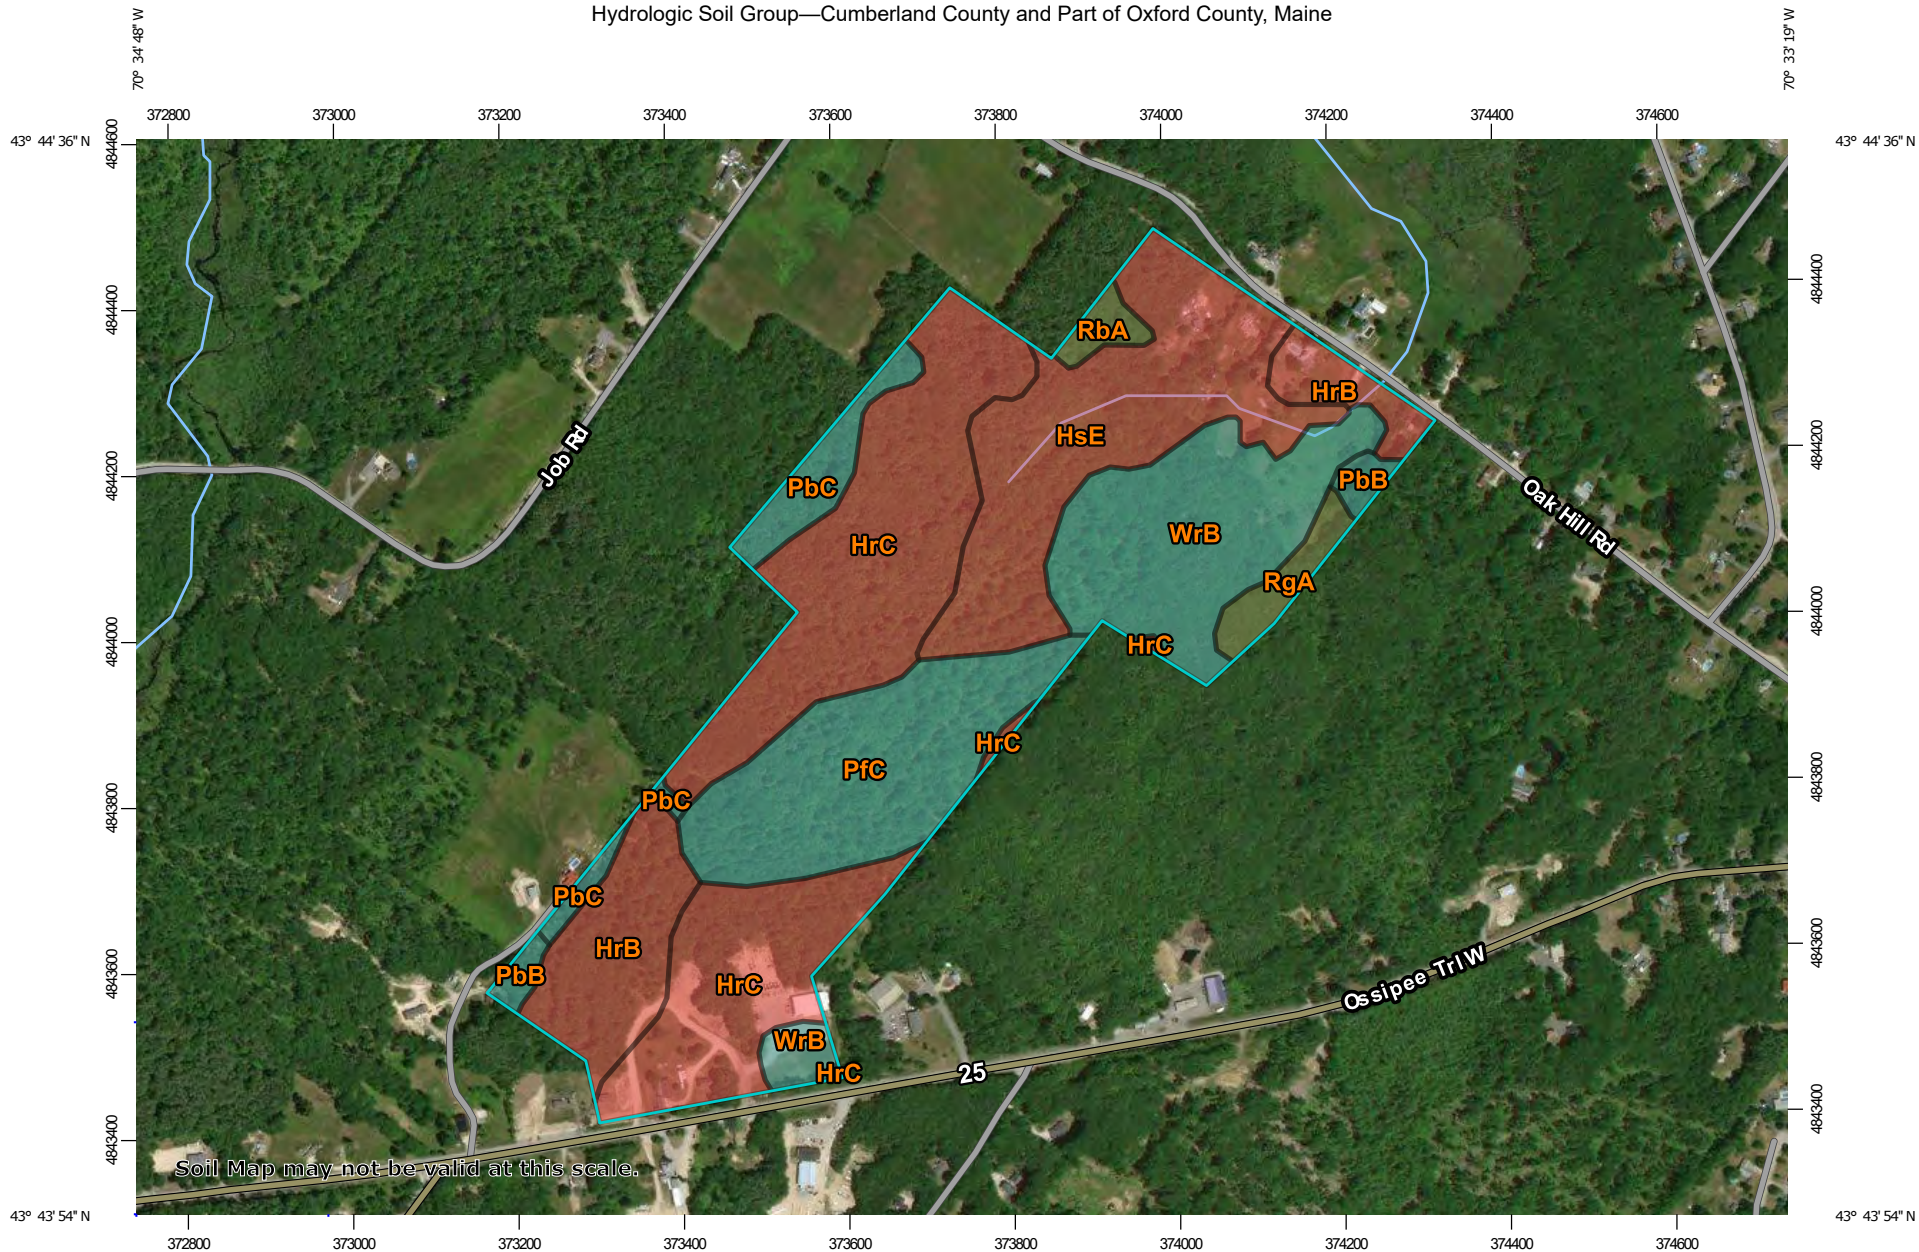

Map Scale: 1:9,130 if printed on A landscape (11" x 8.5") sheet.



Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 19N WGS84

## MAP LEGEND

### Area of Interest (AOI)

 Area of Interest (AOI)

### Soils

#### Soil Rating Polygons

 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

#### Soil Rating Lines

 A  
 A/D  
 B  
 B/D  
 C  
 C/D  
 D  
 Not rated or not available

#### Soil Rating Points

 A  
 A/D  
 B  
 B/D

 C  
 C/D  
 D  
 Not rated or not available

### Water Features

 Streams and Canals

### Transportation

 Rails  
 Interstate Highways  
 US Routes  
 Major Roads  
 Local Roads

### Background

 Aerial Photography

## MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:24,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service  
 Web Soil Survey URL:  
 Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Cumberland County and Part of Oxford County, Maine  
 Survey Area Data: Version 15, Sep 6, 2018

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Apr 29, 2012—Jun 26, 2016

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

## Hydrologic Soil Group

Map unit symbol	Map unit name	Rating	Acres in AOI	Percent of AOI
HrB	Lyman-Tunbridge complex, 0 to 8 percent slopes, rocky	D	12.3	10.4%
HrC	Lyman-Tunbridge complex, 8 to 15 percent slopes, rocky	D	36.3	30.8%
HsE	Lyman-Abram complex, 15 to 35 percent slopes, very rocky	D	22.4	19.0%
PbB	Paxton fine sandy loam, 3 to 8 percent slopes	C	1.7	1.5%
PbC	Paxton fine sandy loam, 8 to 15 percent slopes	C	4.6	3.9%
PfC	Paxton very stony fine sandy loam, 8 to 15 percent slopes	C	18.1	15.4%
RbA	Ridgebury fine sandy loam, 0 to 3 percent slopes	C/D	1.3	1.1%
RgA	Ridgebury very stony fine sandy loam, 0 to 3 percent slopes	C/D	2.4	2.1%
WrB	Woodbridge fine sandy loam, 0 to 8 percent slopes	C	18.6	15.8%
<b>Totals for Area of Interest</b>			<b>117.8</b>	<b>100.0%</b>

## Description

Hydrologic soil groups are based on estimates of runoff potential. Soils are assigned to one of four groups according to the rate of water infiltration when the soils are not protected by vegetation, are thoroughly wet, and receive precipitation from long-duration storms.

The soils in the United States are assigned to four groups (A, B, C, and D) and three dual classes (A/D, B/D, and C/D). The groups are defined as follows:

Group A. Soils having a high infiltration rate (low runoff potential) when thoroughly wet. These consist mainly of deep, well drained to excessively drained sands or gravelly sands. These soils have a high rate of water transmission.

Group B. Soils having a moderate infiltration rate when thoroughly wet. These consist chiefly of moderately deep or deep, moderately well drained or well drained soils that have moderately fine texture to moderately coarse texture. These soils have a moderate rate of water transmission.

Group C. Soils having a slow infiltration rate when thoroughly wet. These consist chiefly of soils having a layer that impedes the downward movement of water or soils of moderately fine texture or fine texture. These soils have a slow rate of water transmission.

Group D. Soils having a very slow infiltration rate (high runoff potential) when thoroughly wet. These consist chiefly of clays that have a high shrink-swell potential, soils that have a high water table, soils that have a claypan or clay layer at or near the surface, and soils that are shallow over nearly impervious material. These soils have a very slow rate of water transmission.

If a soil is assigned to a dual hydrologic group (A/D, B/D, or C/D), the first letter is for drained areas and the second is for undrained areas. Only the soils that in their natural condition are in group D are assigned to dual classes.

## Rating Options

*Aggregation Method:* Dominant Condition

*Component Percent Cutoff:* None Specified

*Tie-break Rule:* Higher

## **Attachment A – Water Quality Percentage Treatment Calculations**



**HIGHLANDS SUBDIVISION, STANDISH - WQ TREATMENT**

Revised Building Layout 2/2019 Based on Preliminary Subdivision Plan Approved 3/4/2019

New Impervious Area (SF) =	422694
Total New Landscaped Area (SF)=	832048
Total Developed Area (SF) =	1254742

95% = 401559 SF

Study Point	Watershed	New Impervious Area (SF)	Total Impervious Area Treated (SF)	New Landscaped Area	Total Landscaped Area Treated (SF)	Developed Area (SF)	Total Developed Area Treated (SF)	Incremental Treatment % (Impervious)	Incremental Treatment % (Developed)	BMP	See Note Below
SP-7	S7-1	-1,932	0	6,700	0	4,768	0	0.00%	0.00%	Untreated	3
	S7-2	61	0	2,400	0	2,461	0	0.00%	0.00%	Untreated	
	S-H-1	5,211	0	808	0	6,019	0	0.00%	0.00%	Untreated	
	S-H-2	2,092	0	21,406	0	23,498	0	0.00%	0.00%	Untreated	
SP-8	S8-1	-9,962	0	0	0	-9,962	0	0.00%	0.00%	Untreated	4
SP-1	S1-1	-700	0	9,000	0	8,300	0	0.00%	0.00%	Untreated	
	S-H-4	6,181	6,181	3,450	32,591	9,631	38,772	1.46%	3.09%	Level Spreader Sta 2+50 L	
	S-H-3	4,932	4,932	742	742	5,674	5,674	1.17%	0.45%	Level Spreader Sta 2+50 L	
	S-E-5	0	0	4,317	1,350	4,317	1,350	0.00%	0.11%	Level Spreader Sta 2+50 L	
	S-FB-3	4,590	4,590	24,500	24,500	29,090	29,090	1.09%	2.32%	Filter Basin #1	
	S-H-5	4,831	4,831	780	780	5,611	5,611	1.14%	0.45%	Filter Basin #1	
	S-H-6	14,359	14,359	9,299	9,299	23,658	23,658	3.40%	1.89%	Filter Basin #1	
	S-E-2	13,600	13,600	6,977	6,977	20,577	20,577	3.22%	1.64%	Filter Basin #1	
	S-E-1	10,560	10,560	8,941	8,941	19,501	19,501	2.50%	1.55%	Filter Basin #1	
	S-D-1	2,670	2,670	4,183	4,183	6,853	6,853	0.63%	0.55%	Filter Basin #1	
	S-H-7	2,584	2,584	4,302	4,302	6,886	6,886	0.61%	0.55%	Filter Basin #1	
	S-H-8	2,029	2,029	4,161	4,161	6,190	6,190	0.48%	0.49%	Filter Basin #1	
	S-H-9	2,864	2,864	2,768	2,768	5,632	5,632	0.68%	0.45%	Filter Basin #1	
	SP-2	S2-1A	13,379	0	41,250	0	54,629	0	0.00%	0.00%	Untreated
S2-1B		6,379	6,311	42,968	0	49,347	6,311	1.49%	0.50%	Untreated	
S-L-1		13,898	13,898	9,227	9,227	23,125	23,125	3.29%	1.84%	Gravel Wetland	
S-L-2		9,389	9,389	8,323	8,323	17,712	17,712	2.22%	1.41%	Gravel Wetland	
S-GW-1		4,304	4,304	50,423	50,423	54,727	54,727	1.02%	4.36%	Gravel Wetland	
S-FB-1		11,210	11,210	46,844	46,844	58,054	58,054	2.65%	4.63%	Gravel Wetland	
S-G-1		4,912	4,912	785	785	5,697	5,697	1.16%	0.45%	Gravel Wetland	
S-G-2		4,777	4,777	2,641	2,641	7,418	7,418	1.13%	0.59%	Gravel Wetland	
S-I-2		9,033	9,033	2,651	2,651	11,684	11,684	2.14%	0.93%	Gravel Wetland	
S-I-1		3,320	3,320	1,899	1,899	5,219	5,219	0.79%	0.42%	Gravel Wetland	
S-I-3		11,977	11,977	4,470	4,470	16,447	16,447	2.83%	1.31%	Gravel Wetland	
S-I-4		12,441	12,441	6,263	6,263	18,704	18,704	2.94%	1.49%	Gravel Wetland	
S-F-1		10,433	10,433	41,889	41,889	52,322	52,322	2.47%	4.17%	Gravel Wetland	
S-G-4		5,084	5,084	410	410	5,494	5,494	1.20%	0.44%	Gravel Wetland	
S-G-5		9,476	9,476	5,373	5,373	14,849	14,849	2.24%	1.18%	Gravel Wetland	
S-H-10		6,442	6,442	4,006	4,006	10,448	10,448	1.52%	0.83%	Gravel Wetland	
S-H-11		1,849	1,849	978	978	2,827	2,827	0.44%	0.23%	Gravel Wetland	
S-H-12	1,978	1,978	0	0	1,978	1,978	0.47%	0.16%	Gravel Wetland		
S-H-13	2,360	2,360	0	0	2,360	2,360	0.56%	0.19%	Gravel Wetland		
S-H-14	3,545	3,545	1,469	1,469	5,014	5,014	0.84%	0.40%	Gravel Wetland		
S-I-5	3,783	3,783	2,307	2,307	6,090	6,090	0.89%	0.49%	Gravel Wetland		

**HIGHLANDS SUBDIVISION, STANDISH - WQ TREATMENT**

Revised Building Layout 2/2019 Based on Preliminary Subdivision Plan Approved 3/4/2019

New Impervious Area (SF) =	422694
Total New Landscaped Area (SF)=	832048
Total Developed Area (SF) =	1254742

95% = 401559 SF

Study Point	Watershed	New Impervious Area (SF)	Total Impervious Area Treated (SF)	New Landscaped Area	Total Landscaped Area Treated (SF)	Developed Area (SF)	Total Developed Area Treated (SF)	Incremental Treatment % (Impervious)	Incremental Treatment % (Developed)	BMP	See Note Below
SP-2	S-H-15	2,767	2,767	0	0	2,767	2,767	0.65%	0.22%	Filter Basin #2	
	S-H-16A	4,861	4,861	4,942	4,942	9,803	9,803	1.15%	0.78%	Filter Basin #2	
	S-H-16B	3,695	3,695	23,062	23,062	26,757	26,757	0.87%	2.13%	Filter Basin #2	
	S-H-17	1,361	1,361	0	0	1,361	1,361	0.32%	0.11%	Filter Basin #2	
	S-H-18	3,873	3,873	12,223	12,223	16,096	16,096	0.92%	1.28%	Filter Basin #2	
	S-S-1	9,860	9,860	6,235	6,235	16,095	16,095	2.33%	1.28%	Filter Basin #2	
	S-S-2	7,987	7,987	5,541	5,541	13,528	13,528	1.89%	1.08%	Filter Basin #2	
	S-S-3	3,657	3,657	925	925	4,582	4,582	0.87%	0.37%	Filter Basin #2	
	S-S-4	4,428	4,428	1,900	1,900	6,328	6,328	1.05%	0.50%	Filter Basin #2	
	S-H-19	2,072	2,072	245	245	2,317	2,317	0.49%	0.18%	Filter Basin #2	
	S-H-20	2,842	2,842	1,826	1,826	4,668	4,668	0.67%	0.37%	Filter Basin #2	
	S-H-21A	3,099	3,099	1,091	1,091	4,190	4,190	0.73%	0.33%	Filter Basin #2	
	S-H-21B	5,007	5,007	9,516	9,516	14,523	14,523	1.18%	1.16%	Filter Basin #2	5
	S-H-22	2,069	2,069	742	742	2,811	2,811	0.49%	0.22%	Filter Basin #2	
	S-H-23A	8,317	8,317	2,885	2,885	11,202	11,202	1.97%	0.89%	Filter Basin #2	
	S-H-23B	11,047	11,047	34,505	34,505	45,552	45,552	2.61%	3.63%	Filter Basin #2	6
	S-H-23C	10,323	10,323	24,289	24,289	34,612	34,612	2.44%	2.76%	Filter Basin #2	7
	S-H-24B	5,357	5,357	9,950	9,950	15,307	15,307	1.27%	1.22%	Filter Basin #2	8
	S-H-24A	3,995	3,995	1,427	1,427	5,422	5,422	0.95%	0.43%	Filter Basin #2	
SP-3	S-3-1	40,000	30,000	112,912	86,181	152,912	116,181	7.10%	9.26%	Wooded Buffer C soils	9
SP-4	S-4-1	0	0	6,204	0	6,204	0	0.00%	0.00%	Untreated	10
SP-5	S-H-25A	3,951	3,951	1,400	1,400	5,351	5,351	0.93%	0.43%	Filter Basin #3	
	S-H-25B	3,168	3,168	9,515	9,515	12,683	12,683	0.75%	1.01%	Filter Basin #3	
	S-H-26A	3,242	3,242	1,140	1,140	4,382	4,382	0.77%	0.35%	Filter Basin #3	
	S-H-26B	2,016	2,016	3,688	3,688	5,704	5,704	0.48%	0.45%	Filter Basin #3	
	S-H-27A	3,591	3,591	1,298	1,298	4,889	4,889	0.85%	0.39%	Filter Basin #3	
	S-H-27B	2,159	2,159	5,165	5,165	7,324	7,324	0.51%	0.58%	Filter Basin #3	
	S-H-28A	3,408	3,408	1,196	1,196	4,604	4,604	0.81%	0.37%	Filter Basin #3	
	S-H-28B	2,060	2,060	5,641	5,641	7,701	7,701	0.49%	0.61%	Filter Basin #3	
	S-H-29A	3,473	3,473	1,218	1,218	4,691	4,691	0.82%	0.37%	Filter Basin #3	
	S-H-29B	2,144	2,144	5,914	5,914	8,058	8,058	0.51%	0.64%	Filter Basin #3	
	S-H-30A	3,448	3,448	7,800	7,800	11,248	11,248	0.82%	0.90%	Filter Basin #3	
	S-H-30B	6,249	6,249	2,185	2,185	8,434	8,434	1.48%	0.67%	Filter Basin #3	
	S-H-32	5,000	5,000	34,895	34,895	39,895	39,895	1.18%	3.18%	Filter Basin #3	11
SP-5	S-H-31A	2,596	3,476	9,448	18,896	12,044	22,372	0.82%	1.78%	Filter Basin #4	12
	S-H-31B	4,745	4,745	1,675	1,675	6,420	6,420	1.12%	0.51%	Filter Basin #4	
	S-H-33	0	0	12,040	12,040	12,040	12,040	0.00%	0.96%	Filter Basin #4	

**HIGHLANDS SUBDIVISION, STANDISH - WQ TREATMENT**

**Revised Building Layout 2/2019** Based on Preliminary Subdivision Plan Approved 3/4/2019

New Impervious Area (SF) =	422694
Total New Landscaped Area (SF)=	832048
Total Developed Area (SF) =	1254742

95% = 401559 SF

Study Point	Watershed	New Impervious Area (SF)	Total Impervious Area Treated (SF)	New Landscaped Area	Total Landscaped Area Treated (SF)	Developed Area (SF)	Total Developed Area Treated (SF)	Incremental Treatment % (Impervious)	Incremental Treatment % (Developed)	BMP	See Note Below
SP-5	S5-1	0	0	10,000	0	10,000	0	0.00%	0.00%	Untreated	
	S5-2	888	0	2,000	0	2,888	0	0.00%	0.00%	Untreated	
SP-6	S6-1	20,000	20,000	66,500	60,000	86,500	80,000	4.73%	6.38%	Wooded Buffer C soils	13
	Subtotal	422,694	404,469	832,048	691,703	1,254,742	1,096,172	95.69%	87.36%		

**NOTES:**

1. Roof drain filter strips (RDFS) - assume treating 1500 SF of roof per lot
2. Single-family lots assumed to have 5000 SF roof and 15000 SF driveways/pavement - Deed Restricted
3. Subtract ex farmhouse & barn from new impervious
4. Subtract existing gravel road for credit - till gravel & re-seed
5. Imp SF/lawn SF = 2500/3000 Lot 1
6. Imp SF/lawn SF = 5000/15000 Lots 2 & 3
7. Imp SF/lawn SF = 5000/15000 Lot 4, 2500/5749 Lot 5
8. Imp SF/lawn SF = 2500/3047 Lot 5
9. Treat lots 6-11
10. 6204 SF imp Lot 5
11. Treat lot 18
12. Treats off-site roof & lawn
13. Lots 14/15/16/17



## **Attachment B – Phosphorus Export Calculations**

<b>Worksheet 1 - PPB calculations</b>			
<b>Project Name: Highlands Subdivision</b>			
<b>Lake Watershed: Sebago Lake</b>			
<b>Town: Standish</b>			
<b>Standard Calculations</b>			
Watershed per acre phosphorus budget (Appendix C)	<b>PAPB</b>	0.061	lbs P/acre/year
Total acreage of development parcel:	<b>TA</b>	29.53	acres
NWI wetland acreage (> 1 ac on NWI maps):	<b>WA</b>	0	acres
Steep slope acreage:	<b>SA</b>	1	acres
Project acreage: $A = TA - (WA + SA)$	<b>A</b>	28.53	acres
<b>Project Phosphorus Budget: <math>PPB = P \times A</math></b>	<b>PPB</b>	1.74033	lbs P/year
<b>Small Watershed Adjustment</b>			
If Project Acreage (A) is greater than the threshold acreage for the small watershed threshold (SWT, from pertinent lake and town info in the table in Appendix C), calculate an alternative PPB using the analysis below and use this value if it is less than the the Standard Calculation PPB.			
Small Watershed Threshold (Appendix C):	<b>SWT</b>	660	acres
Project acreage:	<b>A</b>	29.53	acres
Allowable increase in town's share of annual phosphorus load to lake (Appendix C):	<b>FC</b>	160.29	lbs P/year
Area available for development (Appendix C):	<b>AAD</b>	7543	acres
Ratio of A to AAD ( $R=A/AAD$ )	<b>R</b>	N/A	
<b>Project Phosphorus Budget</b>			
<b>If <math>R &lt; 0.5</math>, <math>PPB = [(FC \times R)/2] + [FC/4]</math></b>	<b>PPB</b>	N/A	lbs P/year
<b>If <math>R &gt; 0.5</math>, <math>PPB = FC \times R</math></b>	<b>PPB</b>	N/A	lbs P/year

Worksheet 2

Pre-PPE and Post-PPE Calculations - HIGHLANDS SUBDIVISION - Roadway and Single-family Lots

Calculate phosphorus export from development for before and after treatment  
Use as many sheets as needed for each development type (commercial, roads, residential lots, etc.)

Project name: HIGHLANDS SUBDIVISION, STANDISH Development type: single-family lots Sheet #1

Land Surface Type or Lot #(s) with description	Acres or # of lots	Export Coefficient from Table 3.1 or Table 3.2	Pre-treatment Algal Av. P Export (lbs P/year)	Treatment Factor for BMP(s) from Chapter 6	Post-treatment Algal Av. P Export (lbs P/year)	Description of BMPs	L	W	Area
<b>Town Residential Street:</b> 22' pavement, 6' sidewalk, 1.5' shoulder at non-curb locations									
Sta 30+00 to sta 43+75 L & R - Road & sidewalk	0.931	1.25	1.1640	0.36	0.4190	Filter Basin #3	1375	29.5	40562.5
Same location - Landscaped area in ROW	0.647	0.3	0.1941	0.36	0.0699	Filter Basin #3	1375	20.5	28187.5
Sta 43+75 to sta 44+50 R - Road & sidewalk	0.029	1.25	0.0366	0.36	0.0132	Filter Basin #3	75	17	1275
Same location - Landscaped area in ROW	0.014	0.3	0.0041	0.36	0.0015	Filter Basin #3	75	8	600
Sta 43+75 to sta 44+50 L - Road & 1.5' shoulder	0.022	1.25	0.0269	1	0.0269	No Treatment	75	12.5	937.5
Same location - Landscaped area in ROW	0.022	0.3	0.0065	1	0.0065	No Treatment	75	12.5	937.5
Sta 44+50 to sta 46+75 - Road & sidewalk	0.152	1.25	0.1905	0.36	0.0686	Filter Basin #4	225	29.5	6637.5
Same location - Landscaped area in ROW	0.106	0.3	0.0318	0.36	0.0114	Filter Basin #4	225	20.5	4612.5
Sta 46+75 to sta 47+19 - Road & Sidewalk	0.030	1.25	0.0372	1	0.0372	No Treatment	44	29.5	1298
Same location - Landscaped area in ROW	0.021	0.3	0.0062	1	0.0062	No Treatment	44	20.5	902
<b>Single Family Lots</b>							<b># EA</b>	<b>Area EA</b>	<b>Area</b>
Lots #6 - 11, 14 - Roofs	0.321	0.5	0.1607	0.4	0.0643	Forested buffer, C soils	7	2000	14000
Lots #6 - 11, 14 - Driveways	0.321	1.25	0.4017	0.4	0.1607	Forested buffer, C soils	7	2000	14000
Lots #6 - 11, 14 - Landscaped areas	1.928	0.3	0.5785	0.4	0.2314	Forested buffer, C soils	7	12000	84000
Lot #15 - Roof	0.046	0.5	0.0230	0.48	0.0110	75' Forested buffer, C soils	1	2000	2000
Lots #15 - Driveways	0.046	1.25	0.0574	0.48	0.0275	75' Forested buffer, C soils	1	2000	2000
Lots #15 - Landscaped areas	0.275	0.3	0.0826	0.48	0.0397	75' Forested buffer, C soils	1	12000	12000
Lots 12 & 13 - Homes with Roof Drain Filter Strips	0.069	0.5	0.0344	0.4	0.0138	Roof Drain Filter Strips	2	1500	3000
Lot #12 & 13 - Driveway	0.092	1.25	0.1148	1	0.1148	No Treatment	2	2000	4000
Lot #12 & 13 - Landscaped areas	0.551	0.3	0.1653	1	0.1653	No Treatment	2	12000	24000
Lot 16 - Roof	0.046	0.5	0.0230	0.72	0.0165	50' Forested buffer, C soils	1	2000	2000
Lot #16 - Driveway	0.046	1.25	0.0574	0.72	0.0413	50' Forested buffer, C soils	1	2000	2000
Lot #16 - Landscaped areas	0.275	0.3	0.0826	0.72	0.0595	50' Forested buffer, C soils	1	12000	12000
Lot #17 - Roof	0.046	0.5	0.0230	0.3	0.0069	150' Forested buffer, C soils	1	2000	2000
Lot #17 - Driveways	0.046	1.25	0.0574	0.3	0.0172	150' Forested buffer, C soils	1	2000	2000
Lot #17 - Landscaped areas	0.275	0.3	0.0826	0.3	0.0248	150' Forested buffer, C soils	1	12000	12000
Lot #18 - Roofs	0.046	0.5	0.0230	0.36	0.0083	Filter Basin #3	1	2000	2000
Lot #18 - Driveways	0.046	1.25	0.0574	0.36	0.0207	Filter Basin #3	1	2000	2000
Lot #18 - Landscaped areas	0.275	0.3	0.0826	0.36	0.0298	Filter Basin #3	1	12000	12000
		<b>Total Pre-PPE (lbs P/year)</b>	3.8053	<b>Total PostPPE (lbs P/year)</b>	1.7138				

**NOTES:**  
NEW ROAD UP TO STA 30+00 DRAINS TO SACO RIVER WATERSHED  
LOTS #1-5 DRAIN TO SACO RIVER WATERSHED  
EXPORT COEFFICIENTS FROM TABLE 3.1, PHOSPHORUS MANUAL  
SINGLE-FAMILY LOTS SHALL BE DEED RESTRICTED TO 4,000 SF IMPERVIOUS AREA & 12,000 SF LANDSCAPED AREA  
FILTER BASINS #3 AND #4 OVERSIZED  
TREATMENT FACTORS FOR NON-STANDARD SIZED BMPs CALCULATED PER MDEP BMP MANUAL, VOLUME II, SECTION 4.3

## WORKSHEET 4 - PROJECT PHOSPHORUS EXPORT SUMMARY

Summarizing the project's algal available phosphorus export (PPE)

**Project Name: Highlands Subdivision**

<b>Project Phosphorus Budget - Worksheet 1</b>	<b>PPB</b>	1.74	lbs P/year
<b>Total Pre-Treatment Phosphorus Export - Worksheet 2</b>	<b>Pre-PPE</b>	3.81	lbs P/year
<b>Total Post-Treatment Phosphorus Export - Worksheet 2</b>	<b>Post-PPE</b>	1.71	lbs P/year
<b>Total Phosphorus Mitigation Credit - Worksheet 3</b>	<b>TMC</b>		lbs P/year
<b>Project Phosphorus Export (Post-PPE - TMC)</b>	<b>PPE</b>	1.71	lbs P/year

**Is the Project Phosphorus Export  $\leq$  the Project Phosphorus Budget? (PPE $\leq$ PPB)**

*If YES, PPE is less than or equal to PPB and the project meets its phosphorus budget.*

*If NO, PPE is greater than PPB, more reduction in phosphorus export is required or the payment of a compensation fee may be an option*

YES

*The amount of phosphorus that needs further treatment or compensation*

0.00 lbs P/year

**Has Project Phosphorus Export been sufficiently reduced? Is**  
*(Pre-PPE - Post-PPE)/Pre-PPE greater than 0.60?*

*If YES, in some watersheds the compensation fee is an available option. If NO, more treatment must be provided. PPE must be further reduced.*

*The post-treatment phosphorus export must be less than 40% of the pre-treatment export (Post-PPE < 0.4\*Pre-PPE)*

%

**If the project is located in a watershed that is eligible for a compensation fee (or is a residential subdivision with buffers), a compensation fee may be appropriate as follows:**

*If Project Export has been reduced by greater than 60% and less than 75%, \$25,000 per pound minus \$833 per 1% Percent Export*

*If Project Export has been reduced by greater than 75%, \$12,500 per pound minus \$500 per 1% Project Export*

## **Attachment C – BMP Sizing Calculations**

TERRADYN CONSULTANTS, LLC  
 41 Campus Dr. Suite 101  
 New Gloucester, ME 04260  
 (207)926-5111 Fax (207)221-1317

Job: \_\_\_\_\_  
 Sheet Number: 1  
 Calculated By: LRB  
 Date: 11/5/2019

STAGE STORAGE CALCULATIONS

**FILTER BASIN #1 - STAGE STORAGE**

WATERSHED IMPERVIOUS AREA= 56280 SF  
 WATERSHED LANDSCAPED AREA= 65166 SF  
 REQUIRED WQV= 6862 CF  
 PROVIDED WQV= 7091 CF  
 REQUIRED FILTER AREA= 4117 SF  
 PROVIDED FILTER AREA= 4139 SF

FROM HYDROCAD OUTPUT  
 IMPERVIOUS AREAS

Paved 0.949 AC 41338 SF  
 Roofs 0.343 AC 14941 SF  
 Total 1.292 AC 56280 SF

Forebay	STAGE (FT)	AREA (SF)	STORAGE (CF)
	390.4	115	0
	391	196	93
	391.9	324	327

FILTER AREA (SF)

Cell #1 west	STAGE (FT)	AREA (SF)	STORAGE (CF)
	390.4	2519	0
	391	2932	1635
WQV	391.55	3506	3406
	391.9	3872	4697

2064

Cell #2 east	STAGE (FT)	AREA (SF)	STORAGE (CF)
	390.4	2702	0
	391	3124	1748
WQV	391.55	3581	3592
	391.9	3872	4896

2075

LANDSCAPED AREAS

Grass C 1.496 AC 65166 SF  
 Total 1.496 AC 65166 SF

Total Pond	STAGE (FT)	AREA (SF)	STORAGE (CF)
	390.4	5221	0
	391	6056	3476
WQV	391.55	7088	7091
	391.9	7744	9920
	392	7744	10695
	393	9241	19187
	394	10477	28276

4139

**FOREBAY SIZING:**

10 storms x Sanded Area x 500 lbs. : 90 lbs. = annual  
 cubic feet per year (acres) per acre-storm ft3  
 of collected sediment

Volume = 53 Cubic Ft

TERRADYN CONSULTANTS, LLC  
 41 Campus Dr. Suite 101  
 New Gloucester, ME 04260  
 (207)926-5111 Fax (207)221-1317

Job: \_\_\_\_\_  
 Sheet Number: 1  
 Calculated By: LRB  
 Date: 11/5/2019

STAGE STORAGE CALCULATIONS

**FILTER BASIN #2 - STAGE STORAGE**

WATERSHED IMPERVIOUS AREA= 97269 SF  
 WATERSHED LANDSCAPED AREA= 86031 SF  
 REQUIRED WQV= 10973 CF  
 PROVIDED WQV= 11278 CF  
 MINIMUM REQ'D FILTER SURFACE AREA= 6584 SF  
 PROVIDED FILTER SURFACE AREA= 6613 SF

FROM HYDROCAD OUTPUT

Paved 1.183 AC 51531 SF  
 Paved 0.228 AC 9932 SF w/curbs & sewers  
 Roofs 0.348 AC 15159 SF  
 1 ac lots C 0.467 AC 20334 SF 2.334 AC  
 1 ac lots D 0.007 AC 314 SF 0.036 AC  
 Total 2.233 AC 97269 SF

2 BEDS

Forebay

STAGE (FT)	AREA (SF)	STORAGE (CF)
434.5	100	0
435	121	55
436	196	214

FILTER AREA (SF)

Cell #1  
north

STAGE (FT)	AREA (SF)	STORAGE (CF)
434.5	3307	0
435	3718	1756
435.95	4354	5591
436	4388	5809

3307

WQV

LANDSCAPED AREAS

Grass C 1.969 AC 85770 SF  
 Grass D 0.006 AC 261 SF

Cell #2  
south

STAGE (FT)	AREA (SF)	STORAGE (CF)
434.5	3306	0
435	3773	1770
435.95	4357	5632
436	4388	5850

3306

Total 1.975 AC 86031 SF

Total Pond

STAGE (FT)	AREA (SF)	STORAGE (CF)
434.5	6613	0
435	7491	3581
435.95	8712	11278
436	8776	11873
436.01	9395	11964
437	11340	22228
438	12659	34227

6613

WQV

**FOREBAY SIZING:**

10 storms x Sanded Area x 500 lbs. : 90 lbs. = annual  
 cubic feet per year (acres) per acre-storm ft3  
 of collected sediment

Volume = 79 Cubic Ft

TERRADYN CONSULTANTS, LLC  
 41 Campus Dr. Suite 101  
 New Gloucester, ME 04260  
 (207)926-5111 Fax (207)221-1317

Job: \_\_\_\_\_  
 Sheet Number: 1  
 Calculated By: LRB  
 Date: 11/5/2019

STAGE STORAGE CALCULATIONS

**FILTER BASIN #3 - STAGE STORAGE**

WATERSHED IMPERVIOUS AREA= 42898 SF  
 WATERSHED LANDSCAPED AREA= 79105 SF  
 REQUIRED WQV= 6212 CF  
 PROVIDED WQV= 6267 CF  
 REQUIRED FILTER AREA= 3727 SF  
 PROVIDED FILTER AREA= 4133 SF

FROM HYDROCAD OUTPUT  
 IMPERVIOUS AREAS

Paved	0.256 AC	11151 SF
Paved	0.637 AC	27748 SF
Roofs	0.000 AC	0 SF
1 ac lots C	0.092 AC	3999 SF
<b>Total</b>	<b>0.985 AC</b>	<b>42898 SF</b>

Forebay	STAGE (FT)	AREA (SF)	STORAGE (CF)
	379.5	60	0
	380	230	73
	380.5	400	230

FILTER  
 AREA (SF)

Cell #1 west	STAGE (FT)	AREA (SF)	STORAGE (CF)
	379.2	2066	0
	380	4362	2571
WQV	380.1	4532	3016
	380.5	5210	4964

2066

LANDSCAPED AREAS

Grass C	1.816 AC	79105 SF
<b>Total</b>	<b>1.816 AC</b>	<b>79105 SF</b>

Cell #2 east	STAGE (FT)	AREA (SF)	STORAGE (CF)
	379.2	2472	0
	380	4362	2734
WQV	380.1	4532	3178
	380.5	5210	5127

2067

Total Pond	STAGE (FT)	AREA (SF)	STORAGE (CF)
	379.2	4538	0
	380	8724	5377
WQV	380.1	9063	6267
	380.5	10420	10321
	382	12670	27638
	383	14630	41288
	384	16806	57006
	384.25	17367	60821

4133

**FOREBAY SIZING:**

10 storms x Sanded Area x 500 lbs. : 90 lbs. = annual  
 cubic feet per year (acres) per acre-storm ft3  
 of collected sediment

Volume = 50 Cubic Ft



TERRADYN CONSULTANTS, LLC  
 41 Campus Drive, Suite 101  
 New Gloucester, ME 04260  
 (207)926-5111 Fax (207)221-1317

Job: \_\_\_\_\_  
 Sheet Number: 1  
 Calculated By: LB  
 Date: 3/6/2019

STAGE STORAGE CALCULATIONS

FILTER BASIN #4

WATERSHED IMPERVIOUS AREA= 8233 SF  
 WATERSHED LANDSCAPED AREA= 32626 SF  
 REQUIRED WQV= 1774 CF  
 PROVIDED WQV= 1959 CF  
 MINIMUM REQ'D FILTER SURFACE AREA= 1064 SF  
 PROVIDED FILTER SURFACE AREA= 1245 SF

FROM HYDROCAD OUTPUT  
 IMPERVIOUS AREAS

Paved	0.169 AC	7362 SF	
Roofs	0.020 AC	871 SF	
1 ac lots C	0.000 AC	0 SF	AC 20 % imperv.
1 ac lots D	0.000 AC	0 SF	AC 20 % imperv.
Total	0.189 AC	8233 SF	

STAGE (FT)	AREA (SF)	STORAGE (CF)
377	1245	0
378	1891	1568
378.2	2020	1959
379	2537	3782
380	3183	6642

WQV EL=

LANDSCAPED AREAS

Grass C	0.749 AC	32626 SF
Grass D	0.000 AC	0 SF
Total	0.749 AC	32626 SF

**FILTER BASIN SIZING FOR MAXIMUM PHOSPHORUS TREATMENT:**

TF = 0.4 BMPTF (standard sizing) / BMP (actual sizing) = **0.36 Treatment Factor**

**FOREBAY SIZING:**

10 storms x Sanded Area x 500 lbs. : 90 lbs. = annual  
 cubic feet per year (acres) per acre-storm ft<sup>3</sup>  
 of collected sediment

Volume = 10 Cubic Ft PROVIDED IN TWO 4' DIA CATCH BASINS

TERRADYN CONSULTANTS, LLC  
 41 Campus Dr. Suite 101  
 New Gloucester, ME 04260  
 (207)926-5111 Fax (207)221-1317

Job: \_\_\_\_\_  
 Sheet Number: 1  
 Calculated By: LRB  
 Date: 2/21/2019

STAGE STORAGE CALCULATIONS

GRAVEL WETLAND - STAGE STORAGE

WATERSHED IMPERVIOUS AREA= 130201 SF  
 WATERSHED LANDSCAPED AREA= 189922 SF  
 REQUIRED WQV= 17181 CF  
 PROVIDED WQV= 17664 CF  
 REQUIRED FILTER AREA= 10308 SF  
 PROVIDED FILTER AREA= 11724 SF

FROM HYDROCAD OUTPUT  
 IMPERVIOUS AREAS

Paved 1.667 AC 72615 SF  
 Paved sub S-H-13 0.054 AC 2352 SF  
 Roofs 1.268 AC 55234 SF  
 Total 2.989 AC 130201 SF

Forebay	STAGE (FT)	AREA (SF)	STORAGE (CF)	Req WQV
	390	1007	0	
	391	1469	1238	
WQV	391.25	1585	1620	10% 1718
	391.5	1700	2030	

Cell #1	STAGE (FT)	AREA (SF)	STORAGE (CF)	Req WQV
	390	5863	0	
	391	6828	6345	
WQV	391.25	7069	8082	45% 7731
	391.5	7310	9880	

LANDSCAPED AREAS

Grass C 4.343 AC 189181 SF  
 Grass D 0.017 AC 741 SF  
 Total 4.360 AC 189922 SF

Cell #2	STAGE (FT)	AREA (SF)	STORAGE (CF)	Req WQV
	390	5863	0	
	391	6674	6268	
WQV	391.25	6876	7962	45% 7731
	391.5	7079	9707	

Total Pond	STAGE (FT)	AREA (SF)	STORAGE (CF)	Req WQV
	390	12733	0	
	391	14970	13852	
WQV	391.25	15530	17664	17181
	391.5	16089	21617	
	392	17209	29941	
	393	19450	48270	
	394	21690	68842	

Highlands Subdivision, Standish

STORMWATER BUFFER / STONE BERM LEVEL SPREADER CALCULATIONS

Reference: Maine Stormwater BMP Manual, Table 5.5

	Location	Subcatchments	Drainage Area, Ac	Imperv. Ac	Lawn, Ac	Buffer flow path, ft	Buffer slope, ft/ft	Stone berm length, ft	Soils
Level Spreader #5	Sta. 2+50 Left	S-E-5, S-H-3, S-H-4	1.156	0.292	0.864	150	0.06	43.5	HSG C - Dixfield, stony sandy loam

HIGHLANDS SUBDIVISION  
LEVEL SPREADER SIZING CALCULATIONS

Level spreaders are sized per Maine DEP Redistribution of Stormwater discharges standard:  
Discharge to a level spreader. The peak stormwater flow rate to a level spreader due to runoff from a 10-year, 24-hour storm must be less than 0.25 cubic feet per second (0.25 cfs) per foot length of level spreader lip.

Location		Q-10, cfs		Length, ft
Level Spreader #1	FB#1 outlet	1.46		5.8
Level Spreader #2	Gravel wetland outlet	5.41		21.6
Level Spreader #3	FB#3 & sub S2-1C	6.95		27.8
Level Spreader #4	S2-1A	5.93		23.7

## **Attachment D – Stormwater BMP Soil Test Pit Logs**



MARK HAMPTON ASSOCIATES, INC.

SOIL EVALUATION • WETLAND DELINEATIONS • SOIL SURVEYS • WETLAND PERMITTING

4474

March 12, 2019

Mr. Larry Bastian  
Terradyne Consultants LLC  
41 Campus Drive Suite 101  
New Gloucester, ME 04260

Re: Soil Evaluation, Proposed Stormwater Devices, Highlands Subdivision Standish, ME

Dear Larry,

I completed a soil evaluation for the proposed stormwater treatment program for the Highlands Subdivision Standish, ME. The soil evaluation was conducted in accordance with the Maine Subsurface Wastewater Disposal Rules dated August 2015, as amended. I evaluated five backhoe excavated soil test pits in the center of the proposed stormwater treatment devices. The soils found on the parcel are moderately well drained glacial till soils over ledge. There is a seasonal high watertable at approximately 20 to 28 inches. There was observed groundwater table in two of the soil test pits. The soil test pit log descriptions are attached.

If you have any questions or require additional information, please contact me.

Sincerely,

Mark J. Hampton L.S.E., C.S.S.  
Licensed Site Evaluator #263  
Certified Soil Scientist #216







# HOUSEKEEPING PERFORMANCE STANDARDS

## FOR: HIGHLANDS SUBDIVISION STANDISH, MAINE

**Project Developer:** Leavitt-Tompson, LLC  
PO Box 703  
Standish, ME 04084

**Responsible Party:** Highlands Subdivision Homeowners Association  
PO Box 703  
Standish, ME 04084

### **Introduction:**

The contractor shall be responsible for maintaining proper housekeeping standards throughout the construction phase of the project. After the construction phase has been completed, the owner or operator of the project will be responsible.

### **Standards:**

In accordance with the housekeeping performance standards required by MDEP chapter 500 stormwater regulations, the following standards shall be met:

- 1. Spill prevention.** Controls must be used to prevent pollutants from being discharged from materials on site, including storage practices to minimize exposure of the materials to stormwater, and appropriate spill prevention, containment, and response planning and implementation.
- 2. Groundwater protection.** During construction, liquid petroleum products and other hazardous materials with the potential to contaminate groundwater may not be stored or handled in areas of the site draining to an infiltration area. An "infiltration area" is any area of the site that by design or as a result of soils, topography and other relevant factors accumulates runoff that infiltrates into the soil. Dikes, berms, sumps, and other forms of secondary containment that prevent discharge to groundwater may be used to isolate portions of the site for the purposes of storage and handling of these materials.
- 3. Fugitive sediment and dust.** Actions must be taken to ensure that activities do not result in noticeable erosion of soils or fugitive dust emissions during or after construction. Oil may not be used for dust control.

Operations during wet periods that experience tracking of mud off the site onto public roads should provide for sweeping of road areas at least once a week and prior to significant storm events. Where chronic mud tracking occurs, a stabilized construction entrance should be provided. Operations during dry months, that experience fugitive dust problems, should wet down the access roads once a week or more frequently as needed.

- 4. Debris and other materials.** Litter, construction debris, and chemicals exposed to stormwater must be prevented from becoming a pollutant source.

To prevent these materials from becoming a source of pollutants, construction and post-construction activities related to a project may be required to comply with applicable

provision of rules related to solid, universal, and hazardous waste, including, but not limited to, the Maine solid waste and hazardous waste management rules; Maine hazardous waste management rules; Maine oil conveyance and storage rules; and Maine pesticide requirements.

- 5. Trench or foundation de-watering.** Trench de-watering is the removal of water from trenches, foundations, coffer dams, ponds, and other areas within the construction area that retain water after excavation. In most cases the collected water is heavily silted and hinders correct and safe construction practices. The collected water must be removed from the ponded area, either through gravity or pumping, and must be spread through natural wooded buffers or removed to areas that are specifically designed to collect the maximum amount of sediment possible, like a cofferdam sedimentation basin. Avoid allowing the water to flow over disturbed areas of the site. Equivalent measures may be taken if approved by the department.
- 6. Non-stormwater discharges.** Identify and prevent contamination by non-stormwater discharges.

**MAINTENANCE PLAN OF STORMWATER MANAGEMENT FACILITIES  
FOR:  
HIGHLANDS SUBDIVISION  
STANDISH, MAINE**

**Project Developer:** Leavitt-Tompson, LLC  
PO Box 703  
Standish, ME 04084

**Responsible Party:** Highlands Subdivision Homeowners Association  
PO Box 703  
Standish, ME 04084

**Prepared By:** Terradyn Consultants, LLC  
41 Campus Drive, Suite 101  
New Gloucester, ME 04260

**LIST OF STORMWATER MEASURES:**

Conveyance & Distribution System (Stormwater Channels & Culverts)  
Level Spreaders  
Roadways & Parking Surfaces  
Catch Basin Systems  
Stormwater Impoundment  
Gravel Wetland  
Underdrained Filter Basin  
Forested Buffers

**INTRODUCTION:**

The owner or operator of the proposed project will be responsible for the maintenance of all stormwater management structures except the rain gardens located on individual lots, the establishment of any contract services required to implement the program, and the keeping of records and maintenance log book. Records of all inspections and maintenance work accomplished must be kept on file and retained for a minimum 5 year time span. The maintenance log book will be made available to the DEP upon request. At a minimum, the appropriate and relevant activities for each of the stormwater management systems will be performed on the prescribed schedule.

**INSPECTION & MAINTENANCE TASKS:**

Inspections should be performed by qualified erosion control professional. NOTE: The following instruction are excerpts from the Maine Department of Environmental Protection's *Stormwater Management for Maine, Volume III BMPs Technical Design Manual*, dated January 2006.

**CONVEYANCE & DISTRIBUTION SYSTEMS: (STORMWATER CHANNELS & CULVERTS, ETC.)**

**1. Inspection schedule:**

- 1.1.** Inspect ditches, swales and other open stormwater channels in the spring, in late fall, and after heavy rains to remove any obstructions to flow, remove accumulated sediments and debris, to control vegetated growth that could obstruct flow, and to repair any erosion of the ditch lining.

Vegetated ditches must be mowed at least annually or otherwise maintained to control the growth of woody vegetation and maintain flow capacity. Any woody vegetation growing through riprap linings must also be removed. Repair any slumping side slopes as soon as practicable. If the ditch has a riprap lining, replace riprap on areas where any underlying filter fabric or underdrain gravel is showing through the stone or where stones have dislodged. The channel must receive adequate routine maintenance to maintain capacity and prevent or correct any erosion of the channel's bottom or side-slopes.

- 1.2.** Inspect culverts in the spring, in late fall, and after heavy rains to remove any obstructions to flow; remove accumulated sediments and debris at the inlet, at the outlet, and within the conduit; and to repair any erosion damage at the culvert's inlet and outlet.
- 1.3.** Inspect vegetated areas, particularly slopes and embankments, early in the growing season or after heavy rains to identify active or potential erosion problems. Replant bare areas or areas with sparse growth. Where rill erosion is evident, armor the area with an appropriate lining or divert the erosive flows to on-site areas able to withstand the concentrated flows.
- 2. Mowing:** Grass should not be trimmed extremely short, as this will reduce the filtering effect of the swale (MPCA, 1989). The cut vegetation should be removed to prevent the decaying organic litter from adding pollutants to the discharge from the swale. The mowed height of the grass should be 2-4 inches taller than the maximum flow depth of the design water quality storm. A minimum mow height of 6 inches is generally recommended (Galli, 1993).
- 3. Erosion:** It is important to install erosion and sediment control measures to stabilize this area as soon as possible and to retain any organic matter in the bottom of the trench.
- 4. Fertilization:** Routine fertilization and/or use of pesticides is strongly discouraged. If complete re-seeding is necessary, half the original recommended rate of fertilizer should be applied with a full rate of seed.
- 5. Sediment Removal:** The level of sediment deposition in the channel should be monitored regularly, and removed from grassed channels before permanent damage is done to the grassed vegetation, or if infiltration times are longer than 12 hours. Sediment should be removed from riprap channels when it reduces the capacity of the channel.

#### **LEVEL SPREADERS:**

- 1. Inspections:** At least once a year and following major storms, the level spreader pool should be inspected for sand accumulation and debris that may reduce its capacity.
- 2. Sediment Removal:** Sediment build-up within the swale should be removed when it has accumulated to approximately 25% of design volume or channel capacity. Dispose of the sediments appropriately.
- 3. Debris:** Remove debris such as leaf litter, branches and tree growth from the spreader.
- 4. Mowing:** Vegetated spreaders may require mowing.
- 5. Snow Storage:** Do not store snow within the area of the level spreader.

- 6. Level Spreader Replacement:** The reconstruction of the level spreader may be necessary when sheet flow from the spreader channelize into the buffer.

#### **ROADWAYS & PARKING SURFACES:**

1. Paved surfaces shall be swept or vacuumed at least twice annually in the Spring to remove all Winter sand, and periodically during the year on an as-needed basis to minimize transportation of sediment during rainfall events.

#### **CATCH BASIN SYSTEMS:**

1. Catch basins are designed with a deep sump to trap larger sediment. Catch basins shall be inspected for sediment depth in the spring and fall, and accumulated sediment shall be removed and disposed of lawfully when it reaches 50% of the design capacity of the sump.

#### **STORMWATER IMPOUNDMENT:**

1. **Inspection schedule:** Inspect impoundment in the spring, in late fall, and after heavy rains to remove any obstructions to flow, remove accumulated sediments and debris, to control vegetated growth that could obstruct flow, and to repair any erosion to the bottom or sides of the impoundment. Vegetated ditches must be mowed at least annually or otherwise maintained to control the growth of woody vegetation and maintain flow capacity. Any woody vegetation growing through riprap linings must also be removed. Repair any slumping side slopes as soon as practicable. If the ditch has a riprap lining, replace riprap on areas where any underlying filter fabric or underdrain gravel is showing through the stone or where stones have dislodged. The channel must receive adequate routine maintenance to maintain capacity and prevent or correct any erosion of the channel's bottom or side-slopes.

During the first year, the impoundment will be inspected semi-annually and following major storm events. Debris and sediment buildup shall be removed from the forebay and basin as needed. Mowing of a grassed basin can occur semiannually to a height no less than 6 inches. Any bare area or erosion rills shall be repaired with new sandy loam then seeded and mulched.

Inspect culverts in the spring, in late fall, and after heavy rains to remove any obstructions to flow; remove accumulated sediments and debris at the inlet, at the outlet, and within the conduit; and to repair any erosion damage at the culvert's inlet and outlet.

Inspect vegetated areas, particularly slopes and embankments, early in the growing season or after heavy rains to identify active or potential erosion problems. Replant bare areas or areas with sparse growth. Where rill erosion is evident, armor the area with an appropriate lining or divert the erosive flows to on-site areas able to withstand the concentrated flows.

2. **Mowing:** Grass should not be trimmed extremely short. The cut vegetation should be removed to prevent the decaying organic litter from adding pollutants to the discharge from the swale. A minimum mow height of 6 inches is generally recommended.
3. **Fertilization:** Routine fertilization and/or use of pesticides is strongly discouraged. If complete re-seeding is necessary, half the original recommended rate of fertilizer should be applied with a full rate of seed.

4. **Sediment Removal:** The level of sediment deposition in the forebay and pond bottom should be monitored regularly, and removed before permanent damage is done to the grassed vegetation.

**GRAVEL WETLANDS (FROM UNH SUBSURFACE GRAVEL WETLAND DESIGN SPECIFICATIONS MANUAL):**

**1ST YEAR POST-CONSTRUCTION:** Inspection frequency should be after every major storm in the first year following construction.

1. Inspect to be certain system drains within 24-48 hours.
2. Watering plants as necessary during the first growing season
3. Re-vegetating poorly established areas as necessary
4. Quarterly inspection of soil and repairing eroded areas, especially on slopes & make timely repairs.
5. Checking inlets, outlets, and overflow spillway for blockage, structural integrity, and evidence of erosion. Risers may need to be cleaned.

**POST-CONSTRUCTION:** Inspection frequency should be at least every 6 months and after every major storm. Activities are expected to include:

1. Check the basin for a dense root mat establishment of wetland vegetation.
2. Check and clean the risers if there is evidence of standing water, discolored water or accumulated sediments in the cells.
3. Check and clean the forebay for sediments, trash and debris. When sediments have accumulated to a depth of 12 inches, standing water is persistent or wetland vegetation become established, the forebay will need to be excavated and reformed.
4. Verify that the cells drain within 24-48 hours. Sediment will need to be removed when an accumulation of 4 inches is evident over the wetland surface.
5. Check and clean all outlets and overflow spillway if blocked or there is evidence of structural damage or erosion.
6. Remove decaying vegetation, litter and debris.
7. Check for foreign species. Particular care must be used to avoid the unintended introduction of invasive species such as purple loosestrife (*Lythrum salicaria*) and common reed (*Phragmites australis*). It is recommended that a qualified wetland biologist be consulted when these are found in the area of the gravel wetland.

**CLEANING CRITERIA FOR SEDIMENTATION FOREBAY:** Sediment should be removed from the sedimentation chamber (forebay) when it accumulates to a depth of more than 12 inches (30 cm) or 10 percent of the pretreatment volume. The sedimentation forebay should be cleaned of vegetation if persistent standing water and wetland vegetation becomes dominant. The cleaning interval is approximately every 4 years. A dry sedimentation forebay is the optimal condition while in practice this condition is rarely achieved. The sedimentation chamber, forebay, and treatment cell outlet devices should be cleaned when drawdown times exceed 60 to 72 hours. Materials can be removed with heavy construction equipment; however, this equipment should not track on the wetland surface. Revegetation of disturbed areas as necessary. Removed sediments should be dewatered (if necessary) and disposed of in an acceptable manner.

**CLEANING CRITERIA FOR GRAVEL WETLAND TREATMENT CELLS:** Sediment should be removed from the gravel wetland surface when it accumulates to a depth of several inches (>10 cm) across the wetland

surface. Materials should be removed with rakes rather than heavy construction equipment to avoid compaction of the gravel wetland surface. Heavy equipment could be used if the system is designed with dimensions that allow equipment to be located outside the gravel wetland, while a backhoe shovel reaches inside the gravel wetland to remove sediment. Removed sediments should be dewatered (if necessary) and disposed of in an acceptable manner.

### **Grassed Underdrained Soil Filter**

During the first year, the basin will be inspected semi-annually and following major storm events. Debris and sediment buildup shall be removed from the forebay and basin as needed. Mowing of a grassed basin can occur semiannually to a height no less than 6 inches. Any bare area or erosion rills shall be repaired with new filter media or sandy loam then seeded and mulched. Maintaining good grass cover will minimize clogging with fine sediments and if ponding exceeds 48 hours, the top of the filter bed must be rototilled to reestablish the soil's filtration capacity.

**Maintenance Agreement:** A legal entity should be established with responsibility for inspecting and maintaining any underdrained filter. The legal agreement establishing the entity should list specific maintenance responsibilities (including timetables) and provide for the funding to cover long-term inspection and maintenance.

**Soil Filter Inspection:** The soil filter should be inspected after every major storm in the first year to be sure it is functioning properly. Thereafter, the filter should be inspected at least once every six months to ensure that it is draining within 48 hours following a one inch storm or greater. And that following a storms that fill the system to overflow, it drains in no less than 36 to 60 hours. If the system drains too fast, an orifice may need to be added on the underdrain outlet or, if already present, may need to be modified. Soil

**Filter Replacement:** The top several inches of the filter shall be replaced with fresh material when water ponds on the surface of the bed for more than 72 hours. The removed sediments should be disposed of in an acceptable manner.

**Sediment Removal:** Sediment and plant debris should be removed from the pretreatment structure at least annually.

**Mowing:** If mowing is desired, only hand held string trimmers or push-mowers are allowed on the filter (no tractor) and the grass bed should be mowed no more than 2 times per growing season to maintain grass heights of no less than 6 inches.

**Fertilization:** Fertilization of the underdrained filter area should be avoided unless absolutely necessary to establish vegetation.

**Harvesting and Weeding:** Harvesting and pruning of excessive growth will need to be done occasionally. Weeding to control unwanted or invasive plants may also be necessary. Add new mulch only as necessary for bioretention cell.

### **VEGETATED STORMWATER BUFFERS**

Buffers should be inspected annually for evidence of erosion or concentrated flows through or around the buffer. All eroded areas should be repaired, seeded and mulched.





**APPENDIX G. Suggested templates for deed restrictions and conservation easements  
for use under the Stormwater Management Law**

**1. Forested buffer, limited disturbance**

DECLARATION OF RESTRICTIONS (Forested Buffer, Limited Disturbance)

THIS DECLARATION OF RESTRICTIONS is made this \_\_\_\_\_ day of \_\_\_\_\_, 20\_\_\_\_,  
by Leavitt-Tompson, LLC , \_\_\_\_\_,  
(name) (street address)  
Standish , Cumberland County, Maine, 04084 , (herein referred to as the  
(city or town) (county) (zip code)  
"Declarant"), pursuant to a permit received from the Maine Department of Environmental Protection under  
the Stormwater Management Law, to preserve a buffer area on a parcel of land near  
191 Ossipee Trail (Route 25) and Oak Hill Road, Standish .  
(road name) (known feature and/or town)

WHEREAS, the Declarant holds title to certain real property situated in Standish , Maine  
(town)  
described in a deed from \_\_\_\_\_ to \_\_\_\_\_ dated  
(name) 31665 / 345 (name of Declarant)  
\_\_\_\_\_, 20\_\_\_\_, and recorded in Book 32638 Page 233 at the Cumberland County  
Registry of Deeds, herein referred to as the "property"; and

WHEREAS, Declarant desires to place certain restrictions, under the terms and conditions herein, over a  
portion of said real property (hereinafter referred to as the "Restricted Buffer") described as follows: (Note:  
Insert description of restricted buffer area location here)

WHEREAS, pursuant to the Stormwater Management Law, 38 M.R.S. Section 420-D and Chapter 500 of  
rules promulgated by the Maine Board of Environmental Protection ("Stormwater Management Rules"),  
Declarant has agreed to impose certain restrictions on the Restricted Buffer Area as more particularly set  
forth herein and has agreed that these restrictions may be enforced by the Maine Department of  
Environmental Protection or any successor (hereinafter the "MDEP"),

NOW, THEREFORE, the Declarant hereby declares that the Restricted Buffer Area is and shall forever be  
held, transferred, sold, conveyed, occupied and maintained subject to the conditions and restrictions set  
forth herein. The Restrictions shall run with the Restricted Buffer Area and shall be binding on all parties  
having any right, title or interest in and to the Restricted Buffer Area, or any portion thereof, and their heirs,  
personal representatives, successors, and assigns. Any present or future owner or occupant of the Restricted  
Buffer Area or any portion thereof, by the acceptance of a deed of conveyance of all or part of the Covenant  
Area or an instrument conveying any interest therein, whether or not the deed or instrument shall so express,  
shall be deemed to have accepted the Restricted Buffer Area subject to the Restrictions and shall agree to  
be bound by, to comply with and to be subject to each and every one of the Restrictions hereinafter set  
forth.

1. **Restrictions on Restricted Buffer Area.** Unless the owner of the Restricted Buffer Area, or any successors or assigns, obtains the prior written approval of the MDEP, the Restricted Buffer Area must remain undeveloped in perpetuity. To maintain the ability of the Restricted Buffer Area to filter and absorb stormwater, and to maintain compliance with the Stormwater Management Law and the permit issued thereunder to the Declarant, the use of the Restricted Buffer Area is hereinafter limited as follows.
  - a. No soil, loam, peat, sand, gravel, concrete, rock or other mineral substance, refuse, trash, vehicle bodies or parts, rubbish, debris, junk waste, pollutants or other fill material may be placed, stored or dumped on the Restricted Buffer Area, nor may the topography of the area be altered or manipulated in any way;
  - b. Any removal of trees or other vegetation within the Restricted Buffer Area must be limited to the following:
    - (i) No purposefully cleared openings may be created and an evenly distributed stand of trees and other vegetation must be maintained. An "evenly distributed stand of trees" is defined as maintaining a minimum rating score of 24 points in any 25 foot by 50 foot rectangle (1,250 square feet) area, as determined by the rating scheme in Table 11:

**Table 11.  
Point System for Determining an Evenly  
Distributed Stand of Trees**

Diameter of tree at 4½ feet above ground level	Points
2 - 4 inches	1
4 - 8 inches	2
8 - 12 inches	4
>12 inches	8

- Where existing trees and other vegetation result in a rating score less than 24 points, no trees may be cut or sprayed with biocides except for the normal maintenance of dead, windblown or damaged trees and for pruning of tree branches below a height of 12 feet provided two thirds of the tree's canopy is maintained;
- (ii) No undergrowth, ground cover vegetation, leaf litter, organic duff layer or mineral soil may be disturbed except that one winding path, that is no wider than six feet and that does not provide a downhill channel for runoff, is allowed through the area;
  - c. No building or other temporary or permanent structure may be constructed, placed or permitted to remain on the Restricted Buffer Area, except for a sign, utility pole (whether constructed of wood, steel or other materials) and appurtenant equipment such as guys and guy anchors, or fence;
  - d. No trucks, cars, dirt bikes, ATVs, bulldozers, backhoes, or other motorized vehicles or mechanical equipment may be permitted on the Restricted Buffer Area;
  - e. Any level lip spreader directing flow to the Restricted Buffer Area must be regularly inspected and adequately maintained to preserve the function of the level spreader.

Any activity on or use of the Restricted Buffer Area inconsistent with the purpose of these Restrictions is prohibited. Any future alterations or changes in use of the Restricted Buffer Area must receive prior approval in writing from the MDEP. The MDEP may approve such alterations and changes in use if such alterations and uses do not impede the stormwater control and treatment capability of the Restricted Buffer Area or if adequate and appropriate alternative means of stormwater control and treatment are provided.

2. **Enforcement.** The MDEP may enforce any of the Restrictions set forth in Section 1 above.
3. **Binding Effect.** The restrictions set forth herein shall be binding on any present or future owner of the Restricted Buffer Area. If the Restricted Buffer Area is at any time owned by more than one owner, each owner shall be bound by the foregoing restrictions to the extent that any of the Restricted Buffer Area is included within such owner's property.
4. **Amendment.** Any provision contained in this Declaration may be amended or revoked only by the recording of a written instrument or instruments specifying the amendment or the revocation signed by the owner or owners of the Restricted Buffer Area and by the MDEP.
5. **Effective Provisions of Declaration.** Each provision of this Declaration, and any agreement, promise, covenant and undertaking to comply with each provision of this Declaration, shall be deemed a land use restriction running with the land as a burden and upon the title to the Restricted Buffer Area.
6. **Severability.** Invalidity or unenforceability of any provision of this Declaration in whole or in part shall not affect the validity or enforceability of any other provision or any valid and enforceable part of a provision of this Declaration.
7. **Governing Law.** This Declaration shall be governed by and interpreted in accordance with the laws of the State of Maine.

\_\_\_\_\_  
(NAME)

STATE OF MAINE \_\_\_\_\_ County, \_\_\_\_\_, 20\_\_.  
(County) (date)

Personally appeared before me the above named \_\_\_\_\_, who swore to the truth of the foregoing to the best of (his/her) knowledge, information and belief and acknowledged the foregoing instrument to be (his/her) free act and deed.

\_\_\_\_\_  
Notary Public  
\_\_\_\_\_

## Highlands Subdivision, Standish

### APPENDIX - *Available Upon Request*

#### HydroCAD Stormwater Calculations

- 2-, 10- and 25-year Pre-development Flows
- 2-, 10- and 25-year Post-development Flows
- Emergency Spillway Check – Filter Ponds & Gravel Wetland
- 10-year Storm Drain Calculations

#### Watershed Maps

- SWP-1.0 Pre-Development Watershed – S1, S2, S7 & S8
- SWP-1.1 Pre-Development Watershed – S2, S3 & S4
- SWP-1.2 Pre-Development Watershed – S4, S5 & S6
- SWP-1.0 Post-Development Watershed – S1, S2, S7 & S8
- SWP-1.1 Post-Development Watershed – S3 & S4
- SWP-1.2 Post-Development Watershed – S5 & S6
- BMP-1.0 Treatment Map
- BMP-1.1 Treatment Map
- BMP-1.2 Treatment Map
- BMP-1.3 Treatment Map

## CORRESPONDENCE WITH PORTLAND WATER DISTRICT re. ABILITY TO SERVE

**Larry Bastian**

---

**From:** Larry Bastian  
**Sent:** Tuesday, March 5, 2019 9:57 AM  
**To:** 'Robert Bartels'  
**Cc:** Brian Leavitt (brian@leavittearthworks.com); Jamie Tompson (jtompson18227@roadrunner.com); Jeff Amos  
**Subject:** RE: Highlands Subdivision, Standish

**NOTE: Portland Water District policy is to issue ability to serve letter during final plan approval by Town.**

Hi Robert,

The Highlands project received preliminary subdivision and site plan approval at the Standish Planning Board last night, so Brian and Jamie would be ready to move ahead on the Oak Hill main renewal as soon as the District is ready.

Thanks,

Larry Bastian, PE  
**Terradyn Consultants, LLC**

---

**From:** Robert Bartels <rbartels@pwd.org>  
**Sent:** Wednesday, February 27, 2019 3:28 PM  
**To:** Larry Bastian <larry@terradyconsultants.com>  
**Cc:** Brian Leavitt (brian@leavittearthworks.com) <brian@leavittearthworks.com>; Jamie Tompson (jtompson18227@roadrunner.com) <jtompson18227@roadrunner.com>; Jeff Amos <jeff@terradyconsultants.com>  
**Subject:** RE: Highlands Subdivision, Standish

Larry,

We are looking into the status of the Oak Hill Road water main renewal and will get back to you shortly.

Once the design is finalized we will need to enter into an 3-party agreement with the developer and contractor. The details of that agreement, and the PWD contribution, will be figured out shortly.

Thanks,

**Robert Bartels**  
**Senior Project Engineer**  
Portland Water District  
Phone:  
E-mail: [rbartels@pwd.org](mailto:rbartels@pwd.org)  
<http://www.pwd.org>

---

**From:** Larry Bastian <larry@terradyconsultants.com>  
**Sent:** Wednesday, February 27, 2019 3:13 PM  
**To:** Robert Bartels <rbartels@pwd.org>  
**Cc:** Brian Leavitt (brian@leavittearthworks.com) <brian@leavittearthworks.com>; Jamie Tompson (jtompson18227@roadrunner.com) <jtompson18227@roadrunner.com>; Jeff Amos <jeff@terradyconsultants.com>  
**Subject:** Highlands Subdivision, Standish

**CAUTION:** This email originated from outside of the organization. Do not click links or open attachments unless you recognize the sender and know the content is safe.

Hi Robert,

Following up on our conversation last week...

This project is on the Standish Planning Board agenda for next Monday, March 4<sup>th</sup>. We are hoping to receive preliminary subdivision & site plan approval at that time. We understand the Planning Board will condition FINAL plan approval upon receiving the ability to serve determination from Portland Water District, so we will provide final review plans to you after we receive preliminary approval from the Town.

Regarding the Oak Hill Road water main renewal as it relates to this project... Is there any information you need from Terradyn or the developers in order to move forward with construction early this spring?

Thanks,

Larry Bastian, PE

**Terradyn Consultants, LLC**

41 Campus Drive, Suite 101

New Gloucester, ME 04260

Ph. 207-926-5111

Cell 207-838-6882

Fax 207-221-1317

## Larry Bastian

---

**From:** Larry Bastian  
**Sent:** Monday, November 12, 2018 11:19 PM  
**To:** Robert Bartels (rbartels@pwd.org)  
**Cc:** Brian Leavitt (brian@leavittearthworks.com); Jamie Tompson (jtompson18227@roadrunner.com)  
**Subject:** Highlands Subdivision, Standish - Ability to Serve letter  
**Attachments:** Highlands\_Standish-Water Plans\_11-13-2018.pdf

Robert,

Attached please find the utility plans as prepared for preliminary subdivision plan submission to the Town of Standish. These plans contain the latest revisions to the on-site water main and services that you and I discussed in our most recent meeting on October 4<sup>th</sup>. Please review these plans and if acceptable to the District, provide a letter of ability to serve the development.

Please contact me if you have any questions.

Thank you,

Larry Bastian, PE  
**Terradyn Consultants, LLC**  
41 Campus Drive, Suite 101  
New Gloucester, ME 04260  
Ph. 207-926-5111  
Cell 207-838-6882  
Fax 207-221-1317



## Nitrate-nitrogen Impact Assessment Highlands Subdivision Oak Hill Road and Route 25, Standish

**Date:** April 3, 2019

### **Purposes of the assessments:**

The purposes of the assessments are to predict the locations and possible effects of wastewater plumes on groundwater from the septic systems planned for the multi-family portion of a development that also includes single family residences on individual lots. This assessment is done to satisfy Sections 15 and 17 of the DEP Site Location of Development rules. A preliminary review of site conditions and wastewater disposal options by John Hopeck, DEP Geologist, led to this observation by Mr. Hopeck:

*...depending on design flow and other design features, and the locations for the disposal systems serving 25 – 32, 45 – 48 and 57 – 60, and 49 – 56 do not appear to acceptable without significant wastewater pretreatment due to their proximity to the downgradient property line.*

### **Information used:**

Information used in this study includes library research of published literature, a plan of the development by Terradyn Consultants, and soil test pit information, a high-intensity soil report and a wetlands report by Mark Hampton, C.S.S, L.S.E.

### **Project summary:**

The property investigated is comprised of lots 11 and 19C on Standish Tax Map 10. The project is a residential housing subdivision of 53.11 acres. It is proposed to be comprised of 17 individual residential lots and 80 multi-family residential units. Wastewater disposal will be by on-site subsurface wastewater disposal systems. Water will be provided by the public water supply.



### **Summary of geology:**

The property is located on the southerly and southeasterly facing slopes of Oak Hill (see Figure 1). There is a surface and groundwater divide on the property at the approximate 450 foot elevation. Flow is radial, with a portion of the property flowing to the southeast and Sticky River, which flows to Sebago Lake and a portion flowing to the southwest to Josies Brook and Saco River (see Figure 4). Surface slopes are gentle to moderate in the areas investigated, ranging from 3% to 10%.

The entire property is mapped as glacial till on the *Surficial Geology of the Standish Quadrangle, Maine* (see Figure 2). This map depicts the site as having shallow bedrock. The *Soil Narrative Report* by Mark Hampton Associates, Inc. is submitted separately as a Class A High-Intensity Soil Map and report. Soils are depicted as Lyman-Tunbridge Complex, Dixfield, Colonel and Brayton. These are soils formed in sandy, loamy glacial lodgment till. The published mapping agrees with this report and the soil logs.

Bedrock beneath the site is mapped as two units of the Sebago Lake Sequence, the Standish and Steep Falls Formations, on the *Bedrock Geology of the Portland 1:100,000 Quadrangle, Maine and New Hampshire* (see Figure 3). These are medium to high grade metamorphic granofels and schists.

The property is not mapped as an aquifer on the *Significant Sand and Gravel Aquifers of the Standish Quadrangle, Maine* (see Figure 4).

### **Summary of hydrogeology:**

The source of groundwater on this site is precipitation. Precipitation falling on this site seeps into the soil and descends until restrictive soil layers or the water table is encountered. Thereupon, the flow of groundwater is down gradient toward wetlands and streams. Where groundwater encounters open fractures on the bedrock surface, a portion of the water will seep downward into the bedrock to recharge the bedrock aquifer.

On this site the soils are sandy loams. Slopes are gentle in the area investigated. Recharge is greater than average over the entire property. This assumption is based on the textures reported in soil logs. Based on the guidelines for nitrogen impact assessment published by the Maine DEP, it is reasonable to assume that 30 to 40% of all precipitation recharges the soil, except in mapped wetland areas, which are areas of groundwater discharge.

The groundwater flow directions on this property can be assumed to be perpendicular to the topographic contour lines. The estimated hydraulic conductivity of the till deposit is 6 feet per day. The hydraulic gradients are assumed to be 3% (0.03). The assumed effective porosity is assumed to be 30%.

The laboratory results of a bedrock well sample are enclosed. The sample was taken from the well at 191 Ossipee Trail West. The results reveal potable drinking water with nitrate-

nitrogen and nitrate concentrations below 0.2 mg/liter. As the site is undeveloped and forested, the assumption is that background soil NO<sub>3</sub>-N is of similar quality.

### **Impact on Groundwater Quality:**

Nitrate-nitrogen is the chemical to assess for impact on groundwater. Nitrate-nitrogen is generated by subsurface wastewater disposal systems. It is a conservative contaminant, meaning it does not readily degrade in groundwater, nor does it attenuate or attach itself to soil particles. Nitrate-nitrogen is limited to 10 mg/liter in public drinking water supplies by the Primary Drinking Water Standard and is the limit placed by the Maine DEP at the property boundaries of a project. The DEP also asks for an estimate of the 8 mg/L NO<sub>3</sub>-N isocon.

The analysis of nitrate-nitrogen impacts was calculated by SOLUTRANS, a 32-bit Windows program for modeling three-dimensional solute transport written by Dr. Charles R. Fitts of Fitts Geosolutions and the University of Southern Maine. The program is based on the analytical solutions of Liej *et. al.* (1991 and 1993). The solutions in SOLUTRANS all assume a uniform one-dimensional flow field, and allow three-dimensional dispersion, retardation and first-order decay.

Variables entered into the calculations include a hydraulic conductivity value of 6 feet per day, a hydraulic gradient of 3% and an assumed porosity of 30%. This leads to a Seepage Velocity of 0.6 feet per day. Additional variables include an initial wastewater concentration of 40 mg/L NO<sub>3</sub>-N, retardation of 1, a decay constant of zero and longitudinal, lateral and vertical dispersivities of 40 feet, 13.3 feet and 1.3 feet, respectively.

Calculations were made and reveal the 10 mg/L NO<sub>3</sub>-N plume will be approximately 95 feet in length and the 8 mg/L plume will be approximately 132 feet in length. The graph of these results is enclosed and is labelled, "Standard System". Using the topographic contour information as a determinant of groundwater flow direction, the calculated 10 and 8 mg/L plumes were drawn on the plan of the project by Mark Cenci Geologic, Inc. and forwarded to Terradyn Consultants.

As suggested by Mr. Hopeck, the estimated 10mg/L plumes of the three disposal areas serving the multi-family units 25-32, 45-48 & 57-60 and 49-56 are too lengthy to remain within the project property boundary. Aerating, denitrifying pre-treatment of the wastewater disposed into these three areas is recommended.

### **Denitrification Systems:**

Each of the three disposal areas to be served by denitrification systems has a design flow of 1,440 gallons per day. The recommended treatment unit for these three systems is the Singulair 960-TNT-1500. This is a unit designed to treat 1,500 gallons per day. The

TNT (Total Nitrogen Treatment) series of products meets the provisions of NSF/ANSI (National Sanitary Foundation/American National Standards Institute) Standard 245 for Wastewater Treatment Systems – Nitrogen Reduction (March 2007).

Attached to this report are a copy of a product cut sheet, the *Norweco Singulair Bio-Kinetic wastewater treatment system with Service Pro Control Center Models 960 and TNT system Owner's Manual* and the *Evaluation Report* from the *Final Report: Norweco, Inc. Singulair Model TNT-500 Wastewater Treatment System 05/06/2015/060*.

The Executive Summary of the *Final Report* states:

Over the course of the Standard 245 evaluation the influent averages 240 mg/L BOD<sub>5</sub>, 270 mg/L TSS, 38 mg/L Total Nitrogen, 310 mg/L alkalinity, 28 degree C and a median pH of 6.7, meeting the requirements of the Standard. The effluent averages over the course of the test were 3 mg/L CBOD<sub>5</sub>, 8 mg/L TSS and 12 mg/L Total Nitrogen, representing a 68% reduction, and the effluent pH ranged between 6.3 and 7.4 SU. The effluent values met the requirements of the Standard.

The performance of the denitrification system was also modelled using Solutrans. Input variables remained the same, with the initial concentration of NO<sub>3</sub>-N assumed to be 15 mg/L. The product cut sheet lists the performance of the TNT unit as producing effluent of 7 mg/L NO<sub>3</sub>-N, however an assumption of 15 mg/L was made to be conservative. The curve of the results is attached and reveal the 10 mg/L plume is approximately 10 feet in length and the 8 mg/L plume is approximately 18 feet in length.

Section 17. B. 4. c. of the *Site Location of Development Permit Application* requires a Monitoring Plan be provided, as outlined in Section 15(C). A waiver of this requirement is requested and is justified because the Singulair product has met the provisions of NSF 245 through rigorous field and laboratory testing, and will be maintained, serviced and inspected. The maintenance requirements and an operation and maintenance plan for the systems is attached, as required by 17. B. 4 d.

A waiver of the requirements of 17. B. 4. e. for a backup system to be located and delineated is requested and justified because the addition of the aerating pretreatment units to these systems will result in clarified wastewater being disposed into the soil. The Singulair TNT-500 met the performance requirements established by NSF/ANSI Standard 40 for Class 1 effluent. With lowered BOD<sub>5</sub>, COD<sub>5</sub> and TSS, the effluent is clarified to the point where a clogging bio-mat will not form within the disposal area, meaning the disposal area will not fail, so long as the aerating pre-treatment is in operation. With a Maintenance Agreement in place and operational, the system will continue to function properly.


An idealized HHE-200 (pages 1 and 3) is attached, depicting the disposal area, typical of the system to serve Units 25-32. This system will be comprised of the Singulair TNT 1500, a pump station if required by finished construction elevations, and a Moundbuster

disposal area comprised of 1380 linear feet of piping. Moundbuster is an approved disposal system when coupled with approved aerating pre-treatment. It is comprised of 4-inch diameter land drain type piping, with sock, spaced 12 inches on center. The separation distance to water table, bedrock and hardpan is in all cases 12 inches. The enclosed cross section shows the Moundbuster piping set at grade on a 10% slope.

**Conclusions:**

The development of this parcel meets the requirements of the Site Location of Development Rules regarding groundwater quality. Three of the wastewater disposal areas will require the use of denitrification, aerating treatment units in order to meet the Rules. These units meet the provisions of NSF Standard 245 and 40 and produce an effluent quality with lower BOD5, COD5, TSS, NO3-N and certain pathogens than anaerobic wastewater disposal systems.

A Maintenance Agreement will be in place and regular inspections of the systems' performance will ensure that water quality standards will remain in compliance.

  
\_\_\_\_\_  
Mark Cenci  
Certified Maine Geologist #467





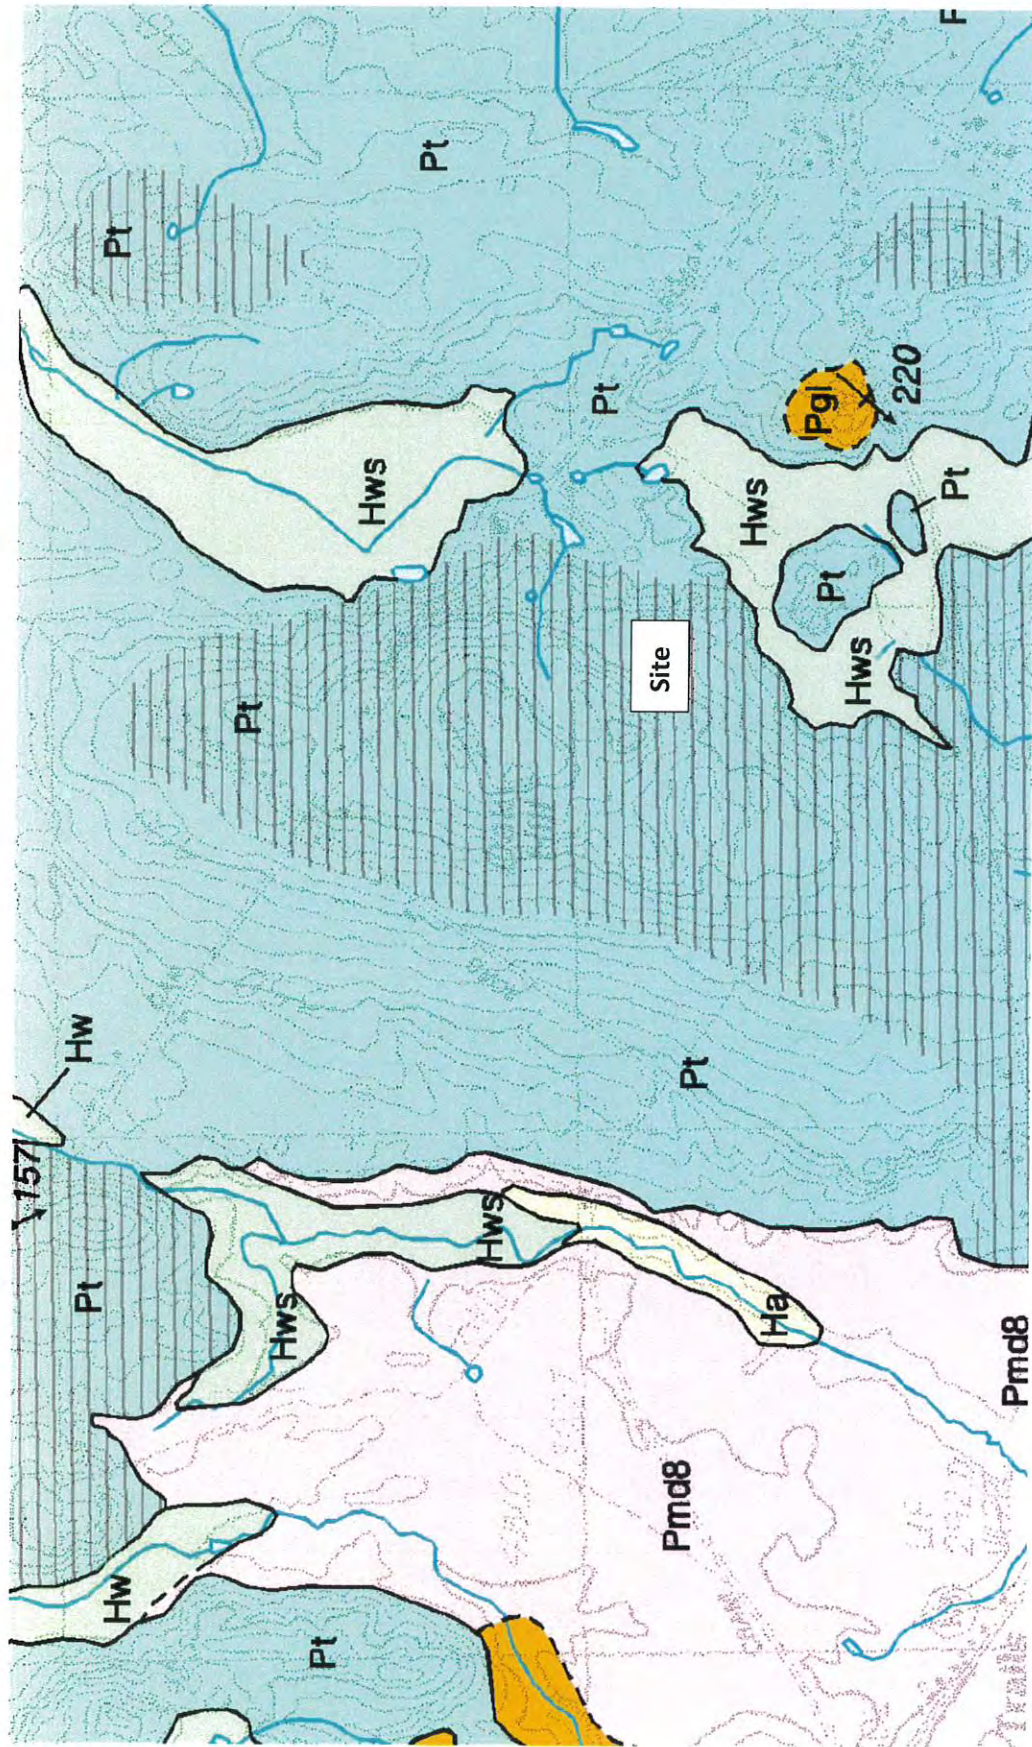


Figure 2.

Detail from *Surficial Geology of the Standish Quadrangle, Maine*  
 Maine Geological Survey, 1999, Open-File No. 99-101

Where Pt = Glacial Till (shallow bedrock) and Hws = Holocene wetland swamp



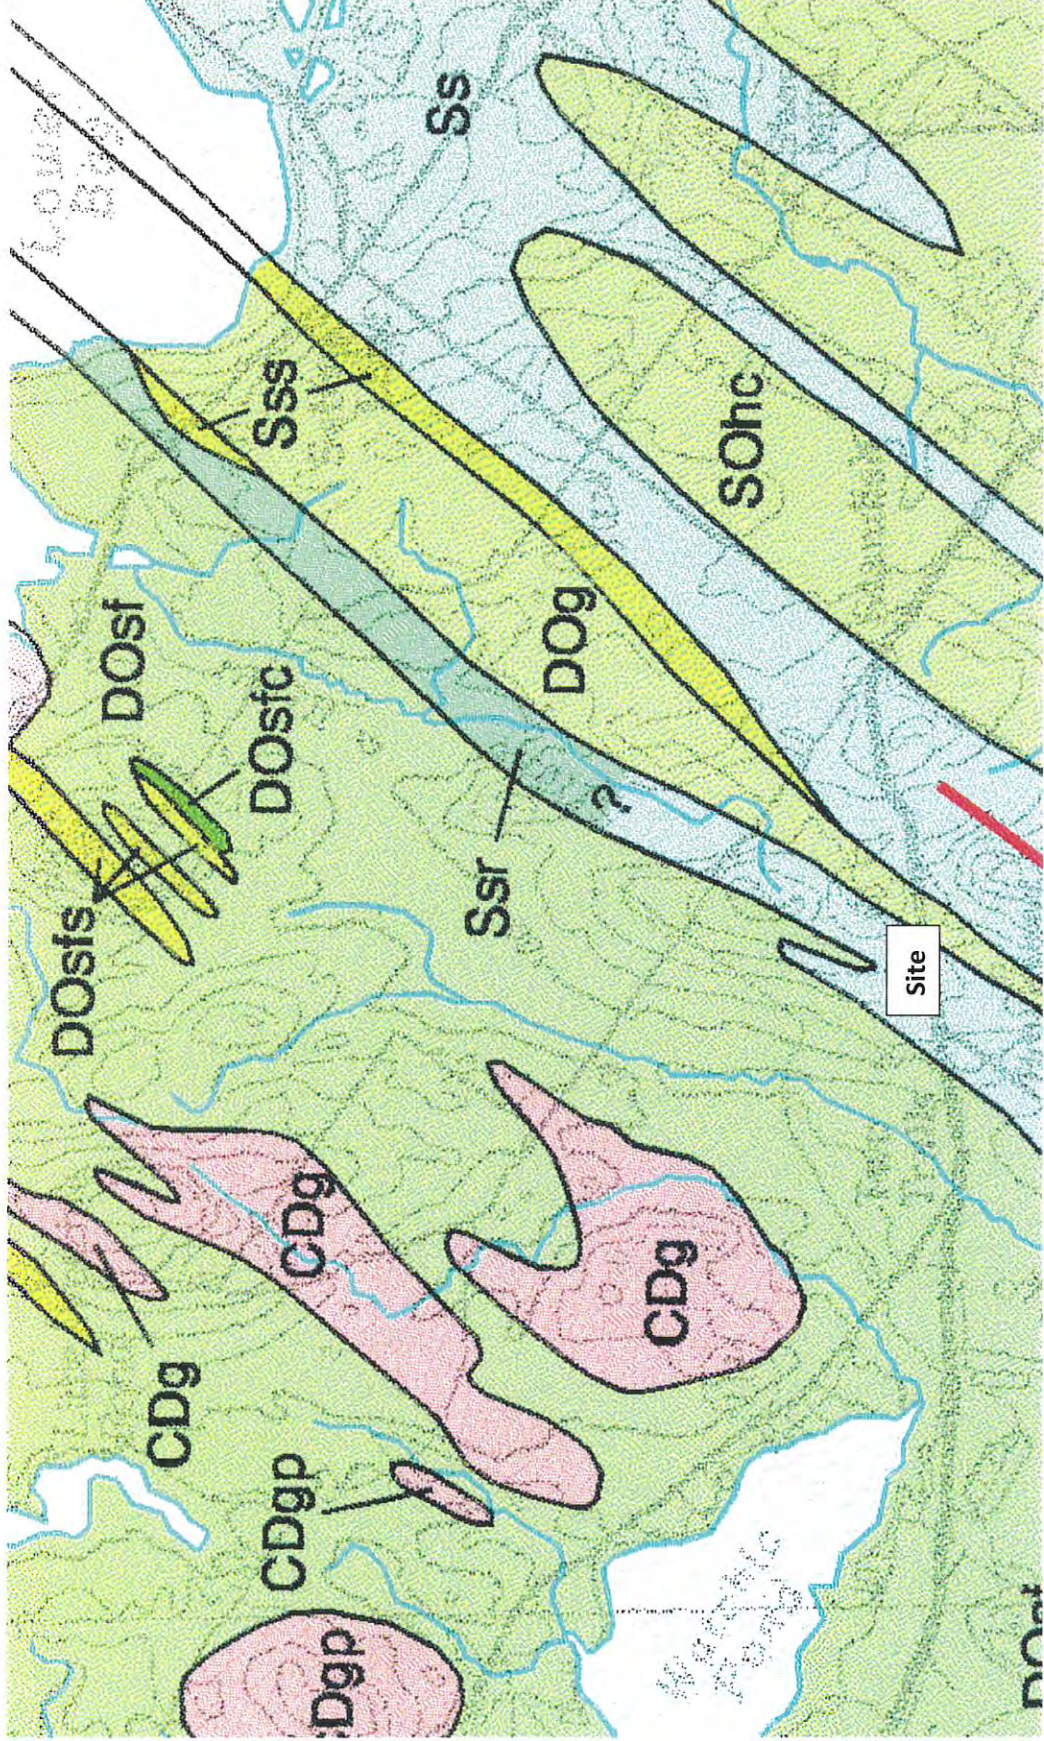


Figure 3.

Detail from *Bedrock Geology of the Portland 1:100,000 Quadrangle Maine and New Hampshire*

1998, Maine Geological Survey, Open-File No. 98-1

Where Ss = Standish Formation and DOsf = Steep Falls Formation



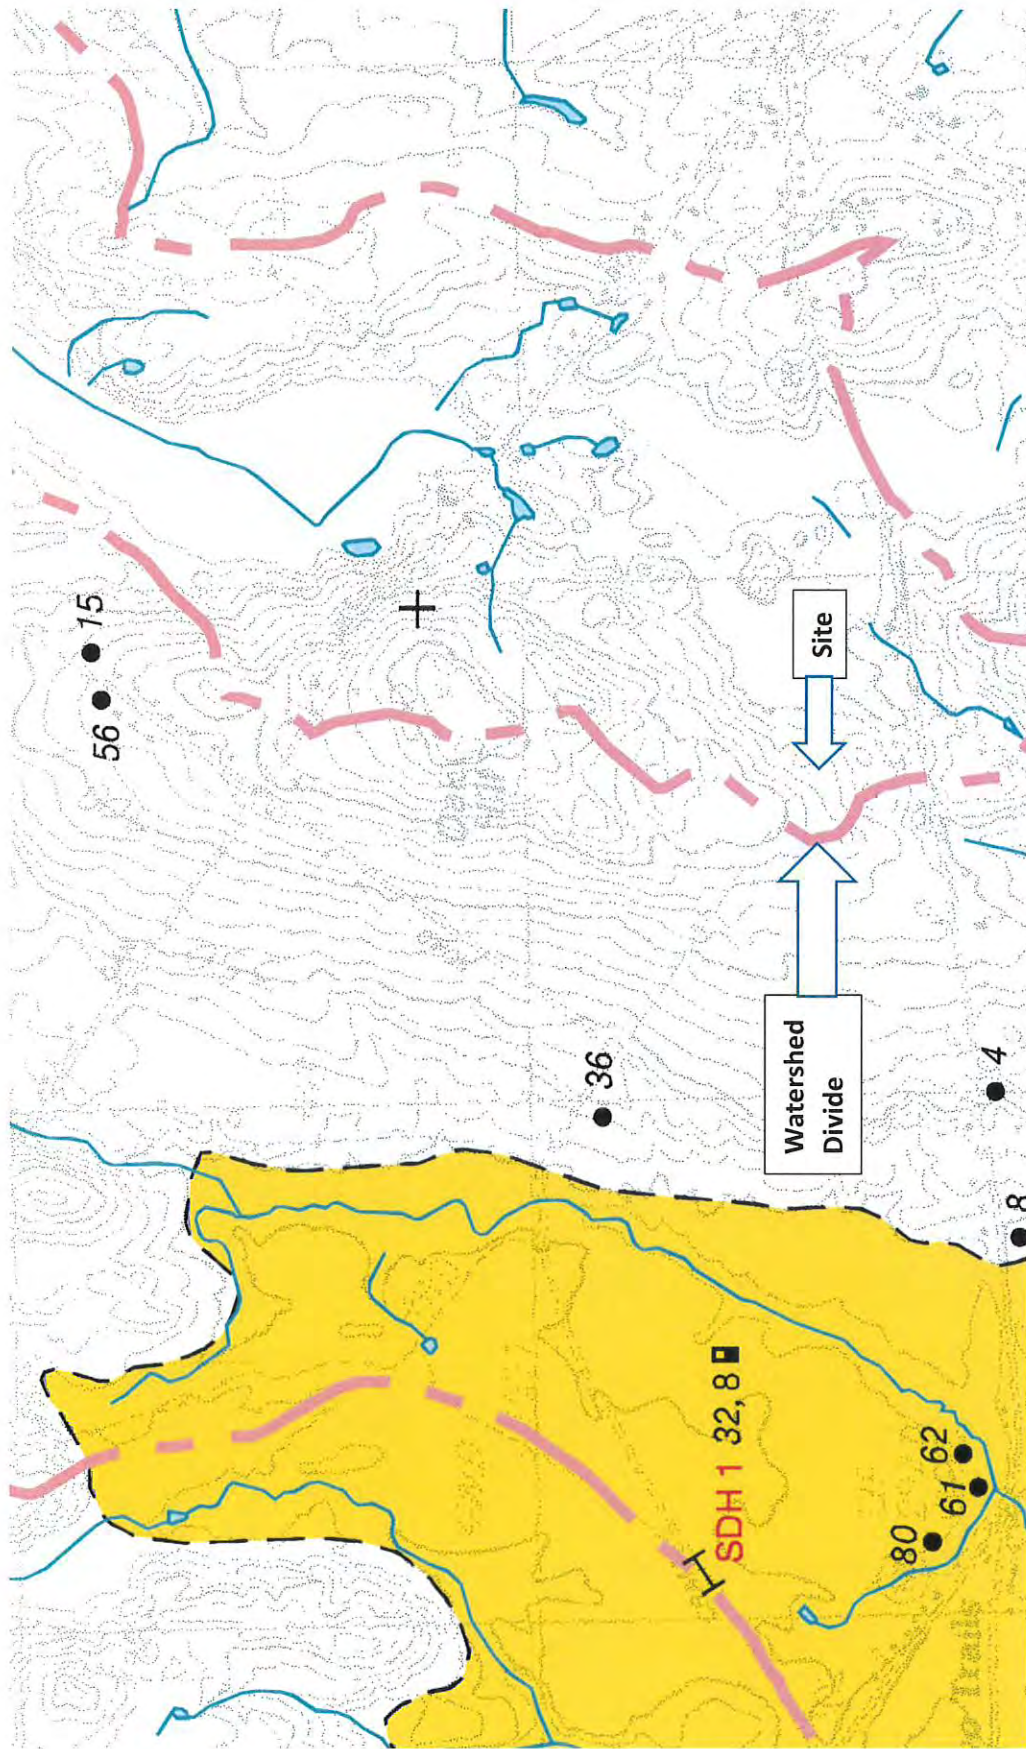


Figure 4.

Detail from *Significant Sand and Gravel Aquifers, Standish Quadrangle, Maine*.

1998. Maine Geological Survey, Open-File Report No. 98-142





# A & L LABORATORY

a division of Granite State Analytical Services, LLC  
 155 Center Street, Building C, PO Box 1507, Auburn, ME 04210  
 http://www.allaboratory.com/ - (207) 784-5354

## CERTIFICATE OF ANALYSIS FOR DRINKING WATER

DATE PRINTED: 11/12/2018  
 CLIENT NAME: Mark Cenci  
 CLIENT ADDRESS: 93 Mill Road  
 North Yarmouth, ME 04097  
 SAMPLE ID#: 1811-00817-001  
 SAMPLED BY: Mark Cenci  
 SAMPLE ADDRESS: Mark Cenci Geologic  
 191 Osippee Trail West  
 Standish ME 04071  
 MORE LOC INFO: Breakroom

Legend	
Passes	
Fails EPA Primary	
Fails EPA Secondary	
Fails State Guideline	
Attention	

DATE AND TIME COLLECTED: 11/07/2018 3:18PM  
 DATE AND TIME RECEIVED: 11/08/2018 8:56AM  
 ANALYSIS PACKAGE: A & L-IC-Basic+As-ME  
 RECEIPT TEMPERATURE: 18° CELSIUS  
 CLIENT JOB #

Test Description	Results	Test Units	Pass /Fail	DQ Flag	RL	Limit	Method	Analyst	Date-Time Analyzed
Arsenic*	0.0287	mg/L			0.001	0.010 mg/L	EPA 200.8	JLR-NH	11/09/18 1:07PM
Calcium	27.8	mg/L			0.1	No Limit	EPA 200.8	JLR-NH	11/09/18 1:07PM
Copper*	<0.001	mg/L			0.001	1.3 mg/L	EPA 200.8	JLR-NH	11/09/18 1:07PM
Hardness (calc.)	77.6	mg CaCO3/L			0.25	No Limit	EPA 200.8	JLR-NH	11/09/18 1:07PM
Iron	0.37	mg/L			0.1	0.3 mg/L	EPA 200.8	JLR-NH	11/09/18 1:07PM
Magnesium	1.98	mg/L			0.1	No Limit	EPA 200.8	JLR-NH	11/09/18 1:07PM
Manganese*	0.0708	mg/L			0.001	0.05 mg/L	EPA 200.8	JLR-NH	11/09/18 1:07PM
Sodium	6.92	mg/L			0.1	No limit	EPA 200.8	JLR-NH	11/09/18 1:07PM
Chloride*	2	mg/L			2	250 mg/L	EPA 300.0	JR-ME	11/08/18 12:34PM
Fluoride*	0.39	mg/L			0.2	4.0 mg/L	EPA 300.0	JR-ME	11/08/18 12:34PM
Nitrate as N*	<0.2	mg/L			0.2	10 mg/L	EPA 300.0	JR-ME	11/08/18 12:34PM
Nitrite as N*	<0.2	mg/L			0.2	1 mg/L	EPA 300.0	JR-ME	11/08/18 12:34PM
pH*	7.67	SU		H	--	6.5 - 8.5 SU	SM 4500-H+ B	JR-ME	11/08/18 1:55PM
Coliform Bacteria*	Present	P-A/100mL			Absent	No Limit	SM 9223 B	JR-ME	11/08/18 9:55AM
E. coli Bacteria*	Absent	P-A/100mL			Absent	Absent	SM 9223 B	JR-ME	11/08/18 9:55AM

The results presented in this report relate to the samples listed above in the condition in which they were received.

RL: "Reporting limit" means the lowest level of an analyte that can be accurately recovered from the matrix of interest.

The thermal preservation requirement of 4°C for nitrate & nitrite has been waived by the Maine CDC for all samples submitted to the Drinking Water Program.  
 Data Qualifier (DQ) Flags: H = Hold time non-compliant.

\* ME Certified Analysis


Rebecca L. Labranche  
 Laboratory Director

This analysis meets State of Maine requirements except as noted.


State Certifications: | A & L Laboratory: ME ME00021 | Granite State Analytical Services LLC: NH NH00003 |

This certificate shall not be reproduced, except in full, without the written approval of Granite State Analytical Services, LLC

## Singlair System, NO<sub>3</sub>-N vs Distance

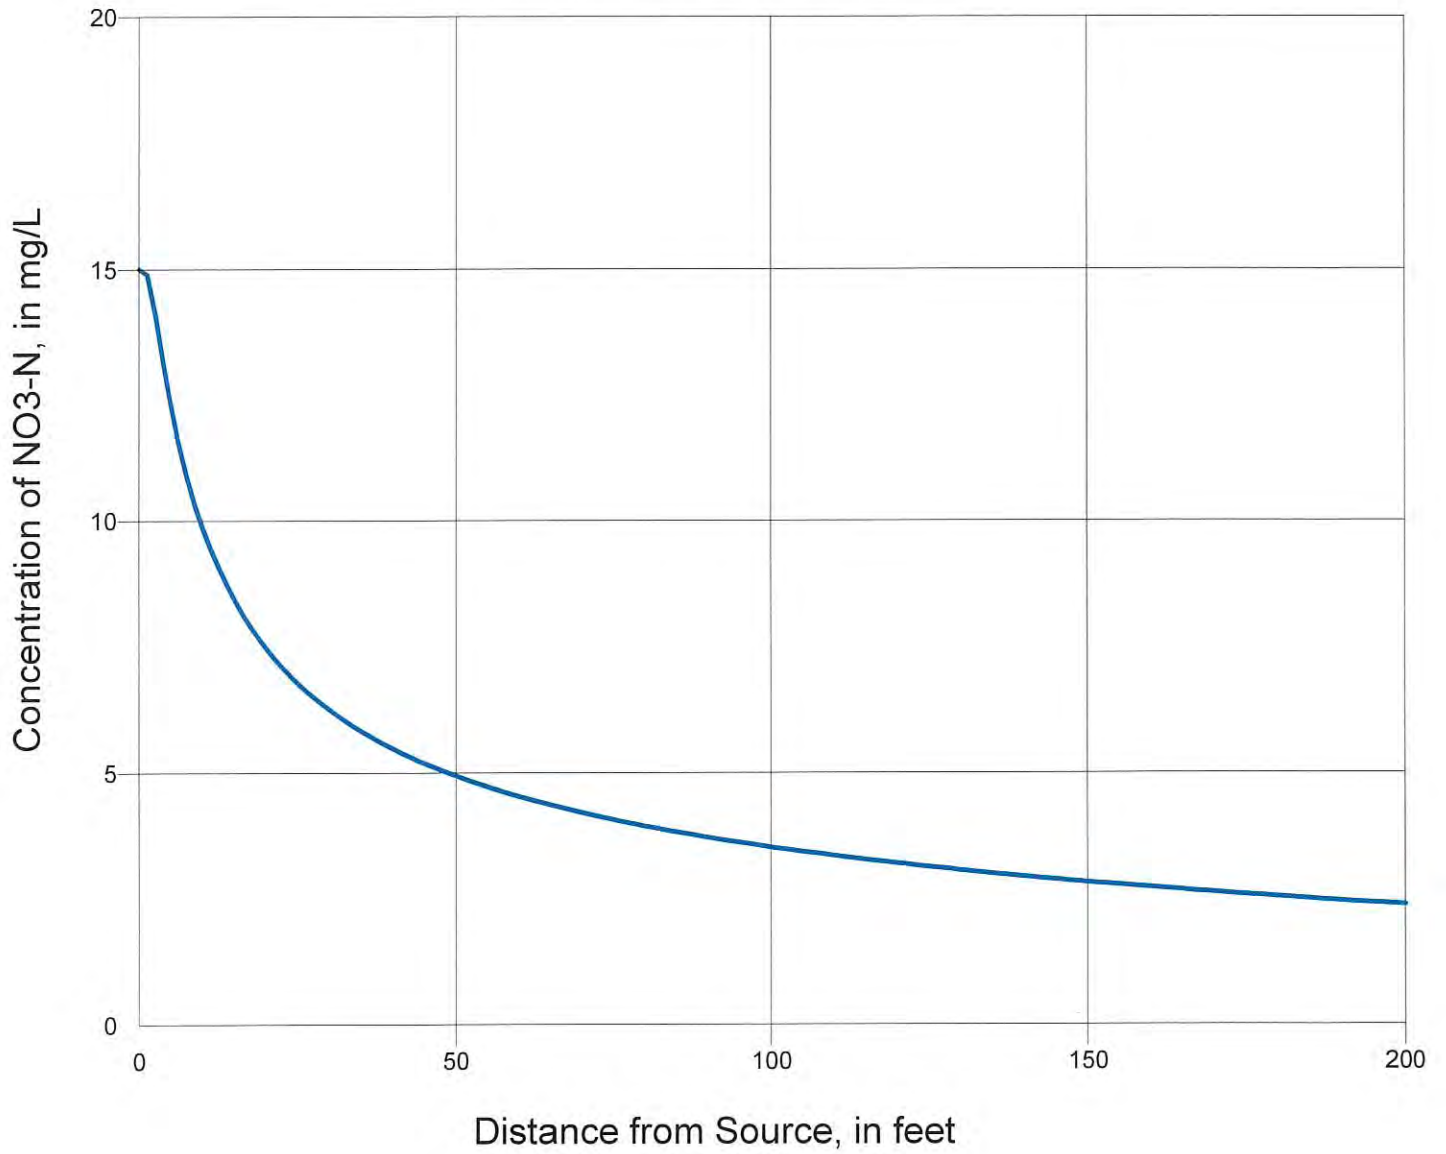

## Standard System, NO<sub>3</sub>-N vs Distance

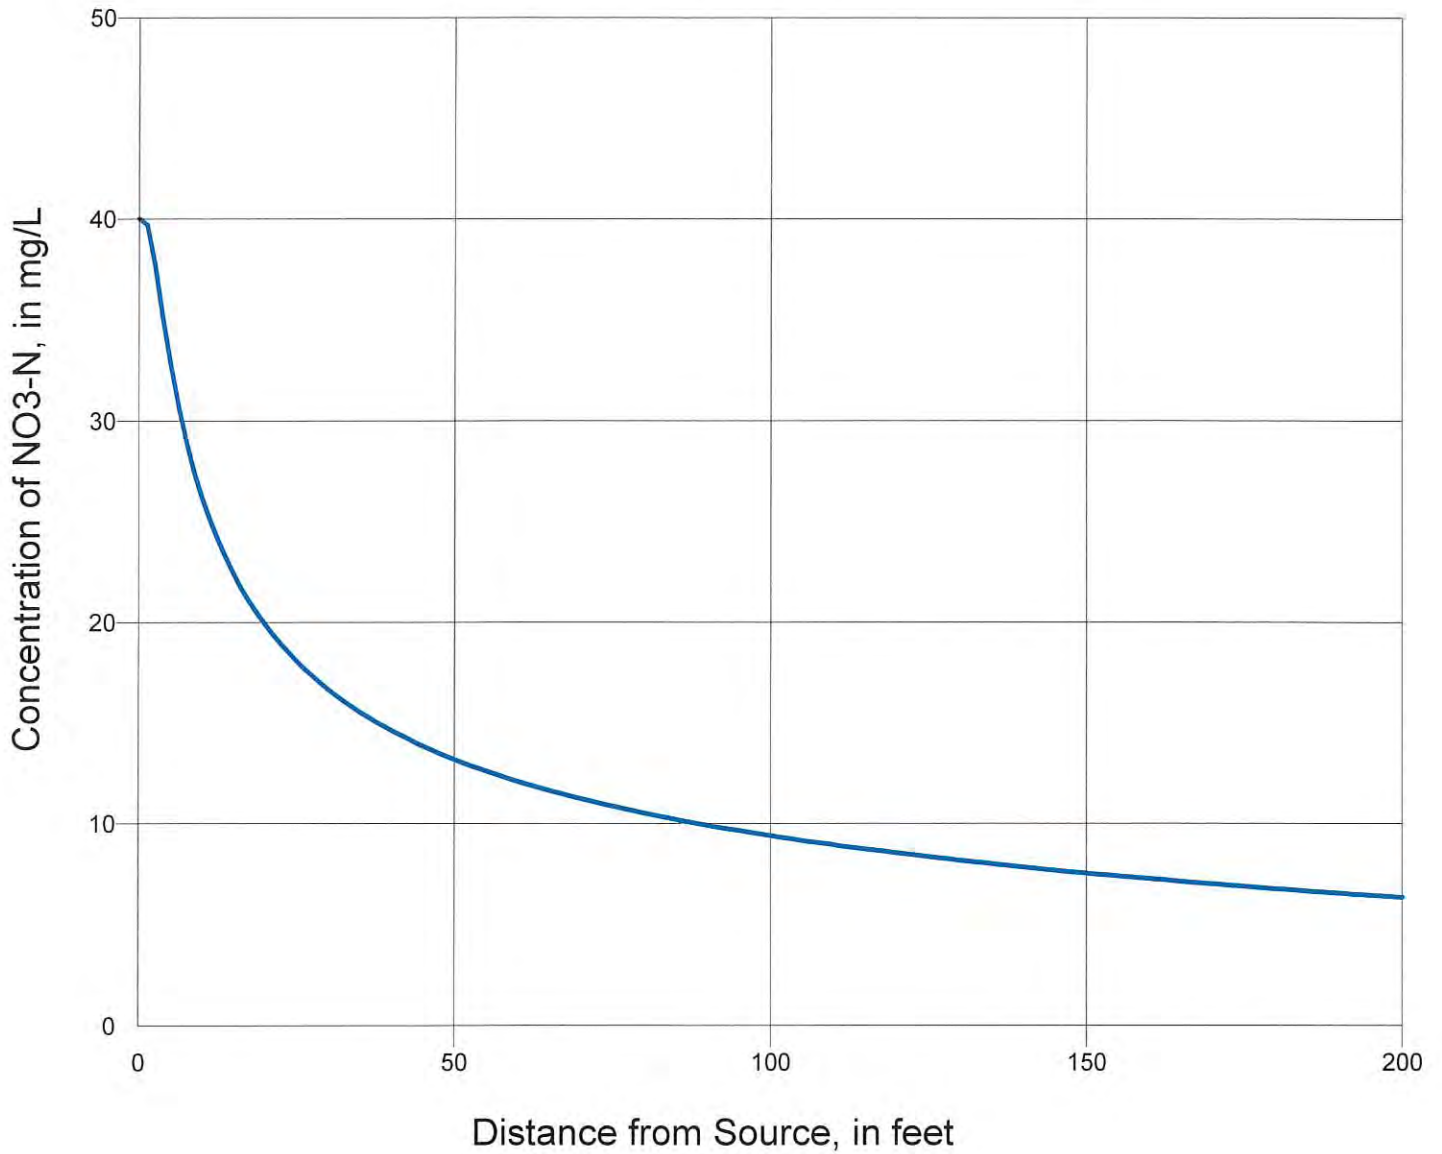

# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Dept. Health & Human Services  
 Div of Environmental Health, 11 SHS  
 (207) 287-5872 Fax: (207) 287-4172

## PROPERTY LOCATION

**>> CAUTION: LPI APPROVAL REQUIRED <<**

City, Town, or Plantation: STANDISH  
 Street or Road: HIGHLANDS  
 Subdivision, Lot #:

Town/City: \_\_\_\_\_ Permit #: \_\_\_\_\_  
 Date Permit Issued: \_\_\_/\_\_\_/\_\_\_ Fee: \$ \_\_\_\_\_ Double Fee Charged [ ]  
 Local Plumbing Inspector Signature: \_\_\_\_\_ L.P.I. #: \_\_\_\_\_  
 Owner  Town  State

## OWNER/APPLICANT INFORMATION

Name (last, first, MI): Leavitt-Tompson, LLC  Owner  Applicant  
 Mailing Address of Owner/Applicant: P.O. Box 703  
Standish, ME 04084  
 Daytime Tel. #:

The Subsurface Wastewater Disposal System shall not be installed until a Permit is issued by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with this application and the Maine Subsurface Wastewater Disposal Rules.  
 Municipal Tax Map # \_\_\_\_\_ Lot # \_\_\_\_\_

## OWNER OR APPLICANT STATEMENT

I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit.

## CAUTION: INSPECTION REQUIRED

I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.  
 (1st) date approved \_\_\_\_\_

Signature of Owner or Applicant \_\_\_\_\_ Date \_\_\_\_\_

Local Plumbing Inspector Signature \_\_\_\_\_ (2nd) date approved \_\_\_\_\_

## PERMIT INFORMATION

<b>TYPE OF APPLICATION</b> <input checked="" type="checkbox"/> First Time System <input type="checkbox"/> Replacement System Type replaced: _____ Year installed: _____ <input type="checkbox"/> Expanded System a. <25% Expansion b. >25% Expansion <input type="checkbox"/> Experimental System <input type="checkbox"/> Seasonal Conversion	<b>THIS APPLICATION REQUIRES</b> <input checked="" type="checkbox"/> No Rule Variance <input type="checkbox"/> First Time System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval <input type="checkbox"/> Replacement System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval <input type="checkbox"/> Minimum Lot Size Variance <input type="checkbox"/> Seasonal Conversion Permit	<b>DISPOSAL SYSTEM COMPONENTS</b> <input checked="" type="checkbox"/> Complete Non-engineered System <input type="checkbox"/> Primitive System (graywater & alt. toilet) <input type="checkbox"/> Alternative Toilet, specify: _____ <input type="checkbox"/> Non-engineered Treatment Tank (only) <input type="checkbox"/> Holding Tank, _____ gallons <input type="checkbox"/> Non-engineered Disposal Field (only) <input type="checkbox"/> Separated Laundry System <input type="checkbox"/> Complete Engineered System (2000 gpd or more) <input type="checkbox"/> Engineered Treatment Tank (only) <input type="checkbox"/> Engineered Disposal Field (only) <input checked="" type="checkbox"/> Pre-treatment, specify: <u>SINCLAIR</u> <input type="checkbox"/> Miscellaneous Components <u>TNT</u>
<b>SIZE OF PROPERTY</b> SQ. FT. _____ ACRES _____	<b>DISPOSAL SYSTEM TO SERVE</b> <input type="checkbox"/> Single Family Dwelling Unit, No. of Bedrooms: _____ <input checked="" type="checkbox"/> Multiple Family Dwelling, No. of Units: <u>3</u> <input type="checkbox"/> Other: _____ (specify) Current Use <input type="checkbox"/> Seasonal <input type="checkbox"/> Year Round <input type="checkbox"/> Undeveloped	<b>TYPE OF WATER SUPPLY</b> <input type="checkbox"/> Drilled Well <input type="checkbox"/> Dug Well <input type="checkbox"/> Private <input checked="" type="checkbox"/> Public <input type="checkbox"/> Other

## DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)

<b>TREATMENT TANK</b> <input type="checkbox"/> Concrete <u>SINCLAIR</u> <input type="checkbox"/> Regular <u>TNT</u> <input type="checkbox"/> Low Profile <u>1500</u> <input type="checkbox"/> Plastic <input type="checkbox"/> Other: _____ CAPACITY: _____ GAL.	<b>DISPOSAL FIELD TYPE &amp; SIZE</b> <input type="checkbox"/> Stone Bed <input type="checkbox"/> Stone Trench <input type="checkbox"/> Proprietary Device a. cluster array <input type="checkbox"/> Linear b. regular load <input type="checkbox"/> H-20 load <input checked="" type="checkbox"/> Other: <u>MOUNDMASTER</u> SIZE: <u>1380</u> sq. ft. x <u>9</u> ft.	<b>GARBAGE DISPOSAL UNIT</b> <input checked="" type="checkbox"/> No <input type="checkbox"/> Yes <input type="checkbox"/> Maybe If Yes or Maybe, specify one below: <input type="checkbox"/> multi-compartment tank <input type="checkbox"/> _____ tanks in series <input type="checkbox"/> increase in tank capacity <input type="checkbox"/> Filter on Tank Outlet	<b>DESIGN FLOW</b> <u>1440</u> gallons per day BASED ON: <input checked="" type="checkbox"/> Table 4A (dwelling unit(s)) <input type="checkbox"/> Table 4C (other facilities) SHOW CALCULATIONS for other facilities <u>3 UNITS @ 180 GPD EACH</u> <input type="checkbox"/> Section 4G (meter readings) ATTACH WATER METER DATA
<b>SOIL DATA &amp; DESIGN CLASS</b> PROFILE CONDITION: <u>B1C</u> at Observation Hole # <u>TPSA</u> Depth <u>15-22"</u> of Most Limiting Soil Factor	<b>DISPOSAL FIELD SIZING</b> <input type="checkbox"/> Medium—2.6 sq. ft. / gpd <input checked="" type="checkbox"/> Medium—Large 3.3 sq. ft. / gpd <input type="checkbox"/> Large—4.1 sq. ft. / gpd <input type="checkbox"/> Extra Large—5.0 sq. ft. / gpd	<b>EFFLUENT/EJECTOR PUMP</b> <input type="checkbox"/> Not Required <input type="checkbox"/> May Be Required <input checked="" type="checkbox"/> Required Specify only for engineered systems: DOSE: _____ gallons	<b>LATITUDE AND LONGITUDE</b> at center of disposal area Lat. _____ d _____ m _____ s Lon. _____ d _____ m _____ s if g.p.s, state margin of error: _____

## SITE EVALUATOR STATEMENT

I certify that on X (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).

Site Evaluator Signature: Paul Pami

SE #: 262

Date: 4-3-19

Site Evaluator Name Printed: MARK CENCI

Telephone Number: 329-3524

E-mail Address: \_\_\_\_\_

Note: Changes to or deviations from the design should be confirmed with the Site Evaluator.

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services  
 Division of Health Engineering, Station 10  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation

STANDISH

Street, Road, Subdivision

HIGHLANDS


Owner or Applicant Name

HIGHLANDS DEVELOPMENT

SUBSURFACE WASTEWATER DISPOSAL PLAN

Scale: 1" = 20' ft

MOUNDBUSTER DISPOSAL AREA  
 23 LENGTHS OF PIPING 60'  
 22' X 60'  
 SPACED 12" ON CENTER

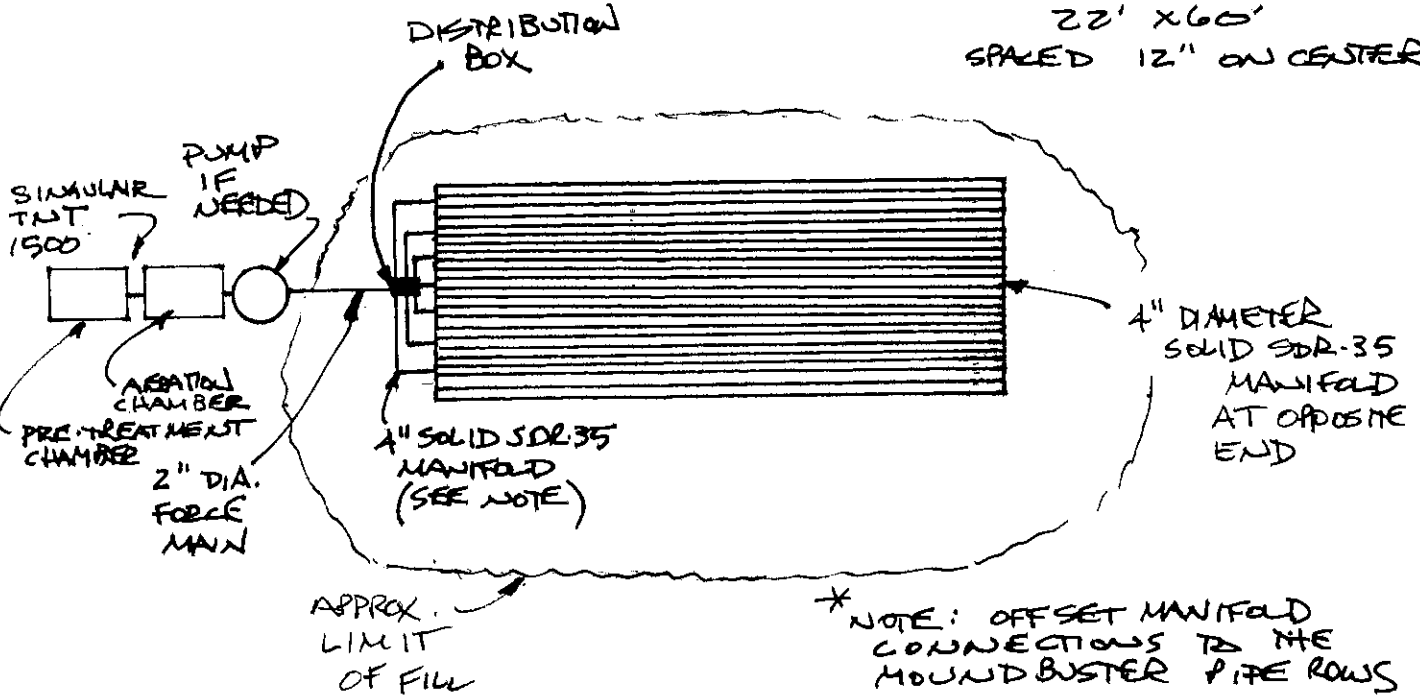

BACKFILL REQUIREMENTS ABOVE GRADE

Depth of Backfill (upslope) 12"  
 Depth of Backfill (downslope) 36"

CONSTRUCTION ELEVATIONS

Finished Grade Elevation (at Row 1) -  
 Top of Proprietary Device (at Row 1) -  
 Bottom of Disposal Field (at Row 1) -


ELEVATION REFERENCE POINT

Location & Description: TO BE SET  
 Reference Elevation is 0.0' or:

SCARIFY ALL GROUND TO BE FILLED. USE GRAVELLY SAND FILL

DISPOSAL FIELD CROSS SECTION

Scales:  
 Vertical: 1" = 5'  
 Horizontal: 1" = 5'

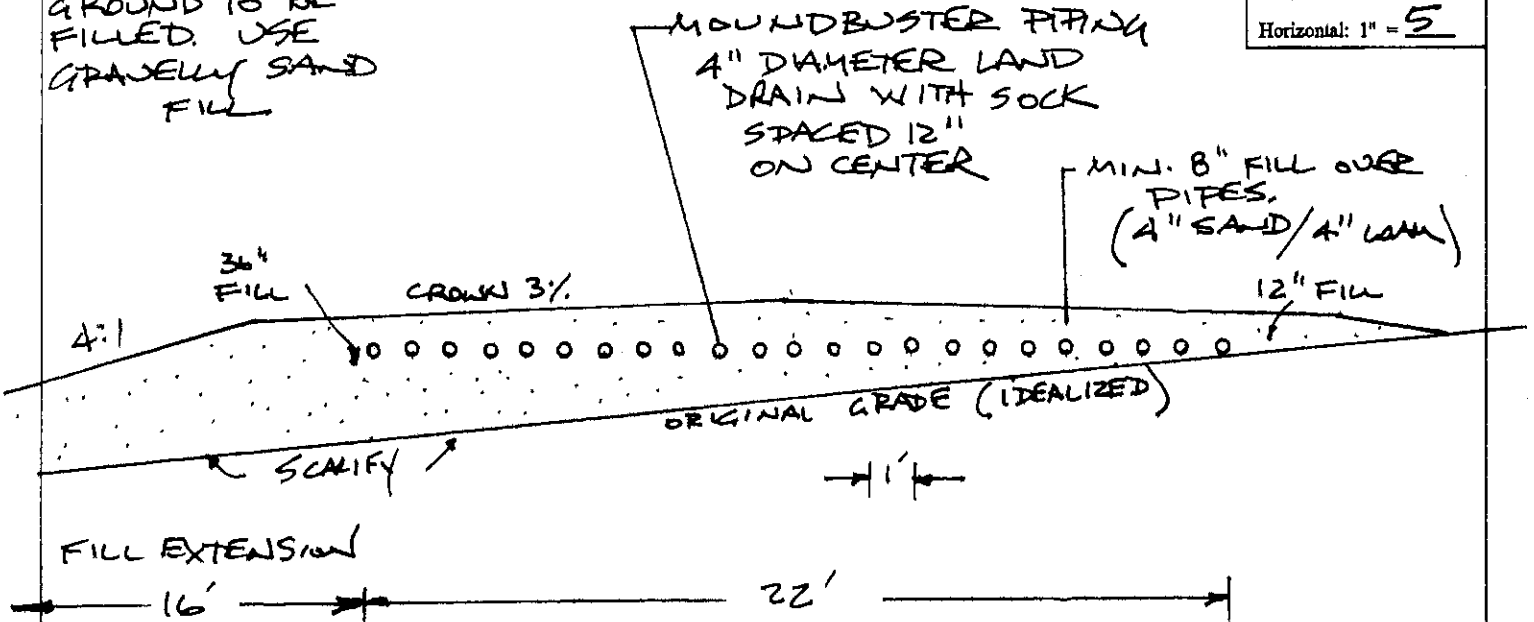

Site Evaluator Signature

SE # 262

Date 4-2-19

# **SINGULAIR® TNT®**



## **ADVANCED TREATMENT UNIT**

**NITROGEN REDUCING WASTEWATER TREATMENT SYSTEM  
ACCOMPLISHES NITRIFICATION AND DENITRIFICATION  
GREATER THAN 68% REDUCTION IN TOTAL NITROGEN**

If regulations in your area are demanding nutrient reduction for onsite treatment and disposal systems, install a Singulair Model TNT! Total Nitrogen Treatment you can rely on from the leader in advanced treatment unit technology.

**NSF STANDARD 245 CERTIFIED PERFORMANCE  
AFFORDABLE DOMESTIC WASTEWATER TREATMENT  
COMPLIES WITH THE MOST STRINGENT EFFLUENT CRITERIA**

The Singulair Model TNT system biologically oxidizes nitrogen compounds without requiring complicated and expensive equipment. Designed to be easily operated and maintained, the TNT system does not require the addition of chemicals or the recirculation of effluent. The Singulair TNT blows away the competition!

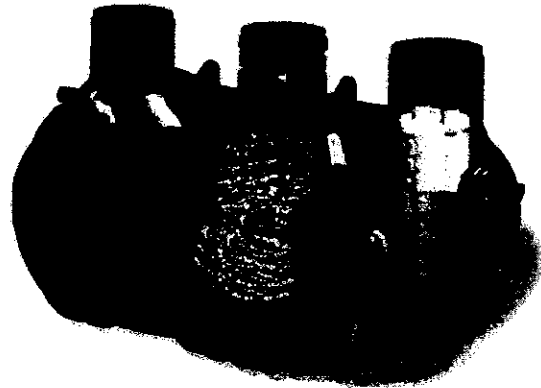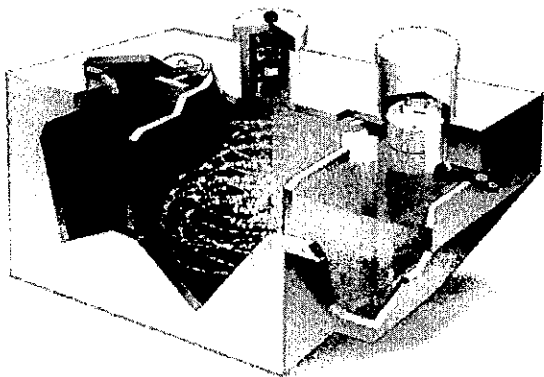

### **PERFORMANCE THAT PROTECTS THE ENVIRONMENT!**

**7 mg/L NITRATE  
12 mg/L TOTAL NITROGEN  
4 mg/L CBOD<sub>5</sub>  
9 mg/L TSS**



### **SINGULAIR® TNT FEATURES**

- Precast concrete tank or high density polyethylene tank
- Low electrical usage
- Surge flows equalized
- No chemicals to add
- Lifetime warranty and exchange
- Sold and serviced by local distributors
- Made in the U.S.A.

***norweco***®

*Engineering the future of water  
and wastewater treatment*

220 REPUBLIC STREET  
NORWALK, OHIO, USA 44857-1156  
TELEPHONE (419) 668-4471  
FAX (419) 663-5440  
email@norweco.com  
www.norweco.com

# **norweco®**

## **SINGULAIR® BIO-KINETIC®**

WASTEWATER TREATMENT SYSTEM WITH SERVICE PRO® CONTROL CENTER

# **MODELS 960 AND TNT® OWNER'S MANUAL**

### **INTRODUCTION**

The Singulair system is the finest equipment available and utilizes the most up-to-date wastewater treatment technology. It is a sound investment that protects you and the environment. Please take the time to familiarize yourself with the contents of this manual.

### **HOW THE SINGULAIR® SYSTEM WORKS**

Developed to serve homes and small businesses beyond the reach of city sewers, the Singulair system employs the extended aeration process. Similar to the treatment method used by most municipal wastewater treatment facilities, this process involves a natural, biological breakdown of the organic matter in wastewater.

Wastewater enters the pretreatment chamber where anaerobic bacterial action combines with the effects of gravity to precondition the waste before it flows into the aeration chamber. Once in the aeration chamber, aerobic bacteria utilize the organic matter in the wastewater to biologically convert the waste into stable substances. Following aeration, flow is transferred to the clarification chamber where the effects of gravity settle out biologically active material. The Bio-Static sludge return, located in the clarification chamber, creates hydraulic currents that gently transfer settled particles back to the aeration chamber. As clarified liquids pass through the Bio-Kinetic system, they are filtered, settled and flow equalized. As a result, complete pretreatment, aeration, clarification and final filtration are assured. The Singulair system reliably protects you, your property and the environment.

### **FEATURES AND ADVANTAGES**

Singulair tanks are reinforced precast concrete, manufactured by the licensed Norweco distributor. Internal walls and baffles are cast-in-place to insure uniformity and maximum strength. Risers and access covers are either heavy duty plastic or concrete construction. All components within the system that will contact the wastewater are constructed entirely of molded plastic, stainless steel or rubber.


The Singulair aerator is powered by a 1725 RPM, 115 volt, 60 hertz, single-phase, fractional horsepower motor. It is the only electrically powered component in the Singulair

system. The aerator has been designed specifically for use in the Singulair system. It costs less to operate and consumes fewer kilowatt hours of electricity than most major appliances.

Singulair aerators are supplied with a Service Pro control center with MCD technology. The NEMA rated control center contains a power switch and time clock that control aerator operation. The local distributor's name, address and telephone number are displayed on the control center cover.

All system controls and necessary owner information are conveniently located at your fingertips.

Non-mechanical flow equalization and final filtration are accomplished within the Singulair tank by the Bio-Kinetic system. This revolutionary device is installed in the clarification chamber and connected to the system outlet. Optional chlorination and dechlorination may be included in the Bio-Kinetic system if required. All Singulair components work together to assure complete pretreatment, aeration, clarification and final filtration.

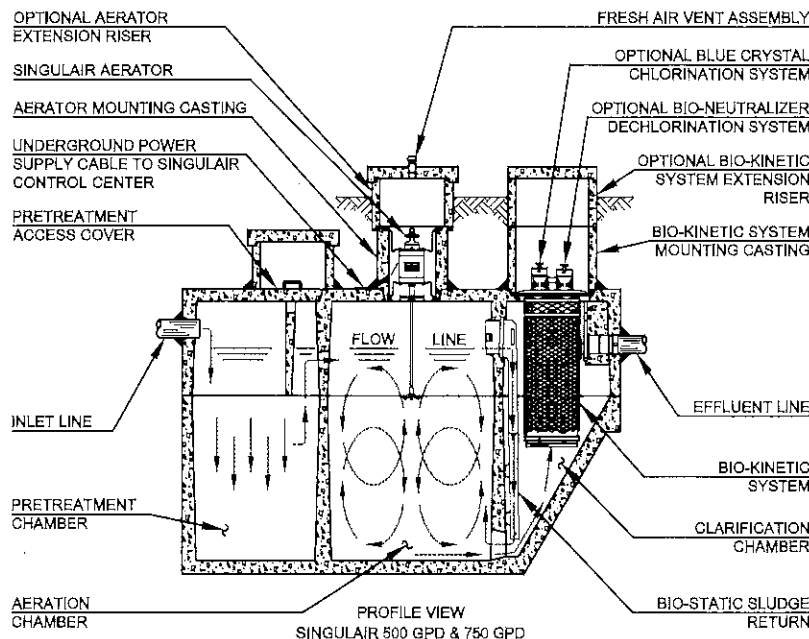



## SINGULAIR® SYSTEM PERFORMANCE

Rivalling the performance of the most advanced wastewater treatment plants in the world, the Singulair system complies with USEPA wastewater treatment guidelines for secondary treatment systems and meets all requirements of NSF/ANSI Standard 40. In ecologically sensitive areas, the most stringent effluent standards are 10 mg/L CBOD and 10 mg/L TSS. Rated Class I after successfully completing the 6 month Standard 40 test protocol, the Model 960 system averaged effluent of 6 mg/L CBOD and 10 mg/L TSS. The Model TNT system averaged effluent of 4 mg/L CBOD, 9 mg/L TSS and 12 mg/L Total Nitrogen and met all requirements of NSF/ANSI Standard 245.

## OPERATIONAL REQUIREMENTS

The Singulair system is designed to treat only domestic wastewater. Domestic wastewater is defined as the waste generated from a typical residence. This includes flows originating from: bathtubs, clothes washers, dishwashers, drinking fountains, water coolers, food grinders, kitchen sinks, lavatories, mop basins, service sinks, shower stalls, sinks, wash sinks, water closets and whirlpool baths. While the use of bio-degradable detergents is recommended, the Singulair system has been designed to handle any reasonable amount of bathroom, kitchen or laundry waste. However, some care should be exercised to insure that non-biodegradable and/or toxic materials are not disposed of via the domestic wastewater plumbing. Do not use the plumbing system for disposal of lint, cooking grease, scouring pads, diapers, sanitary napkins, cotton balls, cotton swabs, cleaning rags, dental floss, strings, cigarette filters, rubber or plastic products, paints and thinning agents, gasoline, motor oil, drain cleaners or other harsh chemicals. These items could plug portions of the plumbing and/or adversely affect system performance. Never connect roofing down spouts, footer drains, sump pump piping, garage and basement floor drains or water softener backwash to the domestic wastewater plumbing or the treatment system. Water softener backwash will interfere with biological treatment and must be disposed of separately.

## ELECTRICAL REQUIREMENTS


Each Singulair control center must be wired to a dedicated 115 VAC, single-phase circuit at the main electrical service panel. A 15 amp circuit is recommended (10 amp minimum). A pictorial wiring diagram is provided inside the control center enclosure. All electrical work must be performed in accordance with the requirements of the National Electrical Code and all applicable local codes. Electrical connections should be made only by a qualified electrician following proper procedures and using safe tools.

**CAUTION: Any time service is required, first shut off the dedicated circuit breaker in the main electrical service panel. Next, shut off the power switch in the Singulair control center. Failure to do so could result in personal injury or equipment damage.**

## SINGULAIR® AERATOR

The aerator has been specifically designed for use in the Singulair system and includes special alloy and molded plastic parts to prolong aerator life. Aerator bearings are pre-lubricated and sealed. Singulair aerators are installed in a concrete mounting casting above the aeration chamber. Fresh air enters the aerator through four intake ports located under the aerator handle. The air is drawn down the hollow aspirator shaft where it is introduced below the liquid surface. Only the molded plastic aspirator and the lower portion of the stainless steel aspirator shaft are submerged.

The aerator is not designed to run under water and will automatically shut off if a high water condition occurs. If the liquid rises to the level of the foam restrictor, the control center will shut off power to the aerator. Next, an automatic diagnostic sequence begins, as outlined in the section titled "Service Pro Control Center".

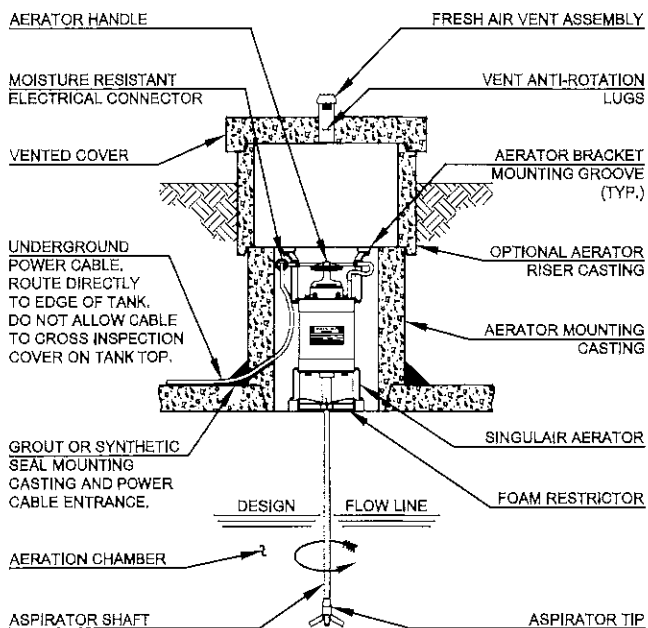


Each Singulair aerator is a precision engineered electro-mechanical device. Do not remove it from its installed position. Do not attempt any type of repair. Contact your Singulair service provider if service is needed. Unauthorized tampering or repair will void important provisions of the limited warranty and exchange program.

## FRESH AIR VENTING SYSTEM

An aerator vent assembly is cast into the concrete access cover above each aerator. The vent assembly supplies fresh air to the aerator, which is drawn through the aspirator and into the wastewater. Finished landscaping should be maintained six inches below the top of the vented access cover and graded to drain runoff away from the cover. Do not allow plants, shrubbery, mulch or landscaping of any type to restrict the flow of air to the vent assembly or obstruct the access cover.



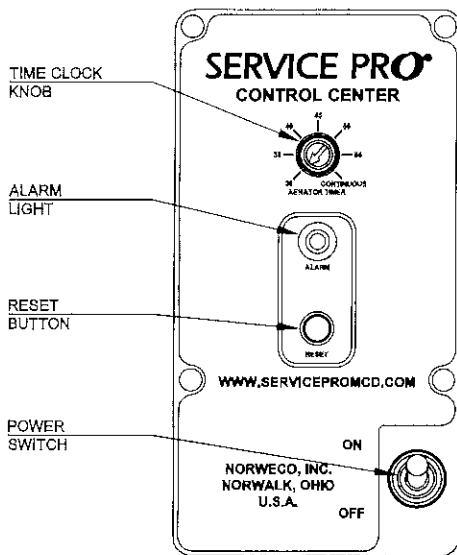

NOTE  
TIME CLOCK  
IS FACTORY  
PRESET TO  
RUN 30 MIN  
PER HOUR

### SERVICE PRO® CONTROL CENTER

Prewired controls are supplied in a sealed NEMA rated enclosure for your safety and the protection of components and wiring. The controls should be located so the alarm light can be seen and the audible alarm heard, while minimizing exposure to harsh weather or conditions that might prevent routine access. If an issue with the aerator is detected, the red alarm light will flash and the control center will attempt to restart the aerator every five minutes for two hours. For an open motor or under current condition, the alarm light will display two short flashes followed by a pause. For an over current condition, the alarm light will flash evenly. If the aerator does not restart after two hours, the audible alarm will sound. To silence the audible alarm and attempt to restart the aerator, push the reset button. If the alarm condition is not resolved, the audible alarm will be silenced for 48 hours, but the alarm light will continue to flash. In this case, contact your service provider. Model 960 systems are supplied with a time clock adjustable in five minute increments up to continuous run. This clock is factory preset to run 30 minutes per hour and should only be adjusted by an authorized Singulair service provider. Model TNT systems are supplied with a non-adjustable time clock.

### SERVICE PRO® MONITORING CENTER

An optional Service Pro MCD control center is available for use with the Singulair system. Designed to connect to a standard telephone line or internet connection, this control center provides MONITORING, COMPLIANCE and DIAGNOSTIC functions complete with telemetry for communication with the Service Pro monitoring center. Once your Service Pro MCD control center is connected to a telephone line or internet connection, commissioned, and covered by a remote monitoring agreement, your service provider will be immediately notified of any alarm condition. The Service Pro monitoring center will automatically log the time and date of alarm conditions, as well as service performed, and store them in your system history record for viewing at [www.servicepromcd.com](http://www.servicepromcd.com).


**NOTE:** The control center regularly communicates with the Service Pro monitoring center using your telephone line or an internet connection. If the control center is using the telephone line when you attempt to place a call, a high pitched digital communication signal will be heard. Hang up all telephones sharing the line and wait a few seconds. This will automatically disconnect the control center and make the line available for use.

### BIO-STATIC® SLUDGE RETURN

Each Bio-Static sludge return is installed in the aeration/clarification chamber wall. Aeration chamber hydraulic currents enter the sludge return(s) and transfer solids from the clarification chamber back to the aeration chamber for additional treatment. The Bio-Static sludge return accomplishes resuspension and return of settled solids without disturbing the contents of the clarification chamber.

### BIO-KINETIC® SYSTEM

Bio-Kinetic systems provide non-mechanical flow equalization through all plant processes. The Bio-Kinetic system contains 3 separate filtration zones, 8 independent settling zones, optional chlorination and dechlorination tablet feed systems and serves as its own chlorine contact chamber. When used with Blue Crystal disinfecting tablets, the performance of the Bio-Kinetic system as a disinfection device is certified to NSF/ANSI Standard 46, Section 11. All components are manufactured from plastic or rubber. Your service provider has the necessary training, tools and equipment for removal and cleaning. If your Bio-Kinetic system is in need of service, contact your service provider. During each semi-annual service inspection, your service provider will remove and clean the Bio-Kinetic system or replace it with a unit from their service stock.

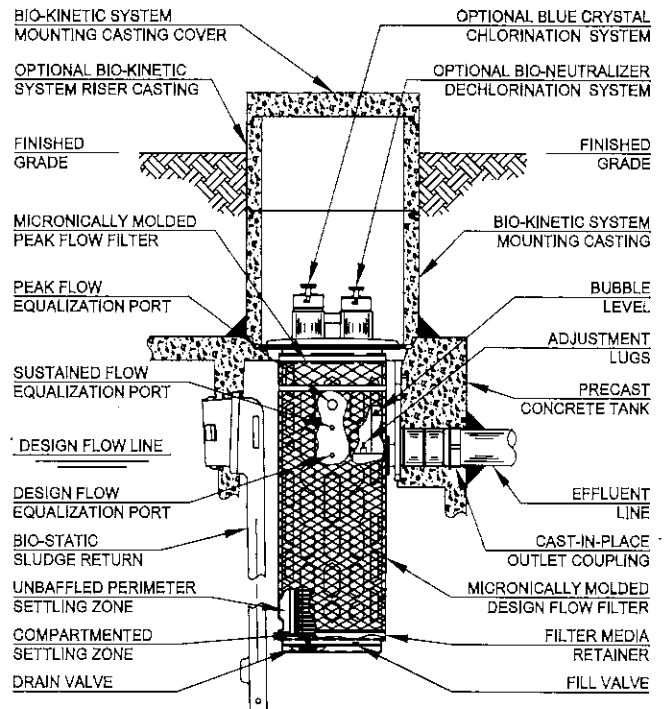

## **NON-MECHANICAL FLOW EQUALIZATION**

The patented design of the Bio-Kinetic system provides non-mechanical flow equalization for the Singulair wastewater treatment plant. Equalization reduces incoming hydraulic surges (e.g. typical shower of 10 minutes duration, bathtub discharge of 5 minutes duration, clothes washer discharge of 2 minutes duration and dishwasher discharge of 2 minutes duration) throughout the system. The flow equalization provided by the Bio-Kinetic system causes wastewater to be held upstream of the final outlet during hydraulic surges, which preserves treatment integrity and enhances system operation. The actual rate of equalization varies and depends upon specific loading patterns and the duration of each flow surge. At the design loading pattern used during the NSF/ANSI Standard 40 performance evaluation, the Singulair system equalizes all flow an average of 50%. As a result, hydraulic surges and periods of high wastewater flow are automatically reduced to protect the environment and all treatment plant processes on a demand use, as needed, basis.

## **BLUE CRYSTAL® RESIDENTIAL DISINFECTING TABLETS**

If local regulations require, an initial supply of Blue Crystal disinfecting tablets will be placed in the Bio-Kinetic system chlorine feed tube(s) at system start-up. Manufactured from calcium hypochlorite, Blue Crystal disinfecting tablets provide effective, economical bacteria killing power. Liquid entering the Bio-Kinetic system contacts the installed Blue Crystal disinfecting tablets, just downstream of the equalization ports. A fully charged feed tube will last an average of six months. During each semi-annual inspection, your Singulair service provider will check system operation and install tablets as needed.

**NOTE:** USEPA guidelines state "On the average, satisfactory disinfection of secondary wastewater effluent can be obtained when the chlorine residual is 0.5 ppm after 15 minutes contact." Retention time must comply with the controlling regulatory jurisdiction.

## **BIO-NEUTRALIZER® DECHLORINATION TABLETS**

In environmentally sensitive areas, regulations may require the use of Bio-Neutralizer dechlorination tablets. Manufactured to chemically neutralize both free and combined chlorine, Bio-Neutralizer dechlorination tablets provide consistent reduction or elimination of chlorine residual without unnecessarily reducing the level of dissolved oxygen in the treatment system effluent. As liquid passes through the final discharge zone of the Bio-Kinetic system, the flow contacts the tablets and residual chlorine is removed from the system effluent. A fully charged feed tube will last an average of six months. During each semi-annual inspection, your Singulair service provider will check system operation and install tablets as needed.

**CAUTION:** *The improper handling of Blue Crystal and Bio-Neutralizer tablets may cause personal injury or property damage. Keep out of the reach of children and do not allow the tablets or feed tubes to contact skin, eyes, or clothing. Blue Crystal tablets may be fatal if swallowed and tablet dust is irritating to the eyes, nose and throat. Do not handle the tablets or feed tubes without first carefully reading the product container label, MSDS information and the handling and storage instructions. Mixing of chemicals may cause a violent reaction leading to fire or explosion. For additional information about Blue Crystal and Bio-Neutralizer tablets contact your Singulair service provider.*

## **ACCESS RISERS AND COVERS**

Concrete access covers are recommended and must be secured after each service visit. A concrete plug should be installed in the access openings of the tank to prevent accidental entry. Access covers should be inspected during service visits and replaced as necessary. If plastic risers and/or covers are utilized, they must be approved for your application and secured as instructed by the manufacturer. Refer to state and local regulations for applicable codes that may apply to your installation.

**DANGER:** *Make sure your service provider does not leave access risers uncovered or partially covered. Failure to properly secure access covers and safety nets could result in bodily injury, illness or death. Do not allow children to play on or around the treatment system. Riser safety nets are available from Norweco for concrete or plastic risers.*


## **NO OWNER MAINTENANCE**

The Singulair system is inspected and serviced by a local, factory-trained service provider, therefore, no owner maintenance is required during the warranty period. The Singulair system does not require pumping as often as a septic tank. Under normal use only the pretreatment chamber should be pumped. How often pumping is necessary depends on system use. The local Singulair service provider will inspect the aeration chamber contents and plant effluent at six month intervals to determine if the pretreatment chamber is discharging excessive solids. Every three years, the pretreatment chamber should be inspected. The pretreatment chamber will normally require pumping at three to five year intervals. Contact your local service provider prior to tank pumping for complete information on removal of equipment, access to individual chambers, coordination of services and proper disposal of tank contents.

If a period of intermittent use, or an extended period of non-use of the system is anticipated, contact your service provider for instructions. Your service provider has detailed service instructions and has been factory-trained in troubleshooting procedures. Contact your service provider if you require service or tank pumping information.

## SINGULAIR® SERVICE PROGRAM

Semi-annual service inspections, at six month intervals for the first two years of system operation, are provided by your local Norweco distributor and are included in the original purchase price of the Singulair system. Costs for travel and labor are not charged to the owner. During an inspection, each mechanical aerator, Bio-Kinetic system and other plant components are serviced as outlined in the Singulair Product Manual and effluent quality is evaluated for color, turbidity, scum overflow and odor. After the initial two year service program is completed, the local service provider will provide continued service at the owner's option. The service program should be renewed by the owner to insure maximum system performance.

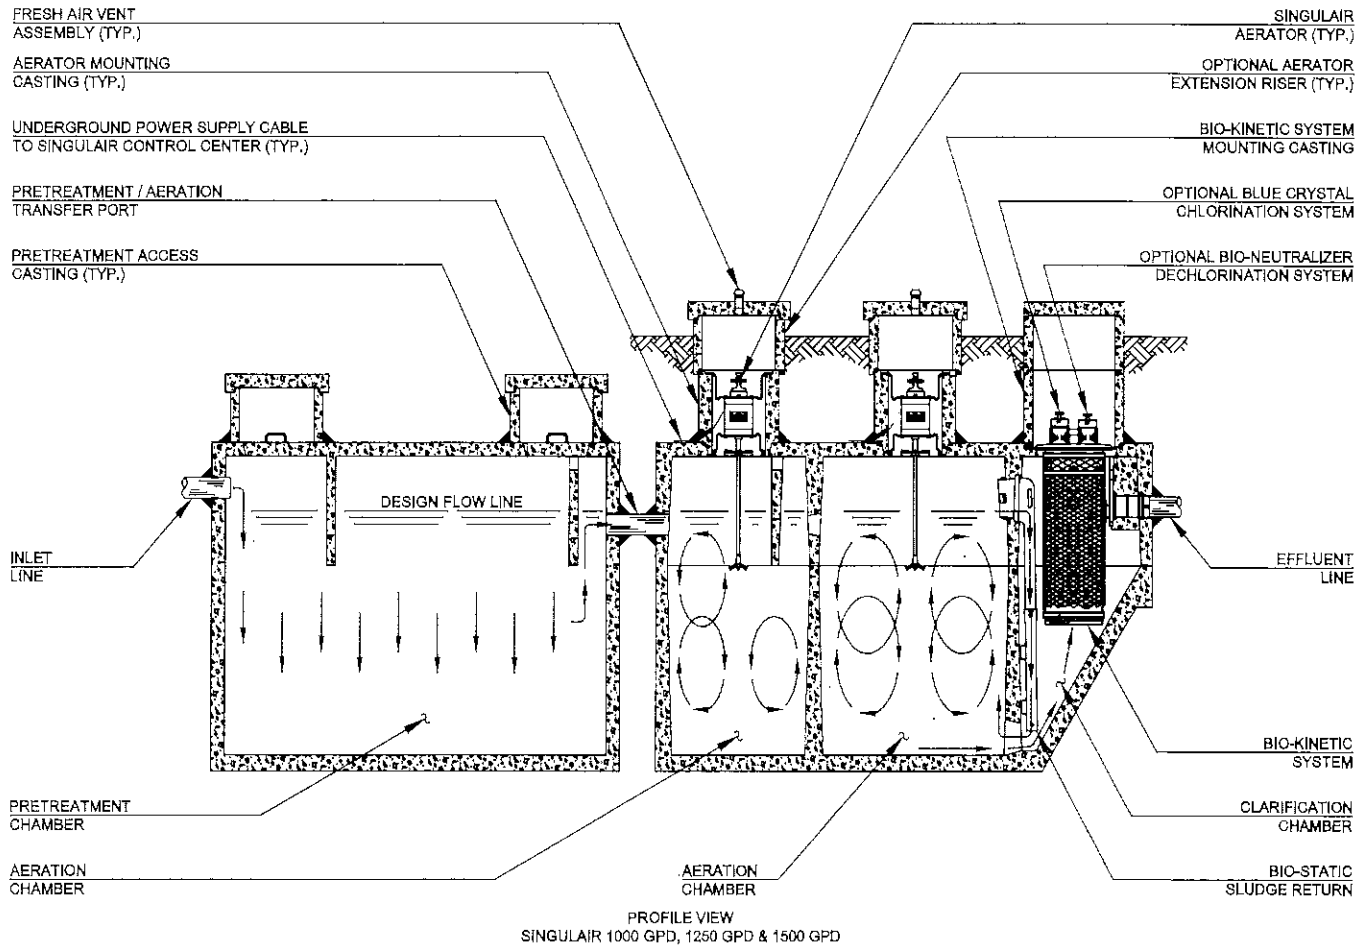

Ask your Singulair service provider about a renewable service contract. If you allow service coverage to expire, you can still obtain the professional assistance of a factory-trained technician. However, these special service calls will be performed on a time and materials basis. Professional service is important to proper system operation and should not be allowed to lapse. Be sure to consider the advantages of a renewable service contract.

The Singulair service provider will perform the following services during each service inspection:

- ✓ Check aerator operation
- ✓ Check aerator power consumption
- ✓ Check aerator air delivery
- ✓ Clean stainless steel aspirator shaft
- ✓ Clean aspirator tip
- ✓ Clean fresh air vent in concrete cover
- ✓ Inspect aeration chamber contents
- ✓ Check operation of control center
- ✓ Adjust time clock when required
- ✓ Remove the Bio-Kinetic system
- ✓ Scrape the clarification chamber
- ✓ Inspect the Bio-Static sludge return
- ✓ Inspect outlet coupling
- ✓ Install a clean Bio-Kinetic system
- ✓ Fill Blue Crystal feed tube
- ✓ Fill Bio-Neutralizer feed tube
- ✓ Inspect effluent quality
- ✓ Inspect outlet line
- ✓ Inspect ground water relief point
- ✓ Inspect effluent disposal system
- ✓ Complete 3-part service record
- ✓ Hang owner's record on front door
- ✓ Enter record into [www.servicepromcd.com](http://www.servicepromcd.com)
- ✓ Mail health department notification

**WARRANTY REGISTRATION**

A Warranty Registration Card was included with the Model 206C aerator before it was shipped from the factory. If this card has not been returned to Norweco, complete and mail it immediately. If it is not returned within thirty days of the installation date, the three year limited warranty and lifetime aerator exchange program will begin on the date of component shipment from the factory.

Remove the aerator model number and serial number record card and store it in a safe location with this Owner's Manual for future reference. If it is necessary to call your service provider for service, make note of the information on the control center data plate and the aerator serial number before calling. Warranty and service records are cross-indexed by owner name, aerator serial number or control center serial number. Supplying the aerator serial number and control center serial number with the service request will give the service provider a ready reference so that changes in system ownership will not delay service.

**SINGULAIR® LIMITED WARRANTY**

The Singulair aerator enjoys the distinction of being the only aerator on the market today backed by a lifetime warranty and exchange program. Each Singulair aerator, Service Pro control center, Bio-Kinetic system and any other components manufactured by Norweco, are warranted to be free from defects in material and workmanship, under normal use and service, for a period of three years from the date of purchase. The three year limited warranty is included in the original purchase price of every Singulair system. The comprehensive aerator exchange program offers Singulair owners a lifetime of protection. Owners with a Singulair system may exchange any aerator of any age for a replacement unit at a prorated cost. If the Singulair aerator or Service Pro control center fails, do not use or dismantle the unit. The local, licensed distributor has detailed warranty and exchange information and should be contacted for service or replacement instructions.

**SERVICE PRO® SECURITY LOG IN**

For your convenience, record your [www.servicepromcd.com](http://www.servicepromcd.com) access information here:

<b>User name:</b>	<b>Password:</b>
-------------------	------------------

**SUPPLEMENTAL SERVICE RECORD**

For your reference, please document service performed on the following chart:

DATE	DESCRIPTION



*Engineering the future of water and wastewater treatment*

220 REPUBLIC STREET  
 NORWALK, OHIO, U.S.A. 44867-1166  
 TELEPHONE (419) 668-4471  
 FAX (419) 663-5440  
[www.norweco.com](http://www.norweco.com)

**DISTRIBUTED LOCALLY BY:**

Norweco®, Norweco.com®, Singulair®, Modulair®, Travalair®, Singulair Green®, Ribbit Rivet®, Hydro-Kinetic®, Hydro-Kinetic Bio-Film Reactor®, Evenair®, Lift-Rail®, Microsonic®, Bio-Dynamic®, Bio-Sanitizer®, Bio-Neutralizer®, Bio-Kinetic®, Bio-Static®, Bio-Germ®, Bio-Max®, Bio-Perc®, Blue Crystal®, Phos-4-Fade®, Enviro-C®, ClearCheck®, ChemCheck®, Tri-Max®, Hydra-Max®, Service Pro®, MCD®, TNT®, WASP®, Grease Buster® and "BUSTER" logo® are registered trademarks of Norwalk Wastewater Equipment Company, Inc.

# SINGULAIR®

## OWNER PROTECTION SERVICE PROGRAM

AT NO ADDITIONAL  
OWNER EXPENSE

POSSIBLE  
EXPENSE



A. Regular service inspections conducted at six month intervals throughout the year.



B. Special service inspections as requested by owner.



C. Labor and transportation expenses for travel on regular service inspections.



D. Labor and transportation expenses for travel on special service inspections.



E. Singulair plant maintenance including Bio-Kinetic system service, visual inspection of effluent quality and cleaning of hopper section using squeegee scraper in clarification tank (where applicable).



F. Inspection of outlet line or disposal system (where accessible).



G. Singulair mechanical aerator maintenance including cleaning of the stainless steel aspirator shaft, power consumption check, noise check, and visual inspection for vibration of the unit while in operation.



H. Visual check of Service Pro control center for Singulair unit (when accessible).



I. Labor expenses required at the site to service or repair, or to remove any part of the control center or Singulair mechanical aerator to be returned for factory repair.



J. Labor required at the site to service, repair or reinstall any part of the Service Pro control center or Singulair mechanical aerator returned from factory repair.



K. Service Pro remote monitoring service (where applicable).



L. Freight costs to and from the factory and lifetime exchange program costs when factory repairs are needed.



M. Costs for replacing missing parts or repairing equipment not eligible for the lifetime exchange program.

**CONTRACT FEE \$ \_\_\_\_\_**

(To Be Paid In Advance By Owner)

**OWNER ACCEPTANCE**

NAME: \_\_\_\_\_

ADDRESS: \_\_\_\_\_

EMAIL: \_\_\_\_\_

DATE: \_\_\_\_\_

**NORWECO SINGULAIR DISTRIBUTOR**

NAME: \_\_\_\_\_

BY: \_\_\_\_\_

DATE: \_\_\_\_\_

**COMPLETE AND RETURN TO YOUR LOCAL NORWECO DISTRIBUTOR**



To:

Local Dist.

Place Stamp  
Here  
Post Office Will  
Not Deliver  
Without Proper  
Postage

# norweco<sup>®</sup> SINGULAIR<sup>®</sup>

## SERVICE CONTRACT

OWNER NAME: \_\_\_\_\_

ADDRESS: \_\_\_\_\_ EFFECTIVE DATE: \_\_\_\_\_ 20 \_\_\_\_\_

(street)

EXPIRATION DATE: \_\_\_\_\_ 20 \_\_\_\_\_

(city)

(state)

(zip)

TELEPHONE NO.: (\_\_\_\_) \_\_\_\_\_ SYSTEM INSTALLED ON: \_\_\_\_\_ 20 \_\_\_\_\_

DIRECTIONS: \_\_\_\_\_

This one year service contract for the Singulair Bio-Kinetic wastewater treatment system located at the site described above, is intended to enable the owner to economically obtain regular service inspections for the Singulair unit, as well as non-scheduled or special service that may be required by a qualified technician. When this contract is in force, the owner will not be charged for any routine service labor. Under the terms of this service agreement, a technician will regularly inspect the plant at six month intervals. It will also be inspected following each special owner service request within a 48-hour period. If improper system operation cannot be remedied at time of inspection, the owner will be notified in writing of an estimated date of correction. The contract shall remain in effect for a period of one year, as specified in the effective and expiration dates listed above.

# WASTEWATER TECHNOLOGY

---

**NSF/ANSI Standard 245 - Wastewater Treatment Systems – Nitrogen Reduction**

**Final Report:**

**Norweco, Inc.  
Singulair Model TNT-500 Wastewater Treatment System  
05/06/2015/060**



NSF International  
789 N. Dixboro Road  
PO Box 130140  
Ann Arbor, Michigan 48113-0140 USA

**Evaluation Report:  
Norweco, Inc.  
Singular Model TNT-500  
Wastewater Treatment System**

**Under the provisions of NSF/ANSI Standard 245  
Wastewater Treatment Systems – Nitrogen Reduction**

**November 2007**



## EXECUTIVE SUMMARY

Testing of the Norweco Singulair Model TNT-500 was conducted under the provisions of NSF/ANSI Standard 245 for Wastewater Treatment Systems – Nitrogen Reduction (March 2007). NSF/ANSI Standard 245 was developed by the NSF Joint Committee on Wastewater Technology.

The performance evaluation was conducted at the NSF Wastewater Technology Test Facility located in Waco, Texas using predominantly residential wastewater diverted from the Waco municipal wastewater collection system. The evaluation consisted of sixteen weeks of dosing at design flow, seven and one half weeks of stress testing, and two and one half weeks of dosing at design flow. Dosing was initiated on June 27, 2005. After a three-week start up period, sample and data collection for the test was officially started on July 18, 2005. Sampling started in the summer and continued into the winter, covering a range of operating temperatures.

Over the course of the evaluation, the average influent Total Nitrogen was 38 mg/L, ranging between 15 and 58 mg/L. The Norweco Singulair Model TNT-500 produced an average effluent Total Nitrogen of 12 mg/L, which results in a 68% reduction in the influent Total Nitrogen.

The Norweco Singulair Model TNT-500 was previously certified as an NSF/ANSI Standard 40 Class I system, producing an average effluent CBOD<sub>5</sub> of 3 mg/L (ranging between <2 and 11 mg/L) and an average effluent total suspended solids was 8 mg/L (ranging between <2 mg/L and 48 mg/L). The effluent successfully met the performance requirements established by NSF/ANSI Standard 40 for Class I effluent.

The maximum 7-day arithmetic mean was 15 mg/L for CBOD<sub>5</sub> and 30 mg/L for total suspended solids, both below the allowed maximums of 40 and 45 mg/L respectively. The maximum 30-day arithmetic mean was 7 mg/L for CBOD<sub>5</sub> and 17 mg/L for total suspended solids, both below the allowed maximums of 25 mg/L and 30 mg/L respectively. The effluent pH during the entire evaluation ranged between, 6.3 and 7.4, within the required range of 6.0 to 9.0. The Model TNT-500 met the requirements for noise levels (less than 60 dbA at a distance of 20 feet), color, threshold odor, oily film and foam.

Over the course of the Standard 245 evaluation the influent averaged 240 mg/L BOD<sub>5</sub>, 270 mg/L TSS, 38 mg/L Total Nitrogen, 310 mg/L alkalinity, 28 °C and a median pH of 6.7, meeting the requirements of the Standard. The effluent averages over the course of the test were 3 mg/L CBOD<sub>5</sub>, 8 mg/L TSS and 12 mg/L Total Nitrogen, representing a 68% reduction, and the effluent pH ranged between 6.3 and 7.4 SU. The effluent values met the requirements of the Standard.

## PREFACE

Performance evaluation of nitrogen reduction for residential wastewater treatment systems is achieved within the provisions of NSF/ANSI Standard 245: Wastewater Treatment Systems – Nitrogen Reduction (March 2007), prepared by the NSF Joint Committee on Wastewater Technology and adopted by the NSF Board of Trustees.

Conformance with the Standard is recognized by issuance of the NSF Mark. This is not to be construed as an approval of the equipment, but a certification of the data provided by the test and an indication of compliance with the requirements expressed in the Standard.

Systems conforming to Standard 245 are classified as having met the requirements of the Standard. Permission to use the NSF Mark is granted only after the equipment has been tested and found to perform satisfactorily, and all other requirements of the Standard have been satisfied. Continued use of the Mark is dependent upon evidence of compliance with the Standard and NSF General and Program Specific Policies, as determined by periodic reinspection of the equipment at the factory, distributors and reports from the field.

NSF Standard 245 requires the testing laboratory to provide the manufacturer of a residential wastewater treatment system, a report including significant data and appropriate commentary relative to the performance evaluation of the system. NSF policy specifies provision of performance evaluation reports to appropriate state regulatory agencies at publication. Subsequent direct distribution of the report by NSF is made only at the specific request or by permission of the manufacturer.


The following report contains results of the entire testing program, a description of the system, its operation and key process control equipment, and a narrative summary of the test program, including test location, procedures and significant occurrences. The system represented herein reflects the equipment authorized to bear the NSF Mark.

## CERTIFICATION

NSF International has determined by performance evaluation under the provisions of NSF/ANSI Standard 245 (March 2007) that the Singlair Model TNT-500 manufactured by Norweco, Inc. has fulfilled the requirements of NSF/ANSI Standard 245. The Singlair Model TNT-500 has therefore been authorized to bear the NSF Mark so long as Norweco, Inc. continues to meet the requirements of Standard 245 and the NSF General and Program Specific Policies.

General performance evaluation and stress tests were performed at the NSF Wastewater Technology Test Facility located in Waco, Texas. The raw wastewater used in the test was municipal wastewater. The characteristics of the wastewater during the test are included in the tabulated data of this report.

The observations and analyses included in this report are certified to be correct and true copies of the data secured during the performance tests conducted by NSF on the wastewater treatment system described herein. The manufacturer has agreed to present the data in this certification in its entirety whenever it is used in advertising, prospectuses, bids or similar uses.



Thomas J. Bruursema  
General Manager  
Wastewater Treatment Unit Certification



Thomas Stevens  
Technical Manager  
Federal Programs

## TABLE OF CONTENTS

	<u>Page</u>
Executive Summary .....	2
Preface.....	3
Certification .....	4
Table of Contents.....	5
1.0 Process Description .....	6
2.0 Performance Evaluation .....	6
2.1 Description of Unit Evaluated .....	6
2.2 Test Protocol .....	7
2.3 Test Chronology .....	8
3.0 Analytical Results .....	9
3.1 Summary .....	9
3.2 Biochemical Oxygen Demand .....	11
3.3 Total Suspended Solids .....	12
3.4 pH.....	13
3.5 Temperature.....	13
3.6 Dissolved Oxygen .....	13
3.7 Alkalinity .....	14
3.8 TKN .....	15
3.9 Ammonia-N .....	16
3.10 Nitrite/nitrate-N .....	16
3.11 Total Nitrogen.....	17
4.0 References .....	18

### Appendices

- Appendix A - Plant Specifications and Drawings
- Appendix B - Standard 245 Section 8 - Performance testing and evaluation
- Appendix C - Analytical Results – BOD<sub>5</sub>, CBOD<sub>5</sub>, TSS, pH and Temperature
- Appendix D - Analytical Results – Nitrogen Analyses
- Appendix E - Owner's Manual

## 1.0 PROCESS DESCRIPTION

The Singlair Model TNT-500 wastewater treatment system utilizes extended aeration activated sludge and filtration processes to achieve treatment. In the activated sludge process, microorganisms remove soluble contaminants from the wastewater, utilizing them as a source of energy for growth and production of new microorganisms. The organisms tend to be flocculent and form clumps, or floc, that physically entrap particulate organic matter. The organic matter is attacked by extracellular enzymes that solubilize the solids to make them available to the microorganisms as a food source. The conversion of the organic matter from soluble to biological solids allows the removal of the organic matter by settling of the solids in the treatment process.<sup>2</sup>

Extended aeration is a modification of the activated sludge process in which the microorganisms are allowed to remain in the treatment process for long periods of time. The large inventory of biological solids in the process provides a buffer for shock loading of organic matter. The long aeration period allows for the organisms in the system to consume themselves, reducing the total amount of solids produced by the treatment process.

The organisms responsible for the degradation of the organic matter are primarily aerobic bacteria. As such, the transfer of oxygen into the wastewater by an aeration system is critical to the treatment process. The aeration system also provides for the mixing of the wastewater and organisms to provide contact between the organic contaminants in the wastewater and the organisms that provide for removal of the contaminants. For this reason, an activated sludge process is referred to as a suspended growth system. The Norweco Singlair Model TNT-500 wastewater treatment system incorporates a timed aeration cycle, providing an environment for the development of facultative bacteria to assist in the reduction of total nitrogen.

## 2.0 PERFORMANCE EVALUATION

### 2.1 Description of Plant Evaluated

The Norweco Singlair Model TNT-500 system tested in this evaluation has a rated hydraulic capacity of 500 gallons per day (gpd). Specifications and drawings are included in Appendix A. The system achieves treatment by a flow equalized, flow through process, starting with a pretreatment chamber, followed by an aeration chamber provided with an infused air system operating on a timed run cycle. Settling is accomplished in a clarification chamber following the aeration chamber. A Bio-Kinetic<sup>®</sup> System, located in the clarification chamber, provides flow equalization, final filtration, and settling prior to effluent discharge.

The Singlair Model TNT-500 system is made up of four treatment stages. Incoming wastewater flows into the pretreatment chamber for removal of easily separated solids. Anaerobic bacteria break down the solids and begin to solubilize organic particles. A tee at the chamber outlet provides for retention of floating solids in the chamber. Wastewater is transferred from the pretreatment chamber by hydraulic displacement into the aeration chamber through the transfer tee.

The aeration chamber provides a retention time of at least 24 hours at design flow. Aeration is achieved by release of air through a rapidly spinning aspirator submerged in the aeration chamber. The spinning of the

aspirator in the wastewater draws air down the aspirator shaft, releasing small bubbles that cause the wastewater to rise in the chamber, establishing a circulation pattern. The infused air provides oxygen for the aerobic bacteria, as well as mixing of the wastewater with the bacteria.

The aerator run cycle is controlled by the use of a time clock. The six month test was performed at full design load (500 gpd), with the aerator running for 60 minutes on and 60 minutes off.

From the aeration chamber, the wastewater passes by hydraulic displacement into the clarification chamber through a cast-in-place transfer port located at the bottom of the wall between the aeration chamber and the clarification chamber. Initial separation of solids takes place in the clarification chamber. The quiescence provided in the clarification chamber allows gravity settling of the solids and sludge. Three of the four side walls in the clarifier are sloped to form a hopper. These 60° sloped walls direct material down to the transfer opening. A stationary sludge return device, located in the clarifier, utilizes hydraulic currents to return settled activated sludge from the bottom of the clarifier back to the aeration chamber.

A Bio-Kinetic® System, connected to an outlet coupling cast in the concrete tank, provides the final treatment stage. The Bio-Kinetic® System is located in the center of the clarification chamber and extends down into the chamber. The outlet coupling allows for installation and service of the System from the ground level. The System is made up of three filtration zones, seven settling zones and three pairs of flow equalization ports. Wastewater from the aeration chamber flows up through the clarification chamber to the Bio-Kinetic® System where it passes through the design flow filter media that extends around the baffled perimeter settling zone. The design flow filter media provides for initial filtration and entrapment of solids. Peak flow filter media is located above the design flow media. Flow control through the System is provided by two design flow equalization ports and two sustained flow equalization ports. The ports become submerged orifices as the water level in the chamber rises, equalizing the flow rate through the entire plant. Extreme hydraulic flows are handled through a pair of peak flow equalization ports, which act to return the plant to normal operating levels. All flow passing through the flow equalization ports drops to a deck that directs flow through an optional chlorine tablet feeder and vertically downward to the unbaffled perimeter settling zone. From this area, flow is displaced to the contact basin and then onto the baffled chamber plates. A continuous baffle on each of 42 plates acts as a kinetic filtration weir with a 1/16-inch opening provided between plates. A larger open area immediately downstream of the baffle provides for settling and storage of solids. The clarified water then passes to an effluent stilling well, final settling zone, adjustable outlet weir, optional dechlorination tablet feeder and discharge zone.

## 2.2 Test Protocol

Section 8 of NSF/ANSI Standard 245 protocol, "Performance Testing and Evaluation", is included in Appendix B. Start up of the plant was accomplished by filling the plant with 2/3 water and 1/3 raw sewage. The plant was then dosed at the design loading rate of 500 gpd as follows:

- 6 a.m. to 9 a.m. - 35 percent of daily rated capacity (175 gallons)
- 11 a.m. to 2 p.m. - 25 percent of daily rated capacity (125 gallons)
- 5 p.m. to 8 p.m. - 40 percent of daily rated capacity (200 gallons)

Dosing was accomplished by opening an electrically actuated valve to feed wastewater to the test plant. Five gallon doses were spread uniformly over each dosing period to comprise the total dose volume for the period.

After a start up period (up to three weeks at the manufacturer's discretion), the plant is subjected to the following loading sequence:

Design loading	-	16 weeks
Stress loading	-	7.5 weeks
Design loading	-	2.5 weeks

During the design loading periods, flow proportioned 24-hour composite influent and effluent samples are collected three times per week. The influent samples are analyzed for five-day biochemical oxygen demand (BOD<sub>5</sub>), total suspended solids (TSS), alkalinity, total Kjeldahl nitrogen (TKN), and ammonia-N. The effluent samples are analyzed for carbonaceous five-day biochemical oxygen demand (CBOD<sub>5</sub>), TSS, alkalinity, TKN, ammonia-N and nitrite/nitrate-N concentrations. Onsite determinations of the influent and effluent pH, temperature and dissolved oxygen are made five days per week on grab samples.

Stress testing is designed to evaluate how the plant performs under non-ideal conditions, including varied hydraulic loadings and electrical or system failure. The test sequence includes (1) Wash Day stress, (2) Working Parent stress, (3) Power/Equipment Failure stress, and (4) Vacation stress. Detailed descriptions of the stress sequences are shown in Appendix B.

During the stress test sequences, 24-hour composite samples are collected twice during each stress recovery period (the week following completion of each of the stress simulations described). The analyses and onsite determinations completed on the samples are the same as described for the design load testing. Each stress is followed by seven consecutive days of dosing at design rated capacity before beginning the next stress test. Sample collection is initiated twenty-four hours after completion of Wash Day, Working Parent and Vacation stresses, and beginning 48 hours after completion of the Power/Equipment Failure stress.

In order for the system to successfully pass the Standard 245 evaluation:

- (1) CBOD<sub>5</sub>: The average of all effluent samples shall not exceed 25 mg/L.
- (2) TSS: The average of all effluent samples shall not exceed 30 mg/L.
- (3) Total Nitrogen: The average total nitrogen concentration of all effluent samples shall be less than 50% of the average total nitrogen concentration of all influent samples.
- (3) pH: Individual effluent values shall remain between 6.0 and 9.0 SU.

### 2.3 Test Chronology

The system was installed under the direction of the manufacturer on January 21, 2005. The infiltration/exfiltration test, during which the entire system was tested for leaks, was completed on January 22, 2005. The unit was filled with 2/3 fresh water and 1/3 raw sewage, and dosing was initiated at the rate of 500 gallons per day beginning June 27, 2005. Sampling was initiated on July 18, 2005. The stress test sequence was started on November 7, 2005 and ended on December 28, 2005. Testing was completed on January 27, 2006.

### **3.0 ANALYTICAL RESULTS**

#### **3.1 Summary**

Chemical analyses of samples collected during the evaluation were completed using the procedures in *Standard Methods for the Examination of Water and Wastewater*<sup>3</sup> and USEPA methods<sup>4</sup>. Copies of the data generated during the evaluation are included in Appendix C. Results of the chemical analyses and onsite observations and measurements made during the design loading period of the evaluation are summarized in Table I. Data collected during stress loading and recovery is not included in the overall averages, as outlined in Section 8.4.3 of the Standard. For a complete summary of the results, please see Appendix C.



TABLE I. SUMMARY OF ANALYTICAL RESULTS

	<u>Average</u>	<u>Std. Dev.</u>	<u>Minimum</u>	<u>Maximum</u>	<u>Median</u>	<u>Interquartile Range</u>
Biochemical Oxygen Demand (mg/L)						
<i>Influent (BOD<sub>5</sub>)</i>	240	74	85	380	230	190 - 300
<i>Effluent (CBOD<sub>5</sub>)</i>	3	2	<2	11	<2	2 - 4
Total Suspended Solids (mg/L)						
<i>Influent</i>	270	130	42	680	250	190 - 310
<i>Effluent</i>	8	9	<2	48	5	3 - 10
pH						
<i>Influent</i>	-	-	5.9	7.3	6.7	6.5 - 7.0
<i>Effluent</i>	-	-	6.3	7.4	6.9	6.8 - 7.0
Temperature (°C)						
<i>Influent</i>	28	3	21	30	29	28 - 30
<i>Effluent</i>	27	4	19	31	28	24 - 30
Dissolved Oxygen (mg/L)						
<i>Effluent</i>	1.9	0.5	0.8	3.4	1.9	1.5 - 2.1
Alkalinity (mg/L)						
<i>Influent</i>	310	38	200	410	300	280 - 320
<i>Effluent</i>	210	32	160	280	200	190 - 230
Total Kjeldahl Nitrogen						
<i>Influent</i>	38	10	15	58	38	30 - 44
<i>Effluent</i>	3.8	3.1	0.5	14	2.8	1.9 - 3.9
Ammonia-N						
<i>Influent</i>	19	4.8	10	30	18	15 - 22
<i>Effluent</i>	2.2	2.1	0.1	10	1.5	2.0 - 1.1
Nitrite/nitrate-N (mg/L)						
<i>Effluent</i>	8.3	4.1	1.5	20	8.0	3.9 - 12
Total Nitrogen						
<i>Influent</i>	38	10	15	58	38	30 - 44
<i>Effluent</i>	12	4.5	4.8	25	11	8.4 - 15

Notes: The median is the point where half of the values are greater and half are less.

The interquartile range is the range of values about the median between the upper and lower 25 percent of all values.

Alkalinity data covers the period from July 18 through October 14 only.

Criteria for evaluating the analytical results from the testing are described in Section 8.4 of NSF/ANSI Standard 245. Section 8.4.1 of the Standard provides guidance addressing the impact of unusual testing conditions, including system upset, improper sampling, improper dosing, or influent characteristics outside the ranges specified in 8.2.1. This section indicates that an assessment shall be conducted to determine the extent to which these conditions adversely affected the performance of the system. Based on this assessment, specific data points may be excluded from the averages. The median influent pH range is between 6.5 and 9.0. While the median value of 6.7 fell within the range, the influent pH ranged from 5.9 and 7.3 during the evaluation. A review of the data determined that no adverse effect resulted from the pH values falling outside the 6.5 to 9.0 range.

Section 8.4.2 of the Standard addresses catastrophic site problems that may occur including, but not limited to, influent characteristics, malfunctions of test site apparatus and acts of God. If these problems jeopardize the validity of the performance testing, manufacturers shall be given the choice to perform maintenance and reinitiate start up of the test, or have the system brought back to pre-existing conditions with no routine maintenance within 3 wks after the site problem has been identified and corrected. No such conditions were observed during this test.

### 3.2 Biochemical Oxygen Demand

The five-day biochemical oxygen demand (BOD<sub>5</sub>) and carbonaceous five-day biochemical oxygen demand (CBOD<sub>5</sub>) analyses were completed using the EPA Method 405.1. The results of the analyses completed on the samples collected during the testing are shown in Figure 1.

#### *Influent BOD<sub>5</sub>:*

The influent BOD<sub>5</sub> ranged from 85 to 380 mg/L during the evaluation, with an average concentration of 240 mg/L and a median concentration of 230 mg/L. The average influent BOD<sub>5</sub> delivered to the treatment unit was within the influent characteristics defined under Section 8.2.1 of NSF/ANSI Standard 245.

#### *Effluent CBOD<sub>5</sub>:*

The effluent CBOD<sub>5</sub> concentrations ranged from <2 to 11 mg/L over the course of the evaluation, with an average concentration of 3 mg/L. The median effluent CBOD<sub>5</sub> concentration was <2 mg/L.

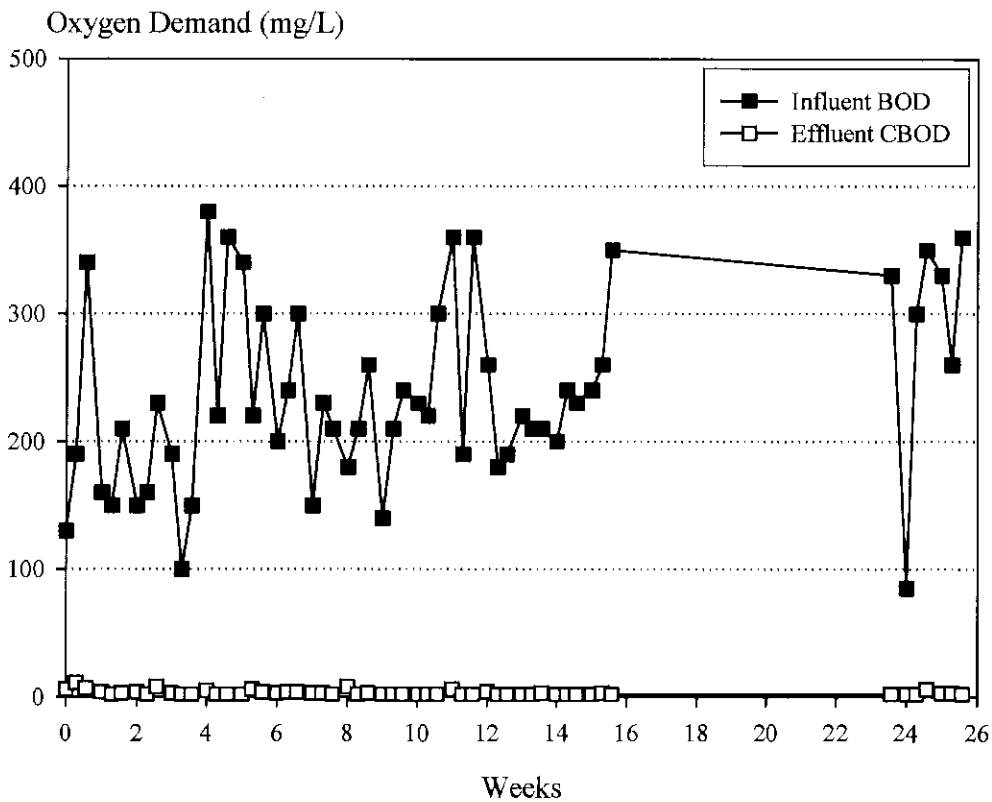


Figure 1. Biochemical Oxygen Demand

### 3.3 Total Suspended Solids

TSS analyses were completed using Methods 209C of *Standard Methods*. The TSS results over the entire evaluation are shown in Figure 2.

#### *Influent TSS:*

The influent TSS ranged from 42 to 680 mg/L during the evaluation, with an average concentration of 270 mg/L and a median concentration of 250 mg/L. The average influent TSS delivered to the treatment unit was within the influent characteristics defined under Section 8.2.1 of NSF/ANSI Standard 245.

#### *Effluent TSS:*

The effluent TSS concentration ranged from <2 to 48 mg/L during the evaluation, with an average concentration of 8 mg/L and a median concentration of 5 mg/L.

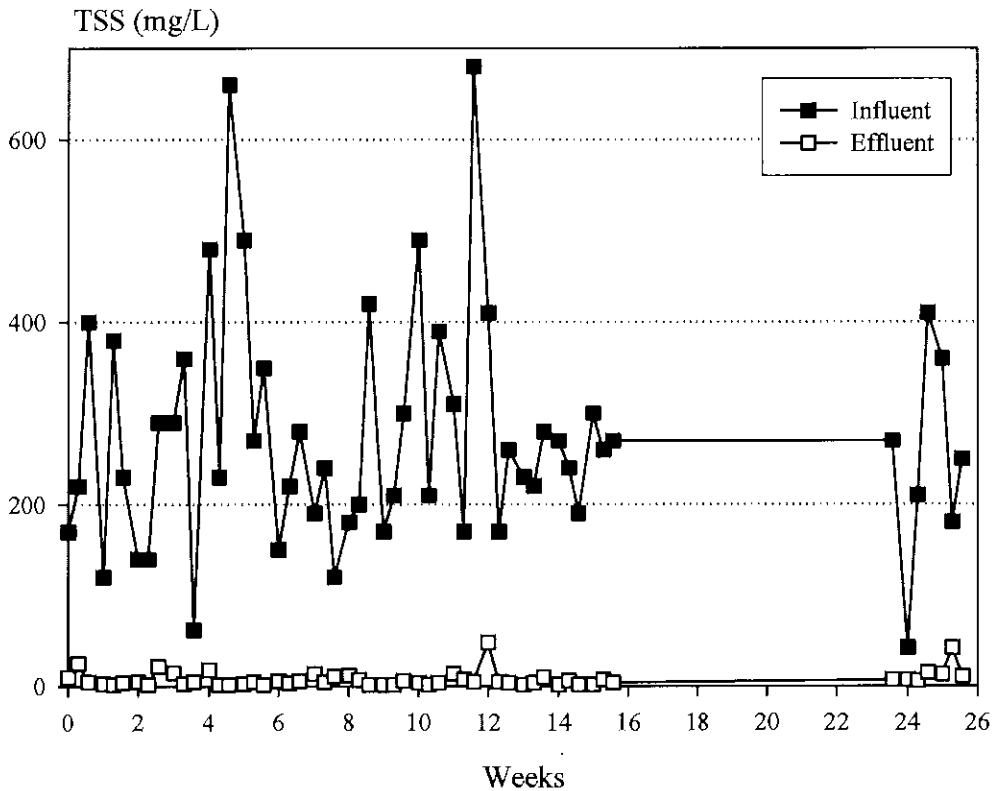


Figure 2. Total Suspended Solids

### 3.4 pH

Over the entire evaluation period, the influent pH ranged from 5.9 to 7.3 (median of 6.7). The effluent pH ranged from 6.3 to 7.4 during the evaluation (median of 6.9); within the 6 to 9 range required by NSF/ANSI Standard 245. The pH data for the evaluation are shown in Appendix C.

### 3.5 Temperature

Influent temperatures over the evaluation period ranged from 21 to 30°C, with an average temperature of 28°C (median of 29°C). The temperature data are shown in Appendix C. The Standard requires that the average influent temperature fall within 10 to 30°C. The average influent temperature was within the characteristics defined under Section 8.2.1 of NSF/ANSI Standard 245.

### 3.6 Dissolved Oxygen

Dissolved Oxygen (DO) was measured in the effluent during the evaluation. The effluent DO ranged between 0.8 to 3.4 mg/L, averaging 1.9 mg/L (median of 1.9 mg/L). All dissolved oxygen data are shown in Appendix C.

### 3.7 Alkalinity

Alkalinity analyses were completed using Method 310.10 from *EPA Methods*. The alkalinity results over the entire evaluation are shown in Figure 3. It should be noted that alkalinity data was taken from July 18, 2006 through October 14, 2006. Sampling was stopped due to a miscommunication with site personnel. While the influent and effluent alkalinities were not collected over the entire test, the range of the samples that were collected were all well within the range required by the Standard, and review of the nitrogen data indicates that alkalinity was not a limiting factor for nitrification in the system.

#### *Influent Alkalinity:*

Over the period during which the influent alkalinity was collected, the influent averaged 310 mg/L, ranging from 200 to 410 mg/L, with a median concentration of 300 mg/L. The influent alkalinity delivered to the treatment unit was within the influent characteristics defined under Section 8.2.1 of NSF/ANSI Standard 245.

#### *Effluent Alkalinity:*

The effluent Alkalinity concentration ranged from 160 to 280 mg/L during the period when alkalinity samples were collected, with an average concentration of 210 mg/L and a median concentration of 200 mg/L.

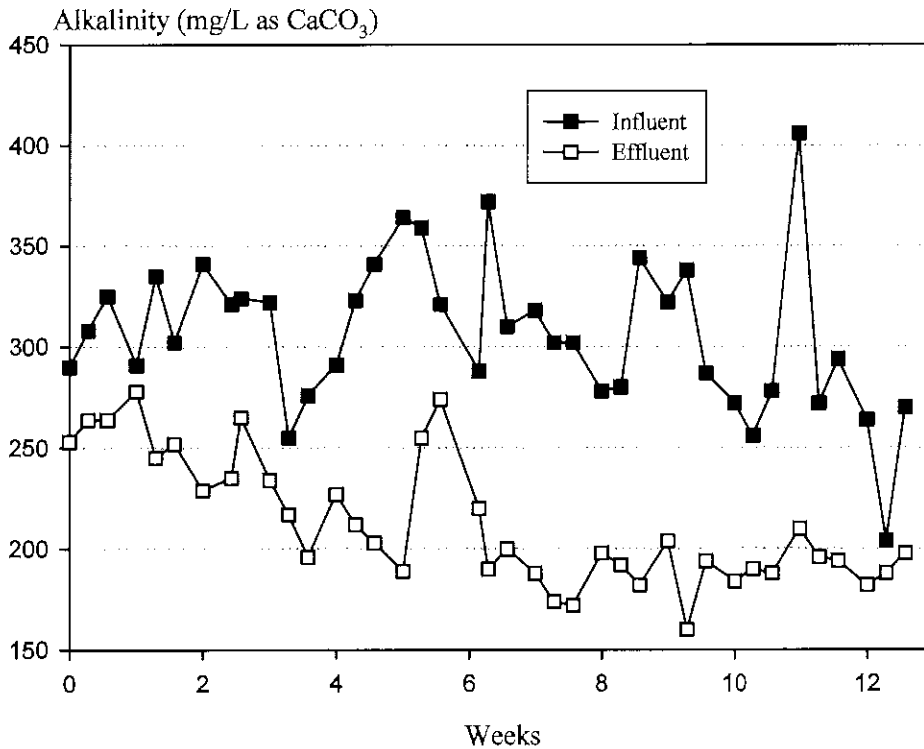


Figure 3: Alkalinity

### 3.8 Total Kjeldahl Nitrogen (TKN)

TKN analyses were completed using Method 351.2 from *EPA Methods*. The TKN results over the entire evaluation are shown in Figure 4.

#### *Influent TKN:*

The influent TKN ranged from 15 to 58 mg/L during the evaluation, with an average concentration of 38 mg/L and a median concentration of 38 mg/L. The influent TKN delivered to the treatment unit was within the influent characteristics defined under Section 8.2.1 of NSF/ANSI Standard 245.

#### *Effluent TKN:*

The effluent TKN concentration ranged from 0.50 to 14 mg/L during the evaluation, with an average concentration of 3.8 mg/L and a median concentration of 2.8 mg/L.

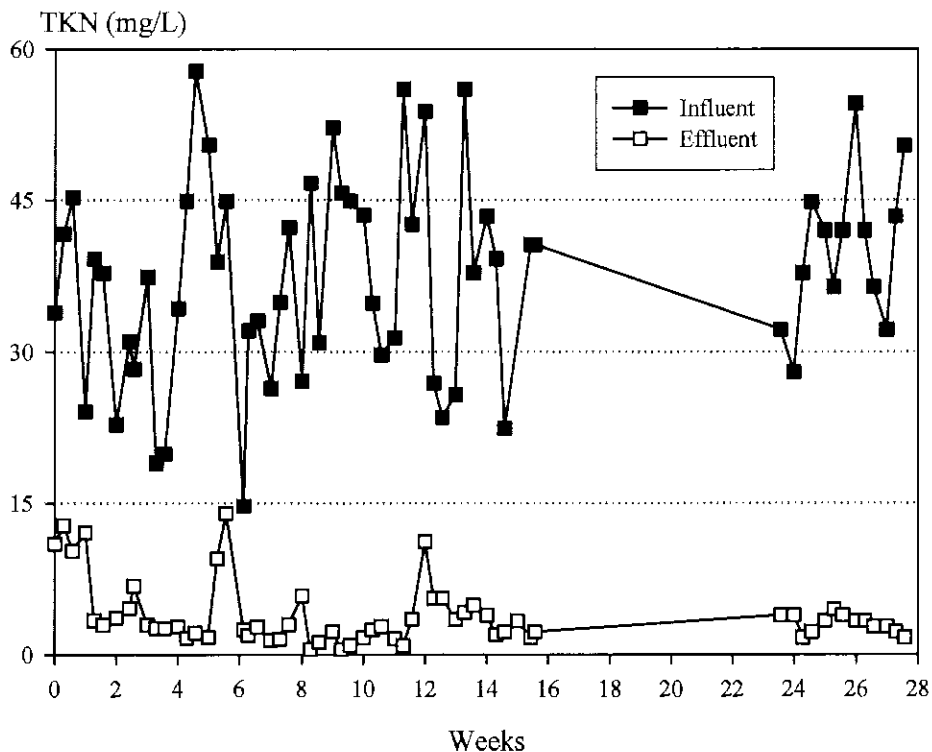


Figure 4: Total Kjeldahl Nitrogen

### 3.9 Ammonia-N

Ammonia-N analyses were completed using Method 350.1 from *EPA Methods*. The Ammonia-N results over the entire evaluation are shown in Figure 5.

#### *Influent Ammonia-N:*

The influent Ammonia-N ranged from 10 to 30 mg/L during the evaluation, with an average concentration of 19 mg/L and a median concentration of 18 mg/L.

#### *Effluent Ammonia-N:*

The effluent Ammonia-N concentration ranged from 0.1 to 10 mg/L during the evaluation, with an average concentration of 2.2 mg/L and a median concentration of 1.5 mg/L.

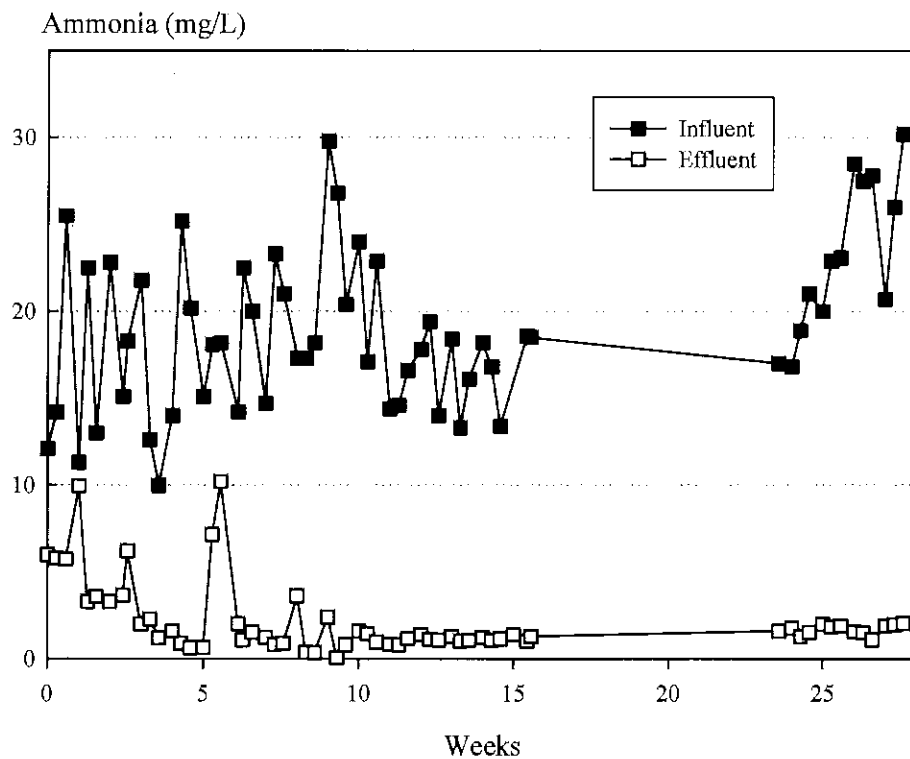


Figure 5: Ammonia

### 3.10 Nitrite/nitrate-N

Nitrite/nitrate-N analyses were completed using Method 353.2 from *EPA Methods*. The Nitrite/nitrate-N results over the entire evaluation are shown in Figure 6.

*Effluent Nitrite/nitrate-N:*

The effluent Nitrite/nitrate-N concentration ranged from 1.5 to 20 mg/L during the evaluation, with an average concentration of 8.3 mg/L and a median concentration of 8.0 mg/L.

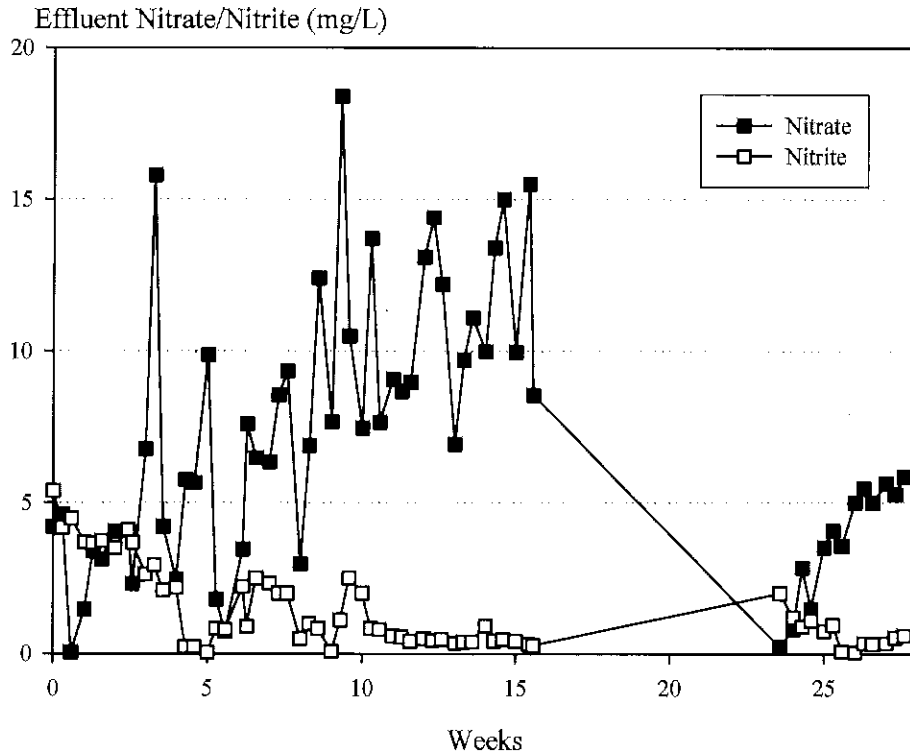


Figure 6: Effluent Nitrate/Nitrite

3.11 Total Nitrogen

Total Nitrogen (TN) is the sum of the total Kjeldahl nitrogen (TKN), nitrite ( $\text{NO}_2$ ) and nitrate ( $\text{NO}_3$ ) in a sample, and is expressed as mg/L as N. The TN results over the entire evaluation are shown in Figure 7.

*Influent Total Nitrogen*

The influent TN ranged from 15 to 58 mg/L during the evaluation, with an average concentration of 38 mg/L and a median concentration of 38 mg/L.

*Effluent Total Nitrogen:*

The effluent TN concentration ranged from 4.8 to 25 mg/L during the evaluation, with an average concentration of 12 mg/L and a median concentration of 11 mg/L. The Singular Model TNT-500



successfully met the requirements of Standard 245 by reducing the influent TN by 68%, which exceeds the pass/fail criteria of 50%.

*Nitrogen Loading:*

Over the course of the evaluation the influent Total Nitrogen loading averaged 0.15 lb/day. The Norweco Singlair Model TNT-500 achieved an average reduction of 0.10 lbs/day.

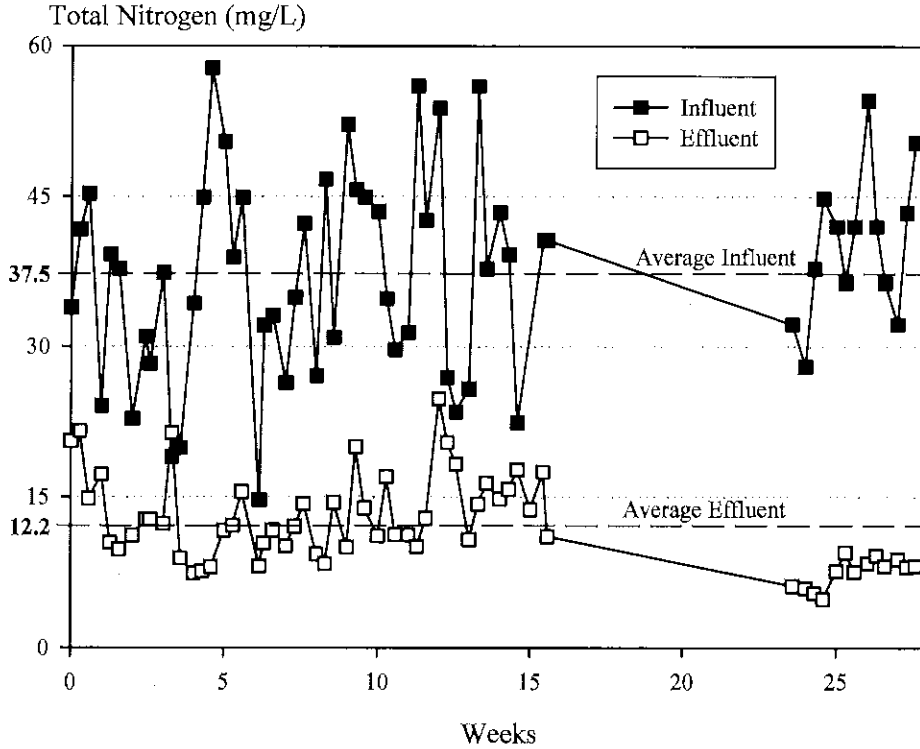


Figure 7: Total Nitrogen

**4.0 REFERENCES**

1. "Environmental Protection Agency Guidelines for Secondary Treatment", Federal Register, Volume 28, No. 159, 1973.
2. Grady, Jr. C.P., and H.C. Lim, Biological Wastewater Treatment: Theory and Applications, Marcel Dekker Publishers, New York, 1980.
3. APHA, AWWA, WPCF, Standard Methods for the Examination of Water and Wastewater, 20th Edition, American Public Health Association, Washington, D.C.
4. U.S. EPA, Methods for Chemical Analysis of Water and Wastes, U.S. Environmental Protection Agency, Washington, D.C.



**Pineland**

Cumberland Hall  
41 Campus Drive, Suite 101  
New Gloucester, ME 04260

**Portland**

565 Congress Street, Suite 310  
Portland, ME 04101

December 10, 2019

Shannon Smith, Project Manager  
Maine Department of Environmental Protection  
Bureau of Land Resources  
Eastern Maine Regional Office – Bangor  
106 Hogan Road  
Bangor, ME 04401

**Subject: Highlands Subdivision, Standish  
Response to Engineering Review Comments**

Dear Shannon:

Our office received comments from William Noble, C.G. for the above referenced project. We have prepared the responses presented below in consultation with Mark Hampton Associates, Inc. and Mark Cenci Geologic, Inc. For clarity, each comment is repeated in italics, followed by our response.

1. *The soil survey maps (plan sheets SS-1.0, SS-1.1, SS-1.2) should be revised or corrected as noted:*

a.) *On sheet SS-1.2, NOTE 1 refers to a Class B soil survey and Longhill Road subdivision rather than a Class A survey and Highlands subdivision.*

Response: The note is revised.

b.) *Soil label description in NOTE 3 of sheet SS-1.2 does not coincide with labels shown within the soil mapping units (only HSG designations are included instead of slope and drainage class).*

Response: The former note 3 is removed from the plan to eliminate this inconsistency. Former note 4 is now note 3.

c.) *The soil name Tunbridge is misspelled as Turnbridge on sheets SS-1.1 and SS-1.2.*

Response: The spelling is corrected.

d.) *Test pit SS-40 was not found and should be identified (likely misidentified as TP-40 on sheet SS-1.2, and on sheet C-3.3, since another TP-40 is shown at filter basin #2 on plan sheets SS-1.0, C-3.1 and C-6.4).*

Response: TP-40 on sheet SS-1.2 is now correctly labeled as SS-40.

e.) *For consistency with the other sheets with the prefix "SS" showing soils mapping, the title block of sheet SS-1.2 should include the label "Soil Boundaries".*

*However, it is suggested that "Soil Boundaries" on all these "SS" sheets be revised to "Soil Survey Map".*

Response: Drawings are renamed "Soil Survey Map".

- 2. There are many test pits on the plan sheets (with prefix TP, SS, and STW) which have the identification number obscured by either lines or other lettering -- these test pit designations should be clearly identified.*

Response: Drawings are revised for clarity.

- 3. All plan sheets have a "preliminary" designation (in the lower left-hand corner) which should be removed unless there are other plan sheets that can be submitted which are the final versions.*

Response: Removed "preliminary"

- 4. The soil report for stormwater treatment basins, dated 3-12-19, refers to the Subsurface Wastewater Disposal Rules. The appropriate reference is Section 7.D.4 of the Stormwater Management Rules. The investigating soil scientist should be aware of this citation for future projects.*

Response: Comment acknowledged

- 5. Test pits (TPs) at proposed underdrained soil filter (UDSF) basins 3 and 4, and the gravel wetland, did not extend at least 3 feet below the basin bottoms, as required by Section 7.D.4 of the Stormwater Management (SM) Rules. The investigating soil scientist should be aware of this requirement for future site location and stormwater projects.*

Response: Comment acknowledged

- 6. The cross-section in plan sheet C-6.5 for UDSF basins 3 and 4 should include a NOTE indicating that sidewalls of the impermeable liners are to extend to above the seasonal high watertable or bedrock, whichever is highest, and the elevation of the top edges of the impermeable liners should also be specified as was done for the cross-sections for UDSF basins 1 and 2.*

Response: The note is added to sheet C-6.5 as suggested. The top edge of the impermeable liner is set at 2' above bottom of each basin, providing minimum 0.5' freeboard above the water quality volume.

- 7. The wastewater design flow for the proposed clubhouse, and how it was determined, should be stated. This information was not found in Section 17 of the site application exhibit.*

Response: The clubhouse is assumed to be an assembly area (meeting hall) with capacity for 168 persons (84 condo units). Design flow is calculated as 2 GPD/person x 168 persons = 336 GPD. This system is conservatively sized for 500 GPD.

- 8. Part II, Section 17.A.6.d of the site application indicates a minimum of 5 TPs at disposal fields handling wastewater design flows greater than 500 gallons-per-day, which applies to the condominium disposal systems, but will not be required for this project due to consistent soil conditions revealed by TP data in the area. However, TP data must be provided from within the footprint of the disposal field to*

*serve condominium units 33-40 in accordance with Section 17.A.6.d (the soil map indicates somewhat poorly-drained Colonel soil at the site of disposal field 33-40).*

Response: TP-117 and TP-118 are provided at the system for units 33-40 – See sheets C-3.0 and C-3.1.

9. *Design information on the subsurface wastewater disposal systems to serve the condominiums should be provided, as outlined in Part II, Section 17.A.6 of the site application. Generally, the information included in subsurface wastewater disposal system applications (HHE-200 forms) should satisfy this requirement.*

Response: HHE-200 forms for the condo units and clubhouse are attached.

10. *Footprints of proposed subsurface wastewater disposal fields at the 18 single-family subdivision lots should be shown on site plans C-3.2 and C-3.3. See Part II, Section 17.A.1 of the site application. Depending on soil conditions or proposed field design at any lot, more than one TP may be required within the footprints, as outlined in Part II, Section 17.A.4 of the site application. Note that there are areas of shallow-to-bedrock soil at lots 2, 3, 5, 14, and 15 that will need additional TP data per Section 17.A.4.a if those areas are selected for a disposal field.*

Response: Disposal field footprints and test pits are now shown on sheets C-3.2 and C-3.3.

11. *A nitrate-nitrogen impact assessment should be conducted on the single-family subdivision lots. This comment may not apply to lots 1-3, 10-12, and 14-18, depending on proposed locations of subsurface wastewater disposal fields at these lots which can meet setback distances in the exemption table in Part II, Section 17.B.1.a of the site application.*

Response: The nitrate-nitrogen impact assessment for single family lots is contained in a memo from Mark Cenci Geologic, Inc., dated November 22, 2019. Disposal field locations and nitrate plumes are shown on the Nitrate Analysis Plans N-1.2 and N-1.3.

12. *A copy of a signed long-term maintenance contract for the condominium disposal systems with advanced wastewater treatment units should be provided, when available. Maintenance is essential for long-term performance of the proposed Singulair® advanced treatment units.*

Response: We request that this requirement be addressed as a condition of approval.

13. *Although there is a handwritten version included with the soil survey report, DEP Form E (Soil Conditions Summary Table) in Section 17 of the application exhibit should be revised as follows: a.) provide lot numbers where applicable (1<sup>st</sup> column), b.) indicate subsurface explorations only at proposed subsurface wastewater disposal field locations (3<sup>rd</sup> column), c.) include information on "P" series of explorations (probes), and d.) include signature of site evaluator at bottom of form. Note that the "SS" and "STW" series of subsurface explorations do not need to be included.*

Response: The requested information is contained in revised Form E for both test pits (TPs) and Probes (P).

*14. Item 20 in the General Notes on sheet C-1.1 should state that DEP review and approval is also required for revisions to subsurface wastewater disposal field locations shown on plan sheets.*

Response: General Note #20 on sheet C-1.1 is revised as requested.

*15. Plan sheets which show TPs should include a NOTE identifying the soil investigator responsible for the location and evaluation of these TPs, and which references the reports (by title and date) wherein subsurface data and narrative regarding the explorations can be found. In addition, the symbol used to show TP locations should be identified in a LEGEND on the plan sheets. This applies to plan sheets C-3.0 through C-3.8. Alternatively, this information could be included with the General Notes on plan sheet C-1.1.*

Response: This information is now included in General Note #23 on sheet C-1.1.

*16. Plan sheets which show wetlands should include a NOTE identifying the investigator responsible for their delineation, and which references the report (by title and date) wherein wetlands mapping information can be found. In addition, the symbol used to show wetlands should be identified in a LEGEND on the plan sheets. This applies to plan sheets C-2.1 through C-2.3, and C-3.1 through C-3.7. Alternatively, this information could be included with the General Notes on plan sheet C-1.1.*

Response: This information is now included in General Note #24 on sheet C-1.1.

*17. If blasting for construction will occur within 500 feet of non-owned off-site structures (buildings and wells), then a map showing anticipated blast locations, and blasting plan, prepared and sign-ed by a qualified blaster, must be provided. See Part II, Sections 20.A and 20.B of the application. The blasting plan must include blasting standards in the statute: 38 MRSA §490-Z (14). The blasting plan must be provided prior to any blasting, and include an anticipated blast design/shot pattern specifically tailored to the project site. Submittal of the blasting plan, and a map showing anticipated blast locations, could be required as a condition of site approval.*

Response: We request that submittal of the blasting plan provided by a licensed professional blasting contractor be addressed as a condition of approval. The attached Exhibit 20 shows the approximate area within 500' of anticipated blasting for bedrock removal.

The following items are attached:

- Updated Soil Conditions Summary Table (Form E) for test pits TP-1 to TP-138
- Soil Profile/Classification (Form F) for test pits TP-99 to TP-138
- Soil Conditions Summary Table (Form E) for probes P-1 to P-20
- Soil Profile/Classification (Form F) for probes P-1 to P-20
- HHE-200 forms for condominium and clubhouse septic systems
- Nitrate-Nitrogen Impact Assessment memo, Mark Cenci Geologic, Inc.
- Exhibit 20, 500' Blasting Radius

Shannon Smith  
December 10, 2019

Project # 1804

- Revised plan sheets: C-1.1 (Subdivision Plan); C-3.0, C-3.1, C-3.2, C-3.3 (grading plans); C-6.5 (filter basin details)
- Revised Soil Survey Map: SS-1.0, SS-1.1, SS-1.2
- Revised Nitrate Analysis Plan for single-family lots: N-1.2, N-1.3

We trust that the above responses and attached materials address the comments. Please contact me directly with additional questions or concerns.

Sincerely,  
**TERRADYN CONSULTANTS LLC**

A handwritten signature in black ink, appearing to read "Jeffrey D. Amos". The signature is fluid and cursive, with a large initial "J" and "A".

Jeffrey D. Amos, P.E.  
President

Attachments:  
As listed above

**FORM E (SOIL CONDITIONS SUMMARY TABLE) & FORM F (SOIL  
PROFILE / CLASSIFICATION) – TEST PITS TP-99 TO TP-138**


# SOIL CONDITIONS SUMMARY TABLE

## SUMMARY LOG OF SUBSURFACE EXPLORATIONS AT PROJECT SITES

Project Name: Highland Subdivision      Applicant Name: Leavitt-Thompson      Project Location (municipality): Standish

Lot No.	Exploration Symbol (TP 1, B 2, etc.)	X if at SSWD Field	Description of subsurface materials by: • Soil profile/condition (if by S.E.), • Soil series name (if by C.S.S.), or by • Geologic unit (if by C.G.)	Depths to (inches):				Ground Surface Slope (%)	Ground Surface Elevation
				Redoximorphic Features	Bedrock	Hydraulically Restrictive Layer	Limit of Exploration		
17	TP-1		3C	24		24	38	2	
17	TP-2		3C	22		22	38	2	
16	TP-3		3C	22		22	40	2	
16	TP-4		3C	22		22	40	2	
15	TP-5	1	2AIII		22		22	10	
15	TP-6		2AIII		22		22	10	
14	TP-7		3C	18		18	36	2	
14	TP-8		3C	16		16	38	2	
12	TP-9		3C	16		16	38	4	
12	TP-10		3C	18		18	40	4	
13	TP-11		3C	16		16	40	6	
13	TP-12		3C	17		17	38	6	
11	TP-13		3C	18		18	38	6	
11	TP-14		3C	18		18	38	6	
10	TP-15		3C	18		18	36	4	
10	TP-16		3C	20		20	40	4	
5	TP-17		3C	18		18	38	3	
5	TP-18		3C	20		20	38	3	
4	TP-19		3C	22		22	40	4	
4	TP-20		3C	22		22	38	4	
9	TP-21		3C	21		21	40	3	
9	TP-22		3C	18		18	40	4	
8	TP-23		3C	16		16	36	4	
8	TP-24		3C	16		16	36	4	
3	TP-25		2AIII		18		18	4	
3	TP-26		2AIII		18		18	4	
2	TP-27		2AIII		15		15	2	
2	TP-28		2AIII		17		17	2	
7	TP-29		3C	20		20	38	2	
7	TP-30		3C	18		18	36	2	
6	TP-31		3C	18		18	36	2	
6	TP-32		3C	18		18	36	2	

### INVESTIGATOR INFORMATION AND SIGNATURE

Signature:   
 Name Printed: Mark J Hampton  
 Date: 11/06/2018  
 Cer/Lic/Reg. #: 263/216  
 Qualification:  Licensed Site Evaluator  
 Certified Geologist       Certified Soil Scientist  
 Other:

affix professional seal




# SOIL CONDITIONS SUMMARY TABLE

## SUMMARY LOG OF SUBSURFACE EXPLORATIONS AT PROJECT SITES

Project Name: Highlands Subdivision      Applicant Name: Leavitt-Thompson      Project Location (municipality): Standish

Lot No.	Exploration Symbol (TP 1, B 2, etc.)	* if at SSWD Field	Description of subsurface materials by: • Soil profile/condition (if by S.E.), • Soil series name (if by C.S.S.), or by • Geologic unit (if by C.G.)	Depths to (inches):				Ground Surface Slope (%)	Ground Surface Elevation
				Redoximorphic Features	Bedrock	Hydraulically Restrictive Layer	Limit of Exploration		
	TP-33		3C						
	TP-34		3C	18		18	38	2	
	TP-35		3C	16		16	38	2	
77-84	TP-36	<input checked="" type="checkbox"/>	3C	20		20	40	2	
	TP-37		3C	20		20	40	2	
61-76	TP-38	<input checked="" type="checkbox"/>	3C	22		22	38	2	
	TP-39		3C	20		20	40	2	
	TP-40		3C	18		18	38	2	
64-83	TP-41	<input checked="" type="checkbox"/>	3C	18		18	38	2	
	TP-42		3C	16		16	40	4	
	TP-43		3C	16		16	40	4	
	TP-44		3C	18		18	36	4	
44-56	TP-45	<input checked="" type="checkbox"/>	3C	18		18	38	4	
	TP-46		3C	15		15	40	8	
	TP-47		3C	15		15	38	8	
	TP-48		3C	18		18	40	4	
	TP-49		3C	17		17	36	6	
	TP-50		3C	15		15	38	10	
	TP-51		3C	15		15	36	10	
5-8	TP-52	<input checked="" type="checkbox"/>	3C	16		16	38	2	
	TP-53		3C	16		16	38	2	
	TP-54		3C	20		20	40	6	
25-32	TP-55	<input checked="" type="checkbox"/>	3C	20		20	40	6	
25-32	TP-56	<input checked="" type="checkbox"/>	3C	15		15	36	8	
45-48 57-60	TP-57	<input checked="" type="checkbox"/>	3C	15		15	38	8	
45-48 57-60	TP-58	<input checked="" type="checkbox"/>	3C	16		16	38	6	
49-56	TP-59	<input checked="" type="checkbox"/>	3C	15		15	38	6	
49-56	TP-60	<input checked="" type="checkbox"/>	3C	16		16	40	8	
	TP-61		3C	15		15	36	8	
	TP-62		3C	17		17	40	4	
	TP-63		3C	15		15	40	6	
	TP-64		3C	16		16	38	4	
			3C	16		16	38	4	

**INVESTIGATOR INFORMATION AND SIGNATURE**

Signature: 

Name Printed: Mark J Hampton      Date: 11/6/2018

Qualification:  Licensed Site Evaluator       Certified Soil Scientist  
 Certified Geologist       Other:      Cert/Lic/Reg. #: 263/216

affix professional seal

**SOIL CONDITIONS SUMMARY TABLE**

**SUMMARY LOG OF SUBSURFACE EXPLORATIONS AT PROJECT SITES**

Project Name: Highlands Subdivision      Applicant Name: Leavitt-Thompson      Project Location (municipality): Standish

Lot No.	Exploration Symbol (TP 1, B 2, etc.)	* If at SSWD Field	Description of subsurface materials by: • Soil profile/condition (if by S.E.), • Soil series name (if by C.S.S.), or by • Geologic unit (if by C.G.)	Depths to (inches):				Ground Surface Slope (%)	Ground Surface Elevation
				Redoximorphic Features	Bedrock	Hydraulically Restrictive Layer	Limit of Exploration		
	TP-65	<input type="checkbox"/>	3C	20		20	38	4	
64-74	TP-66	<input checked="" type="checkbox"/>	3C	20		20	38	4	
	TP-67	<input type="checkbox"/>	3C	18		18	38	4	
	TP-68	<input type="checkbox"/>	3C	18		18	42	4	
	TP-69	<input type="checkbox"/>	3C	16		16	40	2	
	TP-70	<input type="checkbox"/>	3C	16		16	40	2	
5-4 9-12	TP-71	<input checked="" type="checkbox"/>	3C	18		18	38	6	
5-4 9-12	TP-72	<input checked="" type="checkbox"/>	3C	18		18	38	6	
17-24	TP-73	<input checked="" type="checkbox"/>	3C	16		16	36	4	
17-24	TP-74	<input checked="" type="checkbox"/>	3C	16		16	38	4	
	TP-75	<input type="checkbox"/>	3C	18		18	40	4	
	TP-76		3C	15		15	40	4	
club	TP-77	<input checked="" type="checkbox"/>	3C	15		15	38	4	
club	TP-78	<input checked="" type="checkbox"/>	3C	15		15	38	4	
6	TP-79		3C	15		15	38	12	
7	TP-80		3C	15		15	36	12	
7	TP-81		3C	15		15	36	14	
	TP-82	1	3C	15		15	40	16	
8	TP-83	1	3C	16		16	40	10	
9	TP-84		3C	16		16	38	10	
9	TP-85		3C	18		18	38	8	
9	TP-86		3C	18		18	38	8	
10	TP-87		3C	16		16	36	14	
10	TP-88		3C	15		15	36	8	
11	TP-89		3C	18		18	40	6	
11	TP-90		3C	18		18	40	6	
12	TP-91		3C	16		16	42	4	
12	TP-92		3C	16		16	42	4	
15	TP-93		2AIII		18		18	6	
15	TP-94		2AIII		18		18	6	
16	TP-95		3C	18		18	40	4	
16	TP-96		3C	15		15	38	4	

**INVESTIGATOR INFORMATION AND SIGNATURE**

Signature: *Mark J Hampton*      Date: 11/06/2018

Name Printed: Mark J Hampton      Cert/Lic/Reg. #: 263/216

Qualification:  Licensed Site Evaluator       Certified Soil Scientist  
 Certified Geologist       Other:


affix professional seal

### SOIL CONDITIONS SUMMARY TABLE

### SUMMARY LOG OF SUBSURFACE EXPLORATIONS AT PROJECT SITES

Project Name: Highlands Subdivision	Applicant Name: Leavitt-Thompson	Project Location (municipality): Standish
--	-------------------------------------	--

Lot No.	Exploration Symbol (TP 1, B 2, etc.)	* if at SSWD Field	Description of subsurface materials by: • Soil profile/condition (if by S.E.), • Soil series name (if by C.S.S.), or by • Geologic unit (if by C.G.)	Depths to (inches):				Ground Surface Slope (%)	Ground Surface Elevation
				Redoximorphic Features	Bedrock	Hydraulically Restrictive Layer	Limit of Exploration		
	TP-97		3C	17		17	38	2	
	TP-98		3C	16		16	38	2	
JE	TP-99		3C	15		15	36	4	
	TP-100		3C	15		15	40	4	
	TP-101		3C	16		16	36	4	
CLW	TP-102	☒	3C	16		16	36	4	
	TP-103		3C	15		15	37	3	
25-32	TP-104	☒	3C	15		15	36	3	
45-48 57-60	TP-105	☒	3C	16		16	40	4	
61-68	TP-106	☒	3C	16		16	39	4	
71-84	TP-107	☒	3C	18		18	41	4	
25-32	TP-108	☒	3C	15		15	37	3	
45-48 57-60	TP-109	☒	3C	15		15	37	3	
41-44	TP-110	☒	3C	17		17	38	2	
41-44	TP-111	☒	3C	17		17	40	2	
58	TP-112	☒	3C	16		16	36	3	
14 8-12	TP-113	☒	3C	16		16	36	4	
17-24	TP-114	☒	3C	17		17	37	4	
13-16	TP-115	☒	3C	17		17	36	4	
13-16	TP-116	☒	3C	16		16	38	3	
33-40	TP-117	☒	3D	15		15	39	2	
33-40	TP-118	☒	3D	12		12	40	2	
33-40	TP-119	☒	3D	13		13	38	2	
33-40	TP-120	☒	3D	14		14	37	2	
33-40	TP-121	☒	3D	14		14	37	2	
4	TP-122	☒	3C	18		18	38	2	
4	TP-123	☒	3C	18		18	38	2	
5	TP-124	☒	2AII	14	14		14	4	
6	TP-125	☒	3C	16		16	37	6	
6	TP-126	☒	3C	16		16	38	6	
7	TP-127	☒	3C	17		17	39	6	
8	TP-128	☒	3C	17		17	39	6	

INVESTIGATOR INFORMATION AND SIGNATURE	
Signature 	Date 3/11/2019
Name Printed Mark J Hampton	Cert/Lic/Reg. # 263/216
Qualification <input checked="" type="checkbox"/> Licensed Site Evaluator <input type="checkbox"/> Certified Geologist <input checked="" type="checkbox"/> Certified Soil Scientist <input type="checkbox"/> Other:	

affix professional seal



# SOIL PROFILE / CLASSIFICATION INFORMATION

FORM F Rev. 07/11

Project Name: **Highlands Subdivision** Applicant Name: **Leavitt-Thompson** Project Location (municipality): **Standish**

Exploration Symbol # **TP-99**  Test Pit  Boring  Probe

" Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_

" Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				
60				

Soil Details by S.E. **3** Soil Classification **C** Slope **4** Limiting Factor **15**  Groundwater  Restrictive Layer  Bedrock

S.S. Soil Series/Phase Name: \_\_\_\_\_  Hydric  Non-hydric  Hydrologic  Soil Group

Exploration Symbol # **TP-100**  Test Pit  Boring  Probe

" Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_

" Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				
60				

Soil Details by S.E. **3** Soil Classification **C** Slope **4** Limiting Factor **15**  Groundwater  Restrictive Layer  Bedrock

S.S. Soil Series/Phase Name: \_\_\_\_\_  Hydric  Non-hydric  Hydrologic  Soil Group

Exploration Symbol # **TP-101**  Test Pit  Boring  Probe

" Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_

" Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				
60				

Soil Details by S.E. **3** Soil Classification **C** Slope **4** Limiting Factor **16**  Groundwater  Restrictive Layer  Bedrock

S.S. Soil Series/Phase Name: \_\_\_\_\_  Hydric  Non-hydric  Hydrologic  Soil Group

Exploration Symbol # **TP-102**  Test Pit  Boring  Probe

" Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_

" Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				
60				

Soil Details by S.E. **3** Soil Classification **C** Slope **4** Limiting Factor **16**  Groundwater  Restrictive Layer  Bedrock

S.S. Soil Series/Phase Name: \_\_\_\_\_  Hydric  Non-hydric  Hydrologic  Soil Group

### INVESTIGATOR INFORMATION AND SIGNATURE

Signature: *Mark J Hampton* Date: **11/06/2018**

Name Printed: **Mark J Hampton** Cer/Lic/Reg. #: **263/216**

Title:  Licensed Site Evaluator  Certified Soil Scientist  Certified Geologist  Professional Engineer

affix professional seal

**SOIL PROFILE / CLASSIFICATION INFORMATION**

**DETAILED DESCRIPTION OF SUBSURFACE CONDITIONS AT PROJECT SITES**

Project Name: **Highlands Subdivision** Applicant Name: **Leavitt-Thompson** Project Location (municipality): **Standish**

Exploration Symbol # **TP-103**  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and-Distinct
30				
40				
50				
60				

Soil Details by S.E. **3 C** Slope **3** Limiting Factor **15**  Groundwater  Restrictive Layer  Bedrock  
 Profile Condition Percent Depth  
 Soil Series/Phase Name:  Hydric  Non-hydric Hydrologic Soil Group

Exploration Symbol # **TP-104**  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and-Distinct
30				
40				
50				
60				

Soil Details by S.E. **3 C** Slope **3** Limiting Factor **15**  Groundwater  Restrictive Layer  Bedrock  
 Profile Condition Percent Depth  
 Soil Series/Phase Name:  Hydric  Non-hydric Hydrologic Soil Group

Exploration Symbol # **TP-105**  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and-Distinct
30				
40				
50				
60				

Soil Details by S.E. **3 C** Slope **4** Limiting Factor **16**  Groundwater  Restrictive Layer  Bedrock  
 Profile Condition Percent Depth  
 Soil Series/Phase Name:  Hydric  Non-hydric Hydrologic Soil Group

Exploration Symbol # **TP-106**  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and-Distinct
30				
40				
50				
60				

Soil Details by S.E. **3 C** Slope **4** Limiting Factor **16**  Groundwater  Restrictive Layer  Bedrock  
 Profile Condition Percent Depth  
 Soil Series/Phase Name:  Hydric  Non-hydric Hydrologic Soil Group

**INVESTIGATOR INFORMATION AND SIGNATURE**

Signature: *Mark J Hampton* Date: **03/11/2019**  
 Name Printed: **Mark J Hampton** Cert/Lic/Reg. #: **263/216**  
 Title:  Licensed Site Evaluator  Certified Soil Scientist  Certified Geologist  Professional Engineer

*affix professional seal*

**SOIL PROFILE / CLASSIFICATION INFORMATION**

**DETAILED DESCRIPTION OF SUBSURFACE CONDITIONS AT PROJECT SITES**

Project Name: **Highlands Subdivision**

Applicant Name: **Leavitt-Thompson**

Project Location (municipality): **Standish**

Exploration Symbol # **TP-107**  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				
60				

Soil Details by S.E. **3** Soil Classification **C** Slope **4** Limiting Factor **18**  Groundwater  Restrictive Layer  Bedrock  
 Profile Condition Percent Depth  
 Soil Series/Phase Name: \_\_\_\_\_  
 Hydric  Non-hydric Hydrologic Soil Group

Exploration Symbol # **TP-108**  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				
60				

Soil Details by S.E. **3** Soil Classification **C** Slope **3** Limiting Factor **15**  Groundwater  Restrictive Layer  Bedrock  
 Profile Condition Percent Depth  
 Soil Series/Phase Name: \_\_\_\_\_  
 Hydric  Non-hydric Hydrologic Soil Group

Exploration Symbol # **TP-109**  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				
60				

Soil Details by S.E. **3** Soil Classification **C** Slope **3** Limiting Factor **15**  Groundwater  Restrictive Layer  Bedrock  
 Profile Condition Percent Depth  
 Soil Series/Phase Name: \_\_\_\_\_  
 Hydric  Non-hydric Hydrologic Soil Group

Exploration Symbol # **TP-110**  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				
60				

Soil Details by S.E. **3** Soil Classification **C** Slope **2** Limiting Factor **17**  Groundwater  Restrictive Layer  Bedrock  
 Profile Condition Percent Depth  
 Soil Series/Phase Name: \_\_\_\_\_  
 Hydric  Non-hydric Hydrologic Soil Group

**INVESTIGATOR INFORMATION AND SIGNATURE**

Signature: *Mark J Hampton* Date: **03/11/2019**  
 Name Printed: **Mark J Hampton** Cert/Lic/Reg. #: **263/216**  
 Title:  Licensed Site Evaluator  Certified Soil Scientist  Certified Geologist  Professional Engineer

*affix professional seal*

# SOIL PROFILE / CLASSIFICATION INFORMATION

## DETAILED DESCRIPTION OF SUBSURFACE CONDITIONS AT PROJECT SITES

Project Name: **Highlands Subdivision**

Applicant Name: **Leavitt-Thompson**

Project Location (municipality): **Standish**

Exploration Symbol # TP-111  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				
60				

Soil Details by S.E. **3 C** Slope **2** Limiting Factor **17**  Groundwater  Restrictive Layer  Bedrock  
 S.S. Soil Series/Phase Name: \_\_\_\_\_  Hydric  Non-hydric Hydrologic Soil Group

Exploration Symbol # TP-112  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				
60				

Soil Details by S.E. **3 C** Slope **3** Limiting Factor **16**  Groundwater  Restrictive Layer  Bedrock  
 S.S. Soil Series/Phase Name: \_\_\_\_\_  Hydric  Non-hydric Hydrologic Soil Group

Exploration Symbol # TP-113  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				
60				

Soil Details by S.E. **3 C** Slope **4** Limiting Factor **16**  Groundwater  Restrictive Layer  Bedrock  
 S.S. Soil Series/Phase Name: \_\_\_\_\_  Hydric  Non-hydric Hydrologic Soil Group

Exploration Symbol # TP-114  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				
60				

Soil Details by S.E. **3 C** Slope **4** Limiting Factor **17**  Groundwater  Restrictive Layer  Bedrock  
 S.S. Soil Series/Phase Name: \_\_\_\_\_  Hydric  Non-hydric Hydrologic Soil Group

### INVESTIGATOR INFORMATION AND SIGNATURE

Signature: *Mark J Hampton* Date: **03/11/2019**  
 Name Printed: **Mark J Hampton** Cert/Lic/Reg. #: **263/216**  
 Title:  Licensed Site Evaluator  Certified Soil Scientist  Certified Geologist  Professional Engineer

affix professional seal



**SOIL PROFILE / CLASSIFICATION INFORMATION**

**DETAILED DESCRIPTION OF SUBSURFACE CONDITIONS AT PROJECT SITES**

Project Name: Highlands Subdivision

Applicant Name: Leavitt-Thompson

Project Location (municipality): Standish

Exploration Symbol # TP-115  Test Pit  Boring  Probe  
 \* Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 \* Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	friable	Dark gray	
10	Sandy loam	friable	Black	
20	Sandy loam	Firm	olive	Common disked
30				
40				
50				
60				

Soil Details by S.E.  S.S.

Soil Classification Profile <u>3</u> Condition <u>C</u>	Slope Percent <u>4</u>	Limiting Factor Depth <u>17</u> "	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

Exploration Symbol # TP-116  Test Pit  Boring  Probe  
 \* Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 \* Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	friable	Dark gray	
10	Sandy loam	friable	Black	
20	Sandy loam	Firm	black	Common disked
30				
40				
50				
60				

Soil Details by S.E.  S.S.

Soil Classification Profile <u>3</u> Condition <u>C</u>	Slope Percent <u>3</u>	Limiting Factor Depth <u>16</u> "	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

Exploration Symbol # TP-117  Test Pit  Boring  Probe  
 \* Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 \* Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	friable	Dark gray	
10	Sandy loam	friable	Black	
20	Sandy loam	Firm	olive	Common disked
30			gray	
40				
50				
60				

Soil Details by S.E.  S.S.

Soil Classification Profile <u>3</u> Condition <u>D</u>	Slope Percent <u>2</u>	Limiting Factor Depth <u>14</u> "	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

Exploration Symbol # TP-118  Test Pit  Boring  Probe  
 \* Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 \* Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	friable	Dark gray	
10	Sandy loam	friable	Black	
20	Sandy loam	Firm	olive	Common disked
30			gray	
40				
50				
60				

Soil Details by S.E.  S.S.

Soil Classification Profile <u>3</u> Condition <u>D</u>	Slope Percent <u>2</u>	Limiting Factor Depth <u>12</u> "	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

**INVESTIGATOR INFORMATION AND SIGNATURE**

Signature: [Handwritten Signature] Date: 11/12/19  
 Name Printed: Mark J. Hampton Cert/Lic/Reg. #: 236/216  
 Title:  Licensed Site Evaluator  Certified Soil Scientist  Certified Geologist  Professional Engineer

affix professional seal

### SOIL PROFILE / CLASSIFICATION INFORMATION

### DETAILED DESCRIPTION OF SUBSURFACE CONDITIONS AT PROJECT SITES

Project Name: Highlands Subdivision      Applicant Name: Leavitt-Thompson      Project Location (municipality): Standish

Exploration Symbol # TP-119     Test Pit     Boring     Probe

\_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark brown	
10	Sandy loam	Friable	Brown	
20	Sandy loam	Firm	olive gray	Common distinct
30				
40				
50				
60				

Soil Details by S.E.    Soil Classification: Profile 3 Condition D    Slope 2 Percent    Limiting Factor 13 " Depth     Groundwater     Restrictive Layer     Bedrock

S.S.    Soil Series/Phase Name: \_\_\_\_\_     Hydric     Non-hydric    Hydrologic    Soil Group

Exploration Symbol # TP-120     Test Pit     Boring     Probe

\_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark brown	
10	Sandy loam	Friable	Brown	
20	Sandy loam	Firm	olive gray	Common distinct
30				
40				
50				
60				

Soil Details by S.E.    Soil Classification: Profile 3 Condition D    Slope 2 Percent    Limiting Factor 14 " Depth     Groundwater     Restrictive Layer     Bedrock

S.S.    Soil Series/Phase Name: \_\_\_\_\_     Hydric     Non-hydric    Hydrologic    Soil Group

Exploration Symbol # TP-121     Test Pit     Boring     Probe

\_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark brown	
10	Sandy loam	Friable	Brown	
20	Sandy loam	Firm	olive gray	Common distinct
30				
40				
50				
60				

Soil Details by S.E.    Soil Classification: Profile 3 Condition D    Slope 2 Percent    Limiting Factor 14 " Depth     Groundwater     Restrictive Layer     Bedrock

S.S.    Soil Series/Phase Name: \_\_\_\_\_     Hydric     Non-hydric    Hydrologic    Soil Group

Exploration Symbol # TP-122     Test Pit     Boring     Probe

\_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark brown	
10	Sandy loam	Friable	Brown	
20	Sandy loam	Firm	olive gray	Common distinct
30				
40				
50				
60				

Soil Details by S.E.    Soil Classification: Profile 3 Condition C    Slope 2 Percent    Limiting Factor 10 " Depth     Groundwater     Restrictive Layer     Bedrock

S.S.    Soil Series/Phase Name: \_\_\_\_\_     Hydric     Non-hydric    Hydrologic    Soil Group

### INVESTIGATOR INFORMATION AND SIGNATURE

Signature: [Handwritten Signature]      Date: 11/12/19

Name Printed: Mark J. Hampton      Cert/Lic/Reg. #: 236/216

Title:  Licensed Site Evaluator     Certified Soil Scientist     Certified Geologist     Professional Engineer

affix professional seal

**SOIL PROFILE / CLASSIFICATION INFORMATION**

**DETAILED DESCRIPTION OF SUBSURFACE CONDITIONS AT PROJECT SITES**

Project Name: Highland Subdivision      Applicant Name: Leavitt-Thompson      Project Location (municipality): Standish

Exploration Symbol # TP-123     Test Pit     Boring     Probe  
 " Organic horizon thickness \_\_\_\_\_    Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark Brown	
10	Sandy loam	Friable	Brown	
20	Sandy loam	Fine	olive	Common Distinct

Soil Details by S.E.    Soil Classification: 3    Slope: 2    Limiting Factor: 18 "     Groundwater     Restrictive Layer  
 Profile: \_\_\_\_\_    Condition: \_\_\_\_\_    Percent: \_\_\_\_\_    Depth: \_\_\_\_\_     Bedrock  
 S.S.    Soil Series/Phase Name: \_\_\_\_\_     Hydric     Non-hydric    Hydrologic    Soil Group

Exploration Symbol # TP-124     Test Pit     Boring     Probe  
 " Organic horizon thickness \_\_\_\_\_    Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark Brown	
10	Sandy loam	Friable	Brown	None Noted
20				Large

Soil Details by S.E.    Soil Classification: 2    Slope: 4    Limiting Factor: 14 "     Groundwater     Restrictive Layer  
 Profile: AII    Condition: \_\_\_\_\_    Percent: \_\_\_\_\_    Depth: \_\_\_\_\_     Bedrock  
 S.S.    Soil Series/Phase Name: \_\_\_\_\_     Hydric     Non-hydric    Hydrologic    Soil Group

Exploration Symbol # TP-125     Test Pit     Boring     Probe  
 " Organic horizon thickness \_\_\_\_\_    Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark Brown	
10	Sandy loam	Friable	Brown	
20	Sandy loam	Fine	olive	Common Distinct

Soil Details by S.E.    Soil Classification: 3    Slope: 6    Limiting Factor: 16 "     Groundwater     Restrictive Layer  
 Profile: \_\_\_\_\_    Condition: C    Percent: \_\_\_\_\_    Depth: \_\_\_\_\_     Bedrock  
 S.S.    Soil Series/Phase Name: \_\_\_\_\_     Hydric     Non-hydric    Hydrologic    Soil Group

Exploration Symbol # TP-126     Test Pit     Boring     Probe  
 " Organic horizon thickness \_\_\_\_\_    Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark Brown	
10	Sandy loam	Friable	Brown	
20	Sandy loam	Fine	olive	Common Distinct

Soil Details by S.E.    Soil Classification: 3    Slope: 6    Limiting Factor: 16 "     Groundwater     Restrictive Layer  
 Profile: \_\_\_\_\_    Condition: C    Percent: \_\_\_\_\_    Depth: \_\_\_\_\_     Bedrock  
 S.S.    Soil Series/Phase Name: \_\_\_\_\_     Hydric     Non-hydric    Hydrologic    Soil Group

**INVESTIGATOR INFORMATION AND SIGNATURE**

Signature: [Signature]      Date: 11/19/19  
 Name Printed: Mark J. Hampton      Cert/Lic/Reg. #: 263/216  
 Title:  Licensed Site Evaluator     Certified Soil Scientist     Certified Geologist     Professional Engineer

affix professional seal

### SOIL PROFILE / CLASSIFICATION INFORMATION

### DETAILED DESCRIPTION OF SUBSURFACE CONDITIONS AT PROJECT SITES

Project Name: <b>Highland Subdivision</b>	Applicant Name: <b>Leavitt-Thompson</b>	Project Location (municipality): <b>Standish</b>
--	--	---

Exploration Symbol # TP-127     Test Pit     Boring     Probe

\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Fr. soft	Dull gray	
10	Sandy loam	fr. soft	Brown	
20	Sandy loam	Firm	olive	Common Duffet
30				
40				
50				
60				

S.E. Soil Classification 3    C Profile    Condition	Slope 6 Percent	Limiting Factor 17 " Depth	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
S.S. Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

Exploration Symbol # TP-128     Test Pit     Boring     Probe

\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Fr. soft	Dull gray	
10	Sandy loam	fr. soft	Brown	
20	Sandy loam	Firm	olive	Common Duffet
30				
40				
50				
60				

S.E. Soil Classification 3    C Profile    Condition	Slope 6 Percent	Limiting Factor 17 " Depth	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
S.S. Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

Exploration Symbol # TP-129     Test Pit     Boring     Probe

\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Fr. soft	Dull gray	
10	Sandy loam	Fr. soft	Brown	
20	Sandy loam	Firm	olive	Common Duffet
30				
40				
50				
60				

S.E. Soil Classification 3    C Profile    Condition	Slope 6 Percent	Limiting Factor 17 " Depth	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
S.S. Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

Exploration Symbol # TP-130     Test Pit     Boring     Probe

\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Fr. soft	Dull gray	
10	Sandy loam	fr. soft	Brown	
20	Sandy loam	Firm	olive	Common Duffet
30				
40				
50				
60				

S.E. Soil Classification 3    C Profile    Condition	Slope 6 Percent	Limiting Factor 18 " Depth	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
S.S. Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

### INVESTIGATOR INFORMATION AND SIGNATURE

Signature 	Date 11/19/19
Name Printed Mark J. Hampton	Cert/Lic/Reg. # 263/216
Title <input checked="" type="checkbox"/> Licensed Site Evaluator <input checked="" type="checkbox"/> Certified Soil Scientist <input type="checkbox"/> Certified Geologist <input type="checkbox"/> Professional Engineer	

affix professional seal

**SOIL PROFILE / CLASSIFICATION INFORMATION**

**DETAILED DESCRIPTION OF SUBSURFACE CONDITIONS AT PROJECT SITES**

Project Name: Highland Subdivision

Applicant Name: Leavitt-Thompson

Project Location (municipality): Standish

Exploration Symbol # TP-131  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark brown	
10	Sandy loam	Friable	Brown	
20	Sandy loam	Friable	olive	Common Duff
30				
40				
50				
60				

Soil Details by S.E. >>> S.S. >>>

Soil Classification Profile: <u>3</u> Condition: <u>C</u>	Slope Percent: <u>4</u>	Limiting Factor Depth: <u>16</u>	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

Exploration Symbol # TP-132  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark brown	
10	Sandy loam	Friable	Brown	
20	Sandy loam	Firm	olive	Common Duff
30				
40				
50				
60				

Soil Details by S.E. >>> S.S. >>>

Soil Classification Profile: <u>3</u> Condition: <u>C</u>	Slope Percent: <u>2</u>	Limiting Factor Depth: <u>18</u>	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

Exploration Symbol # TP-133  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark brown	
10	Sandy loam	Friable	Brown	
20	Sandy loam	Firm	olive	Common Duff
30				
40				
50				
60				

Soil Details by S.E. >>> S.S. >>>

Soil Classification Profile: <u>3</u> Condition: <u>C</u>	Slope Percent: <u>2</u>	Limiting Factor Depth: <u>18</u>	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

Exploration Symbol # TP-134  Test Pit  Boring  Probe  
 " Organic horizon thickness \_\_\_\_\_ Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark brown	
10	Sandy loam	Friable	Brown	
20	Sandy loam	Firm	olive	Common Duff
30				
40				
50				
60				

Soil Details by S.E. >>> S.S. >>>

Soil Classification Profile: <u>3</u> Condition: <u>C</u>	Slope Percent: <u>4</u>	Limiting Factor Depth: <u>16</u>	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

**INVESTIGATOR INFORMATION AND SIGNATURE**

Signature:	Date: 11/19/19
Name Printed: Mark J. Hampton	Cert/Lic/Reg. #: 263/216
Title: <input checked="" type="checkbox"/> Licensed Site Evaluator <input checked="" type="checkbox"/> Certified Soil Scientist <input type="checkbox"/> Certified Geologist <input type="checkbox"/> Professional Engineer	

affix professional seal

### SOIL PROFILE / CLASSIFICATION INFORMATION

### DETAILED DESCRIPTION OF SUBSURFACE CONDITIONS AT PROJECT SITES

Project Name: <b>Highland Subdivision</b>	Applicant Name: <b>Leavitt-Thompson</b>	Project Location (municipality): <b>Standish</b>
--	--	---

Exploration Symbol # TP-135     Test Pit     Boring     Probe

\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark brown	
10	Sandy loam	Friable	Brown	
20	Sandy loam	Fine	Dark	Common irregular
30				
40				
50				
60				

Soil Classification Profile: <u>3</u> Condition: <u>C</u>	Slope Percent: <u>4</u>	Limiting Factor Depth: <u>16</u> "	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
Soil Series/Phase Name: _____			
		<input type="checkbox"/> Hydric <input type="checkbox"/> Hydrologic <input type="checkbox"/> Non-hydric <input type="checkbox"/> Soil Group	

Exploration Symbol # TP-136     Test Pit     Boring     Probe

\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark brown	
10	Sandy loam	Friable	Brown	None noted
20				
30				
40				
50				
60				

Soil Classification Profile: <u>2</u> Condition: <u>AIII</u>	Slope Percent: <u>2</u>	Limiting Factor Depth: <u>22</u> "	<input type="checkbox"/> Groundwater <input type="checkbox"/> Restrictive Layer <input checked="" type="checkbox"/> Bedrock
Soil Series/Phase Name: _____			
		<input type="checkbox"/> Hydric <input type="checkbox"/> Hydrologic <input type="checkbox"/> Non-hydric <input type="checkbox"/> Soil Group	

Exploration Symbol # TP-137     Test Pit     Boring     Probe

\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark brown	
10	Sandy loam	Friable	Brown	
20				
30	Sandy loam	Fine	Dark	Common irregular
40				
50				
60				

Soil Classification Profile: <u>3</u> Condition: <u>C</u>	Slope Percent: <u>2</u>	Limiting Factor Depth: <u>24</u> "	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
Soil Series/Phase Name: _____			
		<input type="checkbox"/> Hydric <input type="checkbox"/> Hydrologic <input type="checkbox"/> Non-hydric <input type="checkbox"/> Soil Group	

Exploration Symbol # TP-138     Test Pit     Boring     Probe

\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0	Sandy loam	Friable	Dark brown	
10	Sandy loam	Friable	Brown	
20	Sandy loam	Fine	Dark	Common irregular
30				
40				
50				
60				

Soil Classification Profile: <u>3</u> Condition: <u>C</u>	Slope Percent: <u>2</u>	Limiting Factor Depth: <u>16</u> "	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock
Soil Series/Phase Name: _____			
		<input type="checkbox"/> Hydric <input type="checkbox"/> Hydrologic <input type="checkbox"/> Non-hydric <input type="checkbox"/> Soil Group	

### INVESTIGATOR INFORMATION AND SIGNATURE

Signature: <u>Mark J. Hampton</u>	Date: <u>11/19/19</u>
Name Printed: <u>Mark J. Hampton</u>	Cert/Lic/Reg. #: <u>263/216</u>
Title: <input checked="" type="checkbox"/> Licensed Site Evaluator <input checked="" type="checkbox"/> Certified Soil Scientist <input type="checkbox"/> Certified Geologist <input type="checkbox"/> Professional Engineer	

affix professional seal

**FORM E (SOIL CONDITIONS SUMMARY TABLE) & FORM F (SOIL  
PROFILE / CLASSIFICATION) – PROBES P-1 TO P-20**





**SOIL PROFILE / CLASSIFICATION INFORMATION**

**DETAILED DESCRIPTION OF SUBSURFACE CONDITIONS AT PROJECT SITES**

Project Name: <b>Highland Subdivision</b>	Applicant Name: <b>Leavitt-Thompson</b>	Project Location (municipality): <b>Standish</b>
--	--	---

Exploration Symbol # P-1     Test Pit     Boring     Probe

\_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_\_ " Depth of exploration or to refusal

0	Texture	Consistency	Color	Redox Features
10				
20				
30				
40				
50				
60				

Depth below mineral soil surface (inches)

Soil Details by

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater	<input type="checkbox"/> Restrictive Layer	<input type="checkbox"/> Bedrock
Profile _____ Condition _____	Percent _____	15 " Depth	<input type="checkbox"/> Hydric	Hydrologic	<input type="checkbox"/> Non-hydric
Soil Series/Phase Name: _____					
Soil Group					

Exploration Symbol # P-7     Test Pit     Boring     Probe

\_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_\_ " Depth of exploration or to refusal

0	Texture	Consistency	Color	Redox Features
10				
20				
30				
40				
50				
60				

Depth below mineral soil surface (inches)

Soil Details by

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater	<input type="checkbox"/> Restrictive Layer	<input type="checkbox"/> Bedrock
Profile _____ Condition _____	Percent _____	16 " Depth	<input type="checkbox"/> Hydric	Hydrologic	<input type="checkbox"/> Non-hydric
Soil Series/Phase Name: _____					
Soil Group					

Exploration Symbol # P-3     Test Pit     Boring     Probe

\_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_\_ " Depth of exploration or to refusal

0	Texture	Consistency	Color	Redox Features
10				
20				
30				
40				
50				
60				

Depth below mineral soil surface (inches)

Soil Details by

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater	<input type="checkbox"/> Restrictive Layer	<input type="checkbox"/> Bedrock
Profile _____ Condition _____	Percent _____	16 " Depth	<input type="checkbox"/> Hydric	Hydrologic	<input type="checkbox"/> Non-hydric
Soil Series/Phase Name: _____					
Soil Group					

Exploration Symbol # P-4     Test Pit     Boring     Probe

\_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_

\_\_\_\_\_ " Depth of exploration or to refusal

0	Texture	Consistency	Color	Redox Features
10				
20				
30				
40				
50				
60				

Depth below mineral soil surface (inches)

Soil Details by

Soil Classification	Slope	Limiting Factor	<input checked="" type="checkbox"/> Groundwater	<input type="checkbox"/> Restrictive Layer	<input type="checkbox"/> Bedrock
Profile _____ Condition _____	Percent _____	15 " Depth	<input type="checkbox"/> Hydric	Hydrologic	<input type="checkbox"/> Non-hydric
Soil Series/Phase Name: _____					
Soil Group					

**INVESTIGATOR INFORMATION AND SIGNATURE**

Signature 	Date 11/19/19
Name Printed Mark J. Hampton	Cert/Lic/Reg. # 263/216
Title <input checked="" type="checkbox"/> Licensed Site Evaluator <input checked="" type="checkbox"/> Certified Soil Scientist <input type="checkbox"/> Certified Geologist <input type="checkbox"/> Professional Engineer	

affix professional seal

**SOIL PROFILE / CLASSIFICATION INFORMATION**

**DETAILED DESCRIPTION OF SUBSURFACE CONDITIONS AT PROJECT SITES**

Project Name: <b>Highland Subdivision</b>	Applicant Name: <b>Leavitt-Thompson</b>	Project Location (municipality): <b>Standish</b>
--	--	---

Exploration Symbol # P-5     Test Pit     Boring     Probe  
 \_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_  
 \_\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0				
10				
20	[Handwritten: Ledge]			
30				
40				
50				
60				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater <input type="checkbox"/> Restrictive Layer <input checked="" type="checkbox"/> Bedrock
Profile _____ Condition _____	Percent _____	15 " Depth	
Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

Exploration Symbol # P-6     Test Pit     Boring     Probe  
 \_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_  
 \_\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0				
10				
20	[Handwritten: Ledge]			
30				
40				
50				
60				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater <input type="checkbox"/> Restrictive Layer <input checked="" type="checkbox"/> Bedrock
Profile _____ Condition _____	Percent _____	17 " Depth	
Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

Exploration Symbol # P-7     Test Pit     Boring     Probe  
 \_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_  
 \_\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0				
10				
20	[Handwritten: Ledge]			
30				
40				
50				
60				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater <input type="checkbox"/> Restrictive Layer <input checked="" type="checkbox"/> Bedrock
Profile _____ Condition _____	Percent _____	17 " Depth	
Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

Exploration Symbol # P-8     Test Pit     Boring     Probe  
 \_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_  
 \_\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0				
10				
20	[Handwritten: Ledge]			
30				
40				
50				
60				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater <input type="checkbox"/> Restrictive Layer <input checked="" type="checkbox"/> Bedrock
Profile _____ Condition _____	Percent _____	16 " Depth	
Soil Series/Phase Name:		<input type="checkbox"/> Hydric <input type="checkbox"/> Non-hydric	Hydrologic Soil Group

**INVESTIGATOR INFORMATION AND SIGNATURE**

Signature <i>[Handwritten Signature]</i>	Date <b>11/19/19</b>
Name Printed <b>Mark J. Hampton</b>	Cert/Lic/Reg. # <b>263/216</b>
Title <input checked="" type="checkbox"/> Licensed Site Evaluator <input checked="" type="checkbox"/> Certified Soil Scientist <input type="checkbox"/> Certified Geologist <input type="checkbox"/> Professional Engineer	

affix professional seal

### SOIL PROFILE / CLASSIFICATION INFORMATION

### DETAILED DESCRIPTION OF SUBSURFACE CONDITIONS AT PROJECT SITES

Project Name: <b>Highland Subdivision</b>	Applicant Name: <b>Leavitt-Thompson</b>	Project Location (municipality): <b>Standish</b>
--	--	---

Exploration Symbol # P-9     Test Pit     Boring     Probe  
 \_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_  
 \_\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0				
10				
20	Ledge			
30				
40				
50				
60				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater
Profile _____ Condition _____	Percent _____	16 " Depth	<input type="checkbox"/> Restrictive Layer
Soil Series/Phase Name:			<input checked="" type="checkbox"/> Bedrock
S.S.		<input type="checkbox"/> Hydric	Hydrologic
		<input type="checkbox"/> Non-hydric	Soil Group

Exploration Symbol # P-10     Test Pit     Boring     Probe  
 \_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_  
 \_\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0				
10				
20	Ledge			
30				
40				
50				
60				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater
Profile _____ Condition _____	Percent _____	17 " Depth	<input type="checkbox"/> Restrictive Layer
Soil Series/Phase Name:			<input checked="" type="checkbox"/> Bedrock
S.S.		<input type="checkbox"/> Hydric	Hydrologic
		<input type="checkbox"/> Non-hydric	Soil Group

Exploration Symbol # P-11     Test Pit     Boring     Probe  
 \_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_  
 \_\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0				
10				
20	Ledge			
30				
40				
50				
60				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater
Profile _____ Condition _____	Percent _____	14 " Depth	<input type="checkbox"/> Restrictive Layer
Soil Series/Phase Name:			<input checked="" type="checkbox"/> Bedrock
S.S.		<input type="checkbox"/> Hydric	Hydrologic
		<input type="checkbox"/> Non-hydric	Soil Group

Exploration Symbol # P-12     Test Pit     Boring     Probe  
 \_\_\_\_\_ " Organic horizon thickness    Ground surface elev. \_\_\_\_\_  
 \_\_\_\_\_ " Depth of exploration or to refusal

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0				
10				
20	Ledge			
30				
40				
50				
60				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater
Profile _____ Condition _____	Percent _____	14 " Depth	<input type="checkbox"/> Restrictive Layer
Soil Series/Phase Name:			<input checked="" type="checkbox"/> Bedrock
S.S.		<input type="checkbox"/> Hydric	Hydrologic
		<input type="checkbox"/> Non-hydric	Soil Group

### INVESTIGATOR INFORMATION AND SIGNATURE

Signature 	Date 11/19/19
Name Printed Mark J. Hampton	Cert/Lic/Reg. # 263/216
Title <input checked="" type="checkbox"/> Licensed Site Evaluator <input checked="" type="checkbox"/> Certified Soil Scientist <input type="checkbox"/> Certified Geologist <input type="checkbox"/> Professional Engineer	

affix professional seal

### SOIL PROFILE / CLASSIFICATION INFORMATION

### DETAILED DESCRIPTION OF SUBSURFACE CONDITIONS AT PROJECT SITES

Project Name: <b>Highland Subdivision</b>	Applicant Name: <b>Leavitt-Thompson</b>	Project Location (municipality): <b>Standish</b>
--	--	---

Exploration Symbol # P-13     Test Pit     Boring     Probe  
 " Organic horizon thickness    Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0				
10				
20	Ledge			
30				
40				
50				
60				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater
Profile _____ Condition _____	Percent _____	15 " Depth	<input type="checkbox"/> Restrictive Layer
Soil Series/Phase Name:		<input type="checkbox"/> Hydric	Hydrologic
		<input type="checkbox"/> Non-hydric	Soil Group _____

Exploration Symbol # P-14     Test Pit     Boring     Probe  
 " Organic horizon thickness    Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0				
10				
20	Ledge			
30				
40				
50				
60				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater
Profile _____ Condition _____	Percent _____	15 " Depth	<input type="checkbox"/> Restrictive Layer
Soil Series/Phase Name:		<input type="checkbox"/> Hydric	Hydrologic
		<input type="checkbox"/> Non-hydric	Soil Group _____

Exploration Symbol # P-15     Test Pit     Boring     Probe  
 " Organic horizon thickness    Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0				
10				
20	Ledge			
30				
40				
50				
60				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater
Profile _____ Condition _____	Percent _____	14 " Depth	<input type="checkbox"/> Restrictive Layer
Soil Series/Phase Name:		<input type="checkbox"/> Hydric	Hydrologic
		<input type="checkbox"/> Non-hydric	Soil Group _____

Exploration Symbol # P-16     Test Pit     Boring     Probe  
 " Organic horizon thickness    Ground surface elev. \_\_\_\_\_  
 " Depth of exploration or to refusal \_\_\_\_\_

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Redox Features
0				
10				
20	Ledge			
30				
40				
50				
60				

Soil Classification	Slope	Limiting Factor	<input type="checkbox"/> Groundwater
Profile _____ Condition _____	Percent _____	23 " Depth	<input type="checkbox"/> Restrictive Layer
Soil Series/Phase Name:		<input type="checkbox"/> Hydric	Hydrologic
		<input type="checkbox"/> Non-hydric	Soil Group _____

### INVESTIGATOR INFORMATION AND SIGNATURE

Signature 	Date 11/19/19
Name Printed Mark J. Hampton	Cert/Lic/Reg. # 263/216
Title <input checked="" type="checkbox"/> Licensed Site Evaluator <input checked="" type="checkbox"/> Certified Soil Scientist <input type="checkbox"/> Certified Geologist <input type="checkbox"/> Professional Engineer	

affix professional seal



## **HHE-200 FORMS FOR CONDOMINIUMS**

4474

# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

<b>PROPERTY LOCATION</b>		<b>&gt;&gt; CAUTION: LPI APPROVAL REQUIRED &lt;&lt;</b>	
City, Town, or Plantation	Standish	Town/City	Permit #
Street or Road	Kayli Susan Drive	Date Permit Issued: ___/___/___	Fee: \$ _____ Double Fee Charged [ ]
Subdivision, Lot #	Highlands Subdivision Units 1-4, 9-12	Local Plumbing Inspector Signature	L.P.I. # _____
<b>OWNER/APPLICANT INFORMATION</b>		Fee: \$ _____ state min fee \$ _____ Locally adopted fee	Copy: [ ] Owner [ ] Town [ ] State
Name (last, first, MI)	Leavitt-Tompson LLC	The Subsurface Wastewater Disposal System shall not be installed until a Permit is issued by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with this application and the Maine Subsurface Wastewater Disposal Rules.	
Mailing Address of Owner/Applicant	PO Box 703 Standish 04084	Municipal Tax Map # _____ Lot # _____	
Daytime Tel. #		<b>CAUTION: INSPECTION REQUIRED</b>	
<b>OWNER OR APPLICANT STATEMENT</b>		I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.	
I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit.		(1st) date approved _____	
Signature of Owner or Applicant _____ Date _____		Local Plumbing Inspector Signature _____ (2nd) date approved _____	

PERMIT INFORMATION		
<b>TYPE OF APPLICATION</b>	<b>THIS APPLICATION REQUIRES</b>	<b>DISPOSAL SYSTEM COMPONENTS</b>
1. First Time System 2. Replacement System Type replaced: _____ Year installed: _____ 3. Expanded System a. <25% Expansion b. >25% Expansion 4. Experimental System 5. Seasonal Conversion	1. No Rule Variance 2. First Time System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 3. Replacement System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 4. Minimum Lot Size Variance 5. Seasonal Conversion Permit	1. Complete Non-engineered System 2. Primitive System (graywater & alt. toilet) 3. Alternative Toilet, specify: _____ 4. Non-engineered Treatment Tank (only) 5. Holding Tank, _____ gallons 6. Non-engineered Disposal Field (only) 7. Separated Laundry System 8. Complete Engineered System (2000 gpd or more) 9. Engineered Treatment Tank (only) 10. Engineered Disposal Field (only) 11. Pre-treatment, specify: _____ 12. Miscellaneous Components
<b>SIZE OF PROPERTY</b>	<b>DISPOSAL SYSTEM TO SERVE</b>	<b>TYPE OF WATER SUPPLY</b>
91 SQ. FT. ACRES	1. Single Family Dwelling Unit, No. of Bedrooms: _____ 2. Multiple Family Dwelling, No. of Units: _____ 3. Other: 8 2-bedroom units (specify) Current Use Seasonal Year Round <u>Undeveloped</u>	1. Drilled Well 2. Dug Well 3. Private 4. <u>Public</u> 5. Other
<b>SHORELAND ZONING</b>	<b>DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)</b>	
Yes <u>No</u>		

<b>TREATMENT TANK</b>	<b>DISPOSAL FIELD TYPE &amp; SIZE</b>	<b>GARBAGE DISPOSAL UNIT</b>	<b>DESIGN FLOW</b>
1. Concrete a. Regular b. Low Profile 2. Plastic 3. Other: CAPACITY: <u>2x1500</u> GAL.	1. Stone Bed 2. Stone Trench 3. Proprietary Device a. cluster array c. Linear b. regular load d. H-20 load 4. Other: SIZE: <u>5184</u> sq. ft. lin. ft.	1. No 2. Yes 3. Maybe If Yes or Maybe, specify one below: a. multi-compartment tank b. ___ tanks in series c. increase in tank capacity d. Filter on Tank Outlet	<u>1440</u> gallons per day BASED ON: 1. Table 4A (dwelling unit(s)) 2. Table 4C (other facilities) SHOW CALCULATIONS for other facilities
<b>SOIL DATA &amp; DESIGN CLASS</b>	<b>DISPOSAL FIELD SIZING</b>	<b>EFFLUENT/EJECTOR PUMP</b>	<b>LATITUDE AND LONGITUDE</b>
PROFILE CONDITION <u>3 / C</u> at Observation Hole # <u>TP113</u> Depth <u>16</u> " of Most Limiting Soil Factor	1. Medium—2.6 sq. ft. / gpd 2. <u>Medium—Large 3.3 sq. ft. / gpd</u> 3. Large—4.1 sq. ft. / gpd 4. Extra Large—5.0 sq. ft. / gpd	1. Not Required 2. May Be Required 3. <u>Required</u> Specify only for engineered systems: DOSE: _____ gallons	3. Section 4G (meter readings) ATTACH WATER METER DATA at center of disposal area Lat. <u>43</u> d <u>44</u> m <u>05</u> s Lon. <u>70</u> d <u>34</u> m <u>22</u> s if g.p.s, state margin of error: <u>15</u>

SITE EVALUATOR STATEMENT		
I certify that on <u>11/14/2019</u> (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).		
<u>Mark J Hampton</u> Site Evaluator Signature	<u>263</u> SE #	<u>11/14/2019</u> Date
Mark J Hampton Site Evaluator Name Printed	207-756-2900 Telephone Number	 E-mail Address

4474

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation

Street, Road, Subdivision


Standish Kayli Susan Drive Highlands Subdivision Units 1-4, 9-12

Owner's Name


Leavitt-Tompson LLC

**SITE PLAN**

Scale 1" = \_\_\_\_\_ ft. or as shown

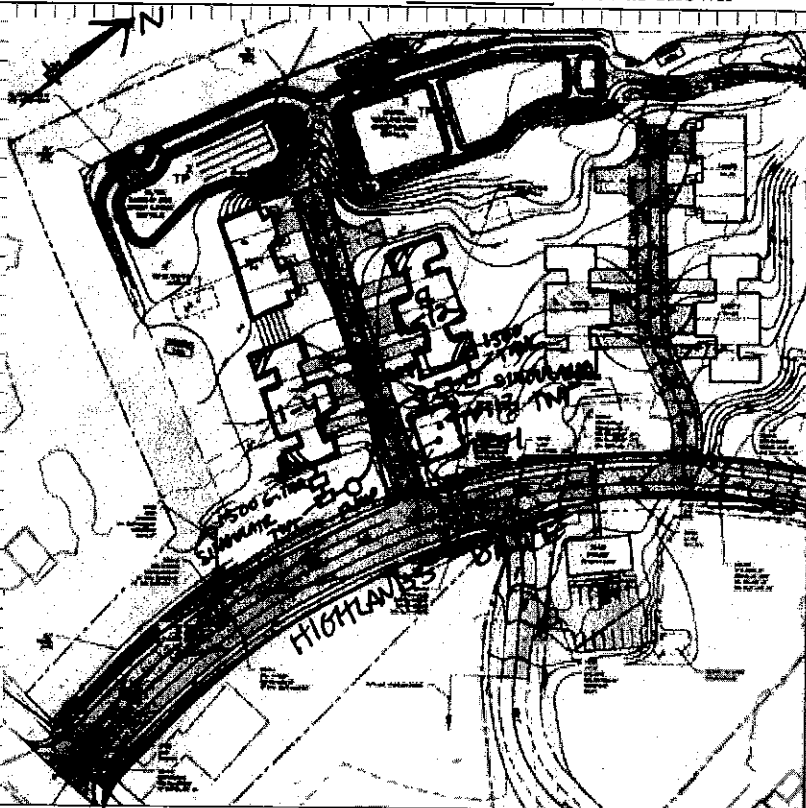

**SITE LOCATION PLAN**

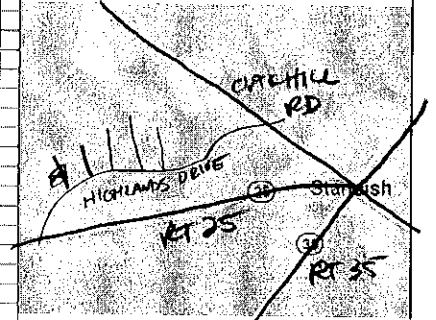

**SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)**

Observation Hole TP113  Test Pit  Boring  
 \_\_\_\_\_ " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3</b> C Profile Condition	Slope <b>4</b> %	Limiting Factor <b>16</b> "	<input checked="" type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	---

Observation Hole TP71  Test Pit  Boring  
 \_\_\_\_\_ " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20		Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3</b> C Profile Condition	Slope <b>4</b> %	Limiting Factor <b>18</b> "	<input checked="" type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	---

*Handwritten Signature*  
 Site Evaluator Signature

263

SE #

11/14/2019

Date



4474


# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Health & Human Services  
Division of Environmental Health  
(207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation: Standish  
Street, Road, Subdivision: Kayli Susan Drive Highlands Subdivision Units 1-4, 9-12

Owner's Name: Leavitt-Tompson LLC

## SUBSURFACE WASTEWATER DISPOSAL PLAN

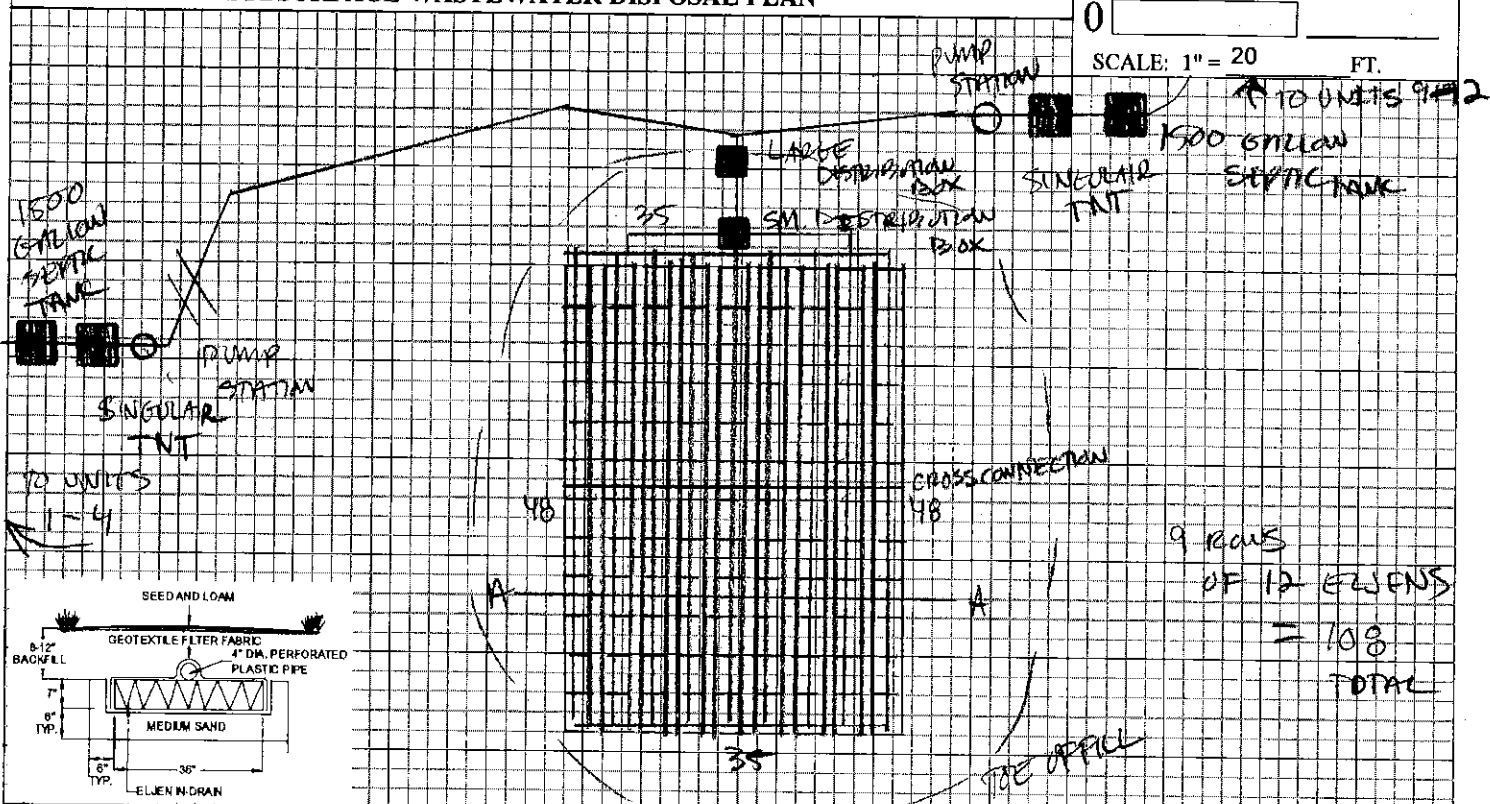

### FILL REQUIREMENTS

Depth of Fill (Upslope) 20

Depth of Fill (Downslope) 36

### CONSTRUCTION ELEVATIONS

Finished Grade Elevation \_\_\_\_\_

Top of Distribution Pipe or Proprietary Device \_\_\_\_\_

Bottom of Disposal Area \_\_\_\_\_

### ELEVATION REFERENCE POINT

Location & Description: \_\_\_\_\_

Reference Elevation: 0

Note: Materials and installation shall be in accordance with Maine Subsurface Wastewater Disposal Rules dated 08/15 as amended.


### DISPOSAL AREA CROSS SECTION

Scale

Horizontal 1" = 6 ft.

Vertical 1" = 4 ft.

Note: All ground to be filled must be scarified

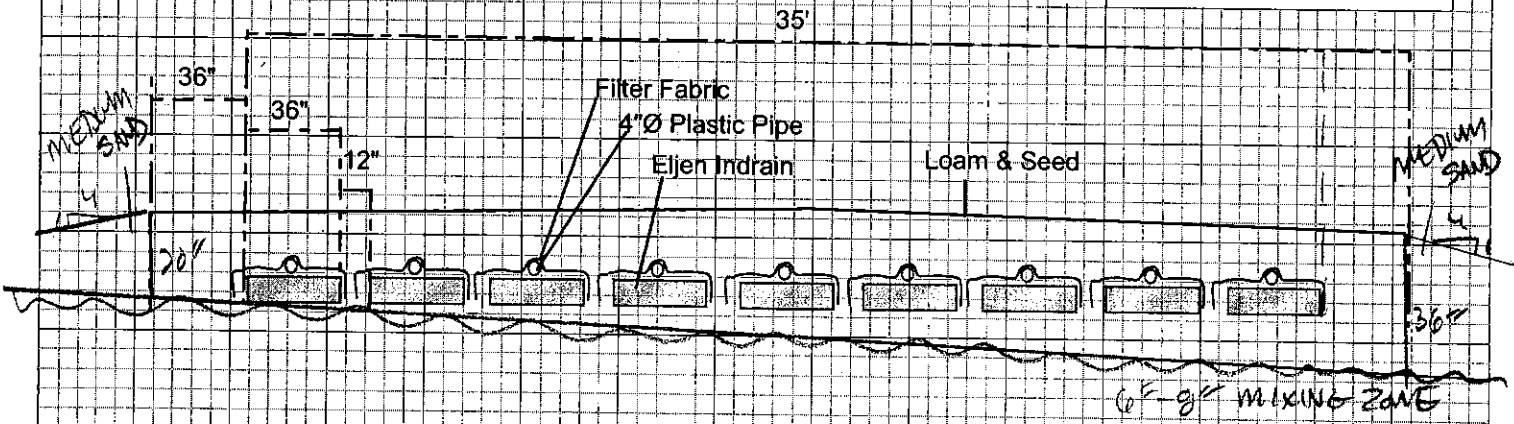

263

11/14/2019

Site Evaluator Signature

SE #

Date

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Maine Dept. Health & Human Services  
Div. Environmental Health, 11SHS  
(207) 287-2070 Fax: (207) 287-4172

<b>PROPERTY LOCATION</b>		<b>&gt;&gt; CAUTION: LPI APPROVAL REQUIRED &lt;&lt;</b>	
City, Town, or Plantation	Standish	Town/City _____	Permit # _____
Street or Road	Kayli Susan Drive	Date Permit Issued: ___/___/___	Fee: \$ _____ Double Fee Charged [ ]
Subdivision, Lot #	Highlands Subdivision Units 5-8	L.P.I. # _____	
<b>OWNER/APPLICANT INFORMATION</b>		Local Plumbing Inspector Signature _____	
Name (last, first, MI)	Leavitt-Tompson LLC	Fee: \$ _____ state min fee \$ _____	Locally adopted fee _____
Mailing Address of Owner/Applicant	PO Box 703 Standish 04084	Copy: [ ] Owner [ ] Town [ ] State	
Daytime Tel. #		The Subsurface Wastewater Disposal System shall not be installed until a Permit is issued by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with this application and the Maine Subsurface Wastewater Disposal Rules.	
<b>OWNER OR APPLICANT STATEMENT</b>		<b>CAUTION: INSPECTION REQUIRED</b>	
I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit.		I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.	
Signature of Owner or Applicant _____ Date _____		(1st) date approved _____	
		Local Plumbing Inspector Signature _____ (2nd) date approved _____	

PERMIT INFORMATION		
<b>TYPE OF APPLICATION</b> 1. <u>First Time System</u> 2. Replacement System Type replaced: _____ Year installed: _____ 3. Expanded System a. <25% Expansion b. >25% Expansion 4. Experimental System 5. Seasonal Conversion	<b>THIS APPLICATION REQUIRES</b> 1. <u>No Rule Variance</u> 2. First Time System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 3. Replacement System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 4. Minimum Lot Size Variance 5. Seasonal Conversion Permit	<b>DISPOSAL SYSTEM COMPONENTS</b> 1. <u>Complete Non-engineered System</u> 2. Primitive System (graywater & alt. toilet) 3. Alternative Toilet, specify: _____ 4. Non-engineered Treatment Tank (only) 5. Holding Tank, _____ gallons 6. Non-engineered Disposal Field (only) 7. Separated Laundry System 8. Complete Engineered System (2000 gpd or more) 9. Engineered Treatment Tank (only) 10. Engineered Disposal Field (only) 11. Pre-treatment, specify: _____ 12. Miscellaneous Components
<b>SIZE OF PROPERTY</b> 91 SQ. FT. <u>ACRES</u>	<b>DISPOSAL SYSTEM TO SERVE</b> 1. Single Family Dwelling Unit, No. of Bedrooms: _____ 2. <u>Multiple Family Dwelling, No. of Units: _____</u> 3. Other: <u>4 2-bedroom units</u> (specify) _____ Current Use Seasonal Year Round <u>Undeveloped</u>	<b>TYPE OF WATER SUPPLY</b> 1. Drilled Well 2. Dug Well 3. Private 4. <u>Public</u> 5. Other _____
<b>SHORELAND ZONING</b> Yes <u>No</u>	<b>DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)</b>	

<b>TREATMENT TANK</b> 1. <u>Concrete</u> a. <u>Regular</u> b. Low Profile 2. Plastic 3. Other: _____ CAPACITY: <u>1x1500</u> GAL.	<b>DISPOSAL FIELD TYPE &amp; SIZE</b> 1. Stone Bed 2. Stone Trench 3. <u>Proprietary Device</u> a. cluster array <u>c. Linear</u> <u>b. regular load</u> d. H-20 load 4. Other: _____ SIZE: <u>2400</u> sq. ft. lin. ft.	<b>GARBAGE DISPOSAL UNIT</b> 1. <u>No</u> 2. Yes 3. Maybe If Yes or Maybe, specify one below: a. multi-compartment tank b. _____ tanks in series c. increase in tank capacity d. Filter on Tank Outlet	<b>DESIGN FLOW</b> 720 gallons per day BASED ON: 1. Table 4A (dwelling unit(s)) 2. Table 4C (other facilities) SHOW CALCULATIONS for other facilities 3. Section 4G (meter readings) ATTACH WATER METER DATA
<b>SOIL DATA &amp; DESIGN CLASS</b> PROFILE CONDITION <u>3 / C</u> at Observation Hole # <u>TP52</u> Depth <u>16</u> " of Most Limiting Soil Factor	<b>DISPOSAL FIELD SIZING</b> 1. Medium--2.6 sq. ft. / gpd 2. <u>Medium--Large 3.3 sq. ft. / gpd</u> 3. Large--4.1 sq. ft. / gpd 4. Extra Large--5.0 sq. ft. / gpd	<b>EFFLUENT/EJECTOR PUMP</b> 1. Not Required 2. May Be Required 3. <u>Required</u> Specify only for engineered systems: DOSE: _____ gallons	<b>LATITUDE AND LONGITUDE</b> at center of disposal area Lat. <u>43</u> d <u>44</u> m <u>05</u> s Lon. <u>70</u> d <u>34</u> m <u>22</u> s if g.p.s, state margin of error: <u>15</u>

SITE EVALUATOR STATEMENT		
I certify that on <u>11/14/2019</u> (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).		
_____ Site Evaluator Signature <b>Mark J Hampton</b> Site Evaluator Name Printed	263 SE # 207-756-2900 Telephone Number	11/14/2019 Date _____ E-mail Address

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation

Street, Road, Subdivision

Owner's Name



Standish Kayli Susan Drive Highlands Subdivision Units 5-8

Leavitt-Tompson LLC

**SITE PLAN**

Scale 1" = \_\_\_\_\_ ft. or as shown

**SITE LOCATION PLAN**

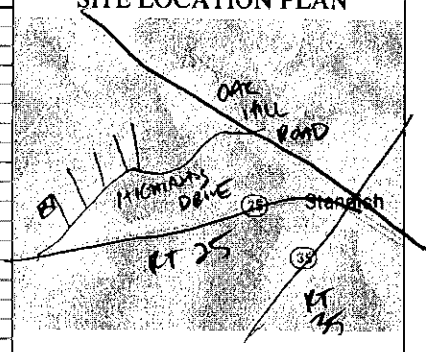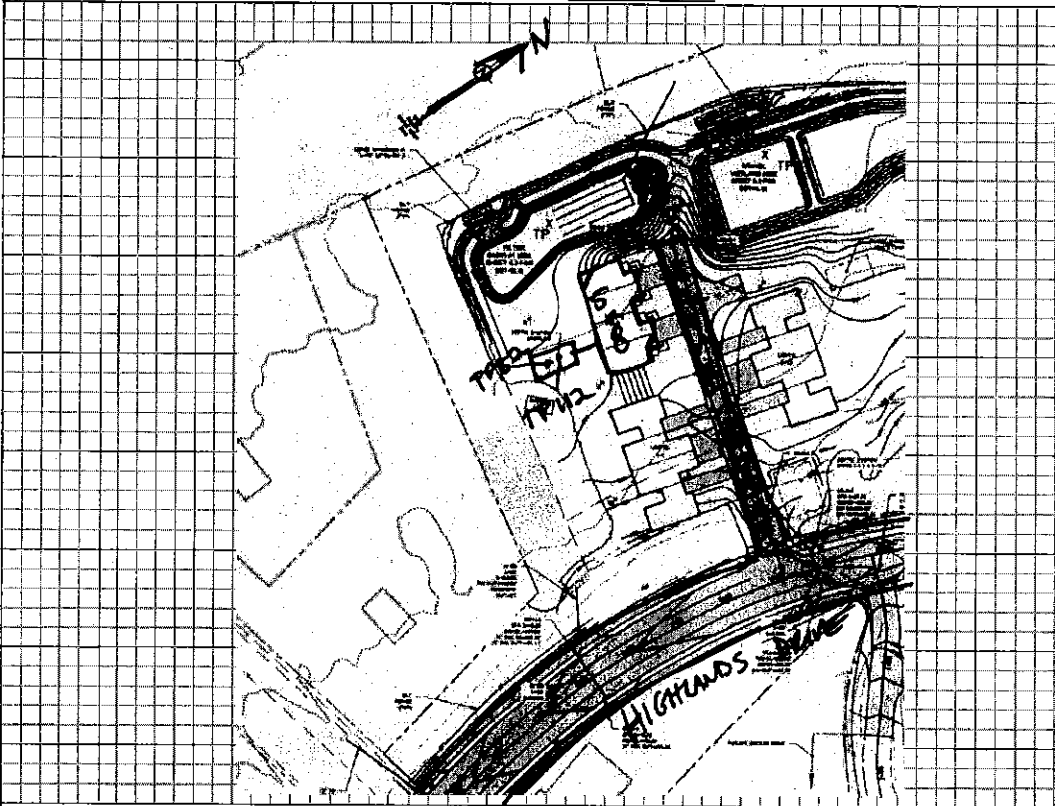

**SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)**

Observation Hole TP52  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <u>3</u> C Profile Condition	Slope <u>4</u> %	Limiting Factor <u>16</u> "	<input checked="" type="checkbox"/> Ground Water <input type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	--

Observation Hole TP112  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <u>3</u> C Profile Condition	Slope <u>3</u> %	Limiting Factor <u>16</u> "	<input checked="" type="checkbox"/> Ground Water <input type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	--

*[Handwritten Signature]*  
 Site Evaluator Signature

263

SE #

11/14/2019

Date

# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION



Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation: **Standish**  
 Street, Road, Subdivision: **Kayli Susan Drive Highlands Subdivision Units 5-8**

Owner's Name: **Leavitt-Tompson LLC**

## SUBSURFACE WASTEWATER DISPOSAL PLAN

0   
 SCALE: 1" = 20 FT.

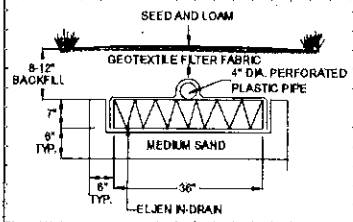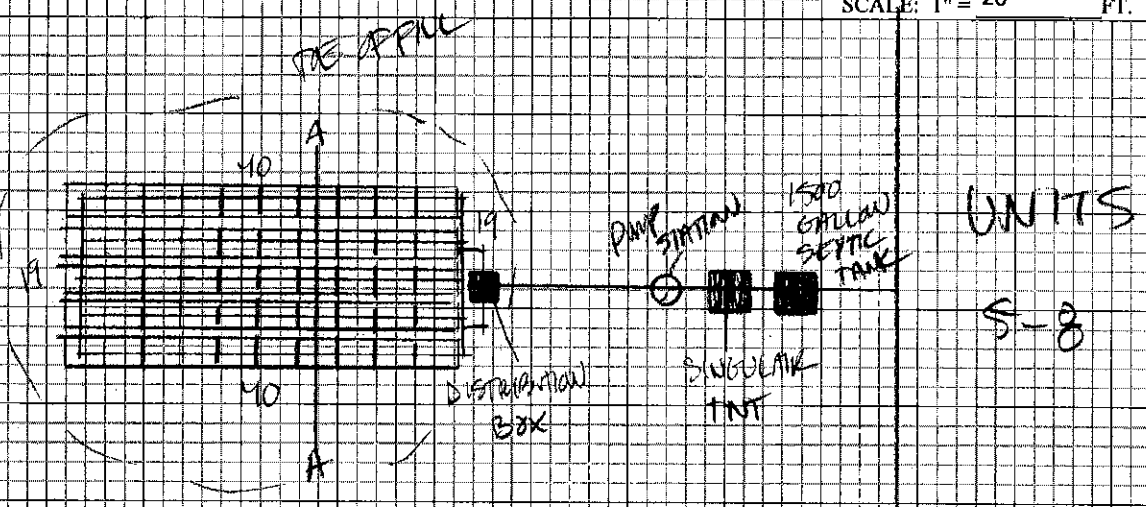

5 ROWS OF  
 10 ELJENS  
 = 50  
 TOTAL

### FILL REQUIREMENTS

Depth of Fill (Upslope) 20  
 Depth of Fill (Downslope) 29

### CONSTRUCTION ELEVATIONS

Finished Grade Elevation \_\_\_\_\_  
 Top of Distribution Pipe or Proprietary Device \_\_\_\_\_  
 Bottom of Disposal Area \_\_\_\_\_

### ELEVATION REFERENCE POINT

Location & Description: \_\_\_\_\_  
 Reference Elevation: 0

Note: Materials and installation shall be in accordance with Maine Subsurface Wastewater Disposal Rules dated 08/15 as amended.


### DISPOSAL AREA CROSS SECTION

A-A

#### Scale

Horizontal 1" = 4 ft.  
 Vertical 1" = 4 ft.

Note: All ground to be filled must be scarified

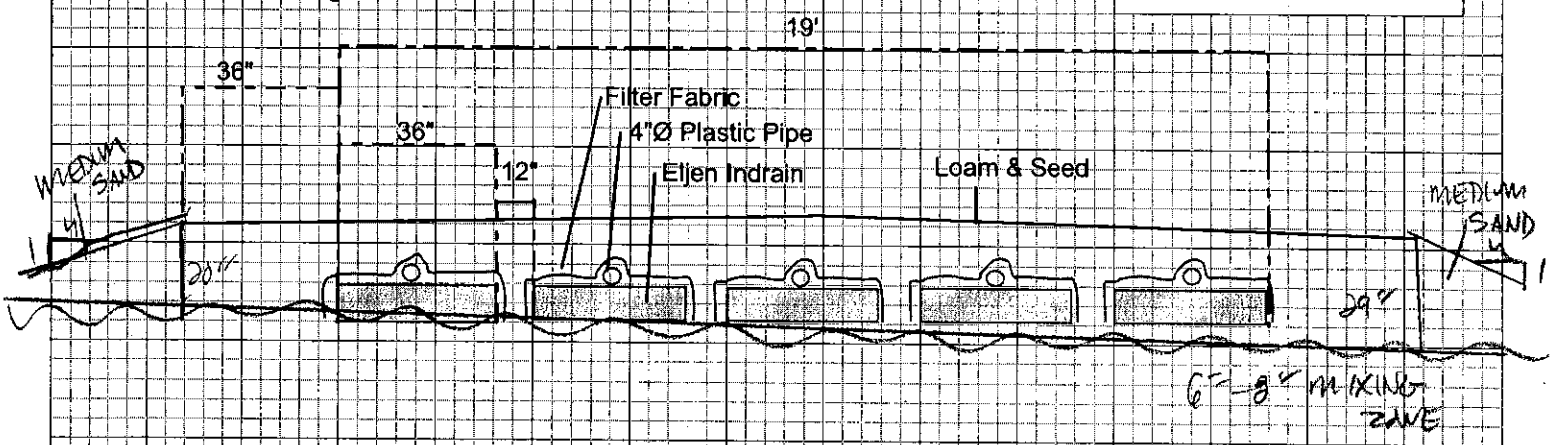

263

11/14/2019

Page 3 of 3

HHE-200 Rev. 02/11

Site Evaluator Signature

SE #

Date

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Maine Dept. Health & Human Services  
Div. Environmental Health, 11SHS  
(207) 287-2070 Fax: (207) 287-4172

<b>PROPERTY LOCATION</b>		<b>&gt;&gt; CAUTION: LPI APPROVAL REQUIRED &lt;&lt;</b>	
City, Town, or Plantation	Standish	Town/City _____	Permit # _____
Street or Road	Jesse Daniel Drive	Date Permit Issued: ___/___/___	Fee: \$ _____ Double Fee Charged [ ]
Subdivision, Lot #	Highlands Subdivision Units 13-16	L.P.I. # _____	
<b>OWNER/APPLICANT INFORMATION</b>		Local Plumbing Inspector Signature _____	
Name (last, first, MI)	Leavitt-Tompson LLC	Fee: \$ _____ state min fee \$ _____	Locally adopted fee _____
Mailing Address of Owner/Applicant	PO Box 703 Standish 04084	Copy: [ ] Owner [ ] Town [ ] State	
Daytime Tel. #		The Subsurface Wastewater Disposal System shall not be installed until a Permit is issued by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with this application and the Maine Subsurface Wastewater Disposal Rules.	
		Municipal Tax Map # _____ Lot # _____	
<b>OWNER OR APPLICANT STATEMENT</b>		<b>CAUTION: INSPECTION REQUIRED</b>	
I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit.		I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.	
Signature of Owner or Applicant _____ Date _____		(1st) date approved _____	
		Local Plumbing Inspector Signature _____ (2nd) date approved _____	

PERMIT INFORMATION		
<b>TYPE OF APPLICATION</b> 1. First Time System 2. Replacement System Type replaced: _____ Year installed: _____ 3. Expanded System a. <25% Expansion b. ≥25% Expansion 4. Experimental System 5. Seasonal Conversion	<b>THIS APPLICATION REQUIRES</b> 1. No Rule Variance 2. First Time System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 3. Replacement System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 4. Minimum Lot Size Variance 5. Seasonal Conversion Permit	<b>DISPOSAL SYSTEM COMPONENTS</b> 1. Complete Non-engineered System 2. Primitive System (graywater & alt. toilet) 3. Alternative Toilet, specify: _____ 4. Non-engineered Treatment Tank (only) 5. Holding Tank, _____ gallons 6. Non-engineered Disposal Field (only) 7. Separated Laundry System 8. Complete Engineered System (2000 gpd or more) 9. Engineered Treatment Tank (only) 10. Engineered Disposal Field (only) 11. Pre-treatment, specify: _____ 12. Miscellaneous Components
<b>SIZE OF PROPERTY</b> 91 SQ. FT. ACRES	<b>DISPOSAL SYSTEM TO SERVE</b> 1. Single Family Dwelling Unit, No. of Bedrooms: _____ 2. Multiple Family Dwelling, No. of Units: _____ 3. Other: 4 2-bedroom units (specify) Current Use Seasonal Year Round <u>Undeveloped</u>	<b>TYPE OF WATER SUPPLY</b> 1. Drilled Well 2. Dug Well 3. Private 4. Public 5. Other
<b>SHORELAND ZONING</b> Yes <u>No</u>		

DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)			
<b>TREATMENT TANK</b> 1. Concrete a. Regular b. Low Profile 2. Plastic 3. Other: _____ CAPACITY: <u>1x1500</u> GAL.	<b>DISPOSAL FIELD TYPE &amp; SIZE</b> 1. Stone Bed 2. Stone Trench 3. Proprietary Device a. cluster array c. Linear b. regular load d. H-20 load 4. Other: _____ SIZE: <u>2400</u> sq. ft. lin. ft.	<b>GARBAGE DISPOSAL UNIT</b> 1. No 2. Yes 3. Maybe If Yes or Maybe, specify one below: a. multi-compartment tank b. ___ tanks in series c. increase in tank capacity d. Filter on Tank Outlet	<b>DESIGN FLOW</b> _____ 720 gallons per day BASED ON: 1. Table 4A (dwelling unit(s)) 2. Table 4C (other facilities) SHOW CALCULATIONS for other facilities
<b>SOIL DATA &amp; DESIGN CLASS</b> PROFILE CONDITION <u>3 / C</u> at Observation Hole # <u>TP116</u> Depth <u>16</u> " of Most Limiting Soil Factor	<b>DISPOSAL FIELD SIZING</b> 1. Medium--2.6 sq. ft. / gpd 2. Medium--Large 3.3 sq. ft. / gpd 3. Large--4.1 sq. ft. / gpd 4. Extra Large--5.0 sq. ft. / gpd	<b>EFFLUENT/EJECTOR PUMP</b> 1. Not Required 2. May Be Required 3. Required Specify only for engineered systems: DOSE: _____ gallons	3. Section 4G (meter readings) ATTACH WATER METER DATA  <b>LATITUDE AND LONGITUDE</b> at center of disposal area Lat. <u>43</u> d <u>44</u> m <u>10</u> s Lon. <u>70</u> d <u>34</u> m <u>16</u> s if g.p.s, state margin of error: <u>15</u>

SITE EVALUATOR STATEMENT		
I certify that on <u>11/14/2019</u> (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).		
_____ Site Evaluator Signature <b>Mark J Hampton</b> Site Evaluator Name Printed	_____ SE # <b>207-756-2900</b> Telephone Number	_____ Date <b>11/14/2019</b> E-mail Address

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation

Street, Road, Subdivision

Owner's Name



Standish Jesse Daniel Drive Highlands Subdivision Units 13-16

Leavitt-Tompson LLC

**SITE PLAN**

Scale 1" = ft. or as shown

**SITE LOCATION PLAN**

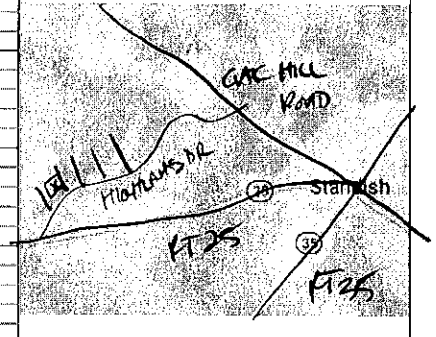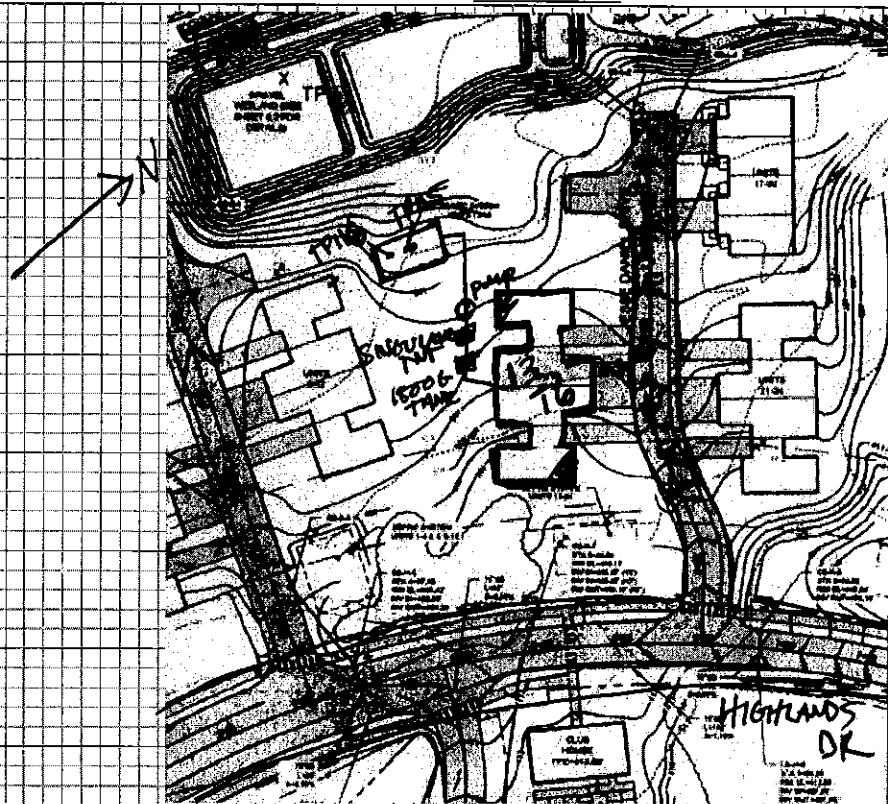

**SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)**

Observation Hole TP116  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3 C</b> Profile Condition	Slope <b>3</b> %	Limiting Factor <b>16</b> "	<input checked="" type="checkbox"/> Ground Water <input type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	--

Observation Hole TP115  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3 C</b> Profile Condition	Slope <b>4</b> %	Limiting Factor <b>17</b> "	<input checked="" type="checkbox"/> Ground Water <input type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	--

*[Handwritten Signature]*  
 Site Evaluator Signature

263

SE #

11/14/2019

Date

4474

# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Health & Human Services  
Division of Environmental Health  
(207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation

Street, Road, Subdivision

Standish

Jesse Daniel Drive



Highlands Subdivision Units 13-16

Owner's Name

Leavitt-Tompson LLC

## SUBSURFACE WASTEWATER DISPOSAL PLAN

0    
SCALE: 1" = 20 FT.

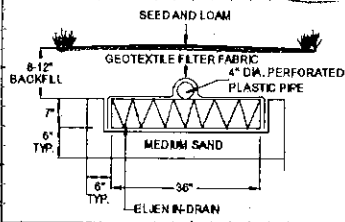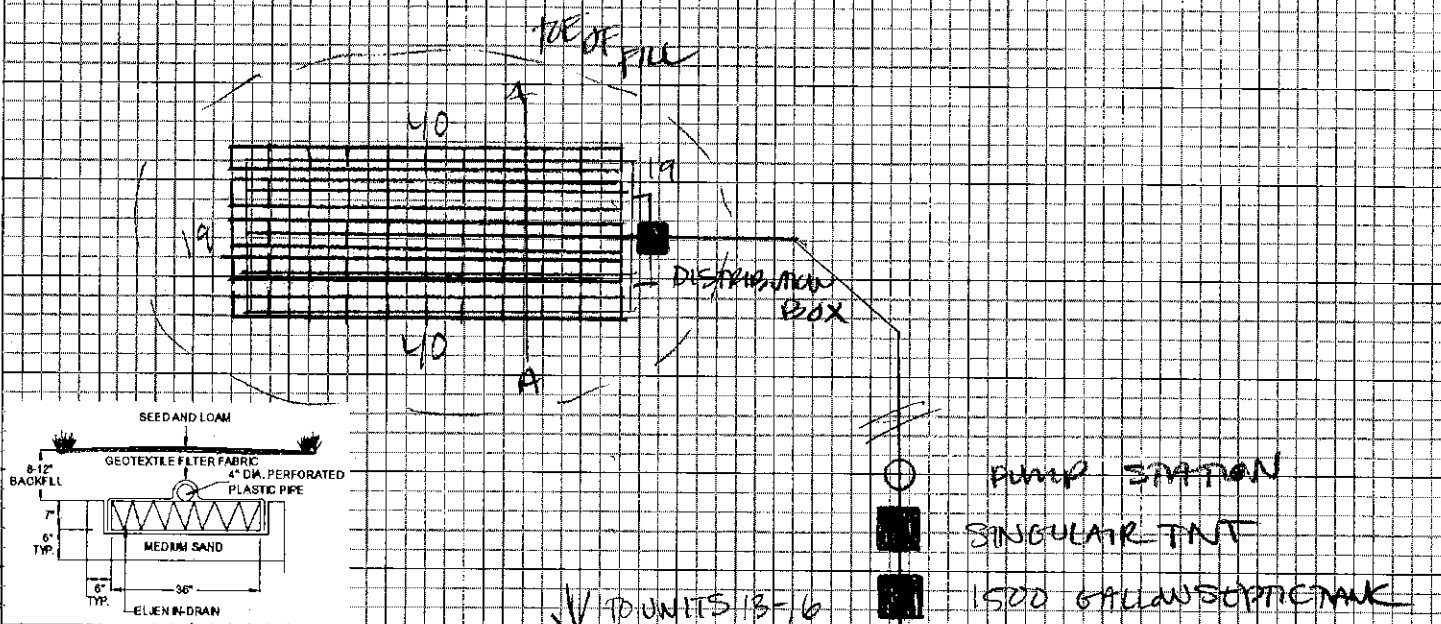

FILL REQUIREMENTS		CONSTRUCTION ELEVATIONS		ELEVATION REFERENCE POINT	
Depth of Fill (Upslope)	20	Finished Grade Elevation	_____	Location & Description:	_____
Depth of Fill (Downslope)	29	Top of Distribution Pipe or Proprietary Device	_____	Reference Elevation:	0
		Bottom of Disposal Area	_____		

Note: Materials and installation shall be in accordance with Maine Subsurface Wastewater Disposal Rules dated 08/15 as amended.


### DISPOSAL AREA CROSS SECTION

Scale

Horizontal 1" = 4 ft.

Vertical 1" = 4 ft.

Note: All ground to be filled must be scarified

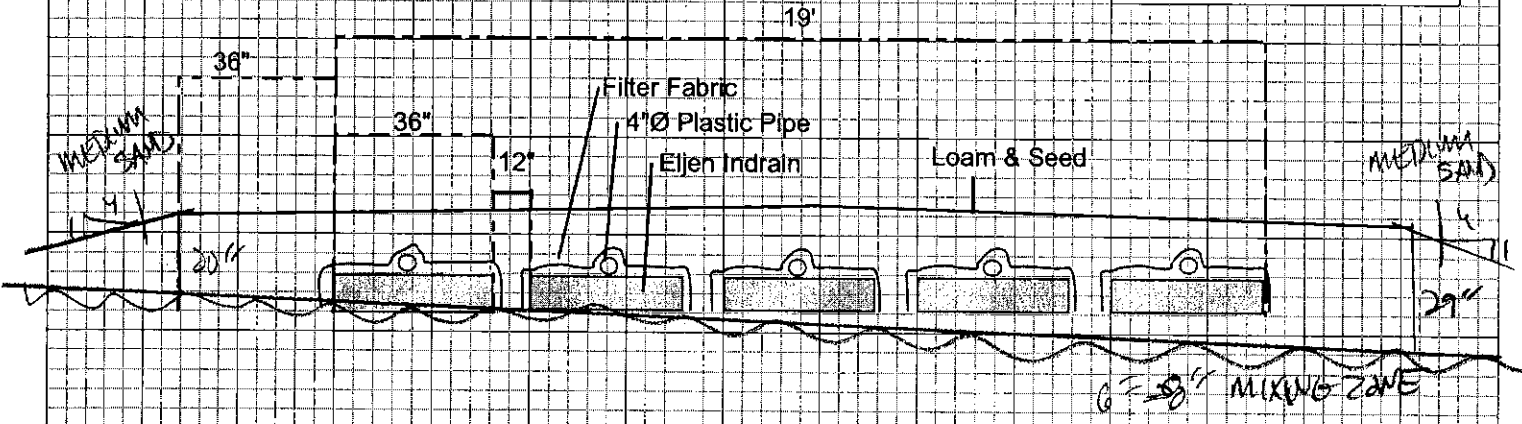

263

11/14/2019

Page 3 of 3

HHE-200 Rev. 02/11

Site Evaluator Signature

SE #

Date



4474

SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Dept. Health & Human Services
Div. Environmental Health, 115HS
(207) 287-2070 Fax: (207) 287-4172

PROPERTY LOCATION: Standish, Jesse Daniel Drive, Highlands Subdivision Units 17-24. OWNER/APPLICANT INFORMATION: Leavitt-Tompson LLC. CAUTION: LPI APPROVAL REQUIRED. CAUTION: INSPECTION REQUIRED.

PERMIT INFORMATION. TYPE OF APPLICATION: 1. First Time System. THIS APPLICATION REQUIRES: 1. No Rule Variance. DISPOSAL SYSTEM COMPONENTS: 1. Complete Non-engineered System. TYPE OF WATER SUPPLY: 4. Public.

DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3). TREATMENT TANK: 1. Concrete. DISPOSAL FIELD TYPE & SIZE: 3. Proprietary Device. GARBAGE DISPOSAL UNIT: 1. No. DESIGN FLOW: 1440 gallons per day. SOIL DATA & DESIGN CLASS: 3 / C. DISPOSAL FIELD SIZING: 2. Medium-Large 3.3 sq. ft. / gpd. EFFLUENT/EJECTOR PUMP: 3. Required.

SITE EVALUATOR STATEMENT. I certify that on 11/14/2019 (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241). Site Evaluator Signature: Mark J Hampton. SE #: 263. Date: 11/14/2019. Telephone Number: 207-756-2900.



4474

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation

Street, Road, Subdivision

Owner's Name



Standish Jesse Daniel Drive Highlands Subdivision Units 17-24

Leavitt-Tompson LLC

**SITE PLAN**

Scale 1" = ft. or as shown

**SITE LOCATION PLAN**

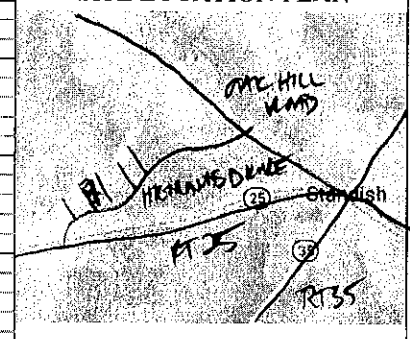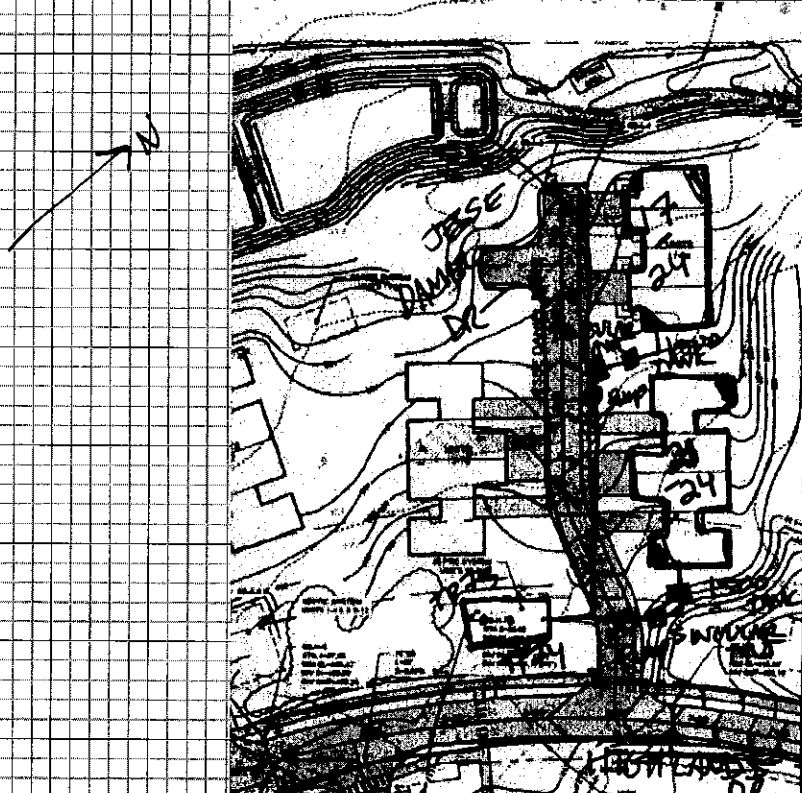

**SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)**

Observation Hole TP73  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Observation Hole TP74  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3 C</b> Profile Condition	Slope <b>4</b> %	Limiting Factor <b>16</b> "	<input checked="" type="checkbox"/> Ground Water <input type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	--

Soil Classification <b>3 C</b> Profile Condition	Slope <b>4</b> %	Limiting Factor <b>16</b> "	<input checked="" type="checkbox"/> Ground Water <input type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	--

*[Handwritten Signature]*  
 Site Evaluator Signature

263

SE #

11/14/2019

Date

4474

# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION


Department of Health & Human Services  
Division of Environmental Health  
(207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation  
Standish Jesse Daniel Drive Highlands Subdivision Units 17-24

Street, Road, Subdivision

Owner's Name  
Leavitt-Tompson LLC

## SUBSURFACE WASTEWATER DISPOSAL PLAN

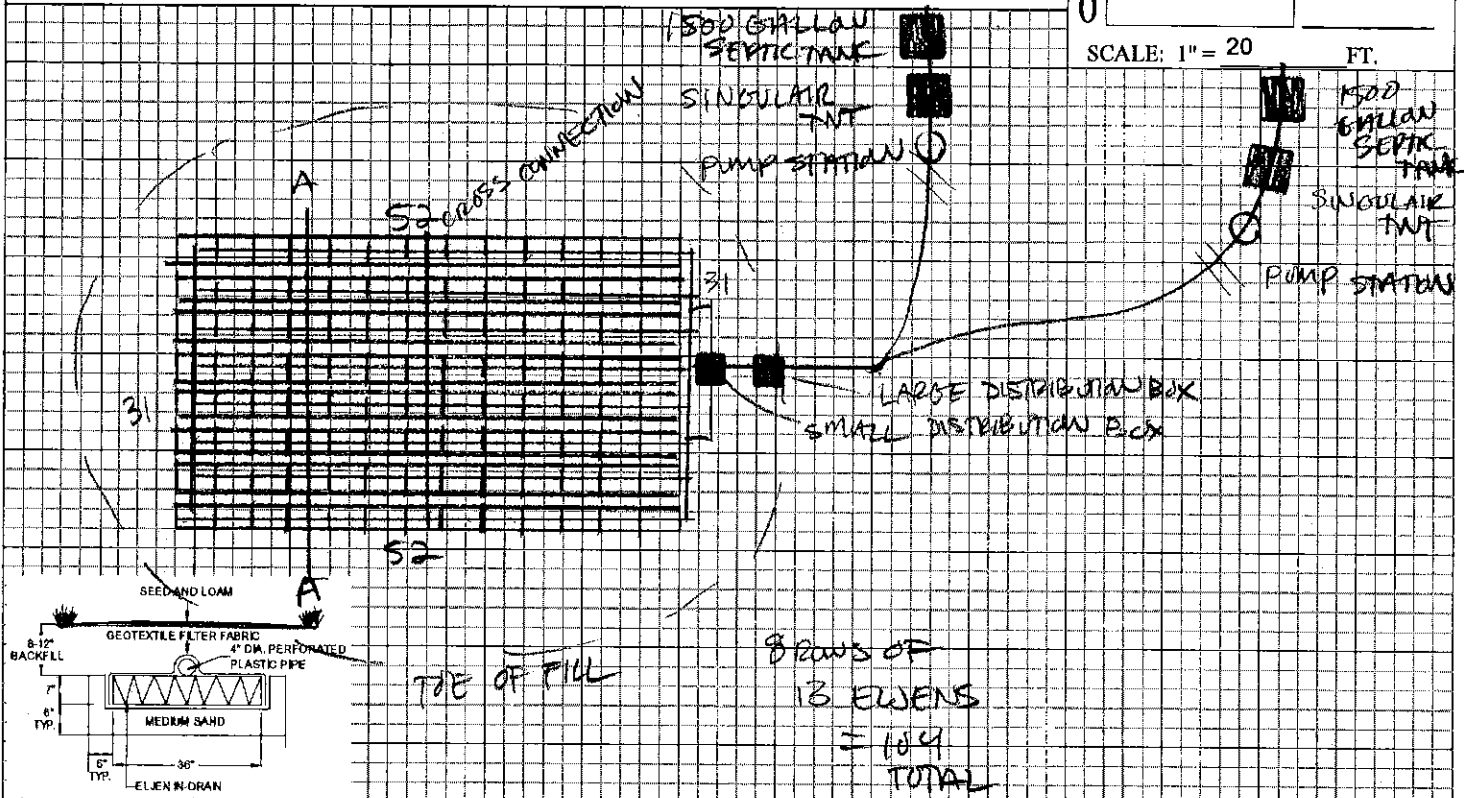

0 [ ]  
SCALE: 1" = 20 FT.

### FILL REQUIREMENTS

Depth of Fill (Upslope) 20  
Depth of Fill (Downslope) 34

### CONSTRUCTION ELEVATIONS

Finished Grade Elevation \_\_\_\_\_  
Top of Distribution Pipe or Proprietary Device \_\_\_\_\_  
Bottom of Disposal Area \_\_\_\_\_

### ELEVATION REFERENCE POINT

Location & Description: \_\_\_\_\_  
Reference Elevation: 0

Note: Materials and installation shall be in accordance with Maine Subsurface Wastewater Disposal Rules dated 08/15 as amended.


### DISPOSAL AREA CROSS SECTION

A-A

Scale

Horizontal 1" = 6 ft.  
Vertical 1" = 4 ft.

Note: All ground to be filled must be scarified

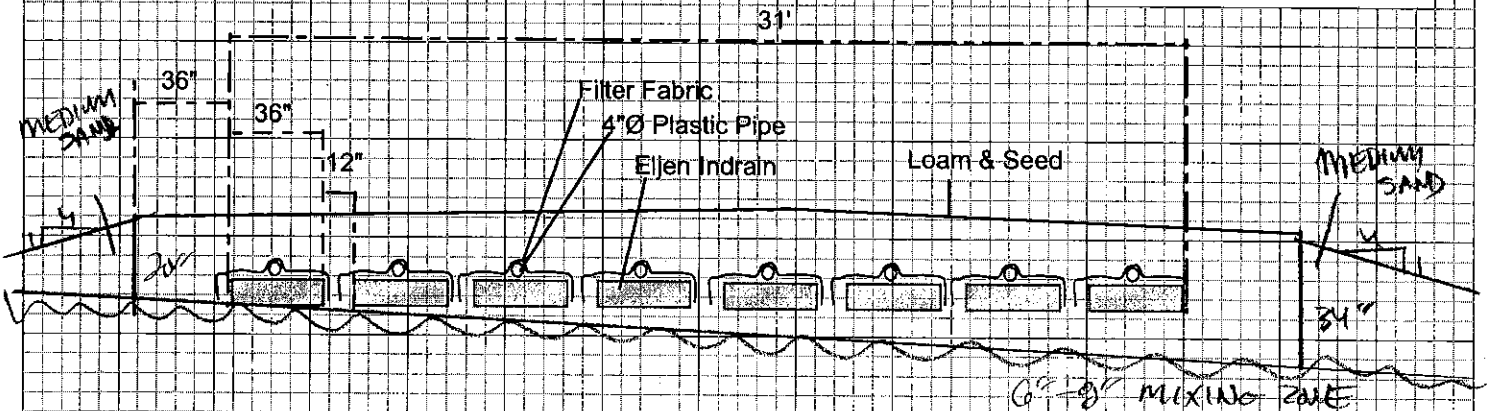

263

11/14/2019

Page 3 of 3  
HHE-200 Rev. 02/11

Site Evaluator Signature

SE #

Date

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Maine Dept. Health & Human Services  
Div. Environmental Health, 11SHS  
(207) 287-2070 Fax: (207) 287-4172

<b>PROPERTY LOCATION</b>		<b>&gt;&gt; CAUTION: LPI APPROVAL REQUIRED &lt;&lt;</b>	
City, Town, or Plantation	Standish	Town/City _____	Permit # _____
Street or Road	Whitney Drive	Date Permit Issued: ___/___/___	Fee: \$ _____ Double Fee Charged [ ]
Subdivision, Lot #	Highlands Subdivision Unit 25-32	_____	L.P.I. # _____
<b>OWNER/APPLICANT INFORMATION</b>		Local Plumbing Inspector Signature _____	
Name (last, first, MI)	Leavitt-Tompson LLC	Fee: \$ _____ state min fee \$ _____	Locally adopted fee _____
Mailing Address of Owner/Applicant	PO Box 703 Standish 04084	Copy: [ ] Owner [ ] Town [ ] State	
Daytime Tel. #		The Subsurface Wastewater Disposal System shall not be installed until a Permit is issued by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with this application and the Maine Subsurface Wastewater Disposal Rules.	
<b>OWNER OR APPLICANT STATEMENT</b>		<b>CAUTION: INSPECTION REQUIRED</b>	
I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit.		I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.	
Signature of Owner or Applicant _____ Date _____		Local Plumbing Inspector Signature _____ (1st) date approved _____	
		Municipal Tax Map # _____ Lot # _____	
		Local Plumbing Inspector Signature _____ (2nd) date approved _____	

PERMIT INFORMATION			
<b>TYPE OF APPLICATION</b> 1. <u>First Time System</u> 2. Replacement System Type replaced: _____ Year installed: _____ 3. Expanded System a. <u>&lt;25% Expansion</u> b. <u>&gt;25% Expansion</u> 4. Experimental System 5. Seasonal Conversion	<b>THIS APPLICATION REQUIRES</b> 1. <u>No Rule Variance</u> 2. First Time System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 3. Replacement System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 4. Minimum Lot Size Variance 5. Seasonal Conversion Permit	<b>DISPOSAL SYSTEM COMPONENTS</b> 1. <u>Complete Non-engineered System</u> 2. Primitive System (graywater & alt. toilet) 3. Alternative Toilet, specify: _____ 4. Non-engineered Treatment Tank (only) 5. Holding Tank, _____ gallons 6. Non-engineered Disposal Field (only) 7. Separated Laundry System 8. Complete Engineered System (2000 gpd or more) 9. Engineered Treatment Tank (only) 10. Engineered Disposal Field (only) 11. Pre-treatment, specify: _____ 12. Miscellaneous Components _____	<b>TYPE OF WATER SUPPLY</b> 1. Drilled Well 2. Dug Well 3. Private 4. <u>Public</u> 5. Other _____
<b>SIZE OF PROPERTY</b> 91 SQ. FT. <u>ACRES</u>	<b>DISPOSAL SYSTEM TO SERVE</b> 1. Single Family Dwelling Unit, No. of Bedrooms: _____ 2. <u>Multiple Family Dwelling</u> , No. of Units: _____ 3. Other: <u>8 2-bedroom units</u> (specify) _____ Current Use Seasonal Year Round <u>Undeveloped</u>		
<b>SHORELAND ZONING</b> Yes <u>No</u>			

DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)			
<b>TREATMENT TANK</b> 1. <u>Concrete</u> a. <u>Regular</u> b. Low Profile 2. Plastic 3. Other: _____ CAPACITY: <u>2x1500</u> GAL.	<b>DISPOSAL FIELD TYPE &amp; SIZE</b> 1. Stone Bed 2. Stone Trench 3. <u>Proprietary Device</u> a. cluster array <u>c. Linear</u> <u>b. regular load</u> d. H-20 load 4. Other: _____ SIZE: <u>4896</u> <u>sq. ft.</u> lin. ft.	<b>GARBAGE DISPOSAL UNIT</b> 1. <u>No</u> 2. Yes 3. Maybe If Yes or Maybe, specify one below: a. multi-compartment tank b. _____ tanks in series c. increase in tank capacity d. Filter on Tank Outlet	<b>DESIGN FLOW</b> 1440 gallons per day BASED ON: 1. Table 4A (dwelling unit(s)) 2. Table 4C (other facilities) SHOW CALCULATIONS for other facilities 3. Section 4G (meter readings) ATTACH WATER METER DATA
<b>SOIL DATA &amp; DESIGN CLASS</b> PROFILE CONDITION <u>3 / C</u> at Observation Hole # <u>TP55</u> Depth <u>15</u> " of Most Limiting Soil Factor _____	<b>DISPOSAL FIELD SIZING</b> 1. Medium--2.6 sq. ft. / gpd 2. <u>Medium--Large 3.3 sq. ft. / gpd</u> 3. Large--4.1 sq. ft. / gpd 4. Extra Large--5.0 sq. ft. / gpd	<b>EFFLUENT/EJECTOR PUMP</b> 1. Not Required 2. May Be Required 3. <u>Required</u> Specify only for engineered systems: DOSE: _____ gallons	<b>LATITUDE AND LONGITUDE</b> at center of disposal area Lat. <u>43</u> d <u>44</u> m <u>09</u> s Lon. <u>70</u> d <u>34</u> m <u>16</u> s if g.p.s, state margin of error: <u>15</u>

SITE EVALUATOR STATEMENT			
I certify that on <u>11/14/2019</u> (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).			
_____ Site Evaluator Signature Mark J Hampton Site Evaluator Name Printed	263 SE # 207-756-2900 Telephone Number	11/14/2019 Date	

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation  
**Standish Whitney Drive**



Street, Road, Subdivision  
**Highlands Subdivision Unit 25-32**

Owner's Name  
**Leavitt-Tompson LLC**

**SITE PLAN**

Scale 1" = \_\_\_\_\_ ft. or as shown

**SITE LOCATION PLAN**

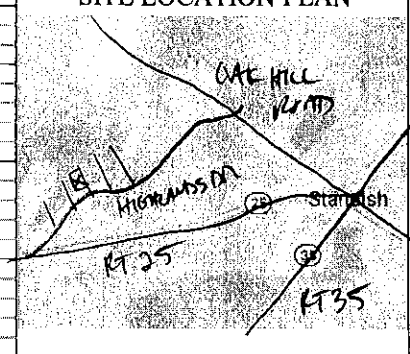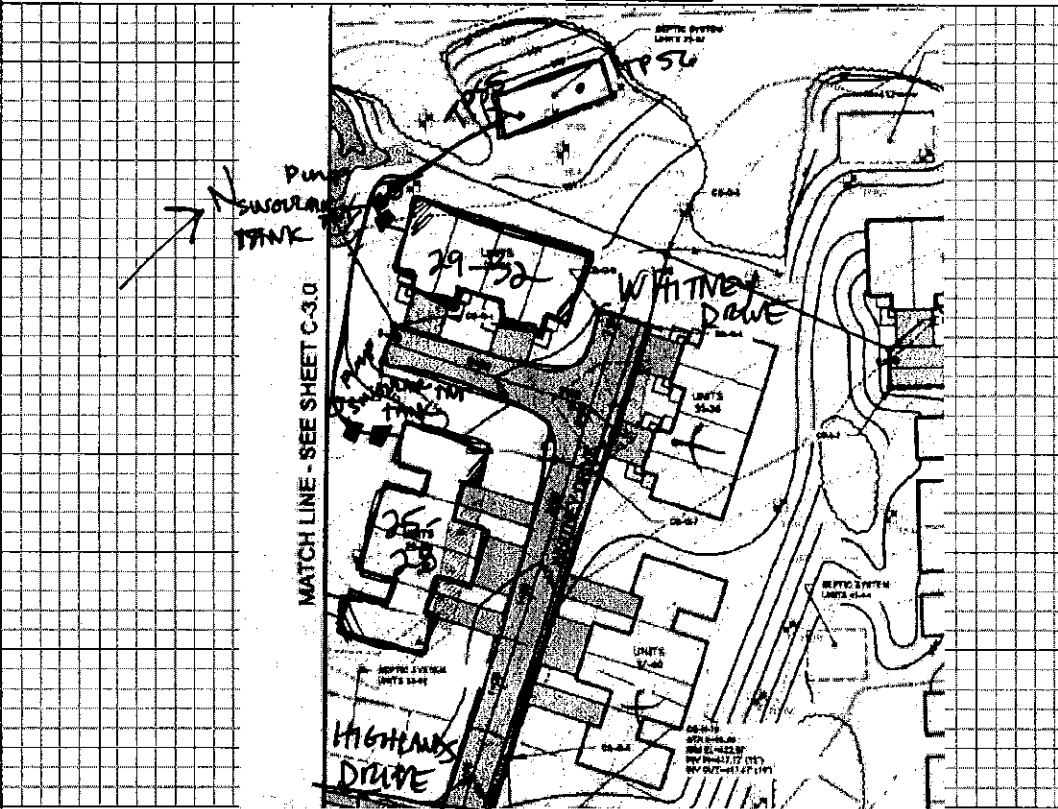

**SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)**

Observation Hole TP55  Test Pit  Boring  
 \_\_\_\_\_ " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3 C</b> Profile Condition	Slope <b>8</b> %	Limiting Factor <b>15</b> "	<input checked="" type="checkbox"/> Ground Water Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	--

Observation Hole TP56  Test Pit  Boring  
 \_\_\_\_\_ " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3 C</b> Profile Condition	Slope <b>8</b> %	Limiting Factor <b>15</b> "	<input checked="" type="checkbox"/> Ground Water Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	--

*Walter J. Hughes*  
 Site Evaluator Signature

263

SE #

11/14/2019

Date

# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION



Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation: Standish  
 Street, Road, Subdivision: Whitney Drive Highlands Subdivision Unit 25-32

Owner's Name: Leavitt-Tompson LLC

## SUBSURFACE WASTEWATER DISPOSAL PLAN

0 [ ] FT.  
 SCALE: 1" = 20 FT.

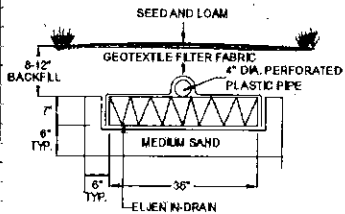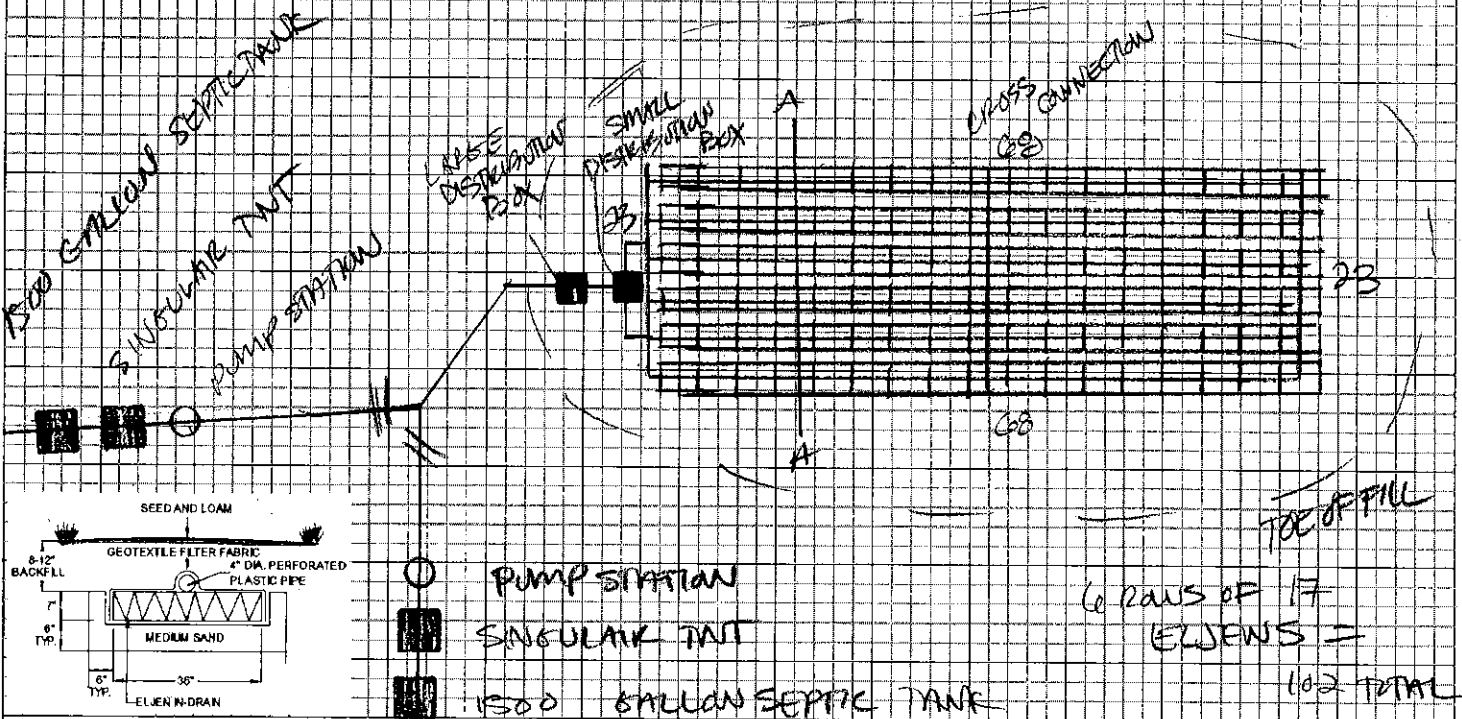

### FILL REQUIREMENTS

Depth of Fill (Upslope) 17  
 Depth of Fill (Downslope) 25

### CONSTRUCTION ELEVATIONS

Finished Grade Elevation \_\_\_\_\_  
 Top of Distribution Pipe or Proprietary Device \_\_\_\_\_  
 Bottom of Disposal Area \_\_\_\_\_

### ELEVATION REFERENCE POINT

Location & Description: \_\_\_\_\_  
 Reference Elevation: 0


Note: Materials and installation shall be in accordance with Maine Subsurface Wastewater Disposal Rules dated 08/15 as amended.

### DISPOSAL AREA CROSS SECTION

#### Scale

Horizontal 1" = 5 ft.  
 Vertical 1" = 4 ft.

Note: All ground to be filled must be scarified

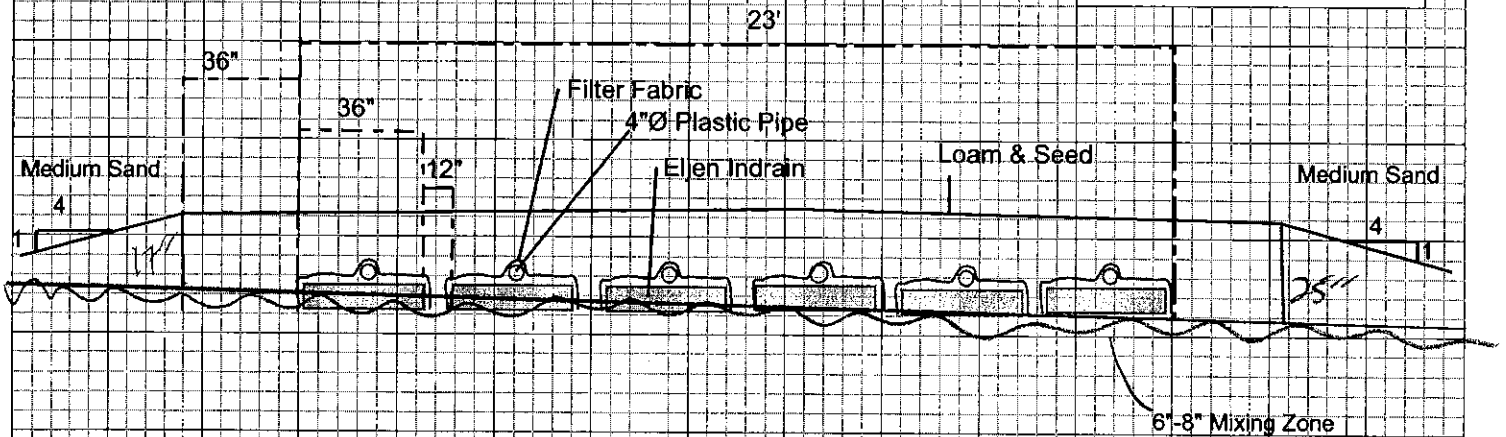

263

11/14/2019

Site Evaluator Signature

SE #

Date

## SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Dept. Health & Human Services  
Div. Environmental Health, 11SHS  
(207) 287-2070 Fax: (207) 287-4172

PROPERTY LOCATION		>> CAUTION: LPI APPROVAL REQUIRED <<	
City, Town, or Plantation	Standish	Town/City _____	Permit # _____
Street or Road	Whitney Drive	Date Permit Issued: ___/___/___	Fee: \$ _____ Double Fee Charged [ ]
Subdivision, Lot #	Highlands Subdivision Units 33-40	_____	L.P.I. # _____
OWNER/APPLICANT INFORMATION		Local Plumbing Inspector Signature _____	
Name (last, first, MI)	Leavitt-Tompson LLC	Fee: \$ _____ state min fee \$ _____	Locally adopted fee _____
Mailing Address of Owner/Applicant	PO Box 703 Standish 04084	Copy: [ ] Owner [ ] Town [ ] State	
Daytime Tel. #		The Subsurface Wastewater Disposal System shall not be installed until a Permit is issued by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with this application and the Maine Subsurface Wastewater Disposal Rules.	
OWNER OR APPLICANT STATEMENT I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit.		Municipal Tax Map # _____ Lot # _____	
Signature of Owner or Applicant _____ Date _____		CAUTION: INSPECTION REQUIRED I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application. (1st) date approved _____ (2nd) date approved _____	

## PERMIT INFORMATION


TYPE OF APPLICATION	THIS APPLICATION REQUIRES	DISPOSAL SYSTEM COMPONENTS
1. First Time System 2. Replacement System Type replaced: _____ Year installed: _____ 3. Expanded System a. <25% Expansion b. >25% Expansion 4. Experimental System 5. Seasonal Conversion	1. No Rule Variance 2. First Time System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 3. Replacement System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 4. Minimum Lot Size Variance 5. Seasonal Conversion Permit	1. Complete Non-engineered System 2. Primitive System (graywater & alt. toilet) 3. Alternative Toilet, specify: _____ 4. Non-engineered Treatment Tank (only) 5. Holding Tank, _____ gallons 6. Non-engineered Disposal Field (only) 7. Separated Laundry System 8. Complete Engineered System (2000 gpd or more) 9. Engineered Treatment Tank (only) 10. Engineered Disposal Field (only) 11. Pre-treatment, specify: _____ 12. Miscellaneous Components
SIZE OF PROPERTY 91 SQ. FT. ACRES	DISPOSAL SYSTEM TO SERVE 1. Single Family Dwelling Unit, No. of Bedrooms: _____ 2. Multiple Family Dwelling, No. of Units: _____ 3. Other: 8 2-bedroom units (specify)	TYPE OF WATER SUPPLY 1. Drilled Well 2. Dug Well 3. Private 4. Public 5. Other
SHORELAND ZONING Yes No	Current Use Seasonal Year Round Undeveloped	

## DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)

TREATMENT TANK	DISPOSAL FIELD TYPE & SIZE	GARBAGE DISPOSAL UNIT	DESIGN FLOW
1. Concrete a. Regular b. Low Profile 2. Plastic 3. Other: _____ CAPACITY: 2x1500 GAL.	1. Stone Bed 2. Stone Trench 3. Proprietary Device a. cluster array c. Linear b. regular load d. H-20 load 4. Other: _____ SIZE: 4992 sq. ft. lin. ft.	1. No 2. Yes 3. Maybe If Yes or Maybe, specify one below: a. multi-compartment tank b. _____ tanks in series c. increase in tank capacity d. Filter on Tank Outlet	1440 gallons per day BASED ON: 1. Table 4A (dwelling unit(s)) 2. Table 4C (other facilities) SHOW CALCULATIONS for other facilities
SOIL DATA & DESIGN CLASS PROFILE CONDITION 3 / D at Observation Hole # TP118 Depth 12" of Most Limiting Soil Factor	DISPOSAL FIELD SIZING 1. Medium--2.6 sq. ft. / gpd 2. Medium--Large 3.3 sq. ft. / gpd 3. Large--4.1 sq. ft. / gpd 4. Extra Large--5.0 sq. ft. / gpd	EFFLUENT/EJECTOR PUMP 1. Not Required 2. May Be Required 3. Required Specify only for engineered systems: DOSE: _____ gallons	3. Section 4G (meter readings) ATTACH WATER METER DATA LATITUDE AND LONGITUDE at center of disposal area Lat. 43 d 44 m 09 s Lon. 70 d 34 m 16 s if g.p.s, state margin of error: 15

## SITE EVALUATOR STATEMENT

I certify that on 11/14/2019 (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).

 Site Evaluator Signature Mark J Hampton Site Evaluator Name Printed	263 SE # 207-756-2900 Telephone Number	11/14/2019 Date _____ E-mail Address
--	---	---

Note: Changes to or deviations from the \_\_\_\_\_ should be confirmed with the Site Evaluator.

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**


Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation **Standish** Street, Road, Subdivision **Whitney Drive Highlands Subdivision Units 33-40**

Owner's Name  
**Leavitt-Tompson LLC**

**SITE PLAN** Scale 1" = \_\_\_\_\_ ft. or as shown

**SITE LOCATION PLAN**

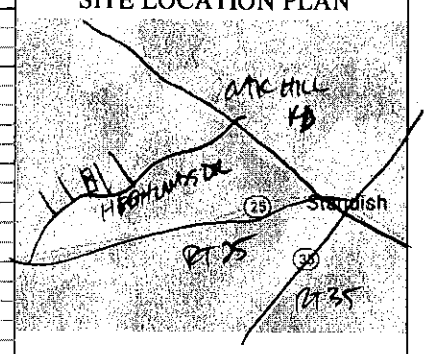

**SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)**

Observation Hole TP118  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil \_\_\_\_\_

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Observation Hole TP117  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil \_\_\_\_\_

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3 D</b> Profile Condition	Slope <b>2</b> %	Limiting Factor <b>12</b> "	<input checked="" type="checkbox"/> Ground Water <input type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	--

Soil Classification <b>3 D</b> Profile Condition	Slope <b>2</b> %	Limiting Factor <b>14</b> "	<input checked="" type="checkbox"/> Ground Water <input type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	--

*W. Leavitt-Tompson*  
 Site Evaluator Signature

263 SE #

11/14/2019 Date







**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Maine Dept. Health & Human Services  
Div. Environmental Health, 11 SHS  
(207) 287-2070 Fax: (207) 287-4172

<b>PROPERTY LOCATION</b>		<b>&gt;&gt; CAUTION: LPI APPROVAL REQUIRED &lt;&lt;</b>	
City, Town, or Plantation	Standish	Town/City _____	Permit # _____
Street or Road	Inverness Drive	Date Permit Issued: ___/___/___	Fee: \$ _____ Double Fee Charged [ ]
Subdivision, Lot #	Highlands Subdivision Units 41-44	L.P.I. # _____	
<b>OWNER/APPLICANT INFORMATION</b>		Local Plumbing Inspector Signature _____	
Name (last, first, MI)	Leavitt-Tompson LLC	Fee: \$ _____ state min fee \$ _____	Locally adopted fee _____
Mailing Address of Owner/Applicant	PO Box 703 Standish 04084	Copy: [ ] Owner [ ] Town [ ] State	
Daytime Tel. #		The Subsurface Wastewater Disposal System shall not be installed until a Permit is issued by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with this application and the Maine Subsurface Wastewater Disposal Rules.	
<b>OWNER OR APPLICANT STATEMENT</b>		<b>CAUTION: INSPECTION REQUIRED</b>	
I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit.		I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.	
Signature of Owner or Applicant _____ Date _____		Local Plumbing Inspector Signature _____ (1st) date approved _____	
		Municipal Tax Map # _____ Lot # _____	
		Local Plumbing Inspector Signature _____ (2nd) date approved _____	

PERMIT INFORMATION			
<b>TYPE OF APPLICATION</b> 1. First Time System 2. Replacement System Type replaced: _____ Year installed: _____ 3. Expanded System a. <25% Expansion b. ≥25% Expansion 4. Experimental System 5. Seasonal Conversion	<b>THIS APPLICATION REQUIRES</b> 1. No Rule Variance 2. First Time System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 3. Replacement System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 4. Minimum Lot Size Variance 5. Seasonal Conversion Permit	<b>DISPOSAL SYSTEM COMPONENTS</b> 1. Complete Non-engineered System 2. Primitive System (graywater & alt. toilet) 3. Alternative Toilet, specify: _____ 4. Non-engineered Treatment Tank (only) 5. Holding Tank, _____ gallons 6. Non-engineered Disposal Field (only) 7. Separated Laundry System 8. Complete Engineered System (2000 gpd or more) 9. Engineered Treatment Tank (only) 10. Engineered Disposal Field (only) 11. Pre-treatment, specify: _____ 12. Miscellaneous Components	<b>TYPE OF WATER SUPPLY</b> 1. Drilled Well    2. Dug Well    3. Private 4. Public    5. Other
<b>SIZE OF PROPERTY</b> 91 SQ. FT. ACRES	<b>DISPOSAL SYSTEM TO SERVE</b> 1. Single Family Dwelling Unit, No. of Bedrooms: _____ 2. Multiple Family Dwelling, No. of Units: _____ 3. Other: 4 2-bedroom units (specify) _____ Current Use    Seasonal    Year Round <u>Undeveloped</u>		
<b>SHORELAND ZONING</b> Yes <u>No</u>			

DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)			
<b>TREATMENT TANK</b> 1. Concrete a. Regular 2. Low Profile 3. Plastic 3. Other: _____ CAPACITY: <u>1x1500</u> GAL.	<b>DISPOSAL FIELD TYPE &amp; SIZE</b> 1. Stone Bed    2. Stone Trench 3. Proprietary Device a. cluster array    c. Linear b. regular load    d. H-20 load 4. Other: _____ SIZE: <u>2400</u> sq. ft. lin. ft.	<b>GARBAGE DISPOSAL UNIT</b> 1. No    2. Yes    3. Maybe If Yes or Maybe, specify one below: a. multi-compartment tank b. _____ tanks in series c. increase in tank capacity d. Filter on Tank Outlet	<b>DESIGN FLOW</b> _____ 720 gallons per day BASED ON: 1. Table 4A (dwelling unit(s)) 2. Table 4C (other facilities) SHOW CALCULATIONS for other facilities 3. Section 4G (meter readings) ATTACH WATER METER DATA
<b>SOIL DATA &amp; DESIGN CLASS</b> PROFILE CONDITION <u>3 / C</u> a) Observation Hole # <u>TP110</u> Depth <u>17</u> " of Most Limiting Soil Factor	<b>DISPOSAL FIELD SIZING</b> 1. Medium—2.6 sq. ft. / gpd 2. <u>Medium—Large 3.3 sq. ft. / gpd</u> 3. Large—4.1 sq. ft. / gpd 4. Extra Large—5.0 sq. ft. / gpd	<b>EFFLUENT/EJECTOR PUMP</b> 1. Not Required 2. May Be Required 3. <u>Required</u> Specify only for engineered systems: DOSE: _____ gallons	<b>LATITUDE AND LONGITUDE</b> at center of disposal area Lat. <u>43</u> d <u>44</u> m <u>12</u> s Lon. <u>70</u> d <u>34</u> m <u>14</u> s if g.p.s, state margin of error: <u>15</u>

SITE EVALUATOR STATEMENT		
I certify that on <u>11/14/2019</u> (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).		
_____ Site Evaluator Signature <b>Mark J Hampton</b> Site Evaluator Name Printed	_____ SE # <b>263</b> Telephone Number <b>207-756-2900</b>	_____ Date <b>11/14/2019</b> E-mail Address

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**



Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation **Standish** Street, Road, Subdivision **Inverness Drive Highlands Subdivision Units 41-44**

Owner's Name **Leavitt-Tompson LLC**

**SITE PLAN** Scale 1" = ft. or as shown

**SITE LOCATION PLAN**

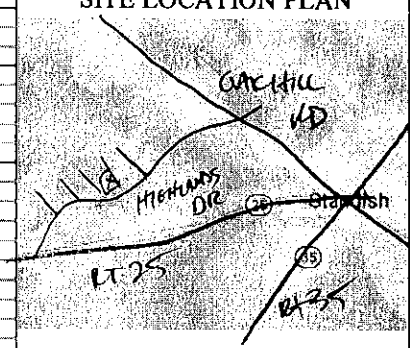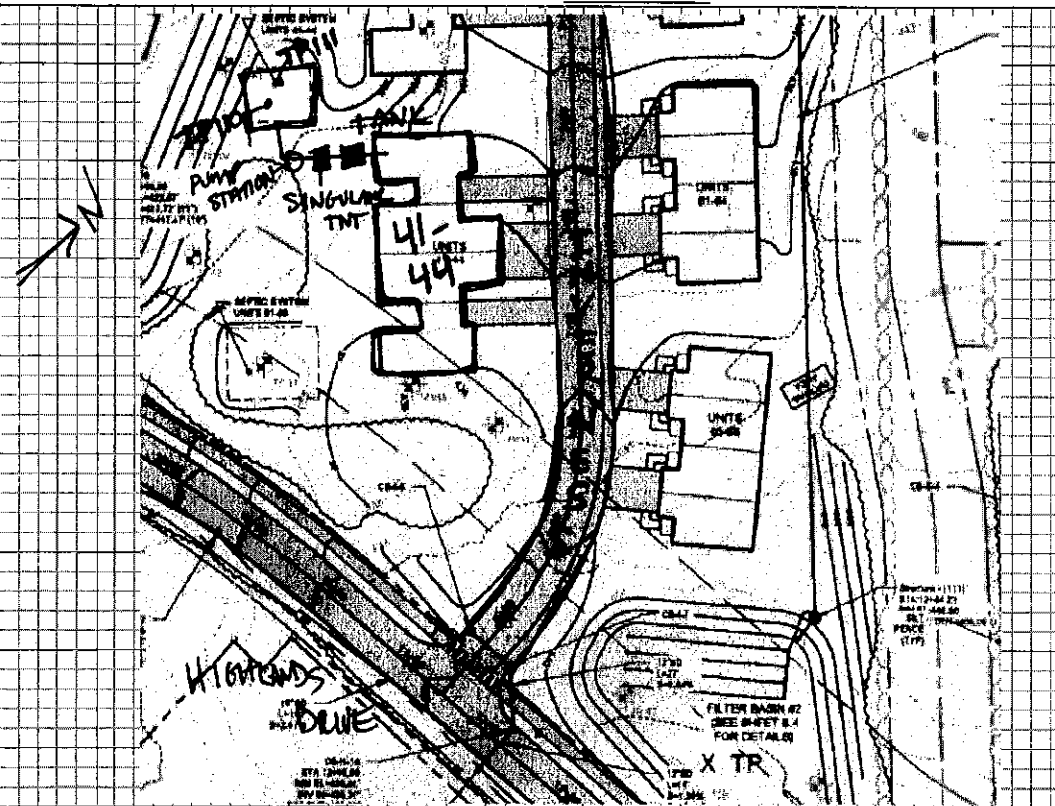

**SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)**

Observation Hole TP110  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Observation Hole TP111  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3 C</b> Profile Condition	Slope <b>2</b> %	Limiting Factor <b>17</b> "	<input checked="" type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	---

Soil Classification <b>3 C</b> Profile Condition	Slope <b>2</b> %	Limiting Factor <b>17</b> "	<input checked="" type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	---

4474


# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Health & Human Services  
Division of Environmental Health  
(207) 287-5672 Fax: (207) 287-3165



Town, City, Plantation: Standish  
Street, Road, Subdivision: Inverness Drive Highlands Subdivision Units 41-44

Owner's Name: Leavitt-Tompson LLC

## SUBSURFACE WASTEWATER DISPOSAL PLAN

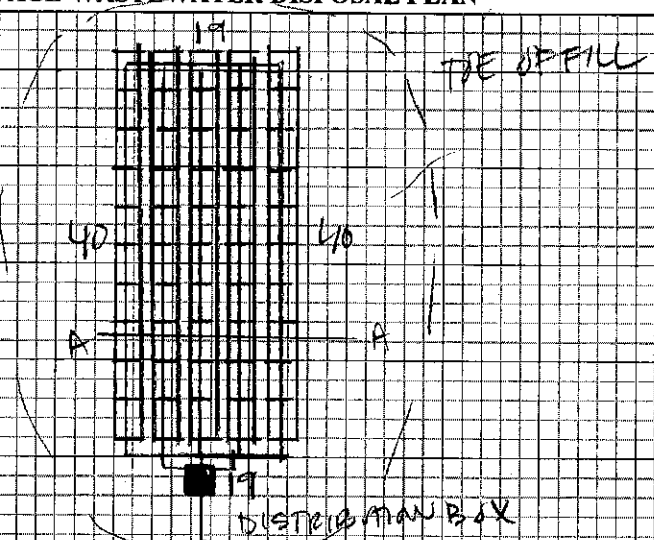

0 [ ]  
SCALE: 1" = 20 FT.

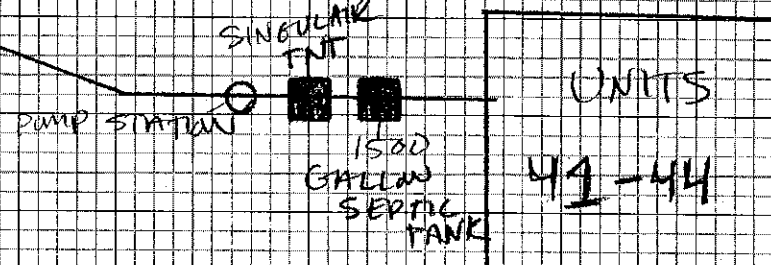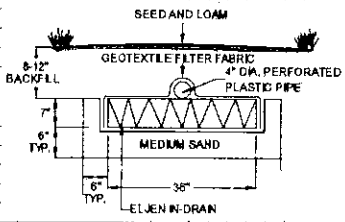

### FILL REQUIREMENTS

Depth of Fill (Upslope) 19  
Depth of Fill (Downslope) 24

### CONSTRUCTION ELEVATIONS

Finished Grade Elevation \_\_\_\_\_  
Top of Distribution Pipe or Proprietary Device \_\_\_\_\_  
Bottom of Disposal Area \_\_\_\_\_

### ELEVATION REFERENCE POINT


Location & Description: \_\_\_\_\_  
Reference Elevation: 0

Note: Materials and installation shall be in accordance with Maine Subsurface Wastewater Disposal Rules dated 08/15 as amended.

### DISPOSAL AREA CROSS SECTION

Scale  
Horizontal 1" = 4 ft.  
Vertical 1" = 4 ft.

Note: All ground to be filled must be scarified

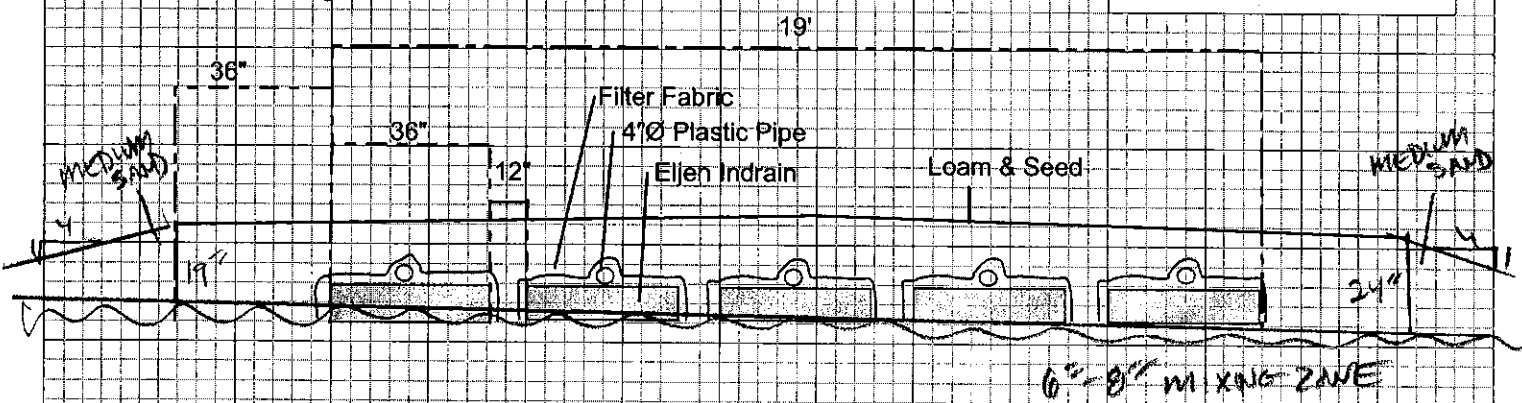

263

11/14/2019

Page 3 of 3  
HHE-200 Rev. 02/11

Site Evaluator Signature

SE #

Date

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Maine Dept. Health & Human Services  
Div. Environmental Health, 11SHS  
(207) 287-2070 Fax: (207) 287-4172

<b>PROPERTY LOCATION</b>		<b>&gt;&gt; CAUTION: LPI APPROVAL REQUIRED &lt;&lt;</b>	
City, Town, or Plantation	Standish	Town/City _____	Permit # _____
Street or Road	Inverness Drive	Date Permit Issued: ___/___/___	Fee: \$ _____ Double Fee Charged [ ]
Subdivision, Lot #	Highlands Subdivision Unit 45-48,57-60	L.P.I. # _____	
<b>OWNER/APPLICANT INFORMATION</b>		Local Plumbing Inspector Signature _____	
Name (last, first, MI)	Leavitt-Tompson LLC	Fee: \$ _____ state min fee \$ _____	Locally adopted fee _____
Mailing Address of Owner/Applicant	PO Box 703 Standish 04084	Copy: [ ] Owner [ ] Town [ ] State	
Daytime Tel. #		The Subsurface Wastewater Disposal System shall not be installed until a Permit is issued by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with this application and the Maine Subsurface Wastewater Disposal Rules.	
<b>OWNER OR APPLICANT STATEMENT</b>		<b>CAUTION: INSPECTION REQUIRED</b>	
I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit.		I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.	
Signature of Owner or Applicant _____ Date _____		(1st) date approved _____	
		Local Plumbing Inspector Signature _____ (2nd) date approved _____	

PERMIT INFORMATION		
<b>TYPE OF APPLICATION</b> 1. <u>First Time System</u> 2. Replacement System Type replaced: _____ Year installed: _____ 3. Expanded System a. <25% Expansion b. >25% Expansion 4. Experimental System 5. Seasonal Conversion	<b>THIS APPLICATION REQUIRES</b> 1. <u>No Rule Variance</u> 2. First Time System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 3. Replacement System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 4. Minimum Lot Size Variance 5. Seasonal Conversion Permit	<b>DISPOSAL SYSTEM COMPONENTS</b> 1. <u>Complete Non-engineered System</u> 2. Primitive System (graywater & alt. toilet) 3. Alternative Toilet, specify: _____ 4. Non-engineered Treatment Tank (only) 5. Holding Tank, _____ gallons 6. Non-engineered Disposal Field (only) 7. Separated Laundry System 8. Complete Engineered System (2000 gpd or more) 9. Engineered Treatment Tank (only) 10. Engineered Disposal Field (only) 11. Pre-treatment, specify: _____ 12. Miscellaneous Components
<b>SIZE OF PROPERTY</b> 91 SQ. FT. <u>ACRES</u>	<b>DISPOSAL SYSTEM TO SERVE</b> 1. Single Family Dwelling Unit, No. of Bedrooms: _____ 2. <u>Multiple Family Dwelling, No. of Units: _____</u> 3. Other: <u>8 2-bedroom units</u> (specify) _____ Current Use Seasonal Year Round <u>Undeveloped</u>	<b>TYPE OF WATER SUPPLY</b> 1. Drilled Well 2. Dug Well 3. Private 4. <u>Public</u> 5. Other _____
<b>SHORELAND ZONING</b> Yes <u>No</u>	<b>DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)</b>	

<b>TREATMENT TANK</b> 1. <u>Concrete</u> a. <u>Regular</u> b. Low Profile 2. Plastic 3. Other: _____ CAPACITY: <u>2x1500</u> GAL.	<b>DISPOSAL FIELD TYPE &amp; SIZE</b> 1. Stone Bed 2. Stone Trench 3. <u>Proprietary Device</u> a. cluster array <u>c. Linear</u> <u>b. regular load</u> d. H-20 load 4. Other: _____ SIZE: <u>4992</u> sq. ft. ln. ft.	<b>GARBAGE DISPOSAL UNIT</b> 1. <u>No</u> 2. Yes 3. Maybe If Yes or Maybe, specify one below: a. multi-compartment tank b. _____ tanks in series c. increase in tank capacity d. Filter on Tank Outlet	<b>DESIGN FLOW</b> _____ 1440 gallons per day BASED ON: 1. Table 4A (dwelling unit(s)) 2. Table 4C (other facilities) SHOW CALCULATIONS for other facilities 3. Section 4G (meter readings) ATTACH WATER METER DATA
<b>SOIL DATA &amp; DESIGN CLASS</b> PROFILE CONDITION <u>3 / C</u> at Observation Hole # <u>TP58</u> Depth <u>15</u> " of Most Limiting Soil Factor	<b>DISPOSAL FIELD SIZING</b> 1. Medium—2.6 sq. ft. / gpd 2. <u>Medium—Large 3.3 sq. ft. / gpd</u> 3. Large—4.1 sq. ft. / gpd 4. Extra Large—5.0 sq. ft. / gpd	<b>EFFLUENT/EJECTOR PUMP</b> 1. Not Required 2. May Be Required 3. <u>Required</u> Specify only for engineered systems: DOSE: _____ gallons	<b>LATITUDE AND LONGITUDE</b> at center of disposal area Lat. 43 d 44 m 12 s Lon. 70 d 34 m 14 s If g.p.s, state margin of error: <u>15</u>

SITE EVALUATOR STATEMENT		
I certify that on <u>11/14/2019</u> (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).		
_____ Site Evaluator Signature <b>Mark J Hampton</b>	_____ SE # <b>263</b>	_____ Date <b>11/14/2019</b>
_____ Site Evaluator Name Printed	_____ Telephone Number <b>207-756-2900</b>	_____ E-mail Address

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation

Street, Road, Subdivision

Owner's Name



Standish Inverness Drive Highlands Subdivision Unit 45-48,57-60

Leavitt-Tompson LLC

**SITE PLAN**

Scale 1" = ft. or as shown

**SITE LOCATION PLAN**

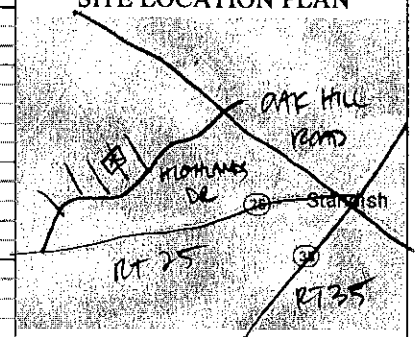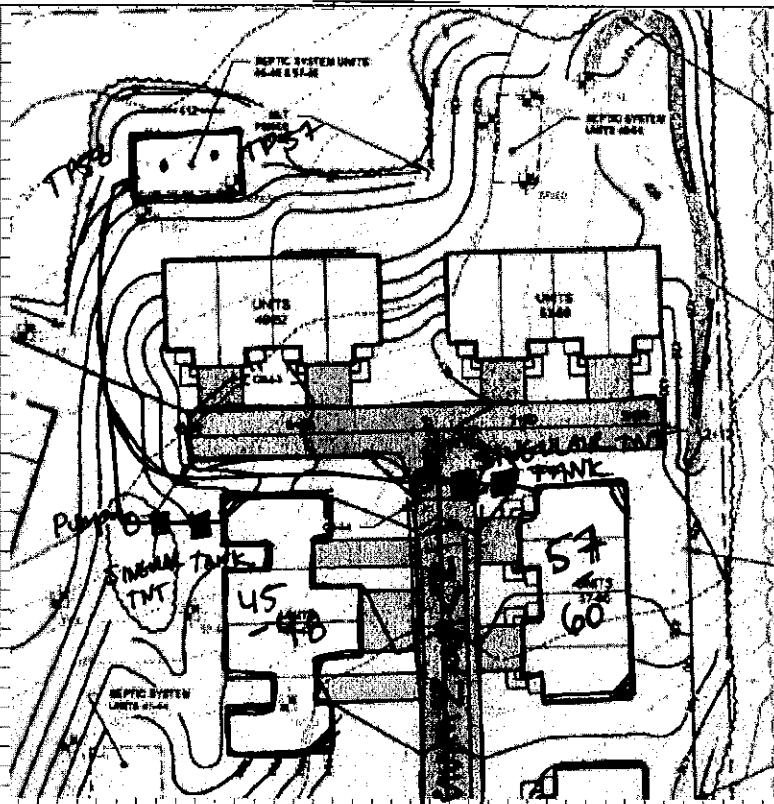

**SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)**

Observation Hole TP58  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <u>3</u> <u>C</u> Profile Condition	Slope <u>6</u> %	Limiting Factor <u>15</u> "	<input checked="" type="checkbox"/> Ground Water Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
---	---------------------	--------------------------------	--

Observation Hole TP57  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <u>3</u> <u>C</u> Profile Condition	Slope <u>6</u> %	Limiting Factor <u>16</u> "	<input checked="" type="checkbox"/> Ground Water Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
---	---------------------	--------------------------------	--

*W. W. Hays*  
 Site Evaluator Signature

263

SE #

11/14/2019

Date

# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION



Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation: Standish  
 Street, Road, Subdivision: Inverness Drive Highlands Subdivision Unit 45-48,57-60

Owner's Name: Leavitt-Tompson LLC

## SUBSURFACE WASTEWATER DISPOSAL PLAN

0  FT.  
 SCALE: 1" = 20 FT.

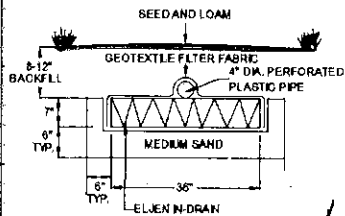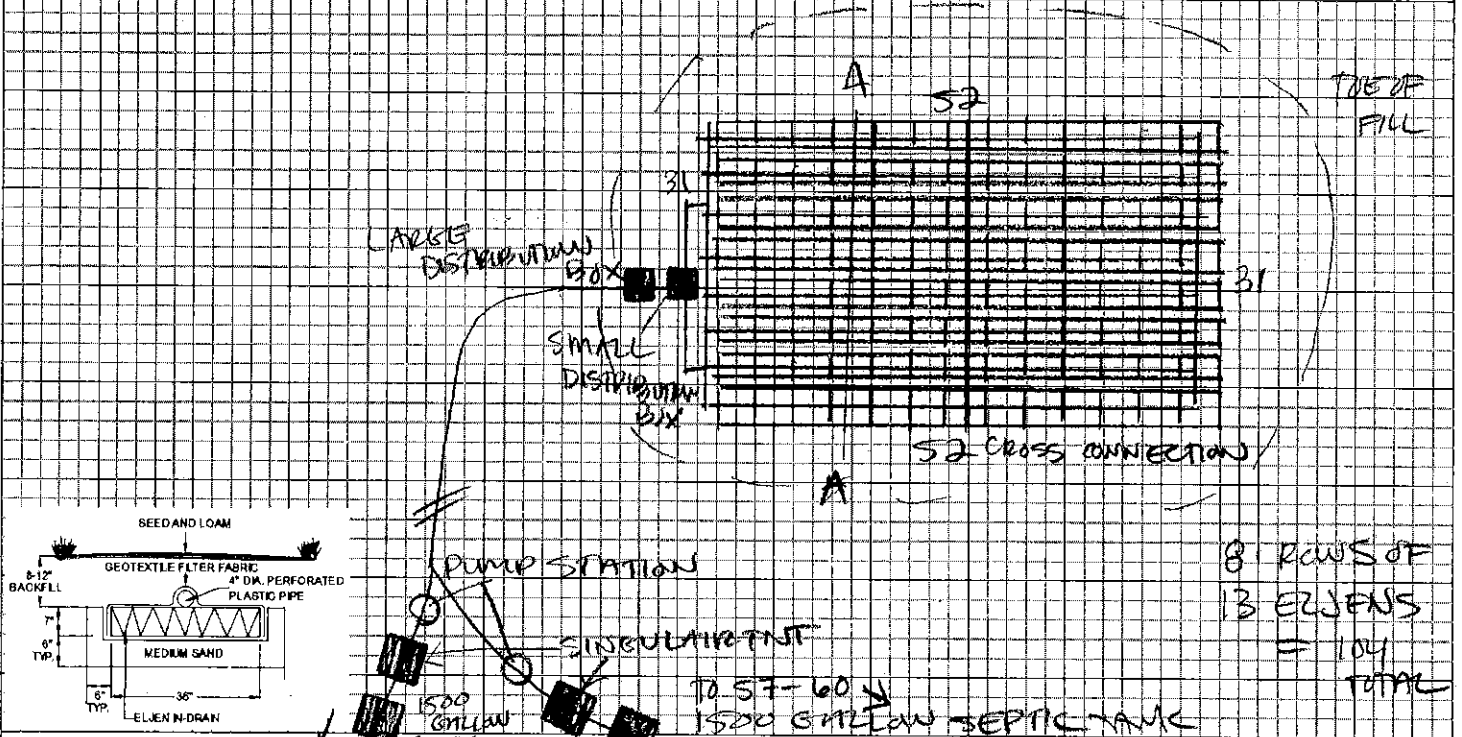

### FILL REQUIREMENTS

Depth of Fill (Upslope) 21  
 Depth of Fill (Downslope) 43

### CONSTRUCTION ELEVATIONS

Finished Grade Elevation \_\_\_\_\_  
 Top of Distribution Pipe or Proprietary Device \_\_\_\_\_  
 Bottom of Disposal Area \_\_\_\_\_

### ELEVATION REFERENCE POINT


Location & Description: \_\_\_\_\_  
 Reference Elevation: 0

Note: Materials and installation shall be in accordance with Maine Subsurface Wastewater Disposal Rules dated 08/15 as amended.

### DISPOSAL AREA CROSS SECTION

Scale  
 Horizontal 1" = 6 ft.  
 Vertical 1" = 4 ft.

Note: All ground to be filled must be scarified

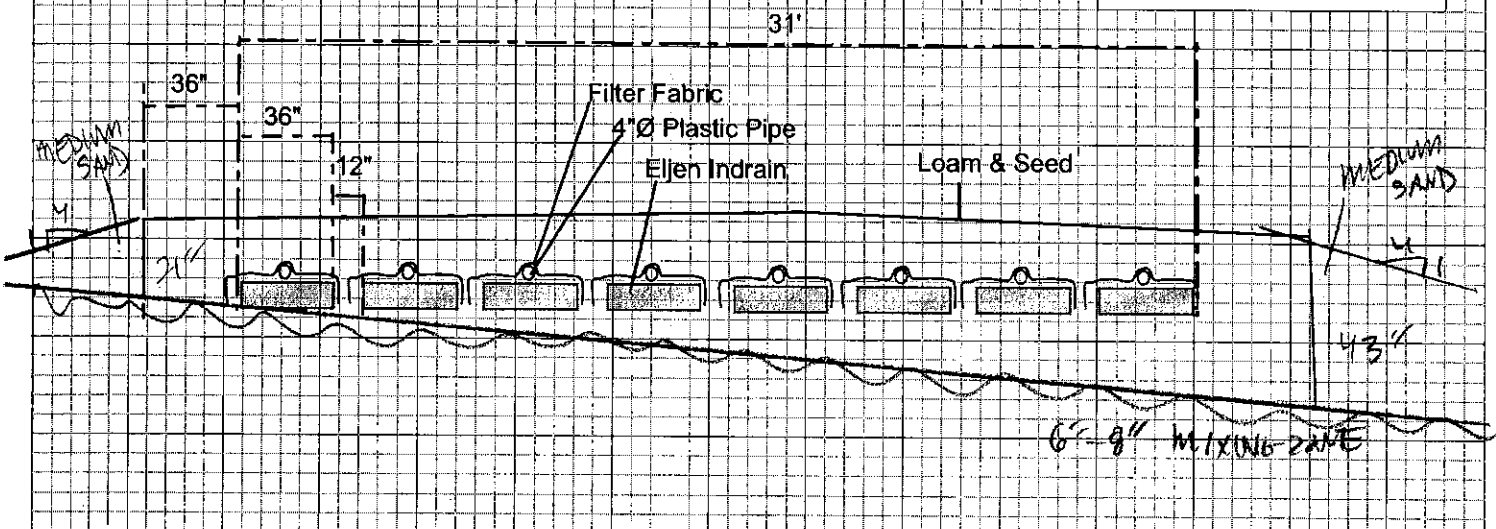

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Maine Dept. Health & Human Services  
Div. Environmental Health, 11SHS  
(207) 287-2070 Fax: (207) 287-4172

<b>PROPERTY LOCATION</b>		<b>&gt;&gt; CAUTION: LPI APPROVAL REQUIRED &lt;&lt;</b>	
City, Town, or Plantation	Standish	Town/City _____	Permit # _____
Street or Road	Inverness Drive	Date Permit Issued: ___/___/___	Fee: \$ _____ Double Fee Charged <input type="checkbox"/>
Subdivision, Lot #	Highlands Subdivision Unit 49-56	_____	L.P.I. # _____
<b>OWNER/APPLICANT INFORMATION</b>		Local Plumbing Inspector Signature _____	
Name (last, first, MI)	Leavitt-Tompson LLC	Owner <input checked="" type="checkbox"/>	Applicant <input type="checkbox"/>
Mailing Address of Owner/Applicant	PO Box 703 Standish 04084	Fee: \$ _____ state min fee \$ _____	Locally adopted fee _____
Daytime Tel. #		Copy: <input type="checkbox"/> Owner <input type="checkbox"/> Town <input type="checkbox"/> State	
<b>OWNER OR APPLICANT STATEMENT</b>		<b>CAUTION: INSPECTION REQUIRED</b>	
I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit.		I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.	
Signature of Owner or Applicant _____		Local Plumbing Inspector Signature _____	
Date _____		(1st) date approved _____	
		(2nd) date approved _____	

PERMIT INFORMATION		
<b>TYPE OF APPLICATION</b> 1. <u>First Time System</u> 2. Replacement System Type replaced: _____ Year installed: _____ 3. Expanded System a. <25% Expansion b. ≥25% Expansion 4. Experimental System 5. Seasonal Conversion	<b>THIS APPLICATION REQUIRES</b> 1. <u>No Rule Variance</u> 2. First Time System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 3. Replacement System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 4. Minimum Lot Size Variance 5. Seasonal Conversion Permit	<b>DISPOSAL SYSTEM COMPONENTS</b> 1. <u>Complete Non-engineered System</u> 2. Primitive System (graywater & alt. toilet) 3. Alternative Toilet, specify: _____ 4. Non-engineered Treatment Tank (only) 5. Holding Tank, _____ gallons 6. Non-engineered Disposal Field (only) 7. Separated Laundry System 8. Complete Engineered System (2000 gpd or more) 9. Engineered Treatment Tank (only) 10. Engineered Disposal Field (only) 11. Pre-treatment, specify: _____ 12. Miscellaneous Components _____
<b>SIZE OF PROPERTY</b> 91 SQ. FT. <u>ACRES</u>	<b>DISPOSAL SYSTEM TO SERVE</b> 1. Single Family Dwelling Unit, No. of Bedrooms: _____ 2. <u>Multiple Family Dwelling, No. of Units: _____</u> 3. Other: <u>8 2-bedroom units</u> (specify) _____ Current Use Seasonal Year Round <u>Undeveloped</u>	<b>TYPE OF WATER SUPPLY</b> 1. Drilled Well 2. Dug Well 3. Private 4. <u>Public</u> 5. Other _____
<b>SHORELAND ZONING</b> Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		

DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)			
<b>TREATMENT TANK</b> 1. <u>Concrete</u> a. Regular b. Low Profile 2. Plastic 3. Other: _____ CAPACITY: <u>2x1500 GAL.</u>	<b>DISPOSAL FIELD TYPE &amp; SIZE</b> 1. Stone Bed 2. Stone Trench 3. <u>Proprietary Device</u> a. cluster array c. <u>Linear</u> b. <u>regular load</u> d. H-20 load 4. Other: _____ SIZE: <u>4896</u> <u>sq. ft.</u> lin. ft.	<b>GARBAGE DISPOSAL UNIT</b> 1. <u>No</u> 2. Yes 3. Maybe If Yes or Maybe, specify one below: a. multi-compartment tank b. _____ tanks in series c. increase in tank capacity d. Filter on Tank Outlet	<b>DESIGN FLOW</b> _____ 1440 gallons per day BASED ON: 1. Table 4A (dwelling unit(s)) 2. Table 4C (other facilities) SHOW CALCULATIONS for other facilities 3. Section 4G (meter readings) ATTACH WATER METER DATA
<b>SOIL DATA &amp; DESIGN CLASS</b> PROFILE CONDITION <u>3 / C</u> at Observation Hole # <u>TP60</u> Depth <u>15</u> " of Most Limiting Soil Factor	<b>DISPOSAL FIELD SIZING</b> 1. Medium--2.6 sq. ft. / gpd 2. <u>Medium--Large 3.3 sq. ft. / gpd</u> 3. Large--4.1 sq. ft. / gpd 4. Extra Large--5.0 sq. ft. / gpd	<b>EFFLUENT/EJECTOR PUMP</b> 1. Not Required 2. May Be Required 3. <u>Required</u> Specify only for engineered systems: DOSE: _____ gallons	<b>LATITUDE AND LONGITUDE</b> at center of disposal area Lat. <u>43</u> d <u>44</u> m <u>09</u> s Lon. <u>70</u> d <u>34</u> m <u>16</u> s If g.p.s, state margin of error: <u>15</u>

SITE EVALUATOR STATEMENT		
I certify that on <u>11/14/2019</u> (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).		
_____ Site Evaluator Signature <b>Mark J Hampton</b> Site Evaluator Name Printed	_____ 263 SE # 207-756-2900 Telephone Number	_____ 11/14/2019 Date _____ E-mail Address



**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**



Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation: Standish  
 Street, Road, Subdivision: Inverness Drive Highlands Subdivision Unit 49-56

Owner's Name: Leavitt-Tompson LLC

**SITE PLAN** Scale 1" = \_\_\_\_\_ ft. or as shown

**SITE LOCATION PLAN**

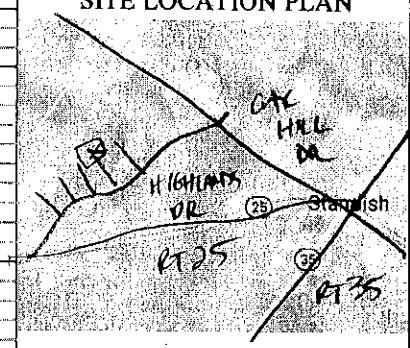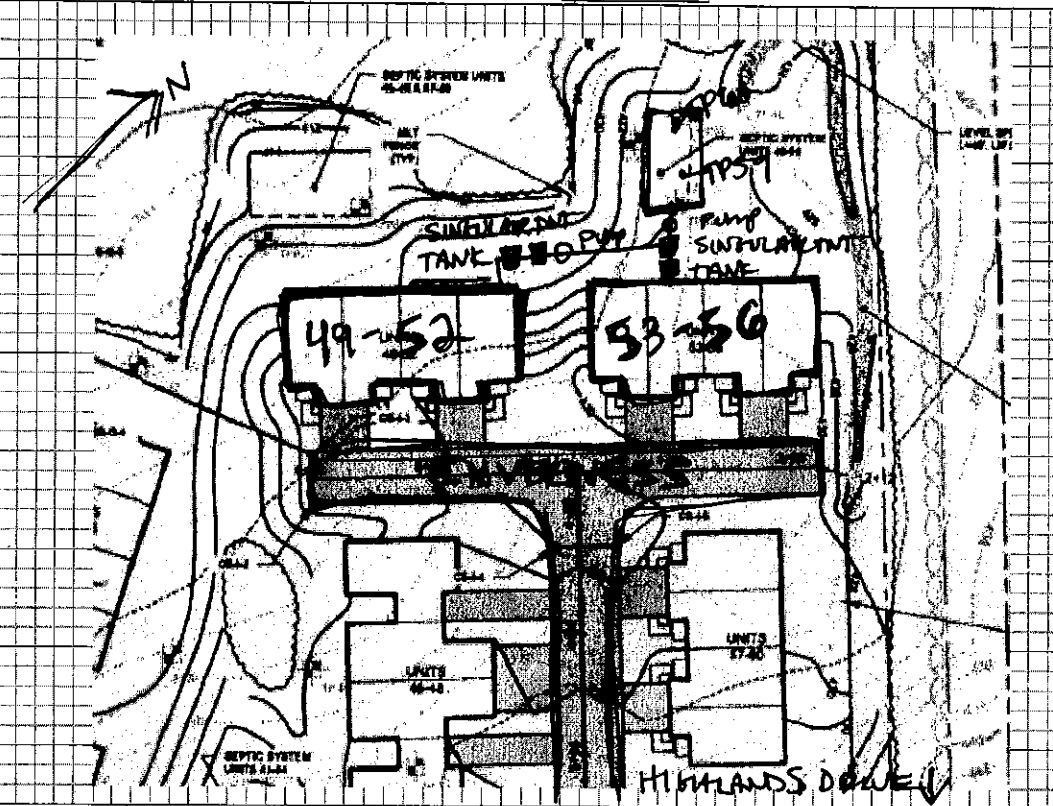

**SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)**

Observation Hole TP60  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Observation Hole TP59  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	Sandy Loam
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0		Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3 C</b> Profile Condition	Slope <b>8</b> %	Limiting Factor <b>15</b> "	<input checked="" type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	---

Soil Classification <b>3 C</b> Profile Condition	Slope <b>8</b> %	Limiting Factor <b>16</b> "	<input checked="" type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	---

*[Handwritten Signature]*  
 Site Evaluator Signature

263

SE #

11/14/2019

Date



# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION



Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation: **Standish**  
 Street, Road, Subdivision: **Inverness Drive Highlands Subdivision Unit 49-56**

Owner's Name: **Leavitt-Tompson LLC**

## SUBSURFACE WASTEWATER DISPOSAL PLAN

0   
 SCALE: 1" = 20 FT.

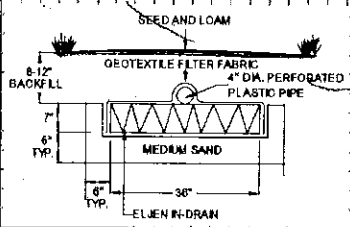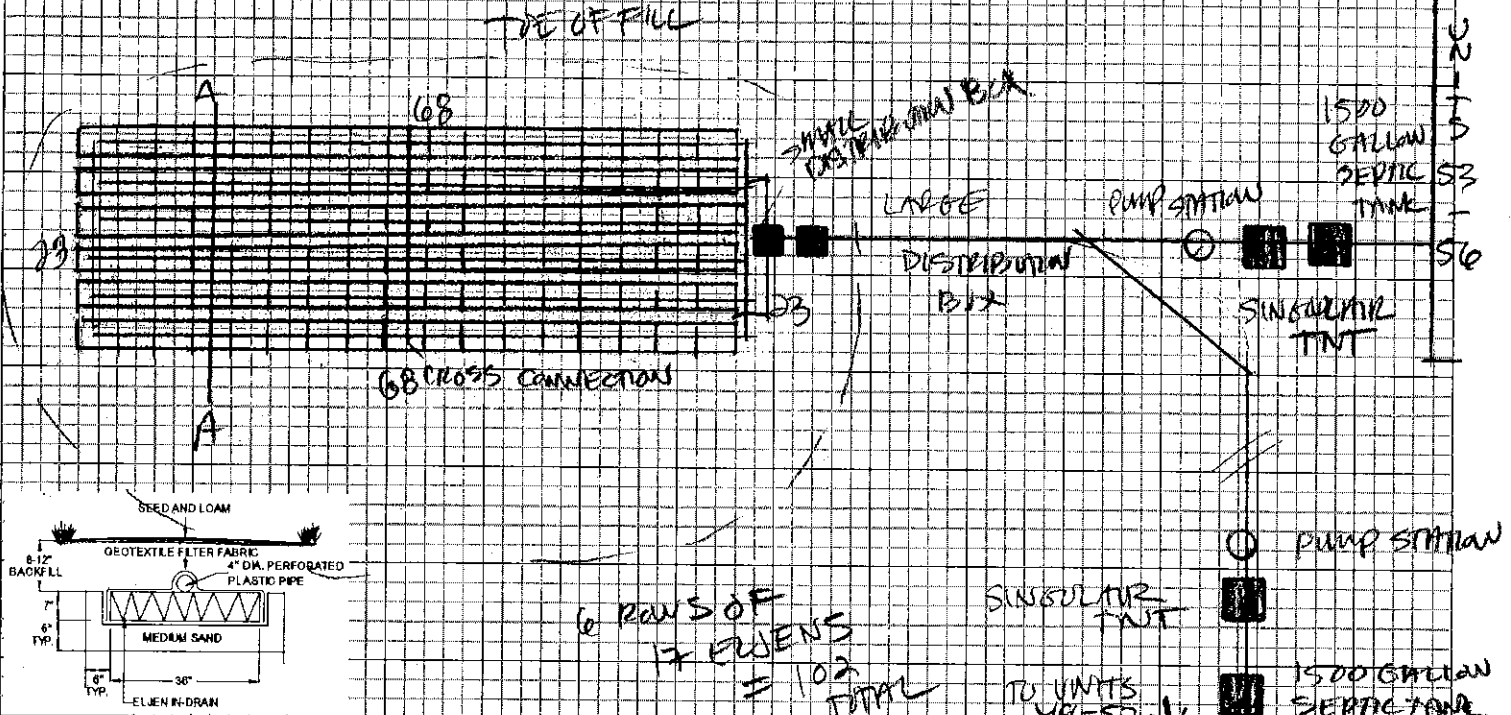

### FILL REQUIREMENTS

Depth of Fill (Upslope) **20**

Depth of Fill (Downslope) **42**

### CONSTRUCTION ELEVATIONS

Finished Grade Elevation \_\_\_\_\_

Top of Distribution Pipe or Proprietary Device \_\_\_\_\_

Bottom of Disposal Area \_\_\_\_\_

### ELEVATION REFERENCE POINT

Location & Description: \_\_\_\_\_

Reference Elevation: **0**

Note: Materials and installation shall be in accordance with Maine Subsurface Wastewater Disposal Rules, dated 08/15 as amended.


### DISPOSAL AREA CROSS SECTION

Scale

Horizontal 1" = 5 ft.

Vertical 1" = 4 ft.

Note: All ground to be filled must be scarified

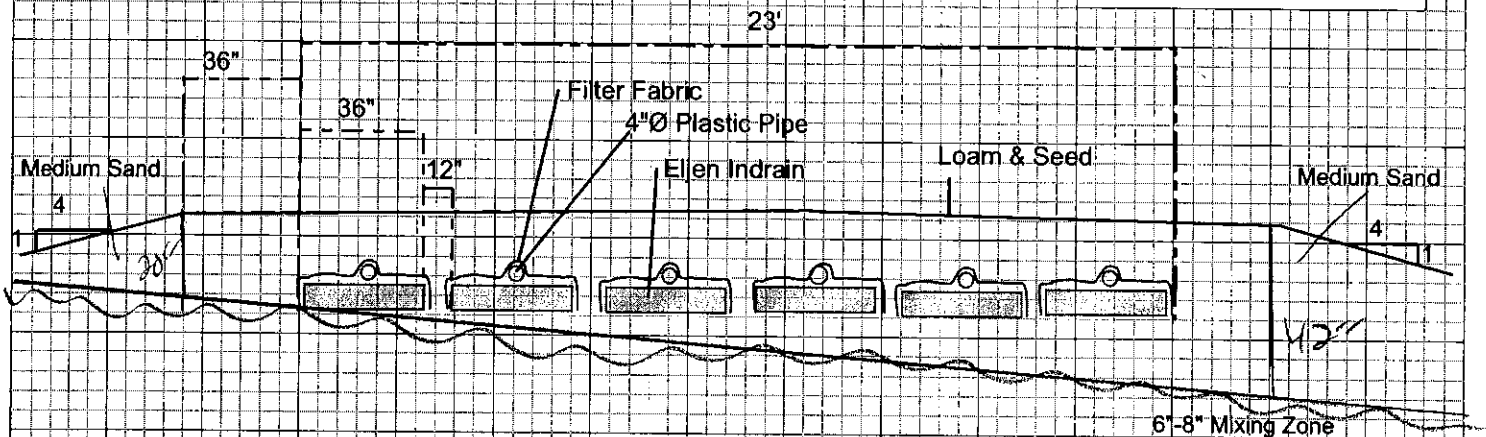

263

11/14/2019

Page 3 of 3

HHE-200 Rev. 02/11

Site Evaluator Signature

SE #

Date

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Maine Dept. Health & Human Services  
Div. Environmental Health, 11SHS  
(207) 287-2070 Fax: (207) 287-4172

<b>PROPERTY LOCATION</b>		<b>&gt;&gt; CAUTION: LPI APPROVAL REQUIRED &lt;&lt;</b>	
City, Town, or Plantation	Standish	Town/City _____	Permit # _____
Street or Road	Inverness Drive	Date Permit Issued: ___/___/___	Fee: \$ _____ Double Fee Charged [ ]
Subdivision, Lot #	Highlands Subdivision Units 61-68	L.P.I. # _____	
<b>OWNER/APPLICANT INFORMATION</b>		Local Plumbing Inspector Signature _____	
Name (last, first, MI)	Leavitt-Tompson LLC	Fee: \$ _____ state min fee \$ _____	Locally adopted fee _____
Mailing Address of Owner/Applicant	PO Box 703 Standish 04084	Copy: [ ] Owner [ ] Town [ ] State	
Daytime Tel. #		The Subsurface Wastewater Disposal System shall not be installed until a Permit is issued by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with this application and the Maine Subsurface Wastewater Disposal Rules.	
<b>OWNER OR APPLICANT STATEMENT</b>		<b>CAUTION: INSPECTION REQUIRED</b>	
I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit.		I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.	
Signature of Owner or Applicant _____ Date _____		Local Plumbing Inspector Signature _____ (1st) date approved _____	

PERMIT INFORMATION			
<b>TYPE OF APPLICATION</b> 1. First Time System 2. Replacement System Type replaced: _____ Year installed: _____ 3. Expanded System a. <25% Expansion b. ≥25% Expansion 4. Experimental System 5. Seasonal Conversion	<b>THIS APPLICATION REQUIRES</b> 1. No Rule Variance 2. First Time System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 3. Replacement System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 4. Minimum Lot Size Variance 5. Seasonal Conversion Permit	<b>DISPOSAL SYSTEM COMPONENTS</b> 1. Complete Non-engineered System 2. Primitive System (graywater & alt. toilet) 3. Alternative Toilet, specify: _____ 4. Non-engineered Treatment Tank (only) 5. Holding Tank, _____ gallons 6. Non-engineered Disposal Field (only) 7. Separated Laundry System 8. Complete Engineered System (2000 gpd or more) 9. Engineered Treatment Tank (only) 10. Engineered Disposal Field (only) 11. Pre-treatment, specify: _____ 12. Miscellaneous Components	<b>TYPE OF WATER SUPPLY</b> 1. Drilled Well    2. Dug Well    3. Private 4. Public    5. Other
<b>SIZE OF PROPERTY</b> 91 SQ. FT. ACRES	<b>DISPOSAL SYSTEM TO SERVE</b> 1. Single Family Dwelling Unit, No. of Bedrooms: _____ 2. Multiple Family Dwelling, No. of Units: _____ 3. Other: 8 2-bedroom units (specify) _____ Current Use    Seasonal    Year Round <u>Undeveloped</u>		
<b>SHORELAND ZONING</b> Yes <u>No</u>			

DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)			
<b>TREATMENT TANK</b> 1. Concrete a. Regular b. Low Profile 2. Plastic 3. Other: _____ CAPACITY: <u>2x1500</u> GAL.	<b>DISPOSAL FIELD TYPE &amp; SIZE</b> 1. Stone Bed    2. Stone Trench 3. Proprietary Device a. cluster array    c. Linear d. regular load    d. H-20 load 4. Other: _____ SIZE: <u>5184</u> sq. ft. lin. ft.	<b>GARBAGE DISPOSAL UNIT</b> 1. No    2. Yes    3. Maybe If Yes or Maybe, specify one below: a. multi-compartment tank b. _____ tanks in series c. Increase in tank capacity d. Filter on Tank Outlet	<b>DESIGN FLOW</b> 1440 gallons per day BASED ON: 1. Table 4A (dwelling unit(s)) 2. Table 4C (other facilities) SHOW CALCULATIONS for other facilities 3. Section 4G (meter readings) ATTACH WATER METER DATA
<b>SOIL DATA &amp; DESIGN CLASS</b> PROFILE CONDITION <u>3 / C</u> at Observation Hole # <u>TP41</u> Depth <u>16</u> " of Most Limiting Soil Factor	<b>DISPOSAL FIELD SIZING</b> 1. Medium—2.6 sq. ft. / gpd 2. <u>Medium—Large 3.3 sq. ft. / gpd</u> 3. Large—4.1 sq. ft. / gpd 4. Extra Large—5.0 sq. ft. / gpd	<b>EFFLUENT/EJECTOR PUMP</b> 1. Not Required 2. May Be Required 3. <u>Required</u> Specify only for engineered systems: DOSE: _____ gallons	<b>LATITUDE AND LONGITUDE</b> at center of disposal area Lat. <u>43</u> d <u>44</u> m <u>12</u> s Lon. <u>70</u> d <u>34</u> m <u>13</u> s if g.p.s, state margin of error: <u>15</u>

SITE EVALUATOR STATEMENT		
I certify that on <u>11/14/2019</u> (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).		
_____ Site Evaluator Signature <b>Mark J Hampton</b> Site Evaluator Name Printed	263 SE # 207-756-2900 Telephone Number	11/14/2019 Date _____ E-mail Address

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation

Street, Road, Subdivision

Owner's Name


Standish Inverness Drive Highlands Subdivision Units 61-68

Leavitt-Tompson LLC

**SITE PLAN**

Scale 1" = \_\_\_\_\_ ft. or as shown

**SITE LOCATION PLAN**

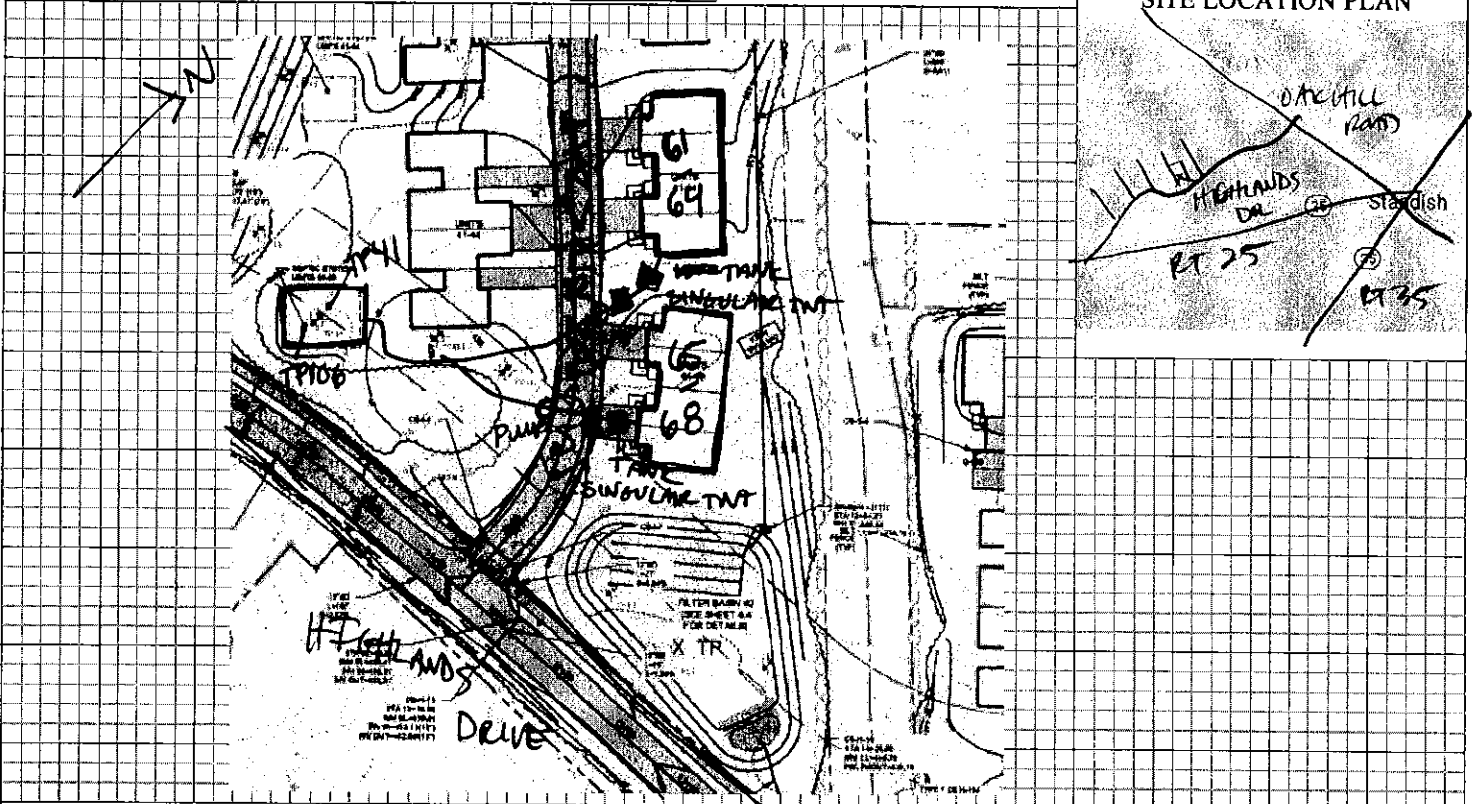

**SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)**

Observation Hole TP41  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3</b> <b>C</b> Profile Condition	Slope <b>4</b> %	Limiting Factor <b>16</b> "	<input checked="" type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
---	---------------------	--------------------------------	---

Observation Hole TP106  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3</b> <b>C</b> Profile Condition	Slope <b>4</b> %	Limiting Factor <b>16</b> "	<input checked="" type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
---	---------------------	--------------------------------	---

*W. J. Hays*  
 Site Evaluator Signature

263

SE #

11/14/2019

Date


# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation: **Standish Inverness Drive**  
 Street, Road, Subdivision: **Highlands Subdivision Units 61-68**

Owner's Name: **Leavitt-Tompson LLC**

## SUBSURFACE WASTEWATER DISPOSAL PLAN

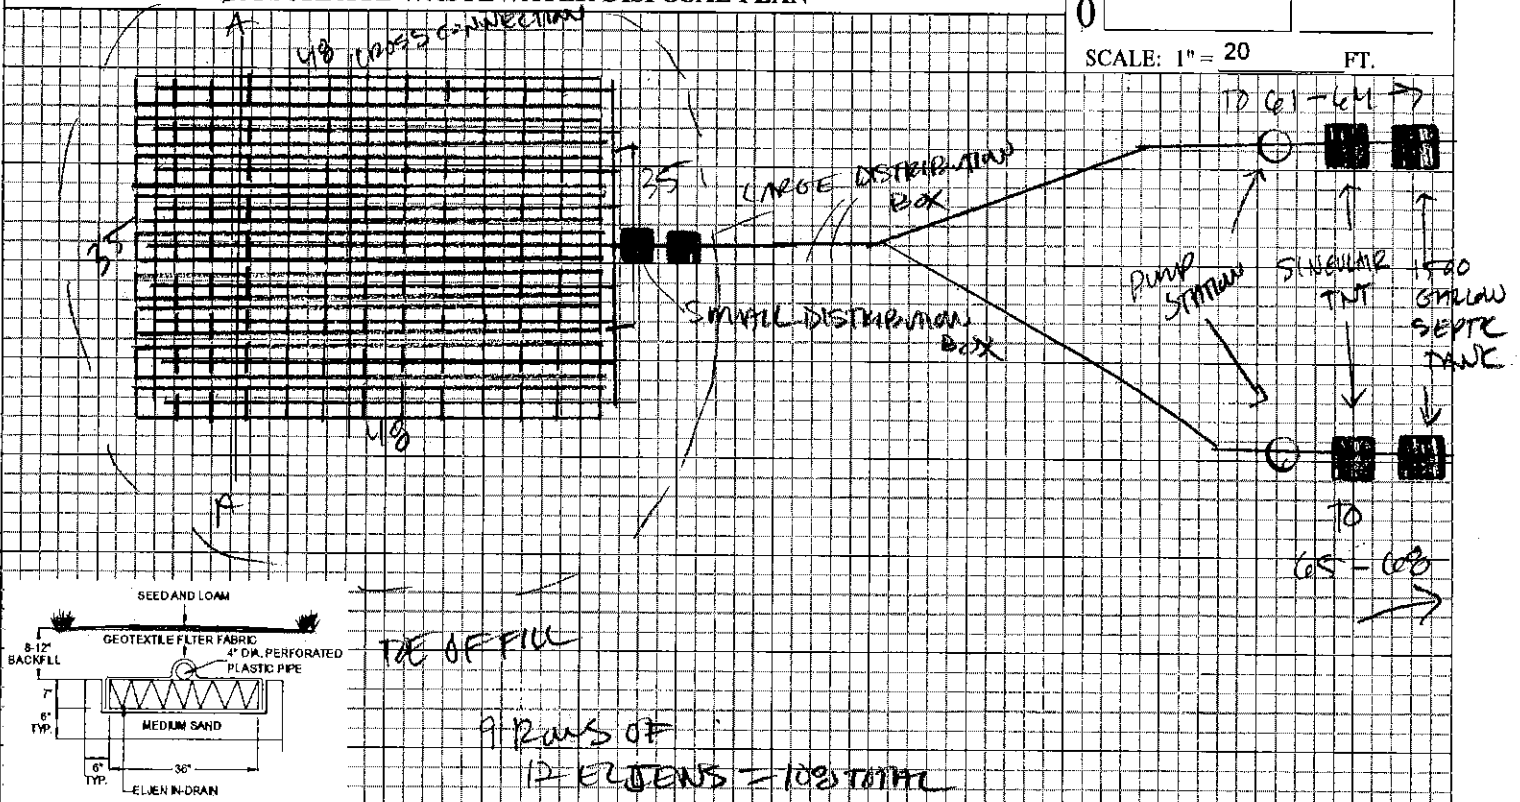

### FILL REQUIREMENTS

Depth of Fill (Upslope) **20**  
 Depth of Fill (Downslope) **36**

### CONSTRUCTION ELEVATIONS

Finished Grade Elevation \_\_\_\_\_  
 Top of Distribution Pipe or Proprietary Device \_\_\_\_\_  
 Bottom of Disposal Area \_\_\_\_\_

### ELEVATION REFERENCE POINT


Location & Description: \_\_\_\_\_  
 Reference Elevation: **0**

Note: Materials and installation shall be in accordance with Maine Subsurface Wastewater Disposal Rules dated 08/15 as amended.

### DISPOSAL AREA CROSS SECTION

Scale  
 Horizontal 1" = 6 ft.  
 Vertical 1" = 4 ft.

Note: All ground to be filled must be scarified

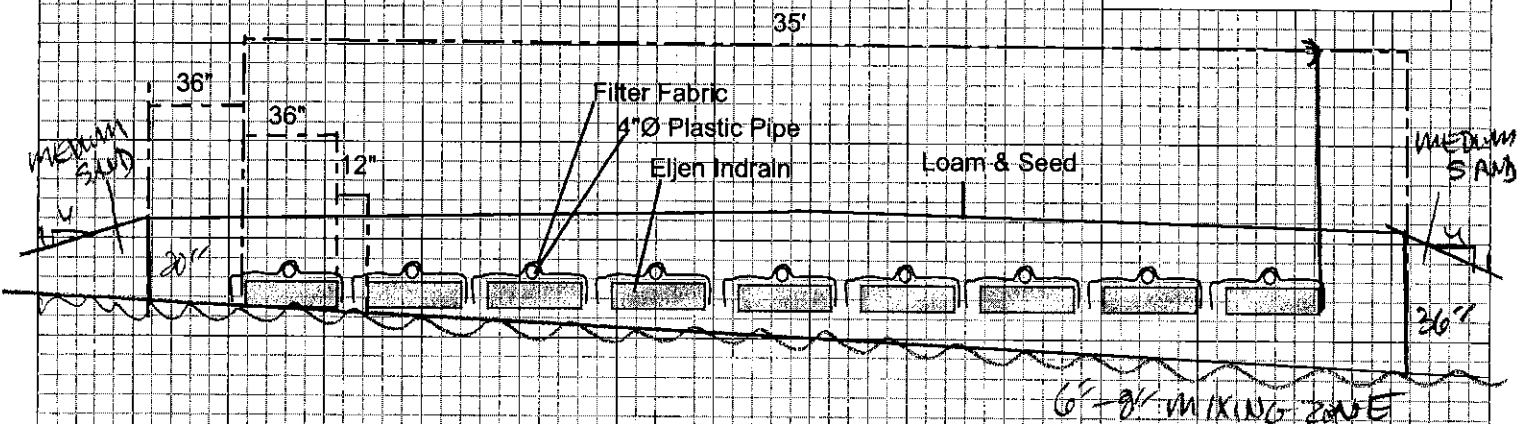

263

11/14/2019

Page 3 of 3

HHE-200 Rev. 02/11

Site Evaluator Signature

SE #

Date

## SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Dept. Health & Human Services  
Div. Environmental Health, 11SHS  
(207) 287-2070 Fax: (207) 287-4172

PROPERTY LOCATION		>> CAUTION: LPI APPROVAL REQUIRED <<	
City, Town, or Plantation	Standish	Town/City _____	Permit # _____
Street or Road	Stonehaven Drive	Date Permit Issued: ___/___/___	Fee: \$ _____ Double Fee Charged [ ]
Subdivision, Lot #	Highlands Subdivision Unit 69-76	L.P.I. # _____	
<b>OWNER/APPLICANT INFORMATION</b>		Local Plumbing Inspector Signature _____	
Name (last, first, MI)	Leavitt-Tompson LLC	Fee: \$ _____ state min fee \$ _____	Locally adopted fee _____
Mailing Address of Owner/Applicant	PO Box 703 Standish 04084	Copy: [ ] Owner [ ] Town [ ] State	
Daytime Tel. #		The Subsurface Wastewater Disposal System shall not be installed until a Permit is issued by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with this application and the Maine Subsurface Wastewater Disposal Rules.	
<b>OWNER OR APPLICANT STATEMENT</b>		<b>CAUTION: INSPECTION REQUIRED</b>	
I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit.		I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.	
Signature of Owner or Applicant _____ Date _____		Local Plumbing Inspector Signature _____ (1st) date approved _____	
Date _____		Local Plumbing Inspector Signature _____ (2nd) date approved _____	
PERMIT INFORMATION			
<b>TYPE OF APPLICATION</b>	<b>THIS APPLICATION REQUIRES</b>	<b>DISPOSAL SYSTEM COMPONENTS</b>	
1. First Time System 2. Replacement System Type replaced: _____ Year installed: _____ 3. Expanded System a. <25% Expansion b. ≥25% Expansion 4. Experimental System 5. Seasonal Conversion	1. No Rule Variance 2. First Time System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 3. Replacement System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 4. Minimum Lot Size Variance 5. Seasonal Conversion Permit	1. Complete Non-engineered System 2. Primitive System (graywater & alt. toilet) 3. Alternative Toilet, specify: _____ 4. Non-engineered Treatment Tank (only) 5. Holding Tank, _____ gallons 6. Non-engineered Disposal Field (only) 7. Separated Laundry System 8. Complete Engineered System (2000 gpd or more) 9. Engineered Treatment Tank (only) 10. Engineered Disposal Field (only) 11. Pre-treatment, specify: _____ 12. Miscellaneous Components	
<b>SIZE OF PROPERTY</b>	<b>DISPOSAL SYSTEM TO SERVE</b>	<b>TYPE OF WATER SUPPLY</b>	
91 SQ. FT. ACRES	1. Single Family Dwelling Unit, No. of Bedrooms: _____ 2. Multiple Family Dwelling, No. of Units: _____ 3. Other: 8 2-bedroom units (specify) Current Use Seasonal Year Round <u>Undeveloped</u>	1. Drilled Well 2. Dug Well 3. Private 4. <u>Public</u> 5. Other	
<b>SHORELAND ZONING</b>	<b>DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)</b>		
Yes <u>No</u>	<b>TREATMENT TANK</b>	<b>DISPOSAL FIELD TYPE &amp; SIZE</b>	<b>GARBAGE DISPOSAL UNIT</b>
	1. Concrete a. Regular b. Low Profile 2. Plastic 3. Other: _____ CAPACITY: <u>2x1500</u> GAL.	1. Stone Bed 2. Stone Trench 3. Proprietary Device a. cluster array c. Linear b. regular load d. H-20 load 4. Other: _____ SIZE: <u>4992</u> sq. ft. lin. ft.	1. No 2. Yes 3. Maybe If Yes or Maybe, specify one below: a. multi-compartment tank b. _____ tanks in series c. increase in tank capacity d. Filter on Tank Outlet
<b>SOIL DATA &amp; DESIGN CLASS</b>	<b>DISPOSAL FIELD SIZING</b>	<b>EFFLUENT/EJECTOR PUMP</b>	<b>DESIGN FLOW</b>
PROFILE CONDITION <u>3 / C</u> at Observation Hole # <u>TP66</u> Depth <u>18</u> " of Most Limiting Soil Factor	1. Medium—2.6 sq. ft. / gpd 2. <u>Medium—Large 3.3 sq. ft. / gpd</u> 3. Large—4.1 sq. ft. / gpd 4. Extra Large—5.0 sq. ft. / gpd	1. Not Required 2. May Be Required 3. <u>Required</u> Specify only for engineered systems: DOSE: _____ gallons	1440 gallons per day BASED ON: 1. Table 4A (dwelling unit(s)) 2. Table 4C (other facilities) SHOW CALCULATIONS for other facilities 3. Section 4G (meter readings) ATTACH WATER METER DATA
<b>LATITUDE AND LONGITUDE</b> at center of disposal area Lat. <u>43</u> d <u>44</u> m <u>12</u> s Lon. <u>70</u> d <u>34</u> m <u>12</u> s if g.p.s, state margin of error: <u>15</u>			
SITE EVALUATOR STATEMENT			
I certify that on <u>11/14/2019</u> (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).			
Site Evaluator Signature <u>Mark J Hampton</u>		263 SE #	11/14/2019 Date
Site Evaluator Name Printed		207-756-2900 Telephone Number	E-mail Address

Note : Changes to or deviations from the \_\_\_\_\_ n should be confirmed with the Site Evaluator.

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**



Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation: Standish  
 Street, Road, Subdivision: Stonehaven Drive Highlands Subdivision Unit 69-76

Owner's Name: Leavitt-Tompson LLC

**SITE PLAN** Scale 1" = \_\_\_\_\_ ft. or as shown

**SITE LOCATION PLAN**

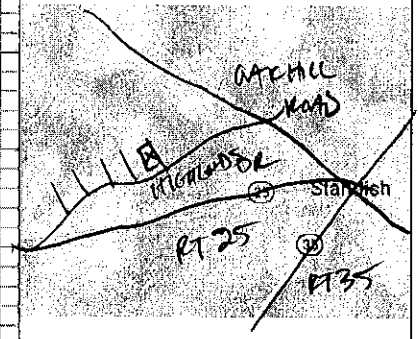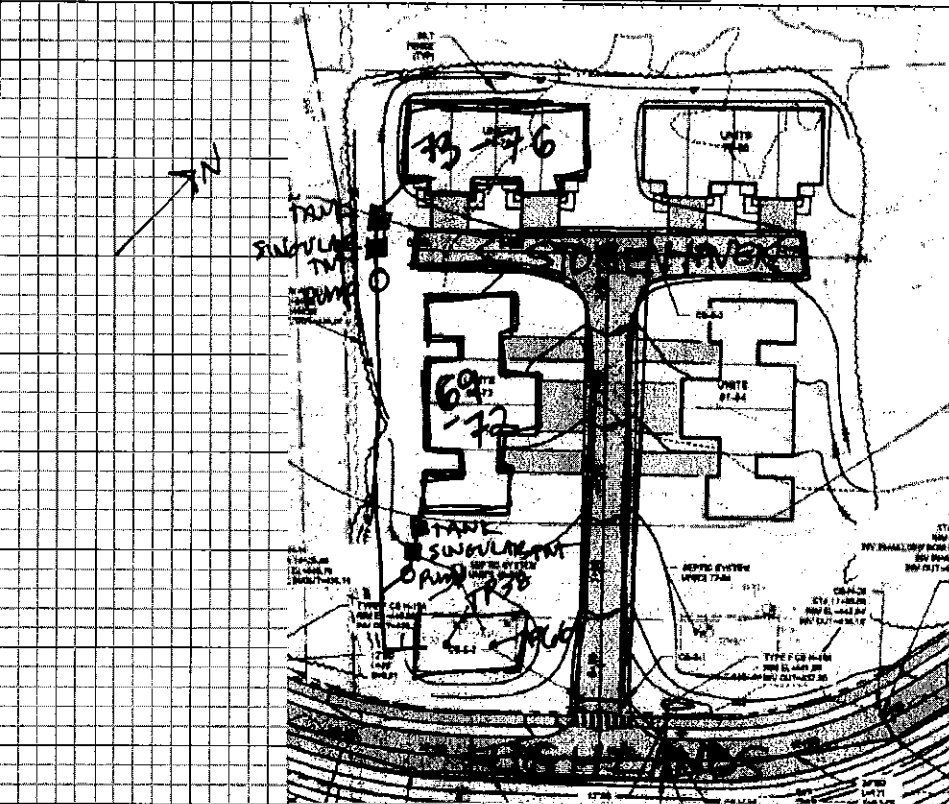

**SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)**

Observation Hole TP66  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Observation Hole TP38  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3 C</b> Profile Condition	Slope <b>2</b> %	Limiting Factor <b>18</b> "	<input checked="" type="checkbox"/> Ground Water Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	--

Soil Classification <b>3 C</b> Profile Condition	Slope <b>2</b> %	Limiting Factor <b>20</b> "	<input checked="" type="checkbox"/> Ground Water Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	--

*Handwritten Signature*  
 Site Evaluator Signature

263

SE #

11/14/2019

Date



# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation: Standish Stonehaven Drive  
 Street, Road, Subdivision: Highlands Subdivision Unit 69-76

Owner's Name: Leavitt-Tompson LLC

## SUBSURFACE WASTEWATER DISPOSAL PLAN

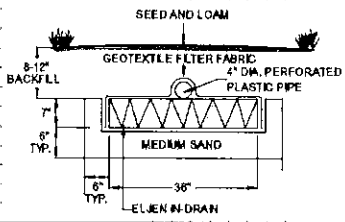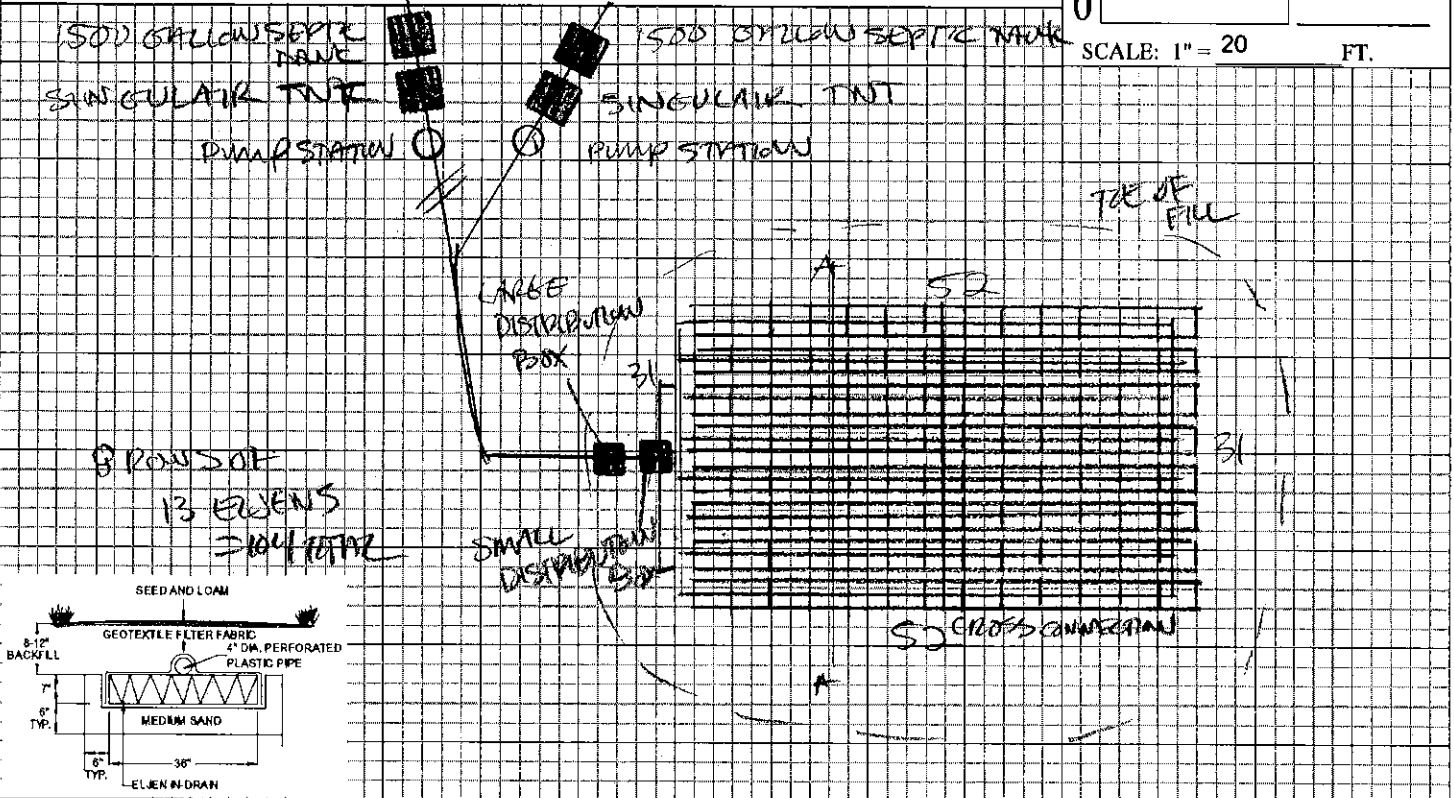

### FILL REQUIREMENTS

Depth of Fill (Upslope) 17  
 Depth of Fill (Downslope) 25

### CONSTRUCTION ELEVATIONS

Finished Grade Elevation \_\_\_\_\_  
 Top of Distribution Pipe or Proprietary Device \_\_\_\_\_  
 Bottom of Disposal Area \_\_\_\_\_

### ELEVATION REFERENCE POINT

Location & Description: \_\_\_\_\_  
 Reference Elevation: 0


Note: Materials and installation shall be in accordance with Maine Subsurface Wastewater Disposal Rules dated 08/15 as amended.

### DISPOSAL AREA CROSS SECTION

#### Scale

Horizontal 1" = 6 ft.  
 Vertical 1" = 4 ft.

Note: All ground to be filled must be scarified

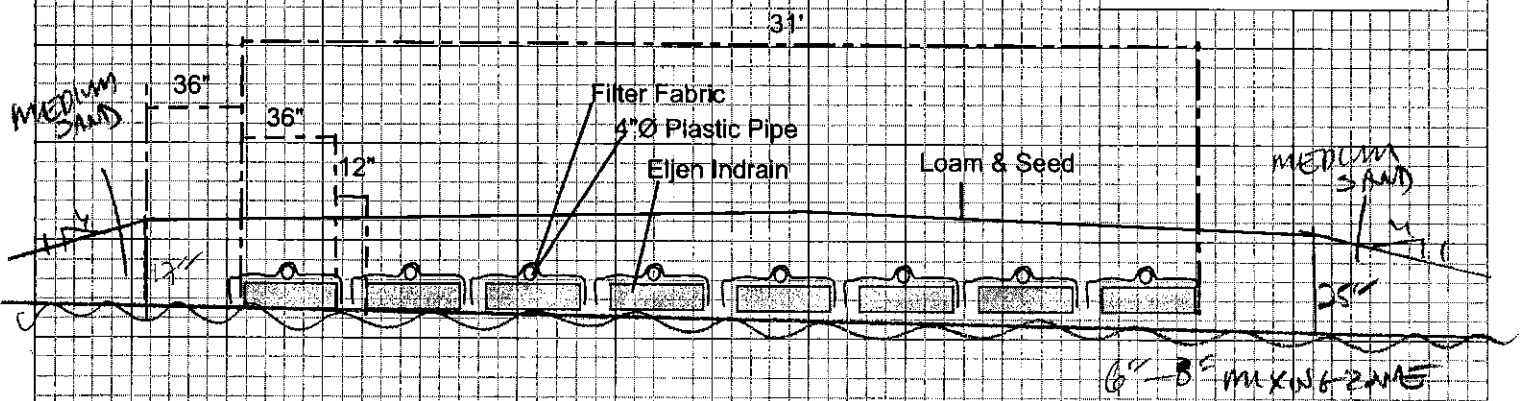

263

11/14/2019

Site Evaluator Signature

SE #

Date



## SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Dept. Health & Human Services  
Div. Environmental Health, 11SHS  
(207) 287-2070 Fax: (207) 287-4172

<b>PROPERTY LOCATION</b>		<b>&gt;&gt; CAUTION: LPI APPROVAL REQUIRED &lt;&lt;</b>	
City, Town, or Plantation	Standish	Town/City _____	Permit # _____
Street or Road	Stonehaven Drive	Date Permit Issued: ___/___/___	Fee: \$ _____ Double Fee Charged [ ]
Subdivision, Lot #	Highlands Subdivision Unit 77-84	_____	L.P.I. # _____
<b>OWNER/APPLICANT INFORMATION</b>		Local Plumbing Inspector Signature _____	
Name (last, first, MI)	Leavitt-Tompson LLC	Fee: \$ _____ state min fee \$ _____	Locally adopted fee _____
	Owner <input checked="" type="checkbox"/>	Copy: [ ] Owner [ ] Town [ ] State	
	Applicant <input type="checkbox"/>	The Subsurface Wastewater Disposal System shall not be installed until a Permit is issued by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with this application and the Maine Subsurface Wastewater Disposal Rules.	
Mailing Address of Owner/Applicant	PO Box 703 Standish 04084	Municipal Tax Map # _____ Lot # _____	
Daytime Tel. #		<b>CAUTION: INSPECTION REQUIRED</b>	
<b>OWNER OR APPLICANT STATEMENT</b>		I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.	
I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit.		(1st) date approved _____	
Signature of Owner or Applicant _____		Local Plumbing Inspector Signature _____	
Date _____		(2nd) date approved _____	

## PERMIT INFORMATION

<b>TYPE OF APPLICATION</b>	<b>THIS APPLICATION REQUIRES</b>	<b>DISPOSAL SYSTEM COMPONENTS</b>
1. First Time System 2. Replacement System Type replaced: _____ Year installed: _____ 3. Expanded System a. <25% Expansion b. >25% Expansion 4. Experimental System 5. Seasonal Conversion	1. No Rule Variance 2. First Time System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 3. Replacement System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 4. Minimum Lot Size Variance 5. Seasonal Conversion Permit	1. Complete Non-engineered System 2. Primitive System (graywater & alt. toilet) 3. Alternative Toilet, specify: _____ 4. Non-engineered Treatment Tank (only) 5. Holding Tank, _____ gallons 6. Non-engineered Disposal Field (only) 7. Separated Laundry System 8. Complete Engineered System (2000 gpd or more) 9. Engineered Treatment Tank (only) 10. Engineered Disposal Field (only) 11. Pre-treatment, specify: _____ 12. Miscellaneous Components
<b>SIZE OF PROPERTY</b>	<b>DISPOSAL SYSTEM TO SERVE</b>	<b>TYPE OF WATER SUPPLY</b>
91 SQ. FT. ACRES	1. Single Family Dwelling Unit, No. of Bedrooms: _____ 2. Multiple Family Dwelling, No. of Units: _____ 3. Other: 8 2-bedroom units (specify) _____ Current Use Seasonal Year Round <u>Undeveloped</u>	1. Drilled Well 2. Dug Well 3. Private 4. Public 5. Other
<b>SHORELAND ZONING</b>	<b>DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)</b>	
Yes <input type="checkbox"/> No <input checked="" type="checkbox"/>		

<b>TREATMENT TANK</b>	<b>DISPOSAL FIELD TYPE &amp; SIZE</b>	<b>GARBAGE DISPOSAL UNIT</b>	<b>DESIGN FLOW</b>
1. Concrete a. Regular b. Low Profile 2. Plastic 3. Other: _____ CAPACITY: 2x1500 GAL.	1. Stone Bed 2. Stone Trench 3. Proprietary Device a. cluster array c. Linear b. regular load d. H-20 load 4. Other: _____ SIZE: 4992 sq. ft. lin. ft.	1. No 2. Yes 3. Maybe If Yes or Maybe, specify one below: a. multi-compartment tank b. ___ tanks in series c. increase in tank capacity d. Filter on Tank Outlet	1440 gallons per day BASED ON: 1. Table 4A (dwelling unit(s)) 2. Table 4C (other facilities) SHOW CALCULATIONS for other facilities
<b>SOIL DATA &amp; DESIGN CLASS</b>	<b>DISPOSAL FIELD SIZING</b>	<b>EFFLUENT/EJECTOR PUMP</b>	<b>LATITUDE AND LONGITUDE</b>
PROFILE CONDITION 3 / C at Observation Hole # TP107 Depth 18" of Most Limiting Soil Factor	1. Medium—2.6 sq. ft. / gpd 2. Medium—Large 3.3 sq. ft. / gpd 3. Large—4.1 sq. ft. / gpd 4. Extra Large—5.0 sq. ft. / gpd	1. Not Required 2. May Be Required 3. Required Specify only for engineered systems: DOSE: _____ gallons	3. Section 4G (meter readings) ATTACH WATER METER DATA at center of disposal area Lat. 43 d 44 m 12 s Lon. 70 d 34 m 12 s if g.p.s, state margin of error: 15

## SITE EVALUATOR STATEMENT

I certify that on 11/14/2019 (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).

Mark J Hampton Site Evaluator Signature  
263 SE # 11/14/2019 Date  
207-756-2900 Telephone Number  
Site Evaluator Name Printed E-mail Address

Note: Changes to or deviations from the \_\_\_\_\_ n should be confirmed with the Site Evaluator.



**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation

Street, Road, Subdivision

Owner's Name

Standish Stonehaven Drive



Highlands Subdivision Unit 77-84

Leavitt-Tompson LLC

**SITE PLAN**

Scale 1" = \_\_\_\_\_ ft. or as shown

**SITE LOCATION PLAN**

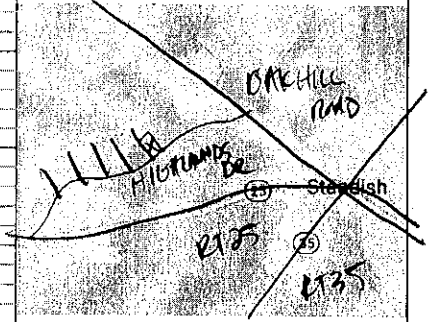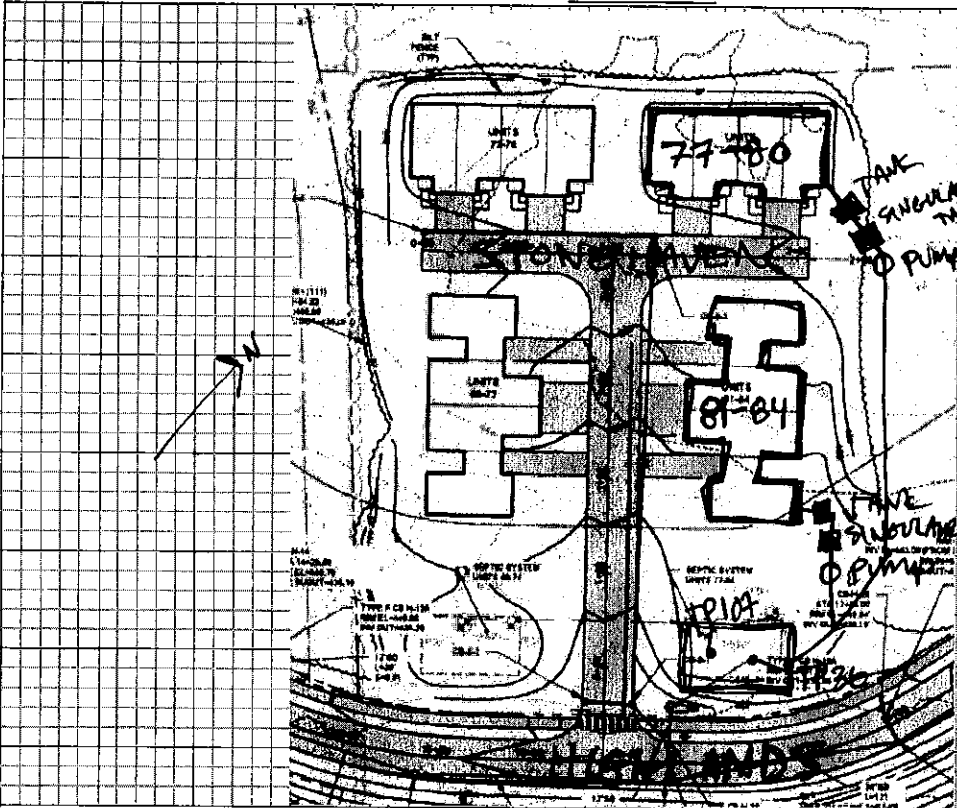

**SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)**

Observation Hole TP107  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Observation Hole TP36  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3 C</b> Profile Condition	Slope <b>2</b> %	Limiting Factor <b>18</b> "	<input checked="" type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	---

Soil Classification <b>3 C</b> Profile Condition	Slope <b>2</b> %	Limiting Factor <b>20</b> "	<input checked="" type="checkbox"/> Ground Water <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	---

*[Handwritten Signature]*  
 Site Evaluator Signature

263

SE #

11/14/2019

Date

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**



Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation  
**Standish Stonehaven Drive**

Street, Road, Subdivision  
**Highlands Subdivision Unit 77-84**

Owner's Name  
**Leavitt-Tompson LLC**

**SUBSURFACE WASTEWATER DISPOSAL PLAN**

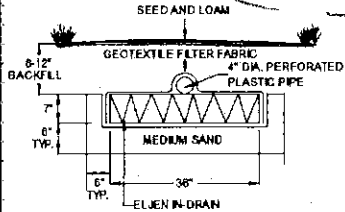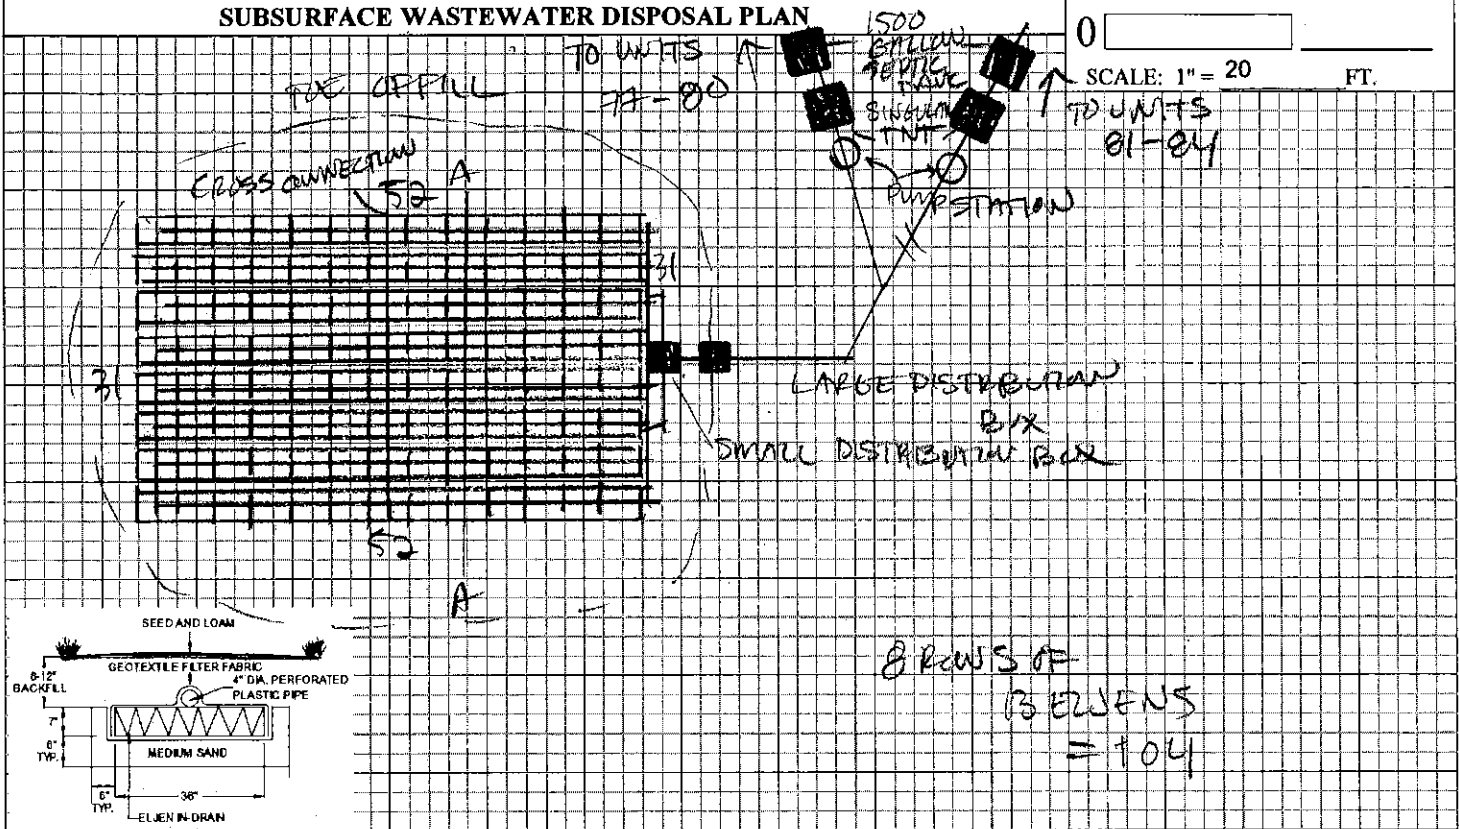

**FILL REQUIREMENTS**

**CONSTRUCTION ELEVATIONS**

**ELEVATION REFERENCE POINT**

Depth of Fill (Upslope) 17  
 Depth of Fill (Downslope) 25

Finished Grade Elevation \_\_\_\_\_  
 Top of Distribution Pipe or Proprietary Device \_\_\_\_\_  
 Bottom of Disposal Area \_\_\_\_\_


Location & Description: \_\_\_\_\_  
 Reference Elevation: 0

Note: Materials and installation shall be in accordance with Maine Subsurface Wastewater Disposal Rules dated 08/13 as amended.

**DISPOSAL AREA CROSS SECTION**

Scale  
 Horizontal 1" = 6 ft.  
 Vertical 1" = 4 ft.

Note: All ground to be filled must be scarified

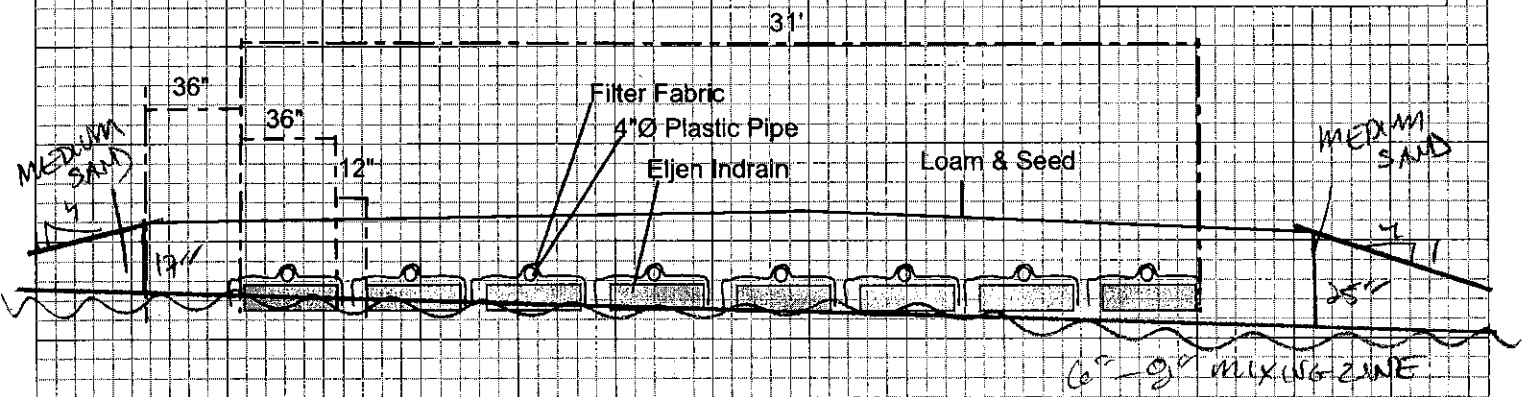

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**

Maine Dept. Health & Human Services  
Div. Environmental Health, 11SHS  
(207) 287-2070 Fax: (207) 287-4172

<b>PROPERTY LOCATION</b>		<b>&gt;&gt; CAUTION: LPI APPROVAL REQUIRED &lt;&lt;</b>	
City, Town, or Plantation	Standish	Town/City _____	Permit # _____
Street or Road	Highlands Drives	Date Permit Issued: ___/___/___	Fee: \$ _____ Double Fee Charged [ ]
Subdivision, Lot #	Highlands Subdivision Clubhouse	L.P.I. # _____	
<b>OWNER/APPLICANT INFORMATION</b>		Local Plumbing Inspector Signature _____	
Name (last, first, MI)	Leavitt-Tompson LLC	Fee: \$ _____ state min fee \$ _____	Locally adopted fee _____
Mailing Address of Owner/Applicant	PO Box 703 Standish 04084	Copy: [ ] Owner [ ] Town [ ] State	
Daytime Tel. #		The Subsurface Wastewater Disposal System shall not be installed until a Permit is issued by the Local Plumbing Inspector. The Permit shall authorize the owner or installer to install the disposal system in accordance with this application and the Maine Subsurface Wastewater Disposal Rules.	
<b>OWNER OR APPLICANT STATEMENT</b>		<b>CAUTION: INSPECTION REQUIRED</b>	
I state and acknowledge that the information submitted is correct to the best of my knowledge and understand that any falsification is reason for the Department and/or Local Plumbing Inspector to deny a Permit.		I have inspected the installation authorized above and found it to be in compliance with the Subsurface Wastewater Disposal Rules Application.	
Signature of Owner or Applicant _____ Date _____		Local Plumbing Inspector Signature _____ (1st) date approved _____	
		Municipal Tax Map # _____ Lot # _____	
		Local Plumbing Inspector Signature _____ (2nd) date approved _____	

PERMIT INFORMATION		
<b>TYPE OF APPLICATION</b> 1. First Time System 2. Replacement System Type replaced: _____ Year installed: _____ 3. Expanded System a. <25% Expansion b. >25% Expansion 4. Experimental System 5. Seasonal Conversion	<b>THIS APPLICATION REQUIRES</b> 1. No Rule Variance 2. First Time System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 3. Replacement System Variance a. Local Plumbing Inspector Approval b. State & Local Plumbing Inspector Approval 4. Minimum Lot Size Variance 5. Seasonal Conversion Permit	<b>DISPOSAL SYSTEM COMPONENTS</b> 1. Complete Non-engineered System 2. Primitive System (graywater & alt. toilet) 3. Alternative Toilet, specify: _____ 4. Non-engineered Treatment Tank (only) 5. Holding Tank, _____ gallons 6. Non-engineered Disposal Field (only) 7. Separated Laundry System 8. Complete Engineered System (2000 gpd or more) 9. Engineered Treatment Tank (only) 10. Engineered Disposal Field (only) 11. Pre-treatment, specify: _____ 12. Miscellaneous Components _____
<b>SIZE OF PROPERTY</b> 91 SQ. FT. ACRES	<b>DISPOSAL SYSTEM TO SERVE</b> 1. Single Family Dwelling Unit, No. of Bedrooms: _____ 2. Multiple Family Dwelling, No. of Units: _____ 3. Other Clubhouse (specify) Current Use Seasonal Year Round <u>Undeveloped</u>	<b>TYPE OF WATER SUPPLY</b> 1. Drilled Well 2. Dug Well 3. Private 4. Public 5. Other
<b>SHORELAND ZONING</b> Yes No	<b>DESIGN DETAILS (SYSTEM LAYOUT SHOWN ON PAGE 3)</b>	

<b>TREATMENT TANK</b> 1. Concrete a. Regular b. Low Profile 2. Plastic 3. Other: _____ CAPACITY: 1500 GAL.	<b>DISPOSAL FIELD TYPE &amp; SIZE</b> 1. Stone Bed 2. Stone Trench 3. Proprietary Device a. cluster array c. Linear b. regular load d. H-20 load 4. Other: _____ SIZE: 1680 sq. ft. lin. ft.	<b>GARBAGE DISPOSAL UNIT</b> 1. No 2. Yes 3. Maybe If Yes or Maybe, specify one below: a. multi-compartment tank b. _____ tanks in series c. increase in tank capacity d. Filter on Tank Outlet	<b>DESIGN FLOW</b> 500 gallons per day BASED ON: 1. Table 4A (dwelling unit(s)) 2. Table 4C (other facilities) SHOW CALCULATIONS for other facilities 3. Section 4G (meter readings) ATTACH WATER METER DATA
<b>SOIL DATA &amp; DESIGN CLASS</b> PROFILE CONDITION 3 / C at Observation Hole # TP77 Depth 15" of Most Limiting Soil Factor	<b>DISPOSAL FIELD SIZING</b> 1. Medium---2.6 sq. ft. / gpd 2. Medium---Large 3.3 sq. ft. / gpd 3. Large---4.1 sq. ft. / gpd 4. Extra Large---5.0 sq. ft. / gpd	<b>EFFLUENT/EJECTOR PUMP</b> 1. Not Required 2. May Be Required 3. Required Specify only for engineered systems: DOSE: _____ gallons	<b>LATITUDE AND LONGITUDE</b> at center of disposal area Lat. 43 d 44 m 07 s Lon. 70 d 34 m 11 s if g.p.s, state margin of error: 15

SITE EVALUATOR STATEMENT		
I certify that on <u>11/14/2019</u> (date) I completed a site evaluation on this property and state that the data reported are accurate and that the proposed system is in compliance with the State of Maine Subsurface Wastewater Disposal Rules (10-144A CMR 241).		
_____ Site Evaluator Signature Mark J Hampton	263 SE # 207-756-2900	11/14/2019 Date
Site Evaluator Name Printed	Telephone Number	E-mail Address

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**



Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation: Standish  
 Street, Road, Subdivision: Highland Drive, Highlands Subdivision Clubhouse

Owner's Name: Leavitt-Tompson LLC

**SITE PLAN** Scale 1" = \_\_\_\_\_ ft. or as shown

**SITE LOCATION PLAN**

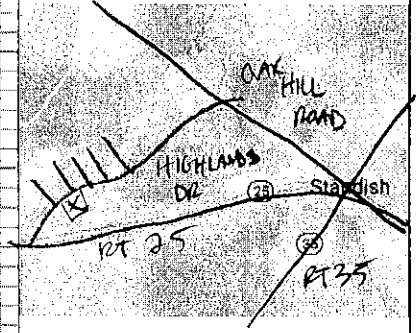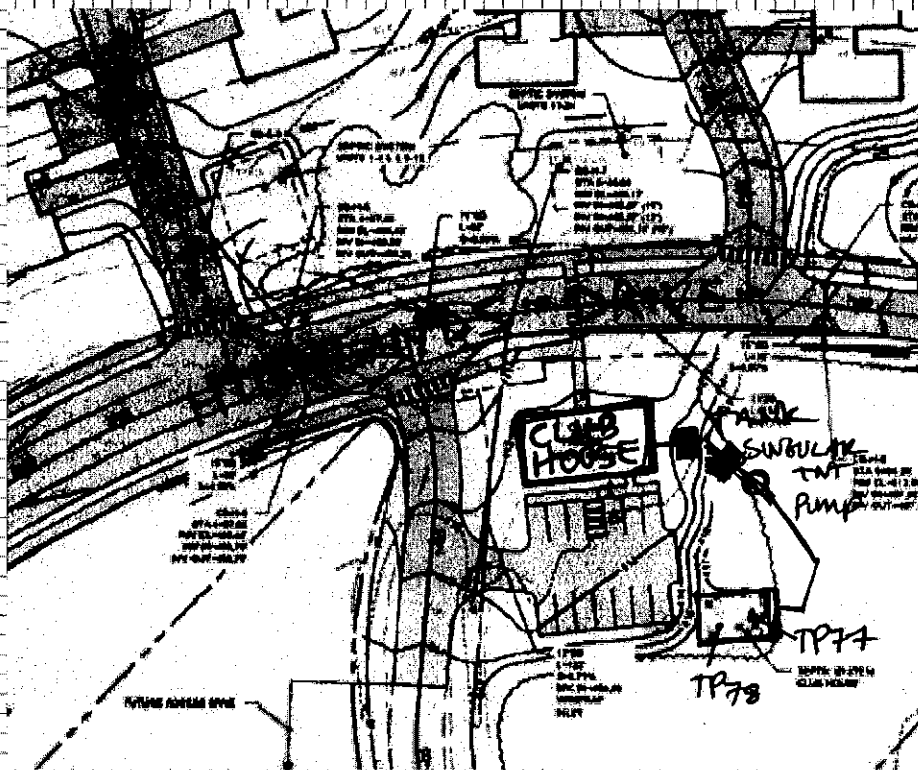

**SOIL DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)**

Observation Hole TP77  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Observation Hole TP78  Test Pit  Boring  
 " Depth of Organic Horizon Above Mineral Soil

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Depth Below Mineral Soil Surface (inches)	Texture	Consistency	Color	Mottling
0	Sandy Loam	Friable	Dark Brown	
10	Sandy Loam	Friable	Brown	
20	Sandy Loam	Firm	Olive	Common and Distinct
30				
40				
50				

Soil Classification <b>3 C</b> Profile Condition	Slope <b>4</b> %	Limiting Factor <b>15</b> "	<input checked="" type="checkbox"/> Ground Water <input type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	--

Soil Classification <b>3 C</b> Profile Condition	Slope <b>4</b> %	Limiting Factor <b>15</b> "	<input checked="" type="checkbox"/> Ground Water <input type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock <input type="checkbox"/> Pit Depth
--	---------------------	--------------------------------	--

*[Signature]*  
 Site Evaluator Signature

263

SE #

11/14/2019

Date

**SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION**


Department of Health & Human Services  
 Division of Environmental Health  
 (207) 287-5672 Fax: (207) 287-3165

Town, City, Plantation: Standish  
 Street, Road, Subdivision: Highland Drive, Highlands Subdivision Clubhouse

Owner's Name: Leavitt-Tompson LLC

**SUBSURFACE WASTEWATER DISPOSAL PLAN**

0 [ ]  
 SCALE: 1" = 20 FT.

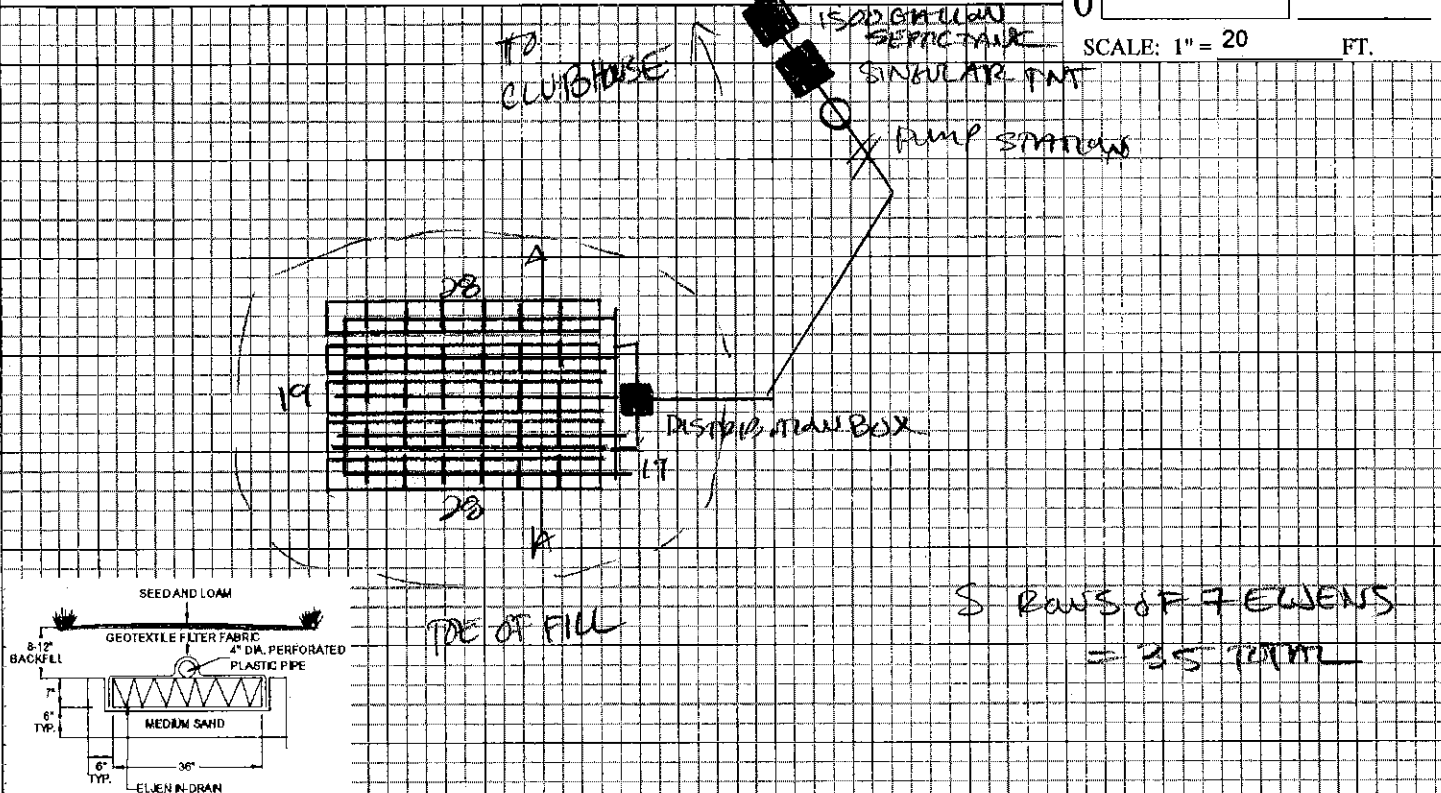

**FILL REQUIREMENTS**

Depth of Fill (Upslope) 20  
 Depth of Fill (Downslope) 26

**CONSTRUCTION ELEVATIONS**

Finished Grade Elevation \_\_\_\_\_  
 Top of Distribution Pipe or Proprietary Device \_\_\_\_\_  
 Bottom of Disposal Area \_\_\_\_\_

**ELEVATION REFERENCE POINT**

Location & Description: \_\_\_\_\_  
 Reference Elevation: 0


Note: Materials and installation shall be in accordance with Maine Subsurface Wastewater Disposal Rules dated 08/15 as amended.

**DISPOSAL AREA CROSS SECTION**

Scale

Horizontal 1" = 4 ft.  
 Vertical 1" = 4 ft.

Note: All ground to be filled must be scarified.

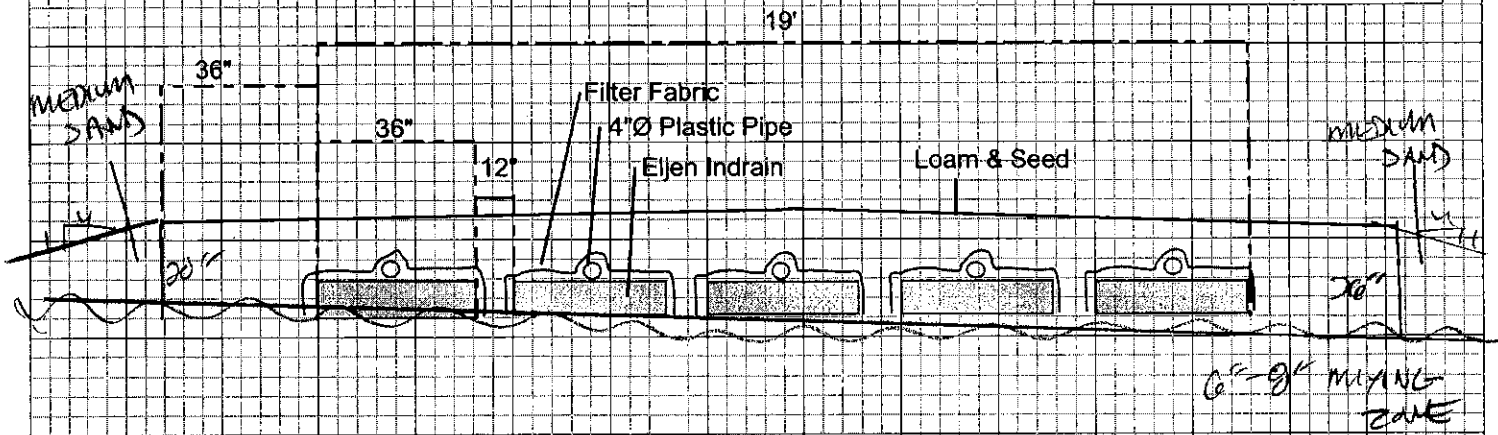

263

11/14/2019

Page 3 of 3  
 HHE-200 Rev. 02/11

Site Evaluator Signature

SE #

Date

## **NITRATE-NITROGEN ASSESSMENT FOR SINGLE-FAMILY LOTS**





**Response to DEP Project Memorandum  
Dated September 12, 2019  
Highlands Subdivision, Standish**

**Date:** November 22, 2019

**Purpose:**

The purpose of this response is to satisfy comment 11 of the DEP Memo which states:

*"A nitrate-nitrogen impact assessment should be conducted on the single-family subdivision lots. This comment may not apply to lots 1-3, 10-12 and 14-18, depending on proposed locations of subsurface wastewater disposal fields at these lots which can meet setback distances in the exemption table in Part II section 17.B.4.a. of the site application."*

**Discussion:**

The *Nitrate-Nitrogen Assessment, Highlands Subdivision* by Mark Cenci Geologic, dated April 3, 2019, was done in response to comments by John Hopeck regarding the need for pretreatment of wastewater from systems serving lots 25-32, 45-48 and 57-60 and 49-56. In that assessment assumptions about groundwater flow were made by a review of on-site soil information, topographic slope data, a wetland delineation, a sample of groundwater from the neighborhood and published literature.

The same information was used in this review of the single-family residential lots. The same ground water flow assumptions and analytical program were used to estimate the 10 mg/liter NO<sub>3</sub>-N plume lengths.

The analysis is not a mass-balance evaluation based upon precipitation dilution, but rather the behavior of the NO<sub>3</sub>-N in groundwater. Therefore, drought condition analysis is not applicable.

The estimated 10 mg/liter NO<sub>3</sub>-N plume length is 95 feet. A review was made of each of the 18 single-family lots to ensure each lot has a suitable septic system location that is more than 95 feet from the down gradient property line.

On this project the home locations must be 15 to 25 feet from the road right-of-way. Therefore, the placement of wastewater disposal areas in the space between the road and the homes is not possible, due to the setback distances required by the Maine Subsurface Wastewater Disposal Rules.


Lots on ground higher than the road will likely require pump stations, although it may be possible to site disposal areas adjacent to homes to avoid pumping. Homes centered on the lots at setback distances of 25 feet from the road were assumed, as were 20' x 45' pipe and stone beds.

Where possible, locations of septic systems were placed on existing test pits by Mark Hampton, LSE, CSS. Several lots had no suitable test pit, so additional soil test pits logs were provided by Hampton.

Plumes were drawn on the site plan, based on topographic information and were sent to Terradyn Consultants, LLC to be included on a plan.



**Conclusions:**

Each of the 18 single-family lots of the Highlands Subdivision can meet the requirement of Section 17.B of the site application. The NO<sub>3</sub>-N in the groundwater does not exceed 10 mg/liter at the project property line based on the analysis of this assessment..

  
Mark Cenci, CG #467




**EXHIBIT 20 – 500' BLASTING RADIUS**

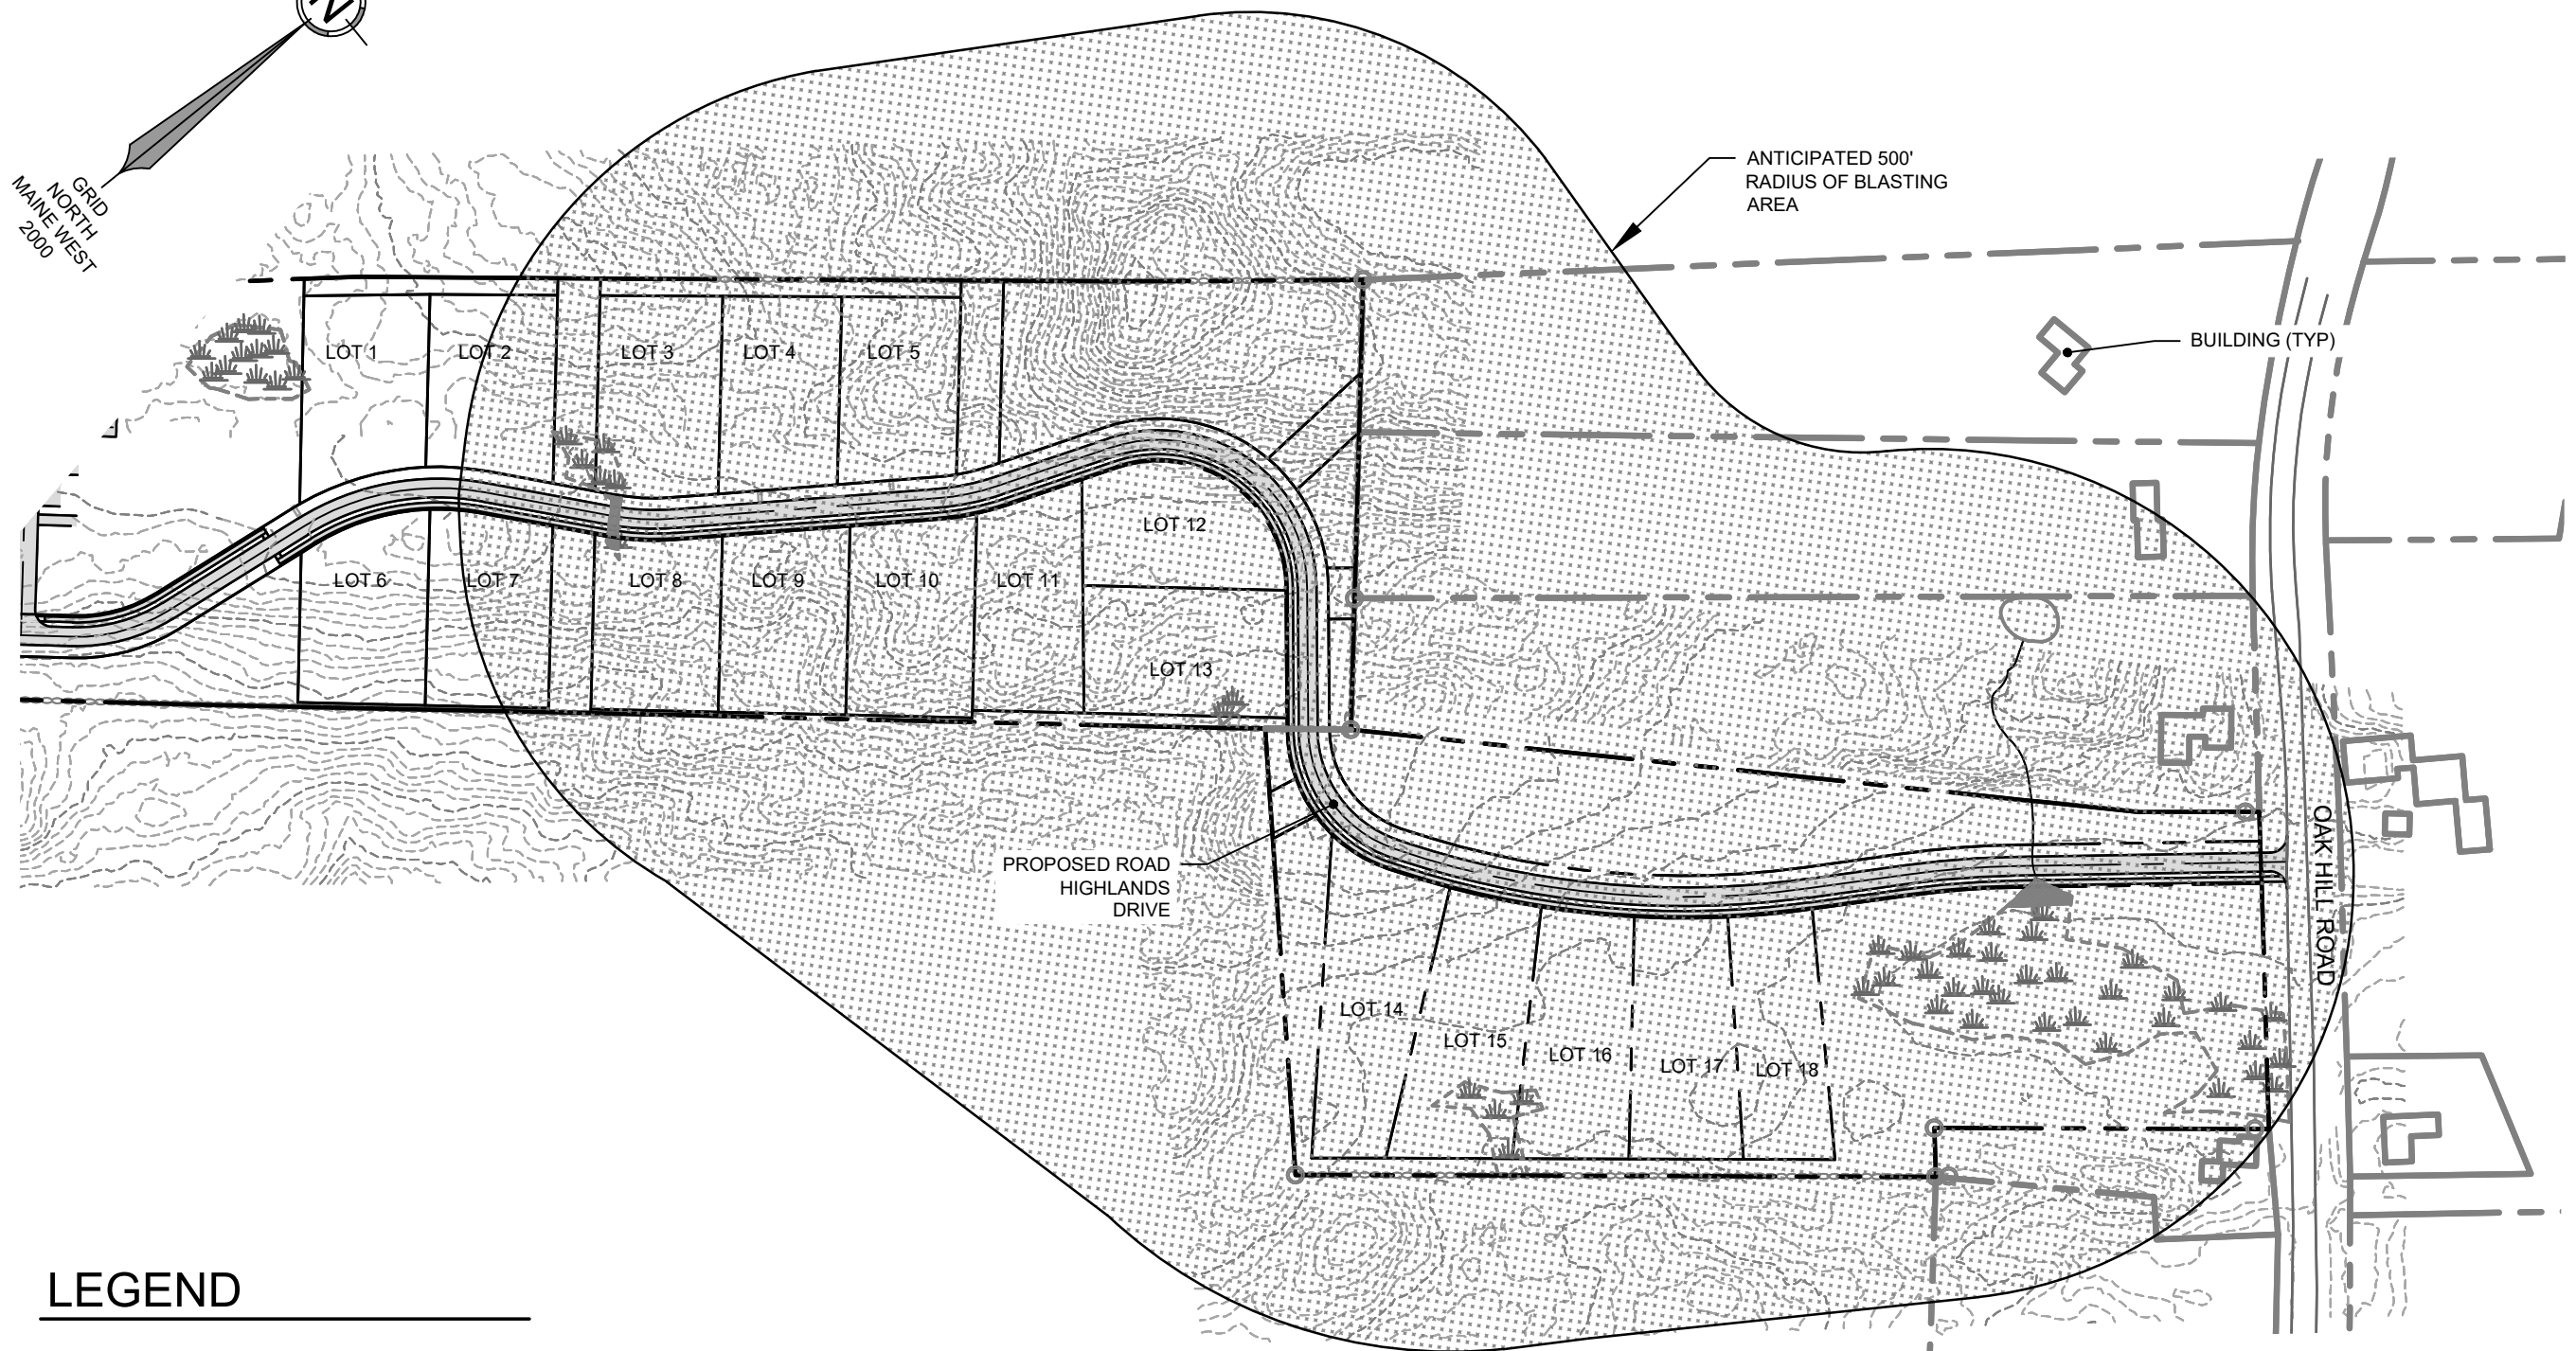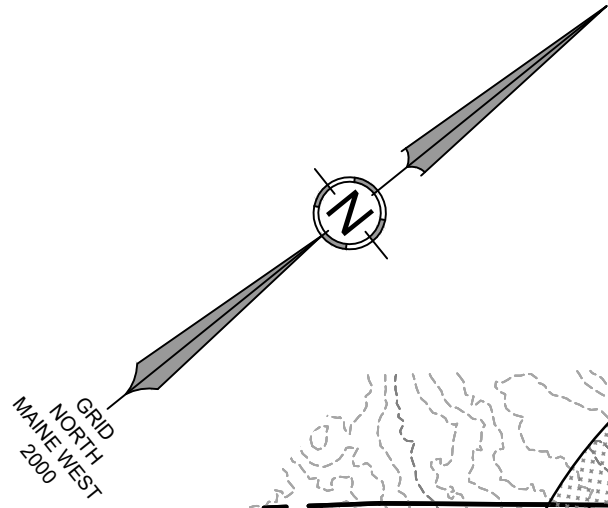

**LEGEND**

 AREA WITHIN 500' OF BLASTING AREA

NOTE: BLASTING WILL BE REQUIRED TO CONSTRUCT HIGHLAND AVENUE IN THE GENERAL AREA FROM STATION 28+00 TO 43+00, AND TO PREPARE BUILDING PADS ALONG THE FRONTAGE OF LOTS 14 AND 15. WHEN BLASTING IS DETERMINED TO BE NECESSARY, THE CONTRACTOR SHALL ADHERE TO THE BLASTING PLAN LOCATED IN THE SITE LOCATION OF DEVELOPMENT APPLICATION SECTION 20.

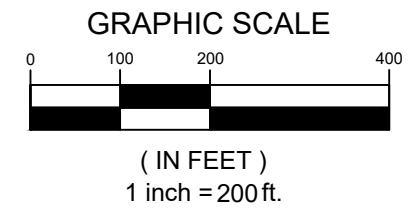

41 Campus Drive, Suite 101  
New Gloucester, ME 04260  
565 Congress Street, Suite 310  
Portland, ME 04101  
(207) 926-5111  
www.terradync consultants.com




Civil Engineering - Land Planning - Stormwater Design - Environmental Permitting

SHEET DESCRIPTION  
**EXHIBIT 20**  
**HIGHLANDS - 500' BLASTING RADIUS**  
PREPARED FOR  
**LEAVITT-TOMPSON, LLC.**  
P.O. BOX 703  
STANDISH, MAINE 04084

JOB NO.	1804-G
DATE	11/29/2019
SCALE	1"=200'
SHEET	1
OF	1




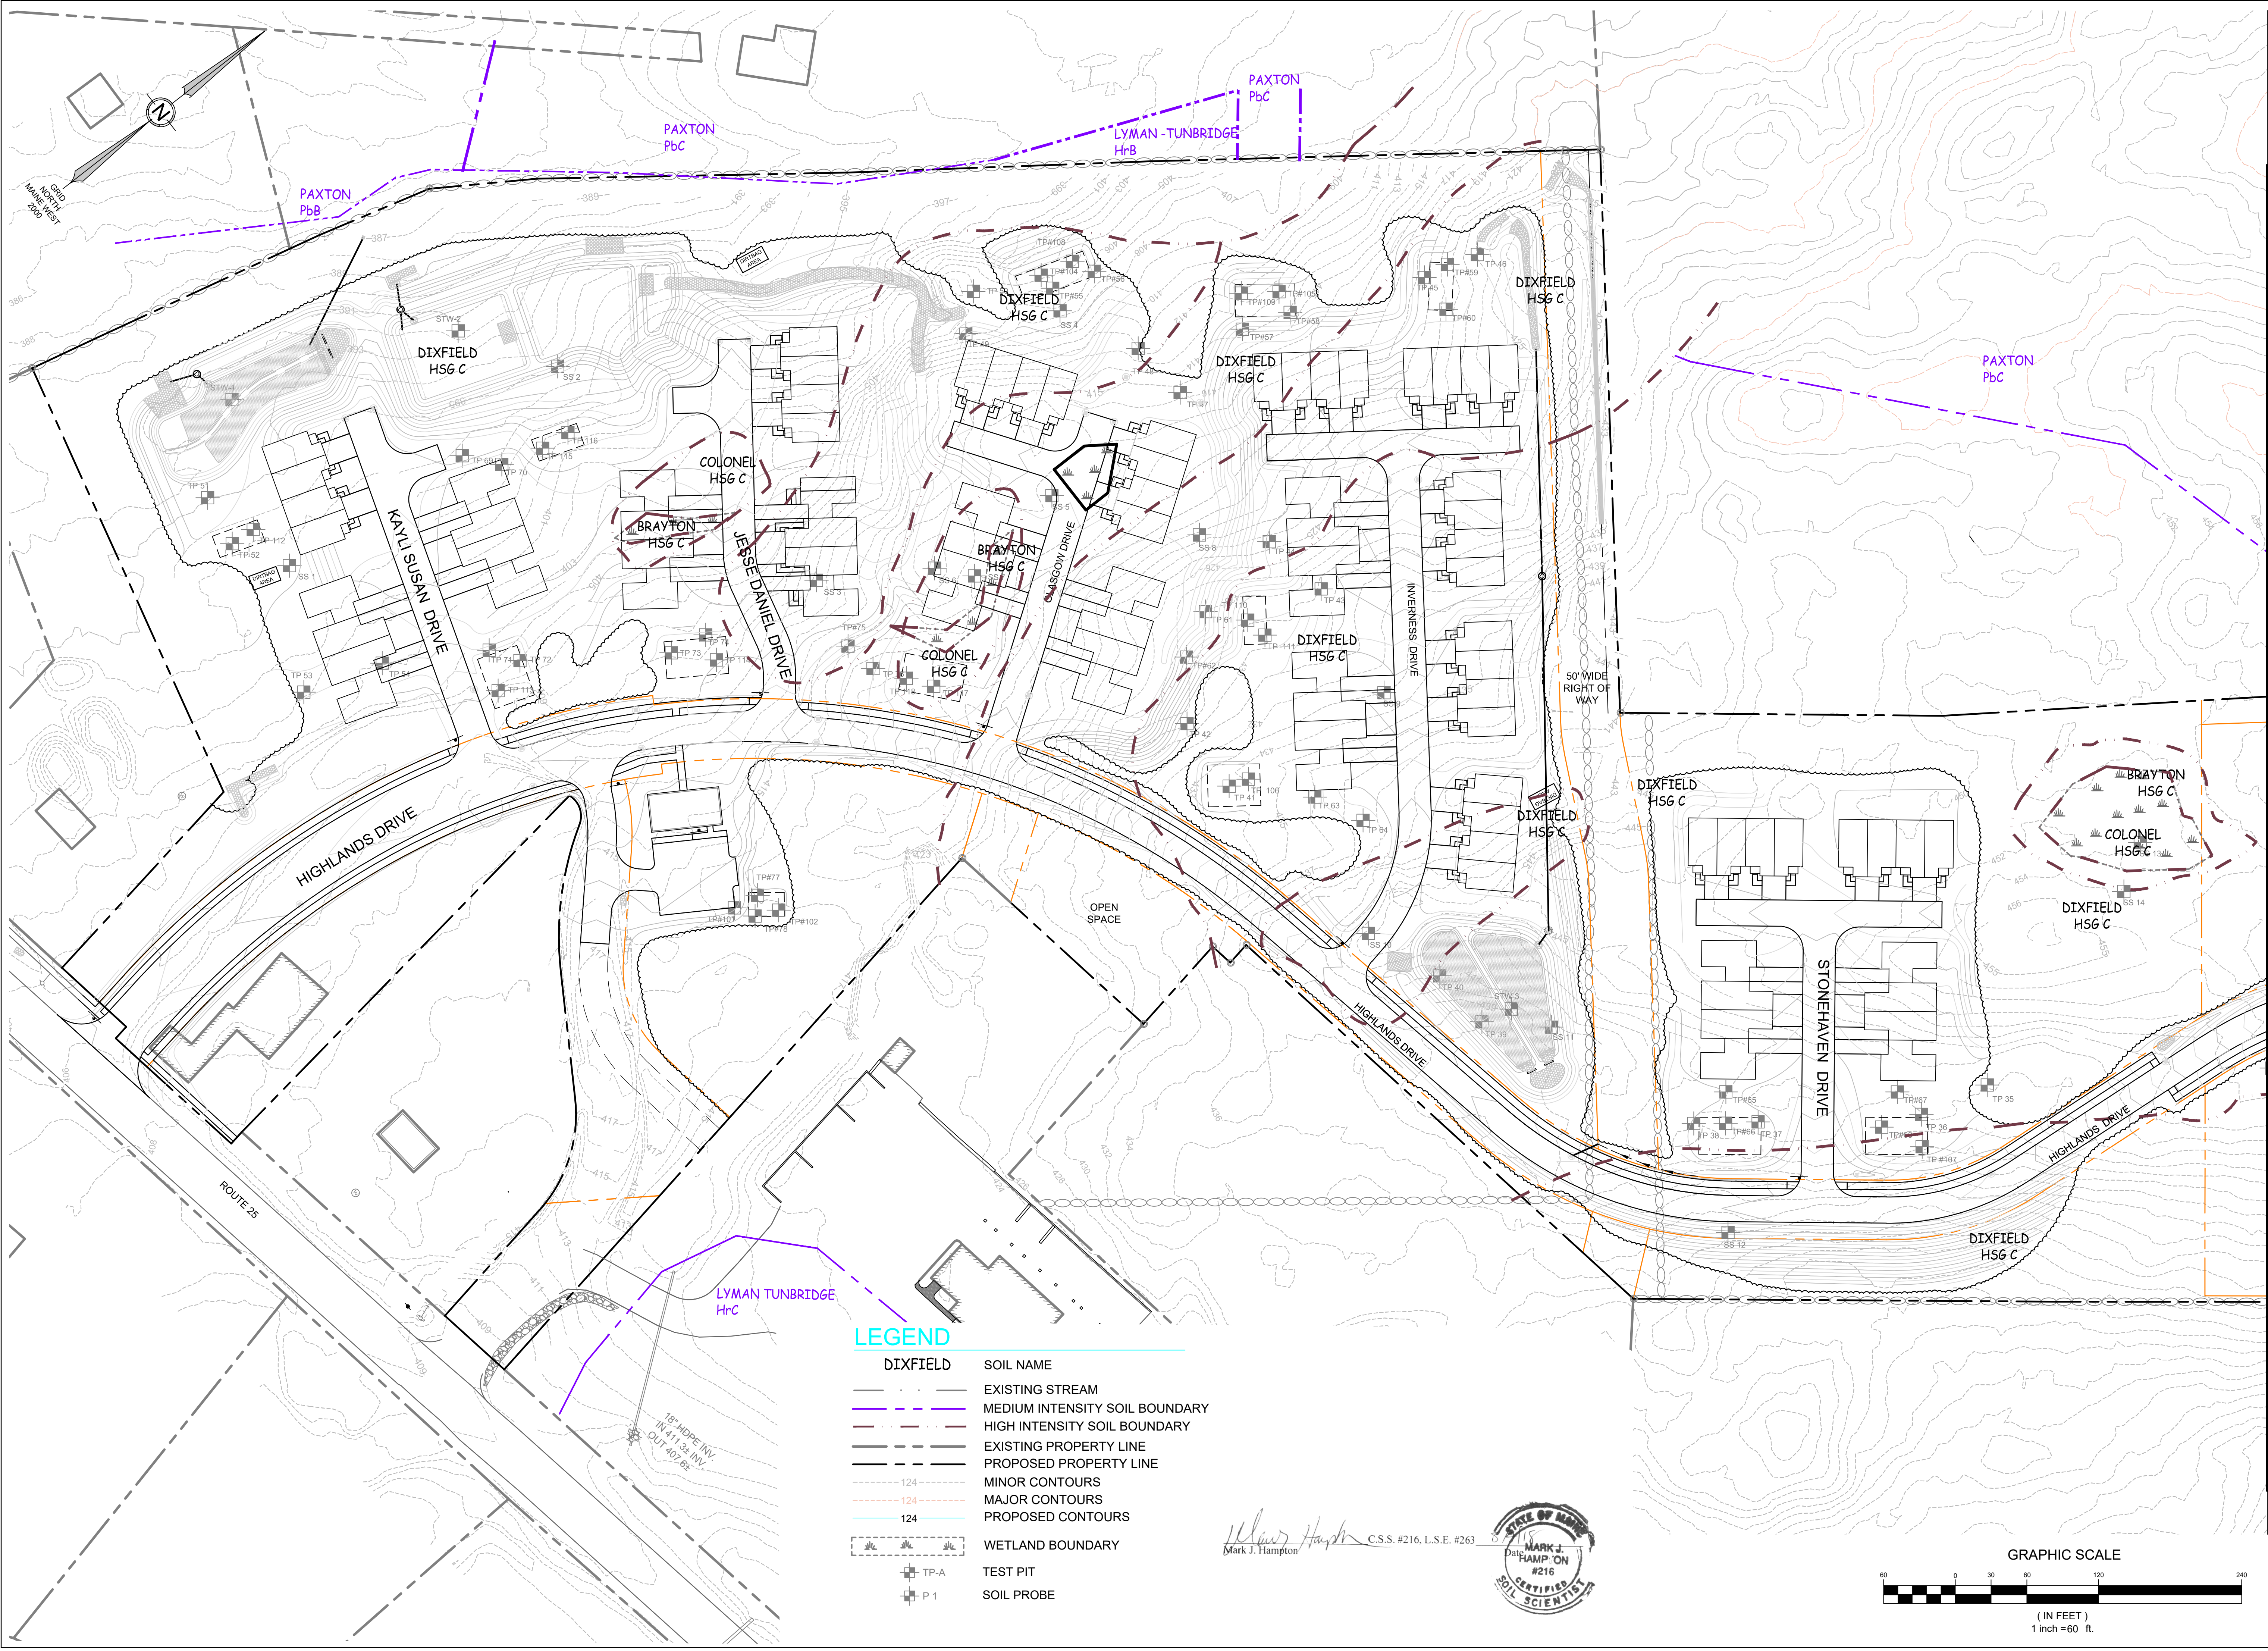

**LEGEND**


DIXFIELD	SOIL NAME
(Symbol)	EXISTING STREAM
(Symbol)	MEDIUM INTENSITY SOIL BOUNDARY
(Symbol)	HIGH INTENSITY SOIL BOUNDARY
(Symbol)	EXISTING PROPERTY LINE
(Symbol)	PROPOSED PROPERTY LINE
(Symbol)	MINOR CONTOURS
(Symbol)	MAJOR CONTOURS
(Symbol)	PROPOSED CONTOURS
(Symbol)	WETLAND BOUNDARY
(Symbol)	TEST PIT
(Symbol)	SOIL PROBE

Mark J. Hampton  
 C.S.S. #216, L.S.E. #263  
 STATE OF MAINE  
 MARK J. HAMPTON  
 #216  
 CERTIFIED  
 SOIL SCIENTIST

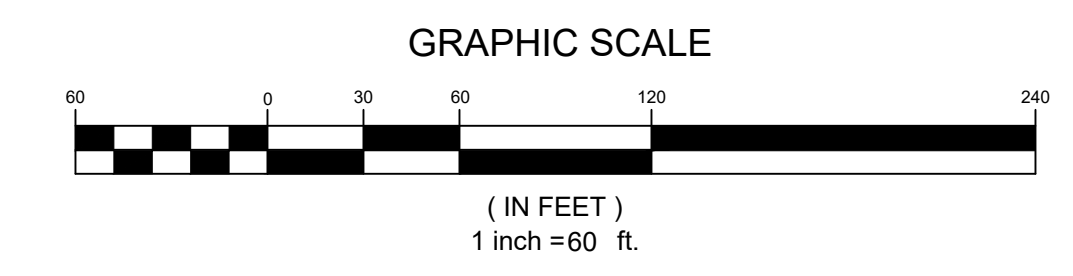

MATCH LINE SEE SHEET SS-1.1

MATCH LINE SEE SHEET SS-1.1

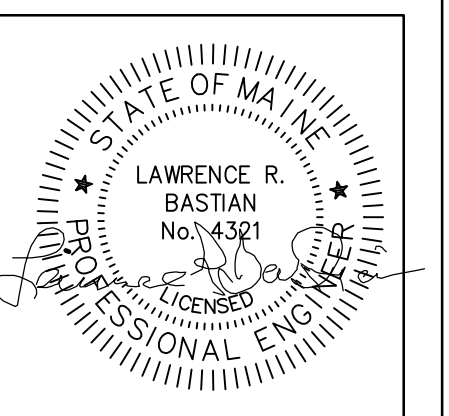

SIGNATURE DATE: 1/21/2019

NO.	DATE	REVISIONS
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
 SUITE 201  
 PORTLAND, ME 04102

41 CAMPUS DRIVE  
 SUITE 101  
 NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
 www.terradynconsultants.com

**TERRADYN**  
 CONSULTANTS, LLC

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
 HIGHLANDS SUBDIVISION  
 STANDISH, MAINE  
 SOIL SURVEY MAP

PREPARED FOR  
 LEAVITT-TOMPSON, LLC  
 P.O. BOX 703  
 STANDISH, MAINE 04084


DATE: 3/15/2019  
 SCALE: 1"=40'  
 DESIGNED: JDA  
 JOB NO: 1804  
 FILE: 1804 SWP POST.DWG

SHEET  
**SS-1.0**



**LEGEND**

- DIXFIELD SOIL NAME
- EXISTING STREAM
- HIGH INTENSITY SOIL BOUNDARY
- MEDIUM INTENSITY SOIL BOUNDARY
- EXISTING PROPERTY LINE
- PROPOSED PROPERTY LINE
- MINOR CONTOURS
- MAJOR CONTOURS
- PROPOSED CONTOURS
- WETLAND BOUNDARY
- TP-A TEST PIT
- P 1 SOIL PROBE

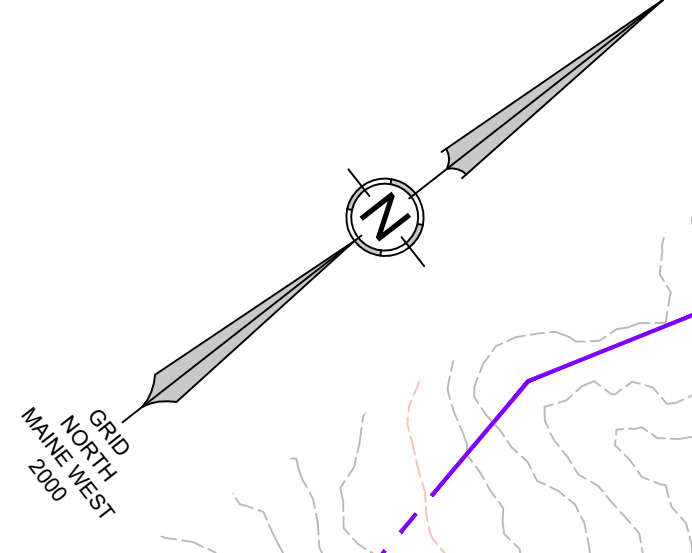


MATCH LINE SEE SHEET SWP-1.0

MATCH LINE SEE SHEET SWP-1.0


MATCH LINE - SEE SHEET SS-1.2

MATCH LINE - SEE SHEET SS-1.2

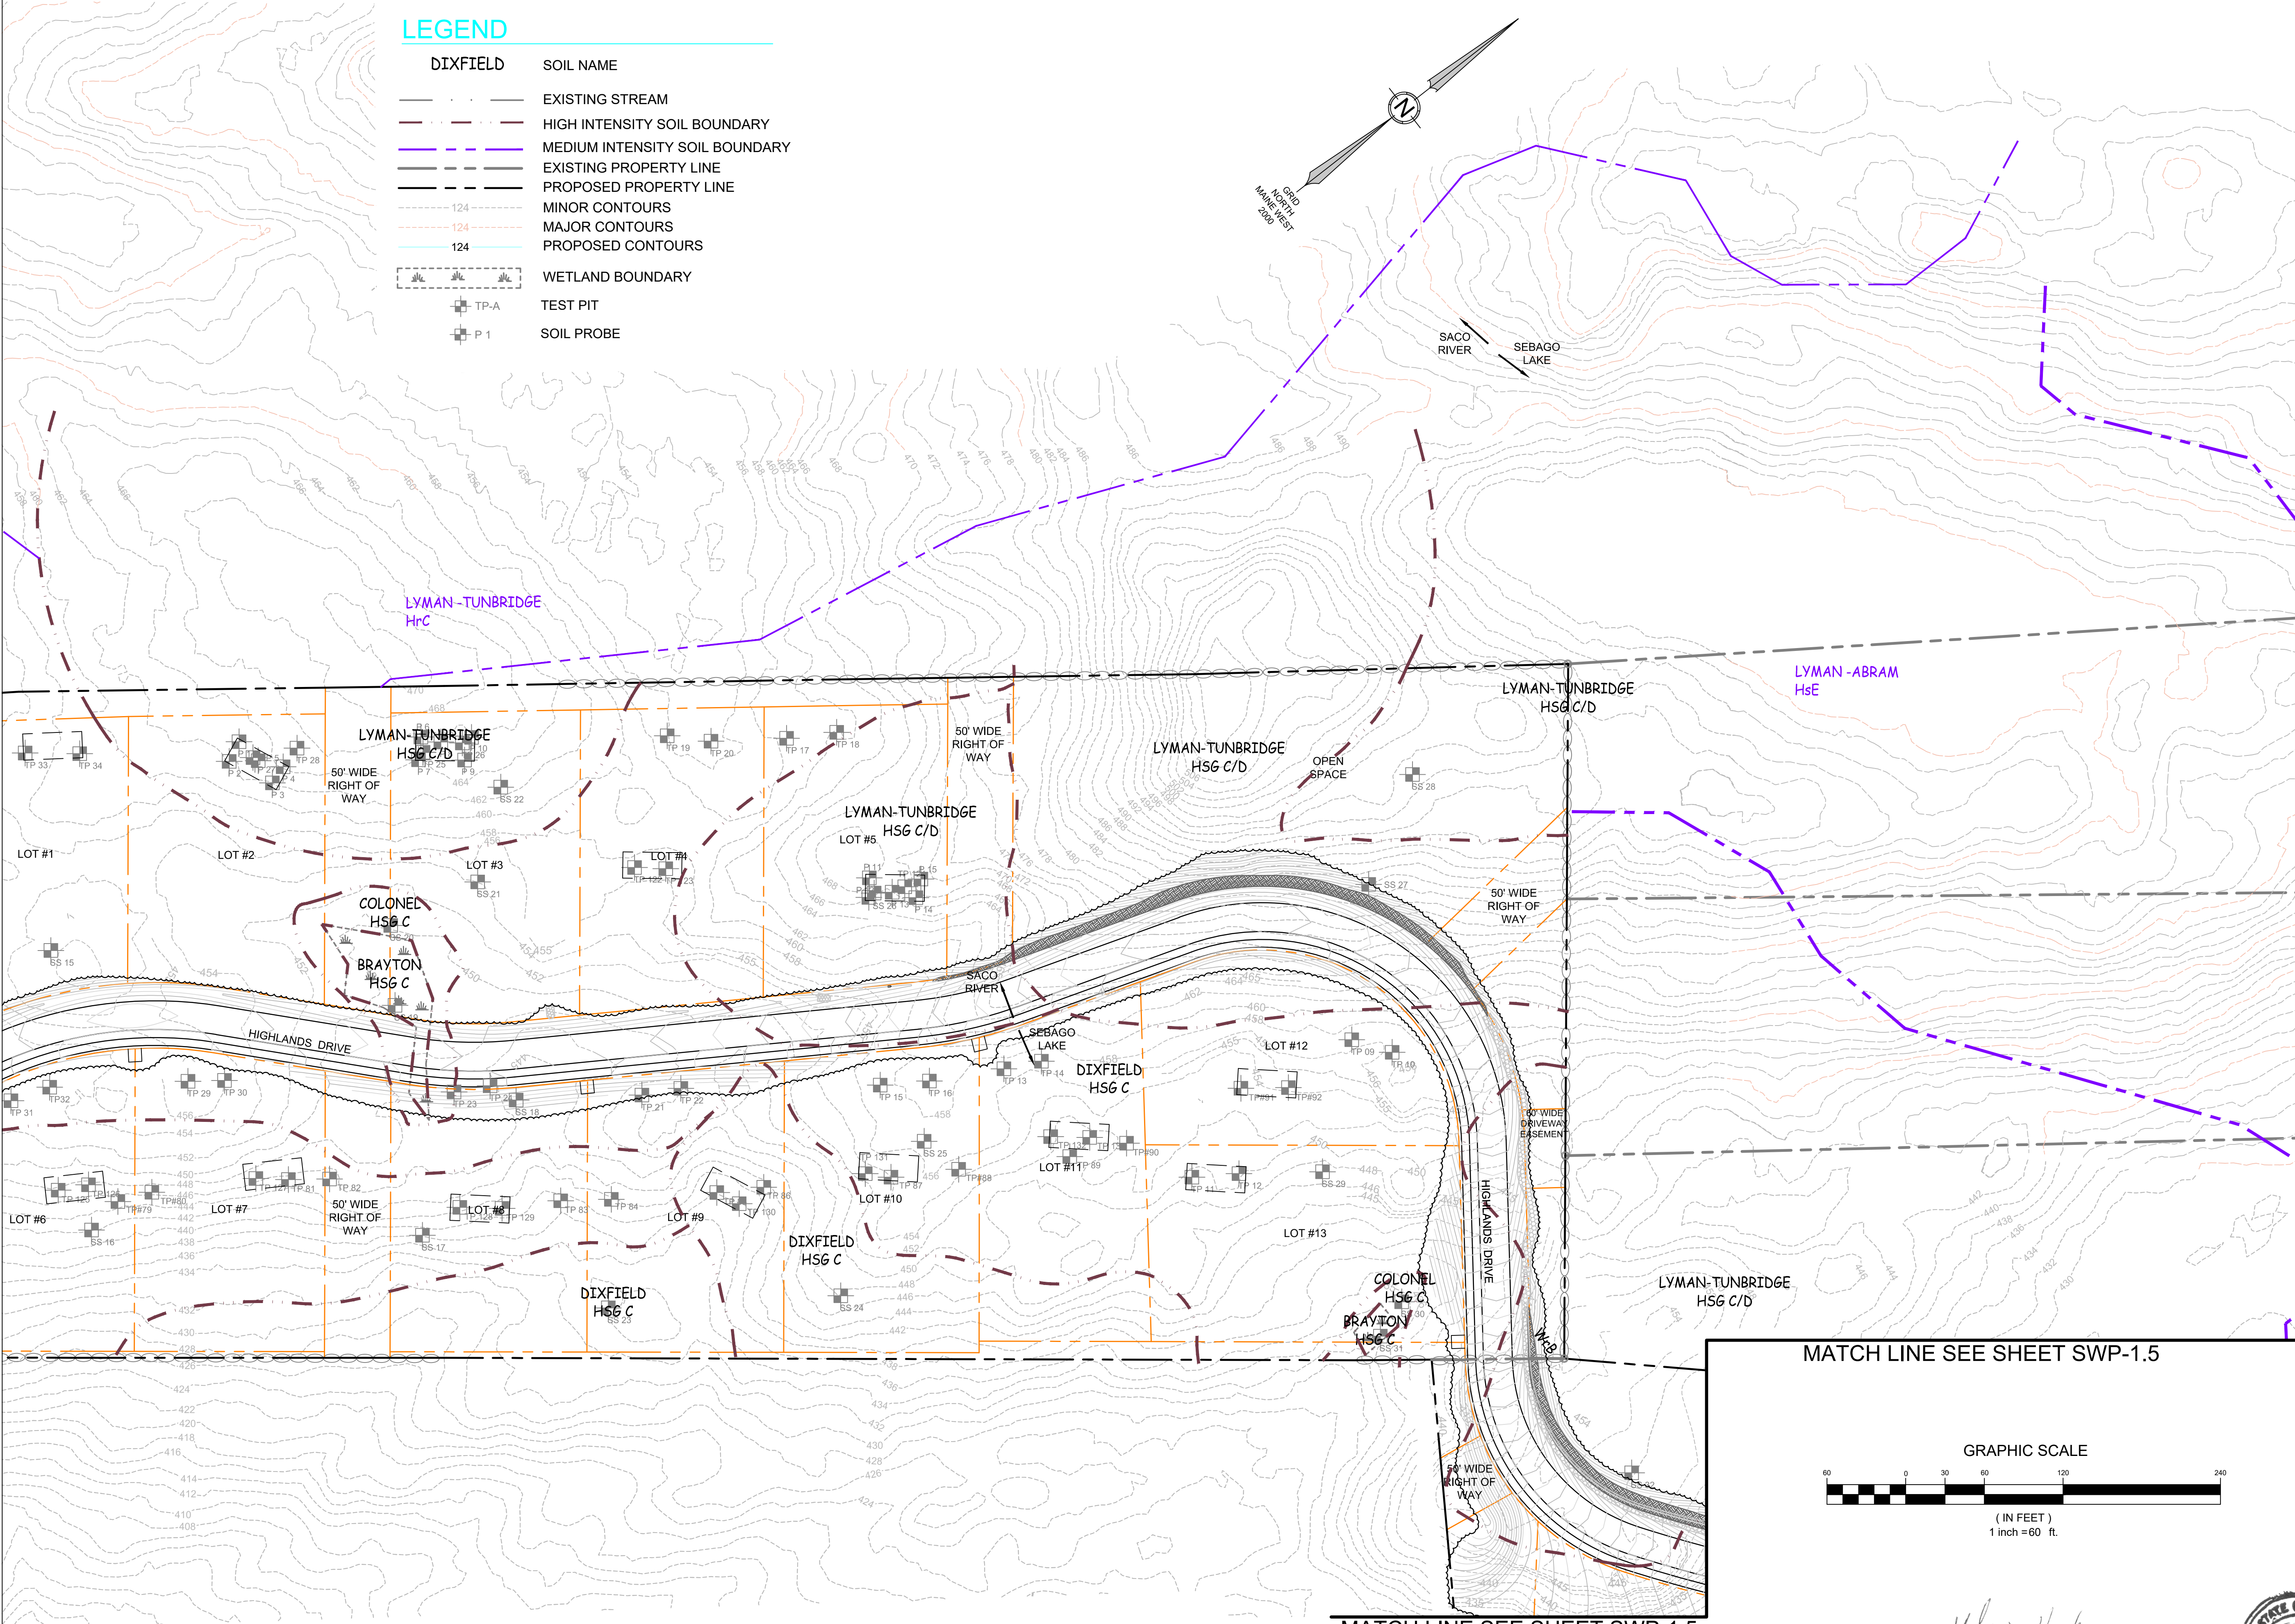


MATCH LINE SEE SHEET SWP-1.5

MATCH LINE SEE SHEET SWP-1.5

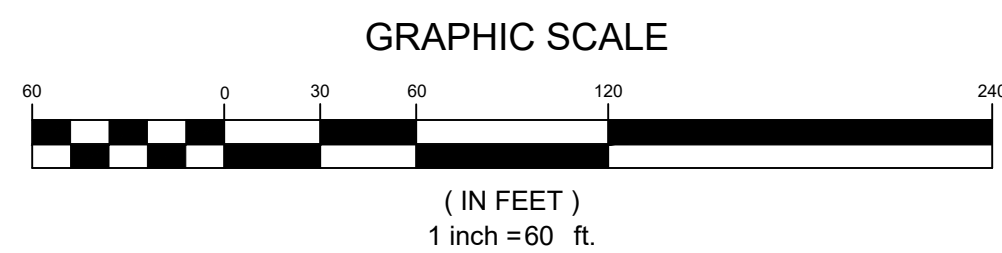

Mark J. Hampton  
C.S.S. #216, L.S.E. #263

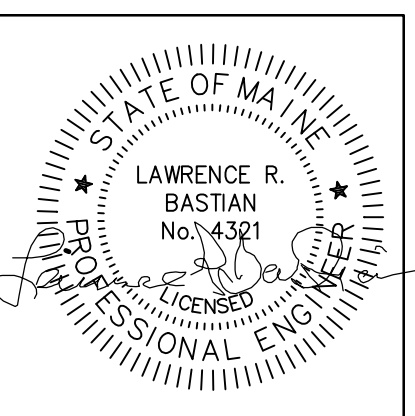

NO.	DATE	REVISIONS
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
www.terradync.com

**TERRADYN**  
CONSULTANTS, LLC

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING


SHEET DESCRIPTION  
HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
SOIL SURVEY MAP

PREPARED FOR  
LEAVITT-TOMPSON, LLC  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE: 3/15/2019  
SCALE: 1"=40'  
DESIGNED: JDA  
JOB NO: 1804  
FILE: 1804 SWP POST.DWG

SHEET **SS-1.1**



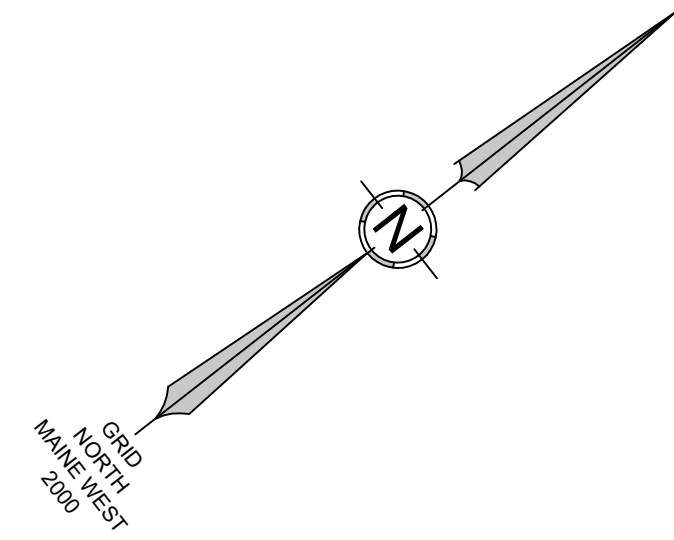

**LEGEND**

- DIXFIELD SOIL NAME
- EXISTING STREAM
- MEDIUM INTENSITY SOIL BOUNDARY
- HIGH INTENSITY SOIL BOUNDARY
- EXISTING PROPERTY LINE
- PROPOSED PROPERTY LINE
- MINOR CONTOURS
- MAJOR CONTOURS
- PROPOSED CONTOURS
- WETLAND BOUNDARY
- TP-A TEST PIT
- P-1 SOIL PROBE

**NOTES:**


- THIS SOILS MAP IS PART OF A CLASS A HIGH INTENSITY SOIL SURVEY ON THE HIGHLANDS SUBDIVISION CALLED "SOIL NARRATIVE REPORT", PREPARED BY MARK HAMPTON ASSOCIATES, INC., DATED JULY 7, 2018. THE FULL REPORT CAN BE FOUND IN SECTION 11 OF THE SITE LOCATION OF DEVELOPMENT APPLICATION FOR THE HIGHLANDS SUBDIVISION.
- THE SOIL MAP WAS DONE IN ACCORDANCE WITH THE STANDARDS ADOPTED BY THE MAINE ASSOCIATION OF PROFESSIONAL SOIL SCIENTISTS AND THE MAINE BOARD OF CERTIFICATION OF GEOLOGISTS AND SOIL SCIENTISTS.
- OFFSITE SOILS WERE OBTAINED FROM THE CUMBERLAND COUNTY SOIL SURVEY AS SHOWN ON THE USDA WEB SOIL SURVEY. THE FULL OUTPUT CAN BE FOUND IN SECTION 12. THE SOIL SURVEY IS OF MEDIUM INTENSITY. THE SOILS ARE SUMMARIZED BELOW:

MAP UNIT SYMBOL	MAP UNIT NAME	HSG RATING
HrB	LYMAN-TUNBRIDGE COMPLEX	D
HsC	LYMAN - ABAM COMPLEX	D
HsE	LYMAN - ABRAM COMPLEX	D
PbB	PAXTON FINE SANDY LOAM	C
PbC	PAXTON FINE SANDY LOAM	C
RbA	RIDGEBURY FINE SANDY LOAM	C/D


MATCH LINE SEE SHEET SWP-1.1

MATCH LINE SEE SHEET SWP-1.1

MATCH LINE SEE SHEET SWP-1.1

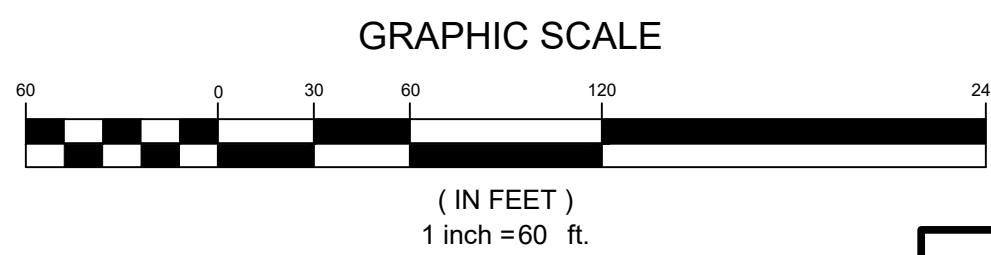

Mark J. Hampton  
C.S.S. #216, L.S.E. #263

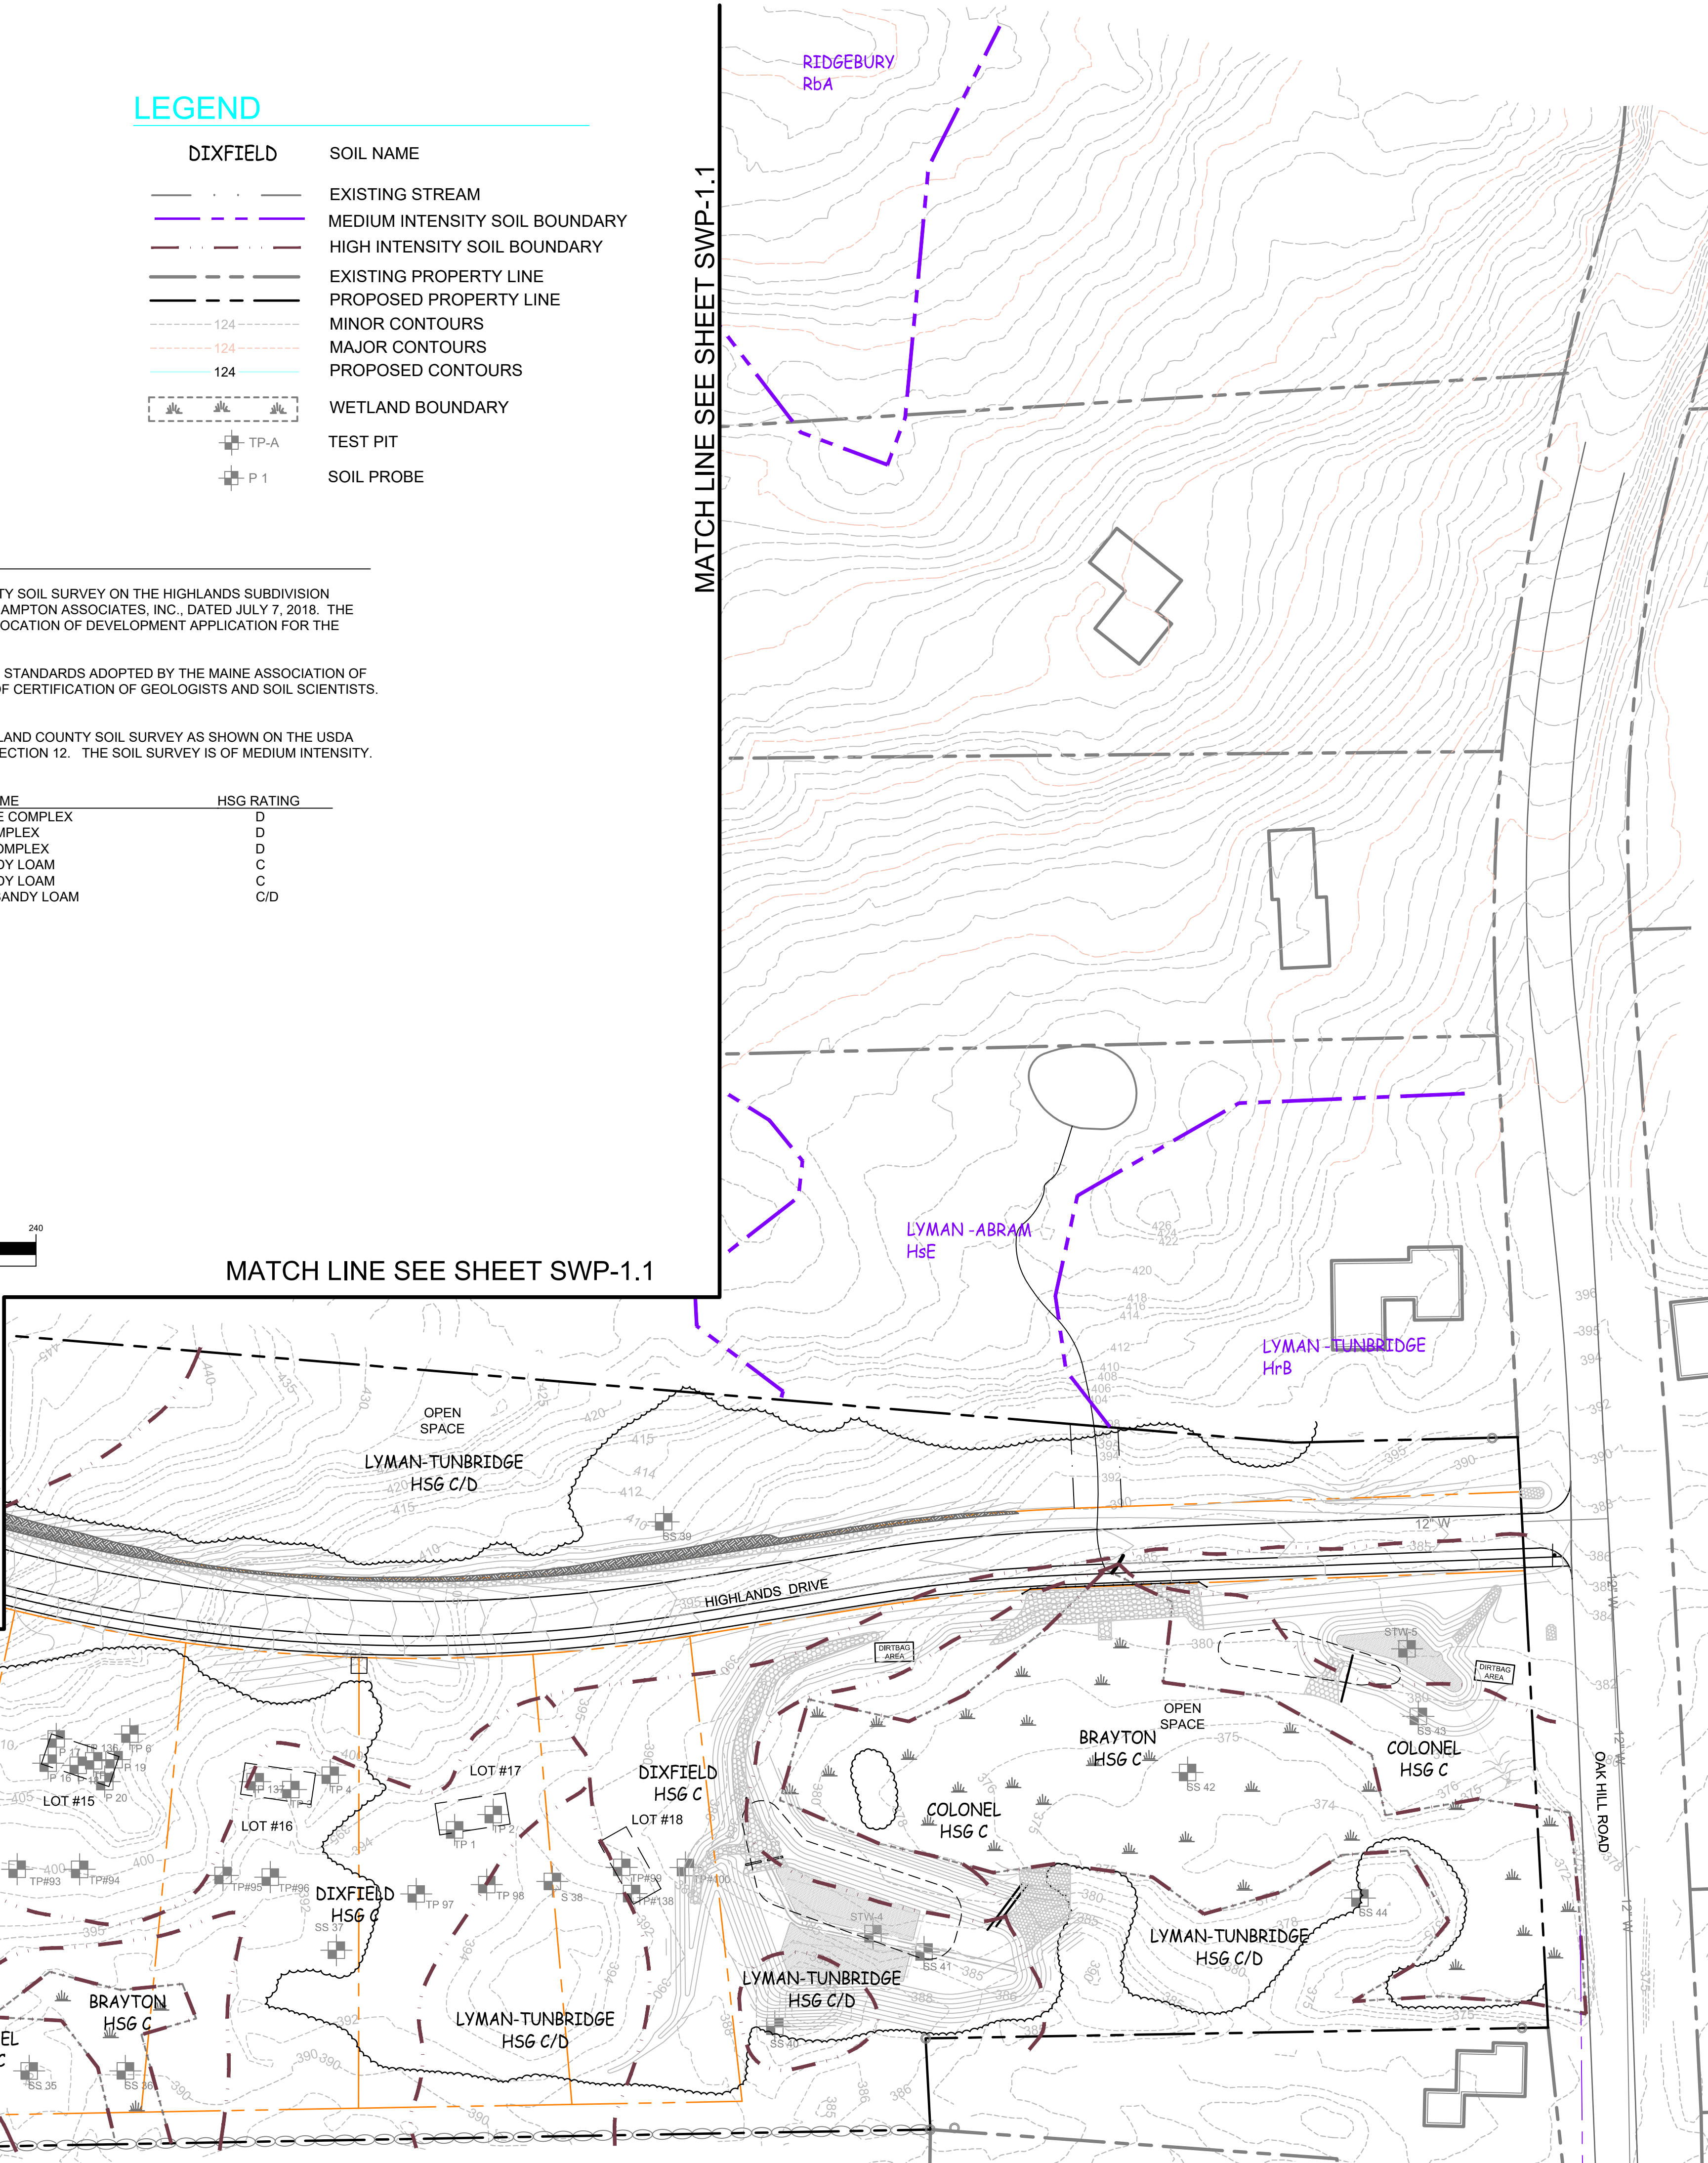

PAGE 1 OF 2 FORM F Rev. 11/09


**SOIL PROFILE / CLASSIFICATION INFORMATION**

Project Name: Highland Subdivision, Applicant Name: Leavitt-Thompson LLC, Project Location: Standish

Exploration Symbol #	STW-1	Test Pit	Boring
Organic horizon thickness	0		
Ground surface elev.	32		
Depth of exploration or to refusal	32		
Texture	Sandy Loam	Friable	Dark Brown
Consistency			Moist
Color			
Mottling			
Depth below mineral soil surface (feet)	0-8		
	8-12		
	12-16		
	16-20		
	20-24		
	24-28		
	28-32		
	32-36		
	36-40		
	40-44		
	44-48		
	48-52		
	52-56		
	56-60		
	60-64		
	64-68		
	68-72		
	72-76		
	76-80		
	80-84		
	84-88		
	88-92		
	92-96		
	96-100		
	100-104		
	104-108		
	108-112		
	112-116		
	116-120		
	120-124		
	124-128		
	128-132		
	132-136		
	136-140		
	140-144		
	144-148		
	148-152		
	152-156		
	156-160		
	160-164		
	164-168		
	168-172		
	172-176		
	176-180		
	180-184		
	184-188		
	188-192		
	192-196		
	196-200		
	200-204		
	204-208		
	208-212		
	212-216		
	216-220		
	220-224		
	224-228		
	228-232		
	232-236		
	236-240		
	240-244		
	244-248		
	248-252		
	252-256		
	256-260		
	260-264		
	264-268		
	268-272		
	272-276		
	276-280		
	280-284		
	284-288		
	288-292		
	292-296		
	296-300		
	300-304		
	304-308		
	308-312		
	312-316		
	316-320		
	320-324		
	324-328		
	328-332		
	332-336		
	336-340		
	340-344		
	344-348		
	348-352		
	352-356		
	356-360		
	360-364		
	364-368		
	368-372		
	372-376		
	376-380		
	380-384		
	384-388		
	388-392		
	392-396		
	396-400		
	400-404		
	404-408		
	408-412		
	412-416		
	416-420		
	420-424		
	424-428		
	428-432		
	432-436		
	436-440		
	440-444		
	444-448		
	448-452		
	452-456		
	456-460		
	460-464		
	464-468		
	468-472		
	472-476		
	476-480		
	480-484		
	484-488		
	488-492		
	492-496		
	496-500		
	500-504		
	504-508		
	508-512		
	512-516		
	516-520		
	520-524		
	524-528		
	528-532		
	532-536		
	536-540		
	540-544		
	544-548		
	548-552		
	552-556		
	556-560		
	560-564		
	564-568		
	568-572		
	572-576		
	576-580		
	580-584		
	584-588		
	588-592		
	592-596		
	596-600		
	600-604		
	604-608		
	608-612		
	612-616		
	616-620		
	620-624		
	624-628		
	628-632		
	632-636		
	636-640		
	640-644		
	644-648		
	648-652		
	652-656		
	656-660		
	660-664		
	664-668		
	668-672		
	672-676		
	676-680		
	680-684		
	684-688		
	688-692		
	692-696		
	696-700		
	700-704		
	704-708		
	708-712		
	712-716		
	716-720		
	720-724		
	724-728		
	728-732		
	732-736		
	736-740		
	740-744		
	744-748		
	748-752		
	752-756		
	756-760		
	760-764		
	764-768		
	768-772		
	772-776		
	776-780		
	780-784		
	784-788		
	788-792		
	792-796		
	796-800		
	800-804		
	804-808		
	808-812		
	812-816		
	816-820		
	820-824		
	824-828		
	828-832		
	832-836		
	836-840		
	840-844		
	844-848		
	848-852		
	852-856		
	856-860		
	860-864		
	864-868		
	868-872		
	872-876		
	876-880		
	880-884		
	884-888		
	888-892		
	892-896		
	896-900		
	900-904		
	904-908		
	908-912		
	912-916		
	916-920		
	920-924		
	924-928		
	928-932		
	932-936		
	936-940		
	940-944		
	944-948		
	948-952		
	952-956		
	956-960		
	960-964		
	964-968		
	968-972		
	972-976		
	976-980		
	980-984		
	984-988		
	988-992		
	992-996		
	996-1000		
	1000-1004		
	1004-1008		
	1008-1012		
	1012-1016		
	1016-1020		
	1020-1024		
	1024-1028		
	1028-1032		
	1032-1036		
	1036-1040		
	1040-1044		
	1044-1048		
	1048-1052		
	1052-1056		
	1056-1060		
	1060-1064		
	1064-1068		
	1068-1072		
	1072-1076		
	1076-1080		
	1080-1084		
	1084-1088		
	1088-1092		
	1092-1096		
	1096-1100		
	1100-1104		
	1104-1108		
	1108-1112		
	1112-1116		
	1116-1120		
	1120-1124		
	1124-1128		
	1128-1132		
	1132-1136		
	1136-1140		
	1140-1144		
	1144-1148		
	1148-1152		
	1152-1156		
	1156-1160		
	1160-1164		
	1164-1168		
	1168-1172		
	1172-1176		
	1176-1180		
	1180-1184		
	1184-1188		
	1188-1192		
	1192-1196		
	1196-1200		
	1200-1204		
	1204-1208		
	1208-1212		
	1212-1216		
	1216-1220		



NOTE:  
 NITROGEN-NITRATE IMPACT ASSESSMENT BY MARK CENCI, GEOLOGIC INC.  
 93 MILL ROAD, NORTH YARMOUTH, ME 04097. REPORT DATED, APRIL 3, 2019

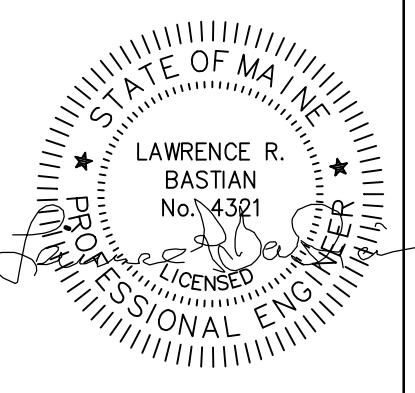

SIGNATURE DATE: 1/21/2019

NO.	DATE	REVISIONS
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
 SUITE 201  
 PORTLAND, ME 04102

41 CAMPUS DRIVE  
 SUITE 101  
 NEW GLOUCESTER, ME 04260



OFFICE: (207) 926-5111  
 www.terradynconsultants.com



CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
 HIGHLANDS SUBDIVISION  
 STANDISH, MAINE  
 NITRATE ANALYSIS PLAN  
 PREPARED FOR  
 LEAVITT-TOMPSON, LLC  
 P.O. BOX 703  
 STANDISH, MAINE 04084

DATE: 3/15/2019  
 SCALE: 1"=40'  
 DESIGNED: JDA  
 JOB NO: 1804  
 FILE: 1804 S.DWG  
 SHEET  
**N-1.0**



*Mark Cenci*  
 Mark Cenci  
 Certified Maine Geologist #467

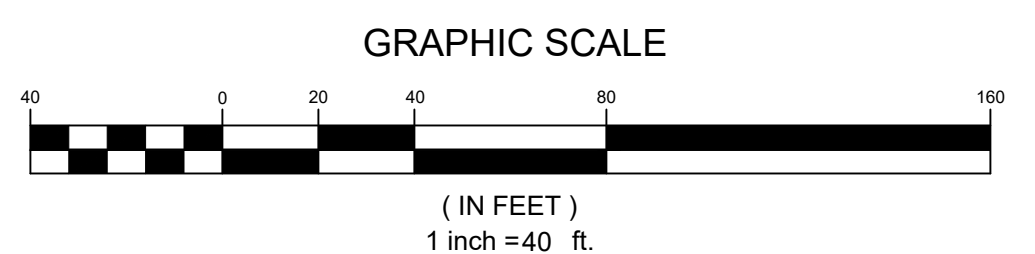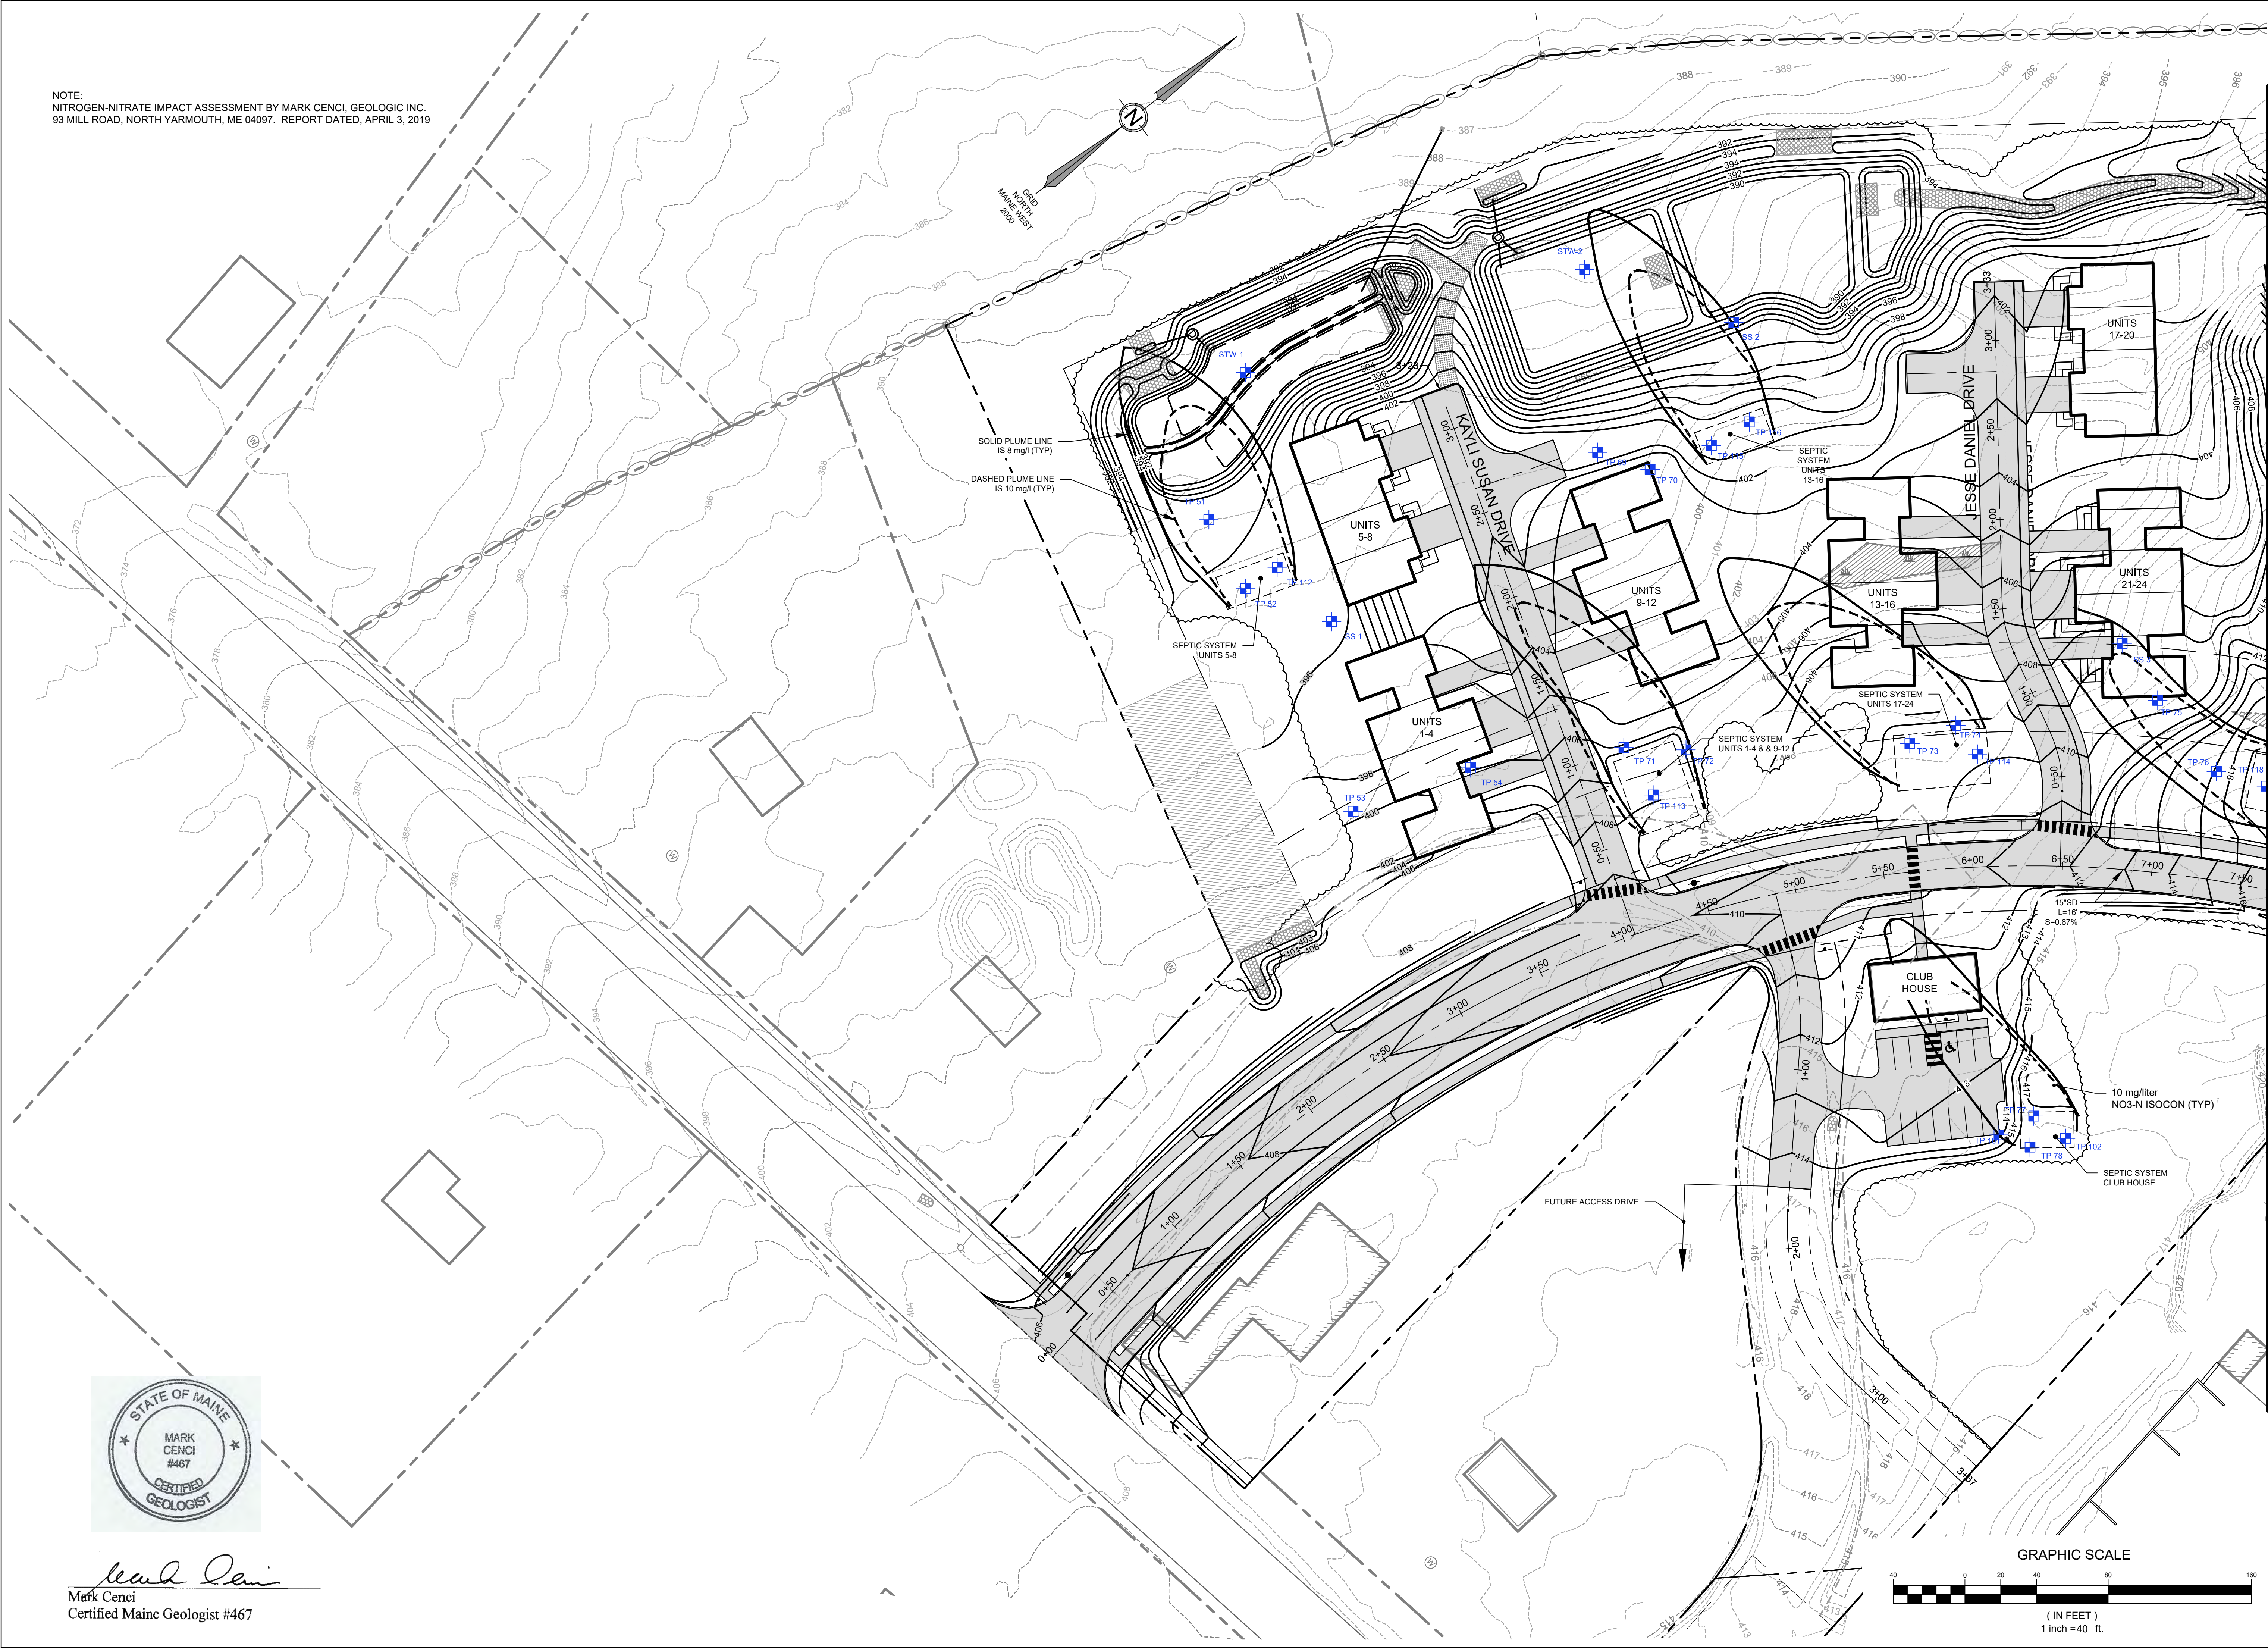

MATCH LINE - SEE SHEET N-1.0

MATCH LINE - SEE SHEET N-1.0






*Mark Cenci*  
 Mark Cenci  
 Certified Maine Geologist #467


MATCH LINE - SEE SHEET N-1.0

MATCH LINE - SEE SHEET N-1.0

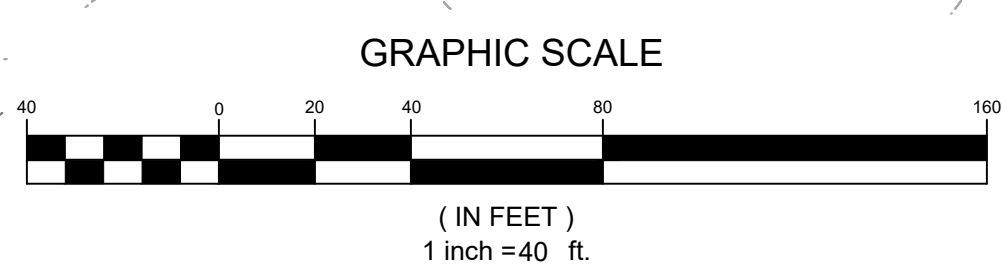


**LEGEND**

- EXISTING PROPERTY LINE
- - - PROPOSED PROPERTY LINE
- - - PROPOSED SETBACK LINE
- - - EXISTING SETBACK LINE
- - - EXISTING EASEMENT
- - - PROPOSED EASEMENT
- STONE WALL
- STREAM
- SOIL BOUNDARY
- TP-A SEPTIC SYSTEM TEST PIT
- SS-A SOILS SURVEY TEST PIT
- STW-A STORMWATER POND TEST PIT
- P 1 SOIL PROBE
- EXISTING MONUMENT
- PROPOSED MONUMENT
- EXISTING IRON PIPE
- EXISTING REBAR
- EXISTING DRILL HOLE
- PROPOSED IRON PIPE
- WETLAND AREA

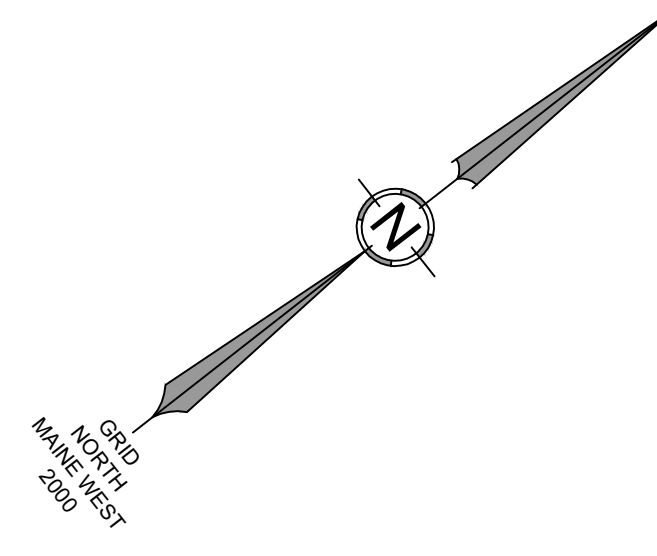

MATCH LINE - SEE SHEET N-1.2

MATCH LINE - SEE SHEET N-1.2

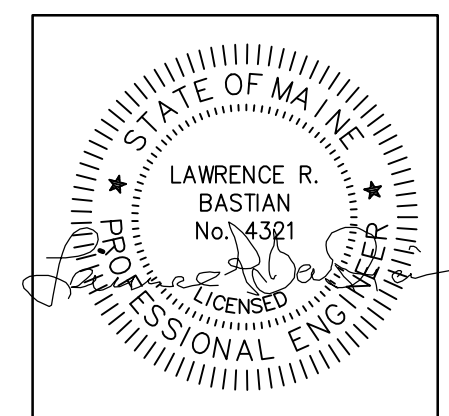


SIGNATURE DATE: 1/21/2019

NO.	DATE	REVISIONS	BY
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS	LRB
3	3/29/2019	MDEP SITE LOCATION APPLICATION	LRB
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN	LRB
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN	LRB

565 CONGRESS STREET  
 SUITE 201  
 PORTLAND, ME 04102

41 CAMPUS DRIVE  
 NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
 www.terradynconsultants.com

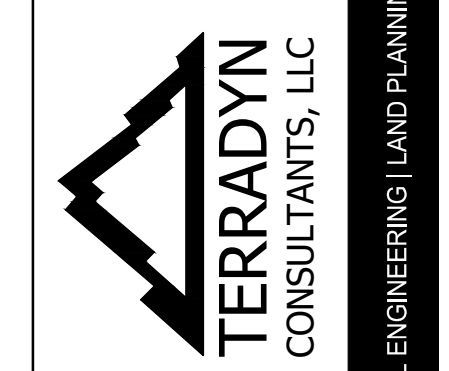

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
 HIGHLANDS SUBDIVISION  
 STANDISH, MAINE  
 NITRATE ANALYSIS PLAN


PREPARED FOR  
 LEAVITT-TOMPSON, LLC  
 P.O. BOX 703  
 STANDISH, MAINE 04084

DATE:	3/15/2019
SCALE:	1"=40'
DESIGNED:	JDA
JOB NO.:	1804
FILE:	1804 S.DWG
SHEET	<b>N-1.1</b>



LEGEND

- EXISTING PROPERTY LINE
- - - PROPOSED PROPERTY LINE
- - - PROPOSED SETBACK LINE
- - - EXISTING SETBACK LINE
- - - EXISTING EASEMENT
- - - PROPOSED EASEMENT
- STONE WALL
- STREAM
- SOIL BOUNDARY
- TP-A SEPTIC SYSTEM TEST PIT
- SS-A SOILS SURVEY TEST PIT
- STW-A STORMWATER POND TEST PIT
- P-1 SOIL PROBE
- EXISTING MONUMENT
- PROPOSED MONUMENT
- EXISTING IRON PIPE
- EXISTING REBAR
- EXISTING DRILL HOLE
- PROPOSED IRON PIPE
- WETLAND AREA

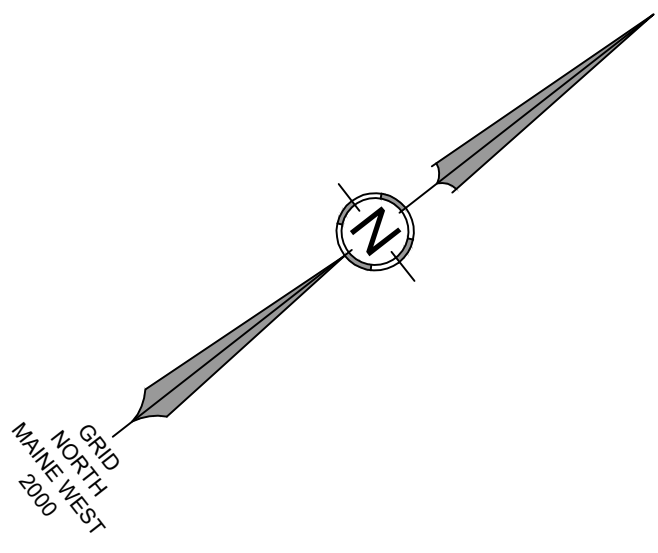


MATCH LINE - SEE SHEET N-1.1

MATCH LINE - SEE SHEET N-1.1



MATCH LINE - SEE SHEET N-1.3

MATCH LINE - SEE SHEET N-1.3

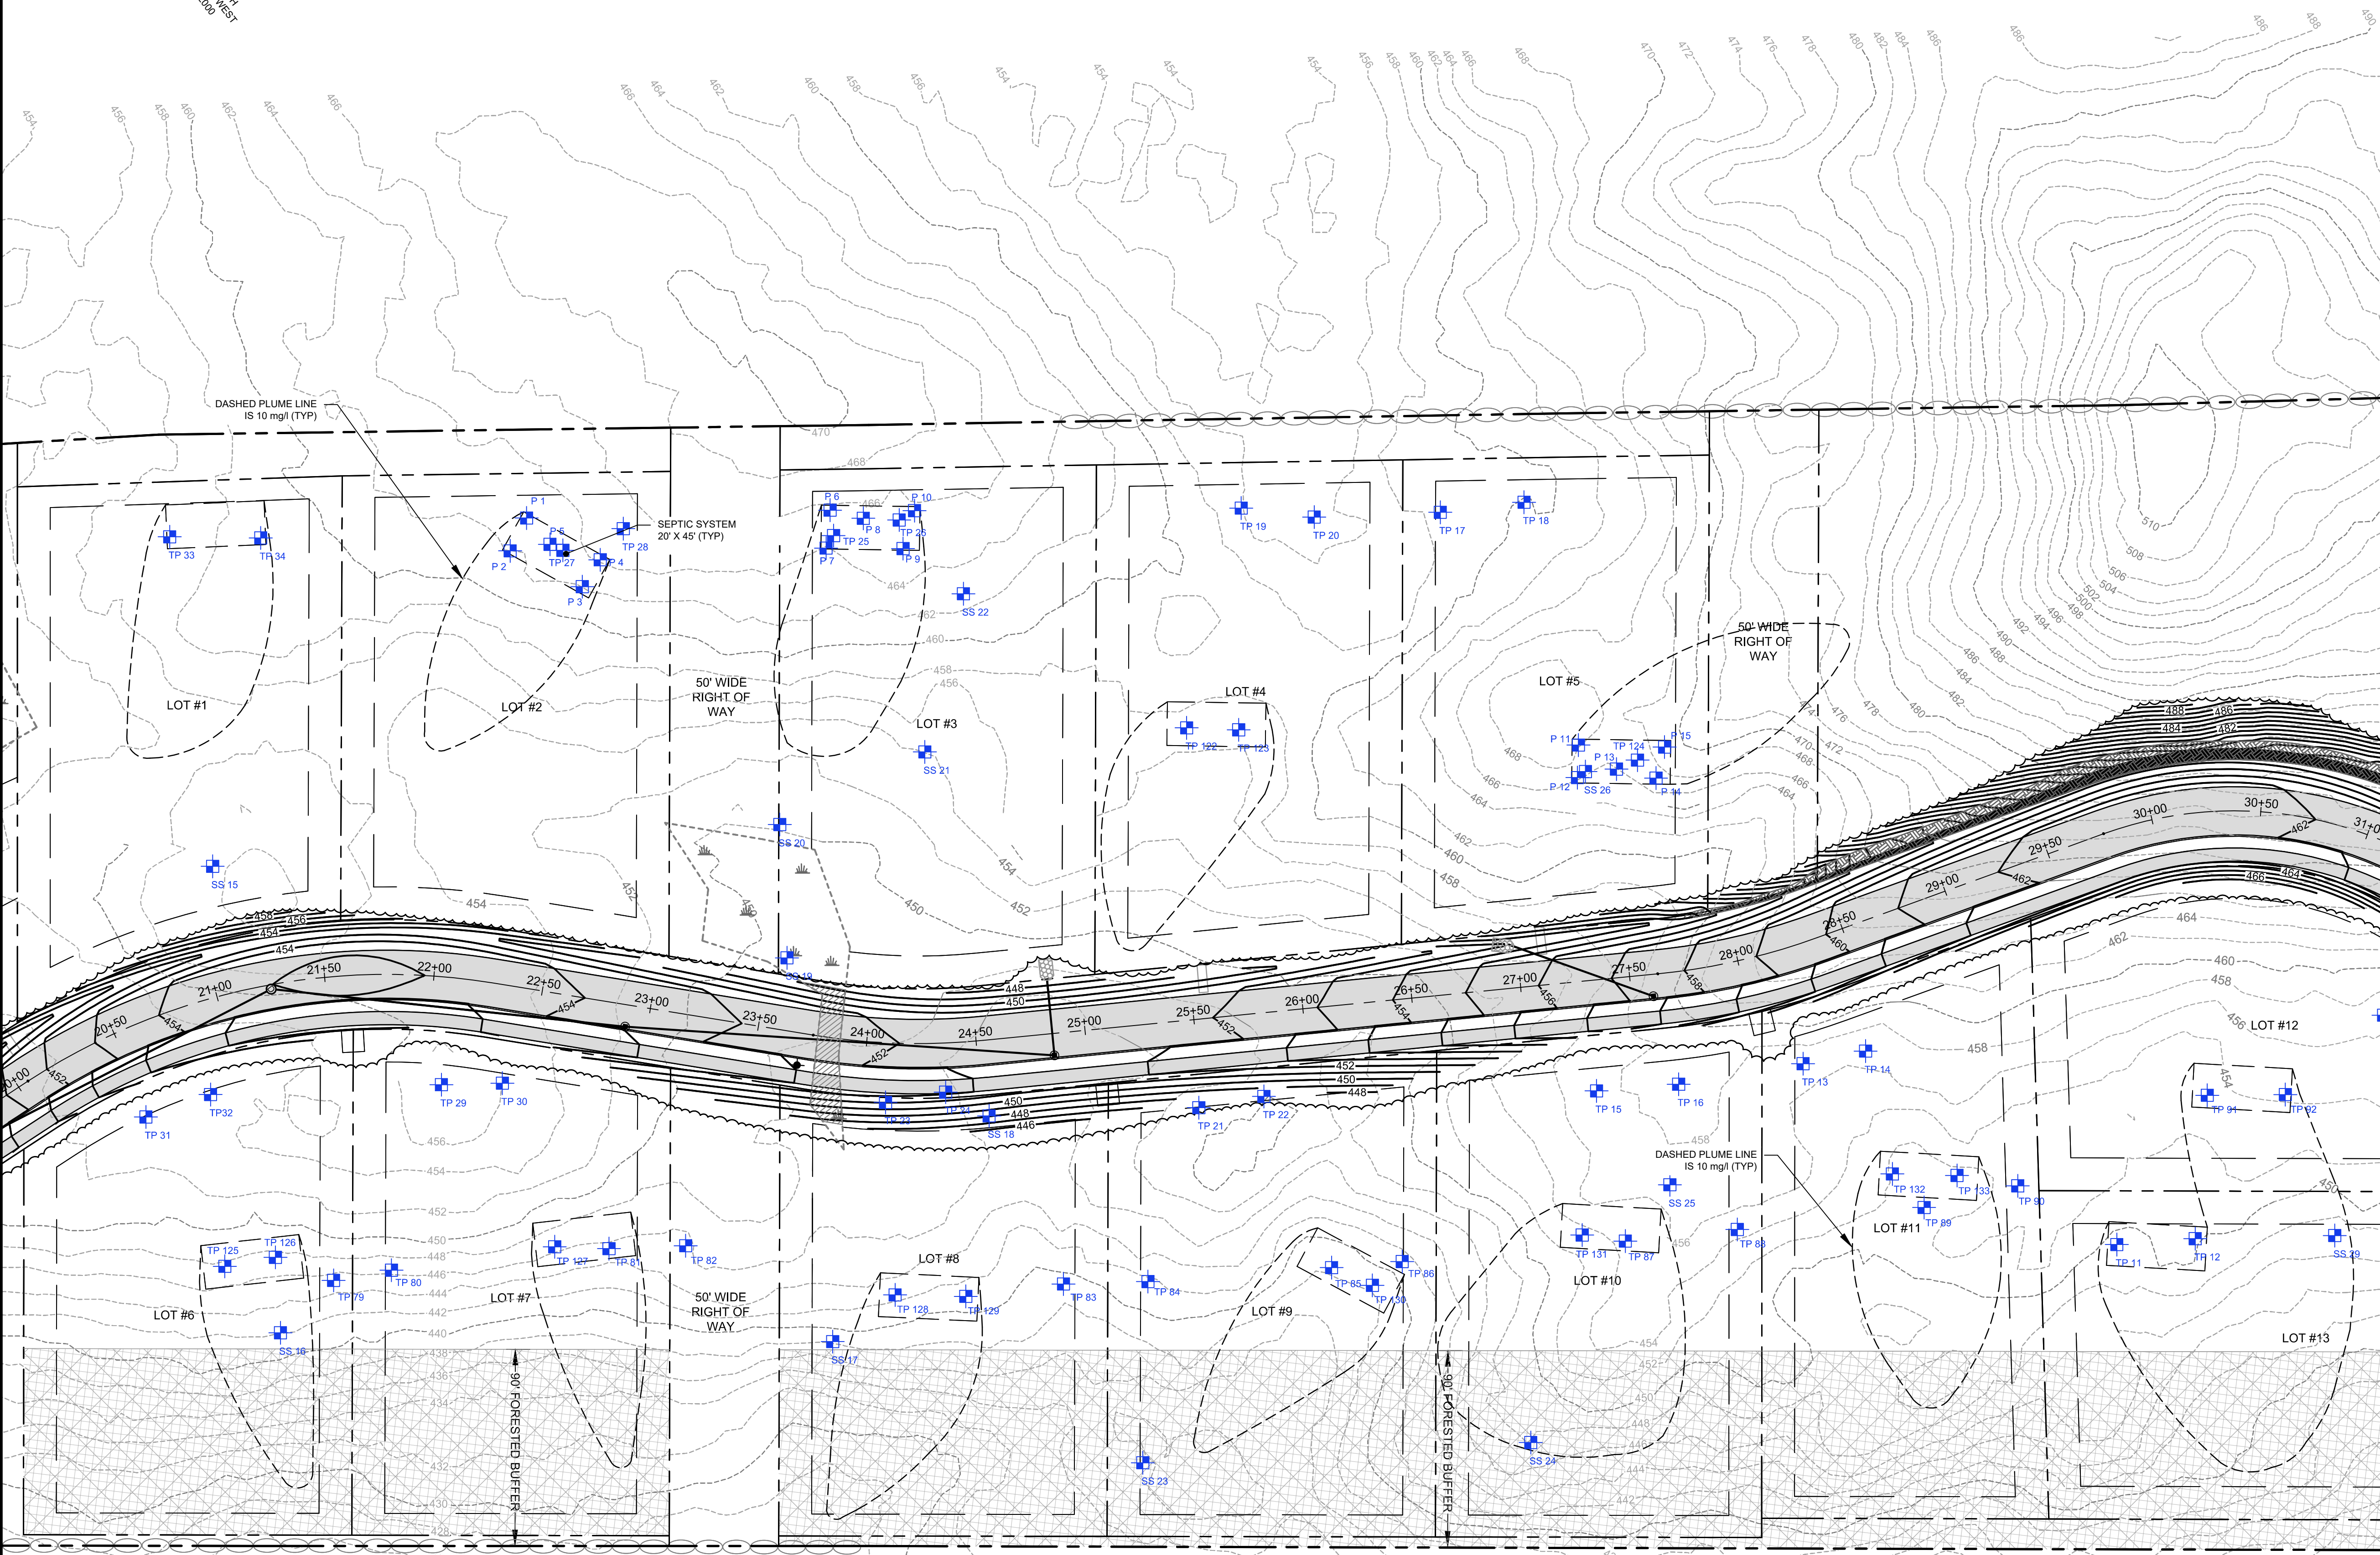

*Mark Cenci*  
**Mark Cenci**  
 Certified Maine Geologist #467

NOTE:  
 NITROGEN-NITRATE IMPACT ASSESSMENT BY MARK CENCI, GEOLOGIC INC.  
 93 MILL ROAD, NORTH YARMOUTH, ME 04097. REPORT DATED, APRIL 3, 2019

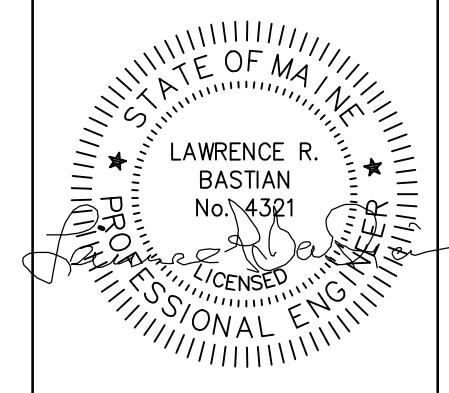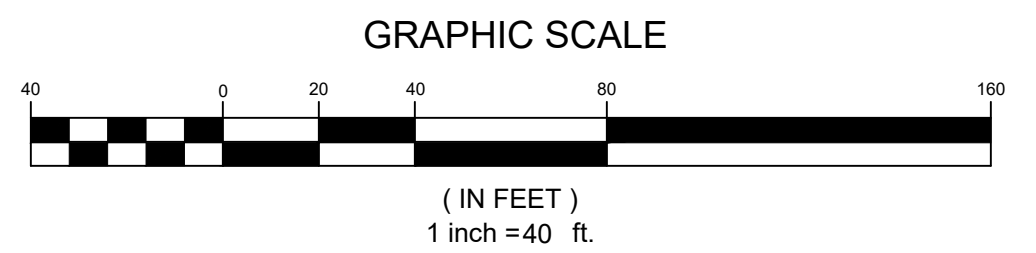

SIGNATURE DATE: 1/21/2019


NO.	DATE	REVISIONS
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
 SUITE 201  
 PORTLAND, ME 04102

41 CAMPUS DRIVE  
 SUITE 101  
 NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
 www.terradynconsultants.com

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

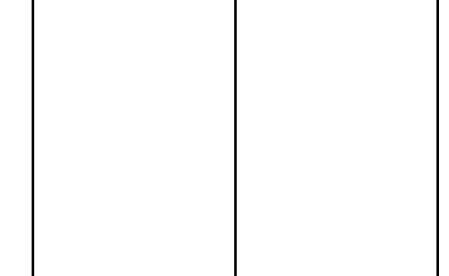

SHEET DESCRIPTION  
 HIGHLANDS SUBDIVISION  
 STANDISH, MAINE  
 NITRATE ANALYSIS PLAN  
 PREPARED FOR  
 LEAVITT-TOMPSON, LLC  
 P.O. BOX 703  
 STANDISH, MAINE 04084

DATE:	3/15/2019
SCALE:	1"=40'
DESIGNED:	JDA
JOB NO:	1804
FILE:	1804 S.DWG
SHEET	<b>N-1.2</b>









*Mark Cenci*  
 Mark Cenci  
 Certified Maine Geologist #467

NOTE:  
 NITROGEN-NITRATE IMPACT ASSESSMENT BY MARK CENCI, GEOLOGIC INC.  
 93 MILL ROAD, NORTH YARMOUTH, ME 04097. REPORT DATED, APRIL 3, 2019

MATCH LINE - SEE SHEET N-1.2

MATCH LINE - SEE SHEET N-1.2

- LEGEND**
- EXISTING PROPERTY LINE
  - - - PROPOSED PROPERTY LINE
  - - - PROPOSED SETBACK LINE
  - - - EXISTING SETBACK LINE
  - - - EXISTING EASEMENT
  - - - PROPOSED EASEMENT
  - STONE WALL
  - STREAM
  - - - SOIL BOUNDARY
  - TP-A SEPTIC SYSTEM TEST PIT
  - SS-A SOILS SURVEY TEST PIT
  - STW-A STORMWATER POND TEST PIT
  - P 1 SOIL PROBE
  - EXISTING MONUMENT
  - PROPOSED MONUMENT
  - EXISTING IRON PIPE
  - EXISTING REBAR
  - EXISTING DRILL HOLE
  - PROPOSED IRON PIPE
  - WETLAND AREA

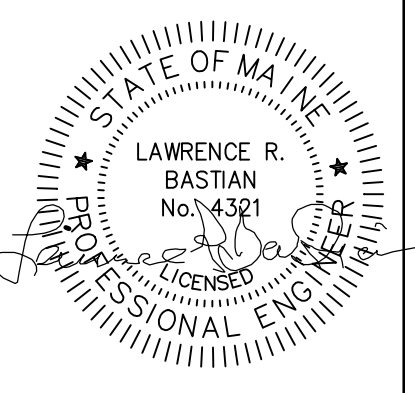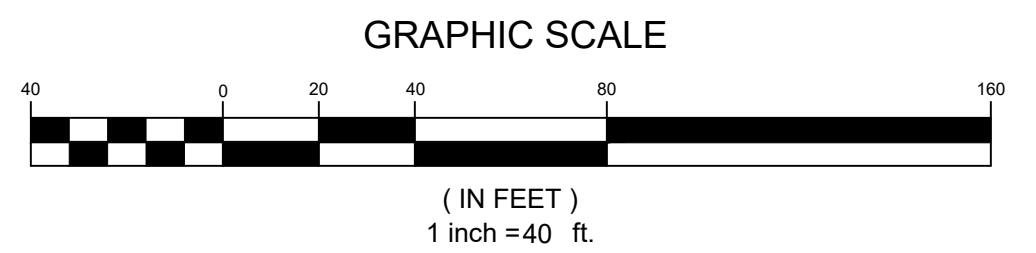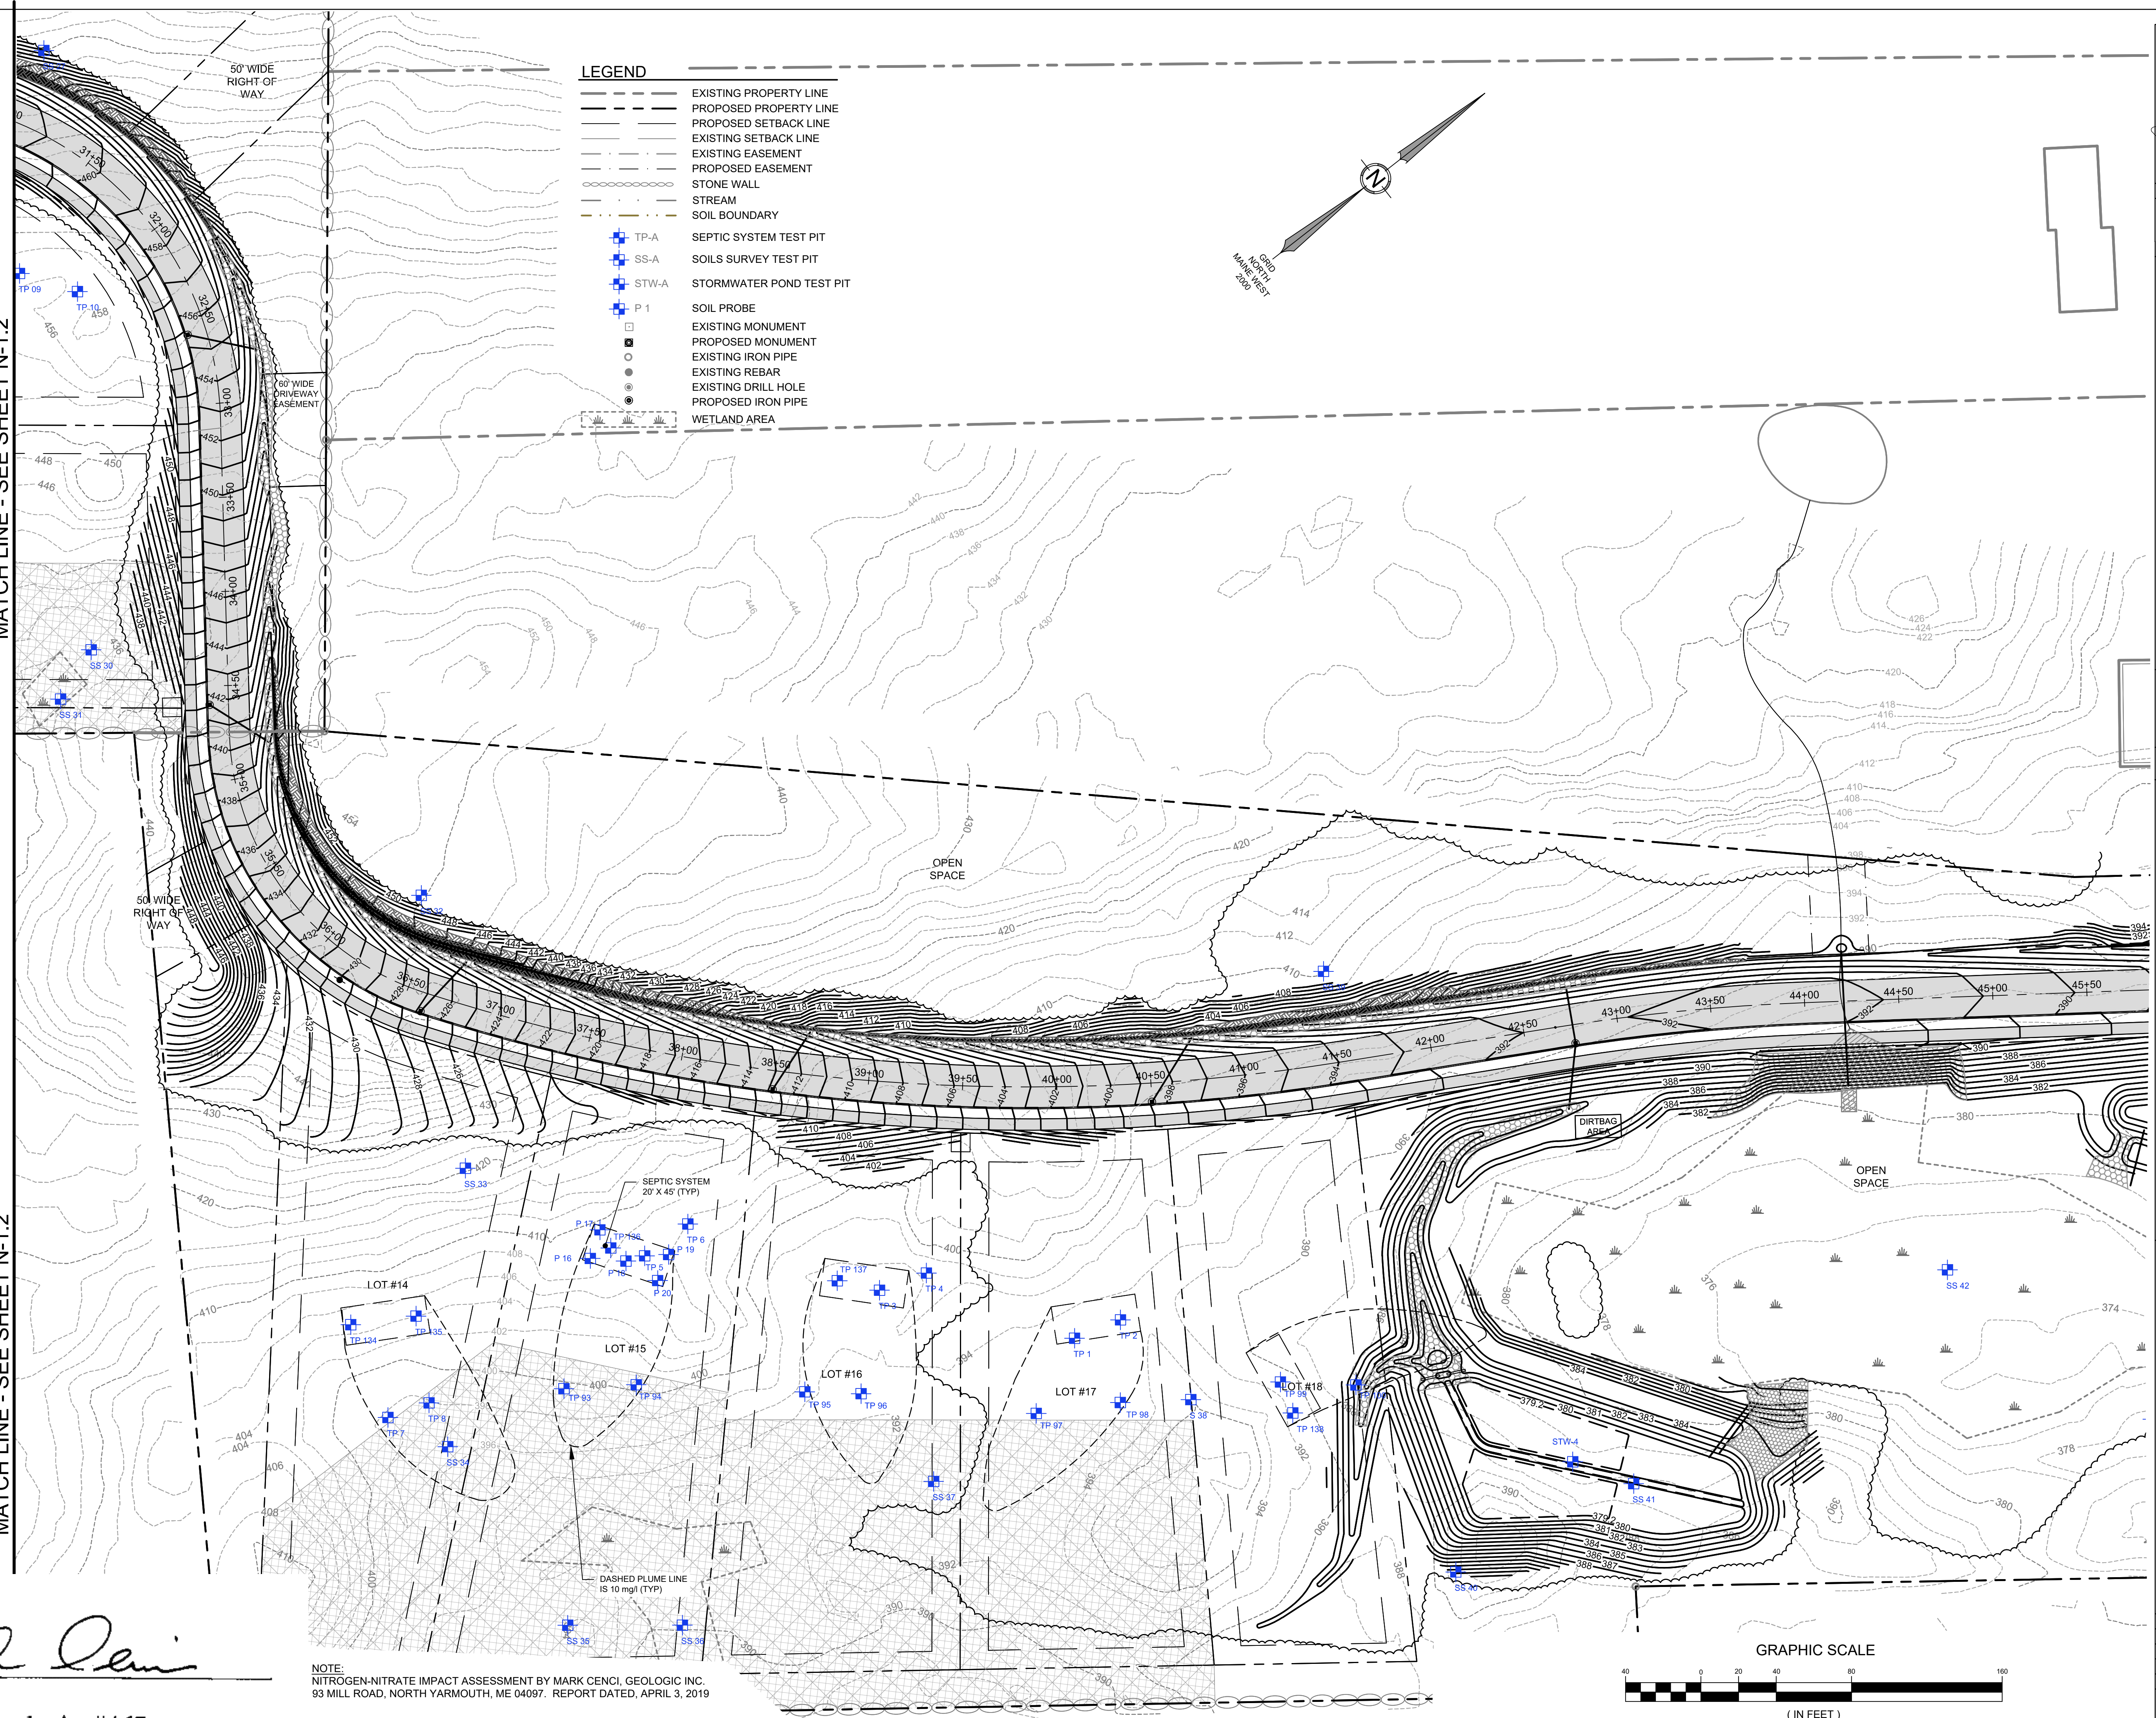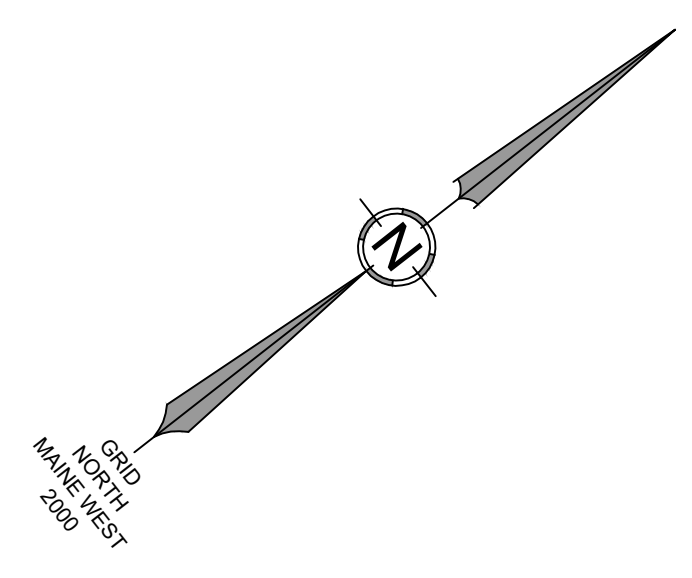

SIGNATURE DATE: 1/21/2019

NO.	DATE	REVISIONS
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
 SUITE 201  
 PORTLAND, ME 04102

41 CAMPUS DRIVE  
 SUITE 101  
 NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
 www.terradync.com

**TERRADYN**  
 CONSULTANTS, LLC

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
 HIGHLANDS SUBDIVISION  
 STANDISH, MAINE  
 NITRATE ANALYSIS PLAN

PREPARED FOR  
 LEAVITT-TOMPSON, LLC  
 P.O. BOX 703  
 STANDISH, MAINE 04084

DATE: 3/15/2019  
 SCALE: 1"=40'  
 DESIGNED: JDA  
 JOB NO: 1804  
 FILE: 1804 S.DWG  
 SHEET **N-1.3**



## ATTACHMENT 2

---

BLASTING APPLICATION  
FEBRUARY 20, 2020



**TOWN OF STANDISH  
PLANNING DEPARTMENT**

175 Northeast Road  
Standish, Maine 04084  
Phone : (207) 642-3461 Fax (207) 642-5181

This Standish **Blasting Application** form must be completed and accompany the application material at time of submission to the Standish Planning Board. Incomplete/inaccurate applications will not be accepted.

§ 181-16.1 Blasting. [Added 8-12-2008 by Order No. 57-08]

**Purpose:**

(1) The purpose of this section is to minimize the effects of airblast overpressure, ground vibration, dust and noise associated with blasting which may be detrimental to individuals and the community in the enjoyment of life, property and the conduct of business through the establishment of standards and notice requirements of blasting operations.

(2) It is also the intent of this section to prevent permanent damage to the geologic, hydrogeologic and wildlife resources and ecological balance in the region and to have a process which can be effectively and efficiently administered without causing undue financial and administrative hardship to blasting operators.

A) Name of Applicant: Leavitt-Tompson, LLC  
Address: P.O. Box 703  
Town /State /zip: Standish, ME 04084  
Phone: 207-642-3675 Fax: 207-642-2426 E-Mail: brian@leavittearthworks.com

Address to which all correspondence regarding this application should be sent if other than above:

Name Terradyn Consultants, LLC, Jeff Amos, PE  
Address 41 Campus Drive, Suite 101  
Town /State /zip: New Gloucester, ME 04260  
Phone: 207-926-5111 Fax: \_\_\_\_\_ E-Mail: jeff@terradyconsultants.com

B) Name of property owner: Leavitt Development LLC- Map 10, Lot 11; Tompson Development Inc- Map 10, Lot 19C

Name \_\_\_\_\_  
Address Same as above  
Town /State /zip: \_\_\_\_\_  
Phone: above Fax: \_\_\_\_\_ E-Mail: \_\_\_\_\_

Ownership  option  purchase and sales contract  other \_\_\_\_\_

C) Locations of the proposed blasting activity. 233 Ossippee Trail West, Standish

Location of Property (Street Location) 80 Oak Hill Road, Standish  
(From County Registry of Deeds): Book 31661 Page 345 (from Tax Maps): Map 10 Lot(s) 11  
32638 Page 233 (from Tax Maps): Map 10 Lot(s) 19C

D) Name of General contractor: Leavitt Earthworks, Inc.

Address: P.O. Box 703  
Town /State /zip: Standish, ME 04084

Phone: 207-642-3675 Fax: 207-642-2426 E-Mail: \_\_\_\_\_(E)  
brian@leavittearthworks.com

The total number of cubic yards of material to be removed by blasting.  
Approximately 50,000 cubic yards

- (F) An estimate of the number of blasts required to remove the specified amount of material. All blasting will be done in conformance with the attached "Section 20 - Blasting" as submitted to Maine DEP. The specific The number of blasts required to remove the anticipated quantity of material will be determined by the licensed blasting contractor based on site specific conditions.
- (G) A description of the project for which the blasting is being undertaken. Attach site plan if applicable. Construct +/-4,750' Town road with underground utilities to serve 18-lot residential subdivision and 84-lot condominium development. Blasting is anticipated to meet required roadway elevations in a +/-1,500' long section and for utility trenching and stormwater facilities.
- (H) Adjacent land uses  
A church, commercial and residential properties on Ossipee Trail;  
Residential properties on Oak Hill Road
- (I) The location of adjacent structures and distance to those structures.  
Four (4) existing structures on Oak Hill Road are located within 500' of the anticipated area of blasting - See Attached plan titled "Highlands - 500' Blasting Radius".
- (J) The projected dates work is to be undertaken. Construction of roadway, water main and associated blasting within 500' of Oak Hill Road is anticipated to begin during summer 2020 and continue intermittently through winter 2021-22 to a distance +/-1,500' southwest of Oak Hill Road. Additional blasting for utility trenches and stormwater facilities will follow, subject to lot/unit sales & market conditions.

I certify that the information submitted for this application is true and correct. All proposed uses will be in conformance with the application and the Standish Zoning Ordinance.



\_\_\_\_\_  
Signature  
For: Leavitt-Tompson, LLC  
Company

\_\_\_\_\_  
Date

Approved by \_\_\_\_\_  
Standish Code Enforcement Officer  
\_\_\_\_\_  
Standish Town Planner

\_\_\_\_\_  
Date


\_\_\_\_\_  
Date

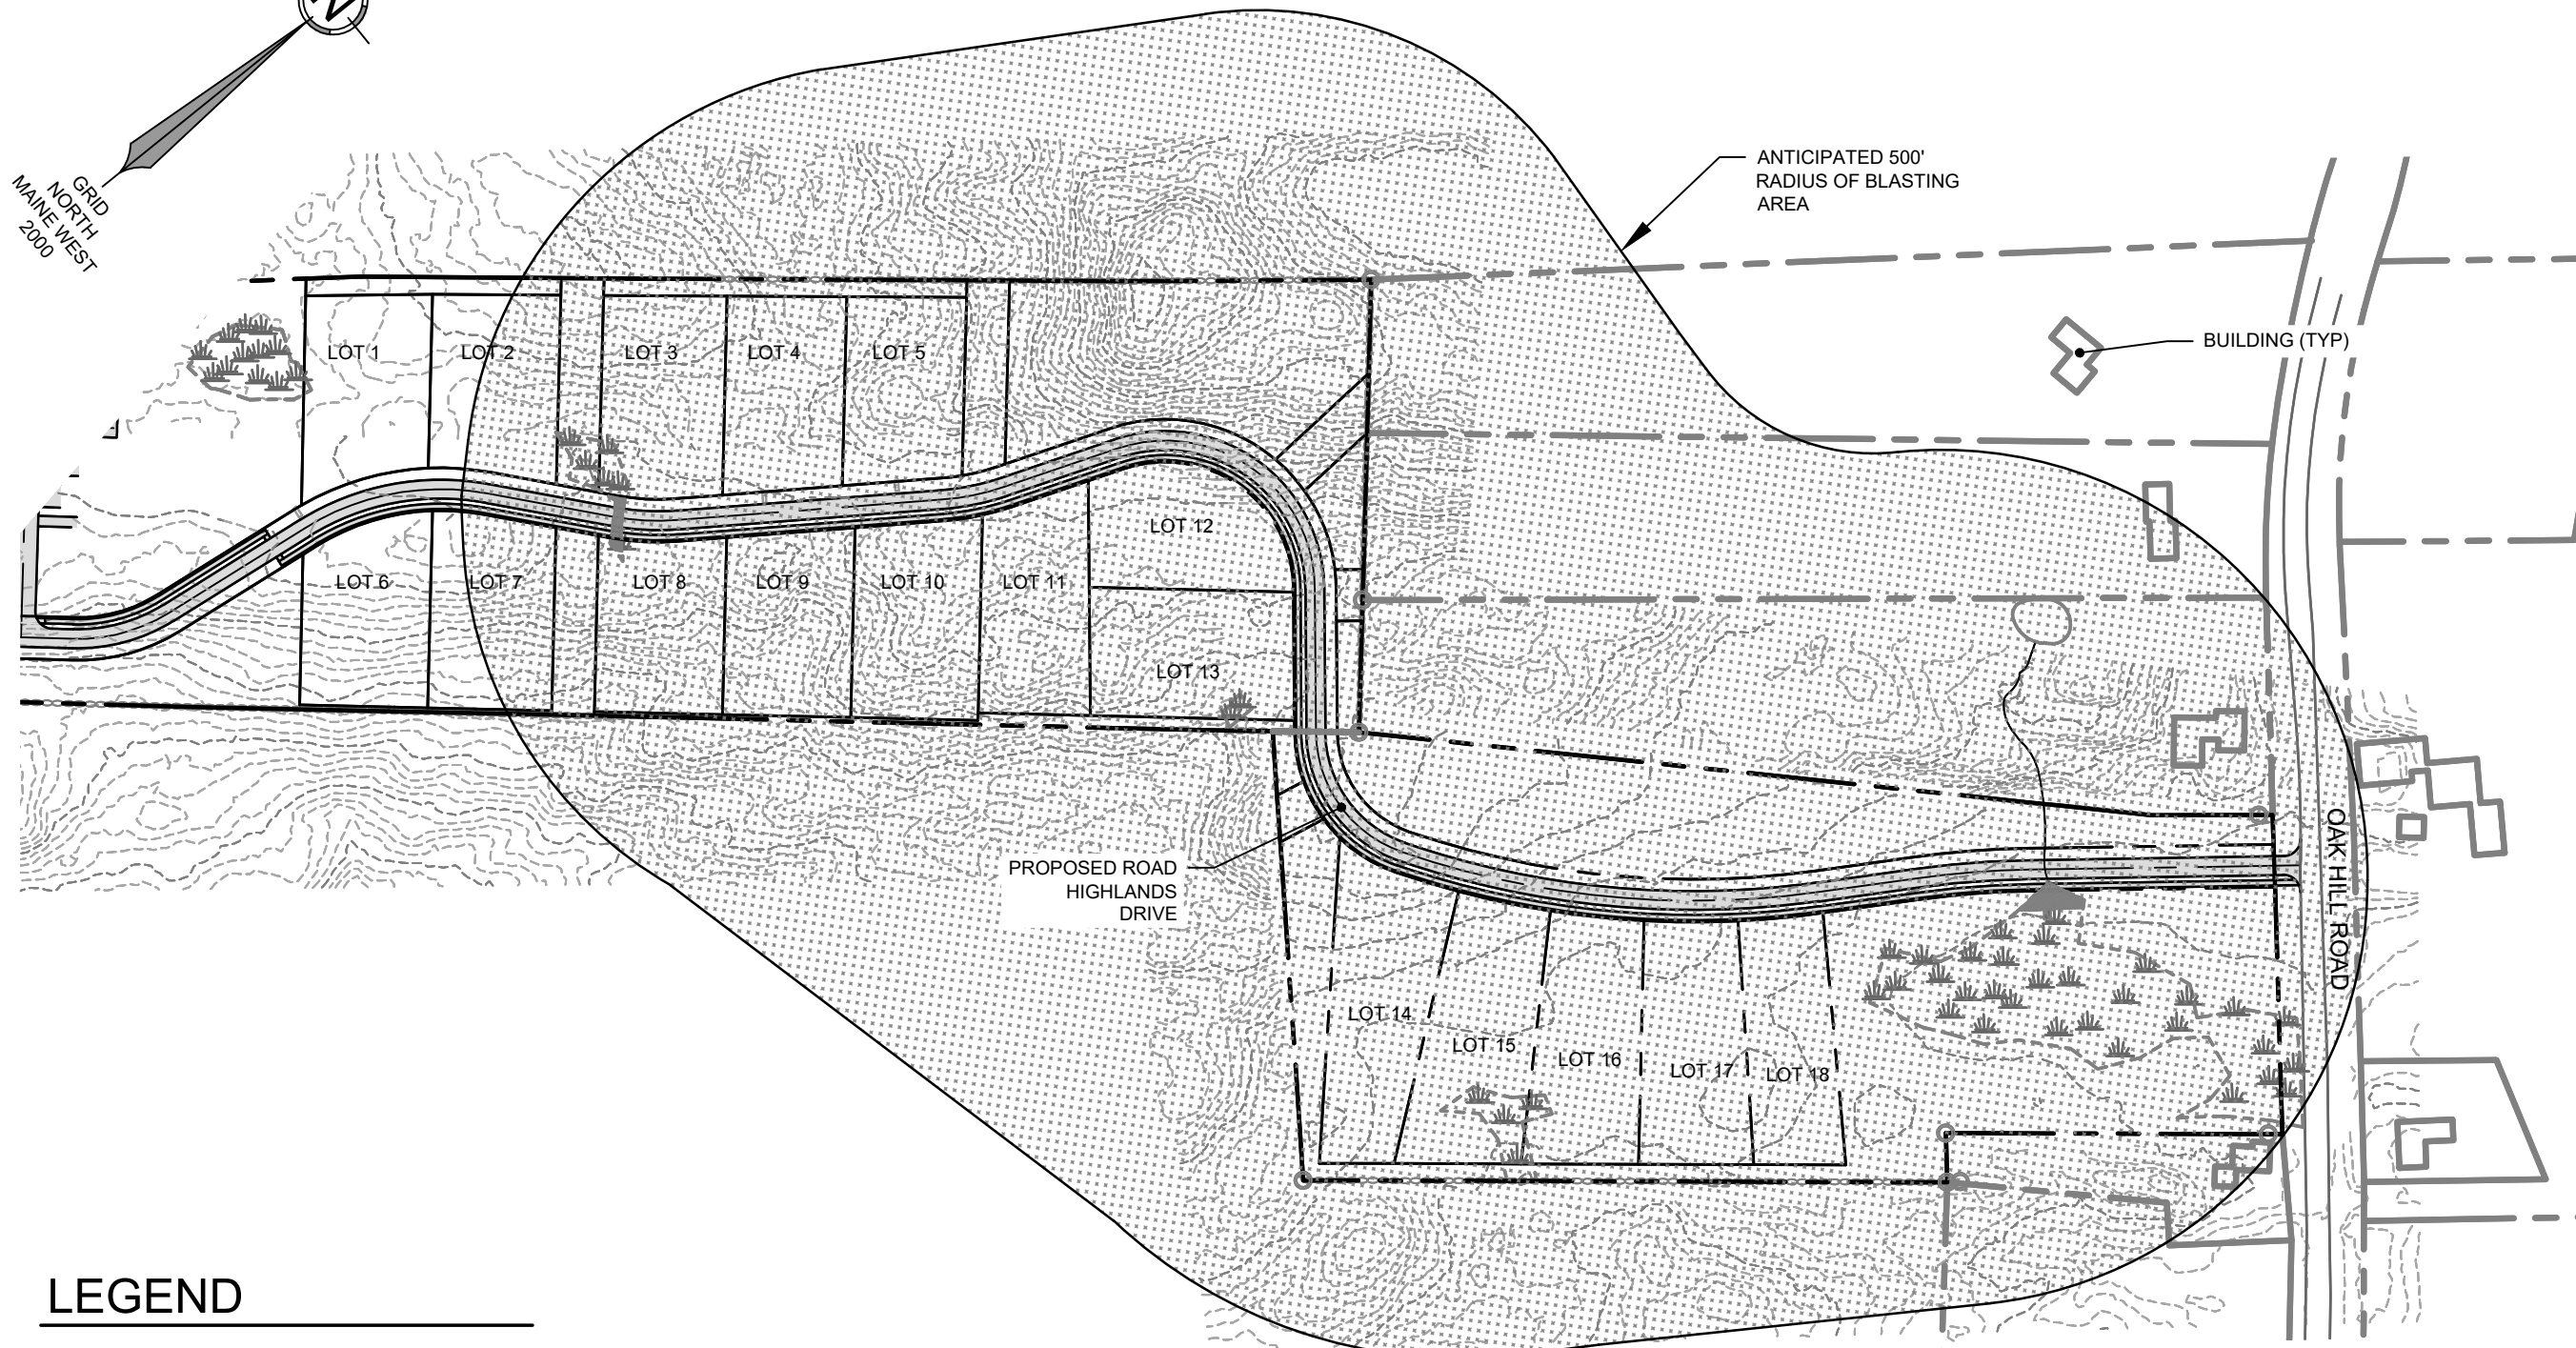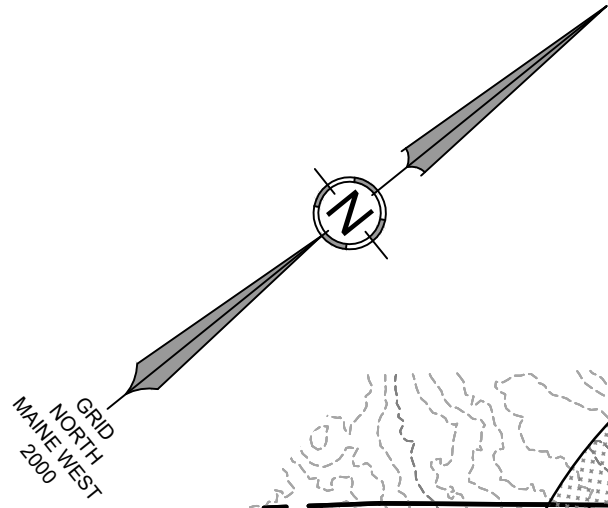

**LEGEND**

 AREA WITHIN 500' OF BLASTING AREA

NOTE: BLASTING WILL BE REQUIRED TO CONSTRUCT HIGHLAND AVENUE IN THE GENERAL AREA FROM STATION 28+00 TO 43+00, AND TO PREPARE BUILDING PADS ALONG THE FRONTAGE OF LOTS 14 AND 15. WHEN BLASTING IS DETERMINED TO BE NECESSARY, THE CONTRACTOR SHALL ADHERE TO THE BLASTING PLAN LOCATED IN THE SITE LOCATION OF DEVELOPMENT APPLICATION SECTION 20.

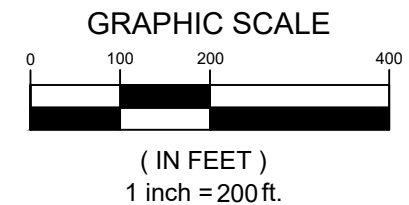

41 Campus Drive, Suite 101  
New Gloucester, ME 04260  
565 Congress Street, Suite 310  
Portland, ME 04101  
(207) 926-5111  
www.terradync consultants.com



Civil Engineering - Land Planning - Stormwater Design - Environmental Permitting

SHEET DESCRIPTION  
**EXHIBIT 20**  
**HIGHLANDS - 500' BLASTING RADIUS**  
PREPARED FOR  
**LEAVITT-TOMPSON, LLC.**  
P.O. BOX 703  
STANDISH, MAINE 04084

JOB NO.	1804-G
DATE	11/29/2019
SCALE	1"=200'
SHEET	1
OF	1



## Section 20 - Blasting

### Introduction

There are several known areas of shallow Bedrock located throughout the site. Blasting will be required to construct Highland Avenue in the general area from station 28+00 to 43+00, and to prepare building pads along the frontage of lots 14 and 15. When blasting is determined to be necessary, the contractor shall adhere to the following plan.

A professional blasting contractor (licensed in the State of Maine) will be employed to conduct any blasting work in accordance with applicable State and local laws. At a minimum, the blasting contractor shall conduct his work in accordance with the following criteria:

1. "Manual of Accident Prevention in Construction" issued by Associated General Contractors of America, Inc.
2. "Construction Safety Rules and Regulations" as adopted by the State Board of Construction Safety, Augusta, Maine.
3. Section 107.12 of the "Standard Specifications" Maine Department of Transportation.
4. Title 38 MRSA § 490-Z (14).

### Requirements

A. The owner or operator shall use sufficient stemming, matting or natural protective cover to prevent flyrock from leaving property owned or under control of the owner or operator or from entering protected natural resources or natural buffer strips. Crushed rock or other suitable material must be used for stemming when available; native gravel, drill cuttings or other material may be used for stemming only if no other suitable material is available.

B. The maximum allowable airblast at any inhabited building not owned or controlled by the developer may not exceed 129 decibels peak when measured by an instrument having a flat response (+ or - 3 decibels) over the range of 5 to 200 hertz.

C. The maximum allowable airblast at an uninhabited building not owned or controlled by the developer may not exceed 140 decibels peak when measured by an instrument having a flat response (+ or - 3 decibels) over the range of 5 to 200 hertz.

D. Monitoring of airblast levels is required in all cases for which a preblast survey is required by paragraph F. The department may waive the monitoring requirement if the owner or operator secures the permission of affected property owners to increase allowable airblast levels on their property and the department determines that no protected natural resource will be adversely affected by the increased airblast levels.

E. If a blast is to be initiated by detonating cord, the detonating cord must be covered by crushed rock or other suitable cover to reduce noise and concussion effects.

F. A preblast survey is required for all production blasting and must extend a minimum radius of 1/2 mile from the blast site. The preblast survey must document any preexisting damage to structures and buildings and any other physical features within the survey radius that could

reasonably be affected by blasting. Assessment of features such as pipes, cables, transmission lines and wells and other water supply systems must be limited to surface conditions and other readily available data, such as well yield and water quality. The preblast survey must be conducted prior to the initiation of blasting at the operation. The owner or operator shall retain a copy of all preblast surveys for at least one year from the date of the last blast on the development site.

(1) The owner or operator is not required to conduct a preblast survey if the department determines that no protected natural resource within the limits of the otherwise required survey is likely to be affected by blasting and production blasting will not occur within 2000 feet of any building not owned or under the control of the developer.

(2) The owner or operator is not required to conduct a preblast survey on properties for which the owner or operator documents the rejection of an offer by registered letter, return receipt requested, to conduct a preblast survey. Any person owning a building within a preblast survey radius may voluntarily waive the right to a survey.

(3) The owner or operator is not required to conduct a preblast survey if the owner or operator agrees to design all blasts so that the weight of explosives per 8 millisecond or greater delay does not exceed that determined by the equation  $W=(D/D_s)^2$ , where W is the maximum allowable weight of explosives per delay of 8 milliseconds or greater, D is the shortest distance between any area to be blasted and any inhabitable structure not owned or controlled by the developer and Ds equals 70 ft./((lb.)<sup>1/2</sup>.

G. Blasting may not occur in the period between sundown and sunrise the following day or in the period between 7:00 p.m. and 7:00 a.m., whichever is greater. Routine production blasting is not allowed in the daytime on Sunday. Detonation of misfires may occur outside of these times but must be reported to the department within 5 business days of the misfire detonation. Blasting may not occur more frequently than 4 times per day. Underground production blasting may be exempted from these requirements provided that a waiver is granted by the department.

H. Sound from blasting may not exceed the following limits at any protected location:

Number of Blasts Per Day Sound Level Limit

1	129 decibels
2	126 decibels
3	124 decibels
4	123 decibels

I. The maximum peak particle velocity at inhabitable structures not owned or controlled by the developer may not exceed the levels established in Table 1 in paragraph K and the graph published by the United States Department of the Interior in "Bureau of Mines Report of Investigations 8507," Appendix B, Figure B-1. The department may grant a variance to allow ground vibration levels greater than 2 inches per second on undeveloped property not owned or controlled by the

applicant if the department determines that no protected natural resource, unusual natural area or historic site will be adversely affected by the increased ground vibration levels. If inhabitable structures are constructed on the property after approval of the development and prior to completion of blasting, the developer immediately must notify the department and modify blasting procedures to remain in compliance with the standards of this subsection.

J. Based upon an approved engineering study, the department may grant a variance to allow higher vibration levels for certain buildings and infrastructures. In reviewing a variance application, the department shall take into account that the standards in this paragraph and paragraph I are designed to protect conventional low-rise structures such as churches, homes and schools. In cases of practical difficulty, the department may grant a variance from paragraph I if it can be demonstrated that no adverse impacts on existing infrastructures or protected natural resources, unusual natural areas or historic sites will result.

K. Table 1 of this paragraph or the graph published by the United States Department of the Interior in "Bureau of Mines Report of Investigations 8507," Appendix B, Figure B-1 must be used to evaluate ground vibration effects for those blasts for which a preblast survey is required.

(1) Either Table 1 of this paragraph or the graph published by the United States Department of the Interior in "Bureau of Mines Report of Investigations 8507," Appendix B, Figure B-1 may be used to evaluate ground vibration effects when blasting is to be monitored by seismic instrumentation.

(2) Blasting measured in accordance with Table 1 of this paragraph must be conducted so that the peak particle velocity of any one of the 3 mutually perpendicular components of motion does not exceed the ground vibration limits at the distances specified in Table 1 of this paragraph.

(3) Seismic instruments that monitor blasting in accordance with Table 1 of this paragraph must have the instrument's transducer firmly coupled to the ground.

(4) An owner or operator using Table 1 of this paragraph must use the scaled-distance equation,  $W=(D/D_s)^2$ , to determine the allowable charge weight of explosives to be detonated in any 8 millisecond or greater delay period without seismic monitoring, where W is equal to the maximum weight of explosives, in pounds, and D and D<sub>s</sub> are defined as in Table 1 of this paragraph. The department may authorize use of a modified scaled-distance factor for production blasting if the owner or operator can demonstrate to a 95% confidence level, based upon records of seismographic monitoring at the specific site of the mining activity covered by the permit, that use of the modified scaled-distance factor will not cause the ground vibration to exceed the maximum allowable peak particle velocities of Table 1 of this paragraph.

(5) Blasting monitored in accordance with the graph published by the United States Department of the Interior in "Bureau of Mines Report of Investigations 8507," Appendix B, Figure B-1 must be conducted so that the continuously variable particle velocity criteria are not exceeded.

The owner or operator may apply for a variance of the ground vibration monitoring requirement prior to conducting blasting at the development site if the owner or operator agrees to design all blasts so that the weight of explosives per 8 millisecond or greater delay does not exceed that

determined by the equation  $W=(D/D_s)^2$ , where W is the maximum allowable weight of explosives per delay of 8 milliseconds or greater, D is the shortest distance between any area to be blasted and any inhabitable structure not owned or controlled by the developer and  $D_s$  equals 70 ft./lb.<sup>1/2</sup>. As a condition of the variance, the department may require submission of records certified as accurate by the blaster and may require the owner or operator to document compliance with the conditions of this paragraph.

**TABLE 1**

Distance versus Peak Particle Velocity Method

Distance (D) from the blast area (feet)	Maximum allowable peak particle velocity (Vmax) for ground vibration (in./sec.)	Scaled-distance factor (Ds) to be applied without seismic monitoring
0 to 300	1.25	50
301-5000	1.00	55
Greater than 5000	0.75	65

L. A record of each blast, including seismographic data, must be kept for at least one year from the date of the last blast, must be available for inspection at the development or at the offices of the owner or operator if the development has been closed, completed or abandoned before the one-year limit has passed and must contain at a minimum the following data:

- (1) Name of blasting company or blasting contractor;
- (2) Location, date and time of blast;
- (3) Name, signature and social security number of blaster;
- (4) Type of material blasted;
- (5) Number and spacing of holes and depth of burden or stemming;
- (6) Diameter and depth of holes;
- (7) Type of explosives used;
- (8) Total amount of explosives used;
- (9) Maximum amount of explosives used per delay period of 8 milliseconds or greater;
- (10) Maximum number of holes per delay period of 8 milliseconds or greater;
- (11) Method of firing and type of circuit;
- (12) Direction and distance in feet to the nearest dwelling, public building, school, church or commercial or institutional building neither owned nor controlled by the developer;

- (13) Weather conditions, including factors such as wind direction and cloud cover;
- (14) Height or length of stemming;
- (15) Amount of mats or other protection used;
- (16) Type of detonators used and delay periods used;
- (17) The exact location of each seismograph and the distance of each seismograph from the blast;
- (18) Seismographic readings;
- (19) Name and signature of the person operating each seismograph; and
- (20) Names of the person and the firm analyzing the seismographic data.

M. All field seismographs must record the full analog wave form of each of the 3 mutually perpendicular components of motion in terms of particle velocity. All seismographs must be capable of sensor check and must be calibrated according to the manufacturer's recommendations.

N. If any blasting activity exceeds the standards in this subsection, the department must be notified within 48 hours of the blast event. Notification must include the name of the blasting operator, the location, date and time of the blasting event and a description of the specific occurrence that is in noncompliance with this subsection. Use of explosives at the quarry may be suspended by the department until the cause of the noncompliance is identified and appropriate steps are implemented to reduce, prevent or eliminate reoccurrence.

O. Prior to blasting, the owner or operator shall develop and implement a plan that provides an opportunity for prior notification of a planned blast for all persons located within 1,000 feet of the blast site. Notification may be by telephone, in writing, by public notice in a newspaper of general circulation in the area affected or by other means identified in the plan. The plan must be in writing and available for inspection by the department.



## ATTACHMENT 3

---

PEER REVIEW COMMENT RESPONSE

MARCH 26, 2020



**Pineland**

Cumberland Hall  
41 Campus Drive, Suite 101  
New Gloucester, ME 04260

**Portland**

565 Congress Street, Suite 310  
Portland, ME 04101

March 26, 2020

Mr. Zach Mosher Planner  
Town of Standish  
175 Northeast Road  
Standish, Maine 04085

**Subject: Highlands Subdivision Final Subdivision & Site Plan  
Response to Peer Review Comments**

Dear Zach:

Our office received peer review comments for the above referenced project from Peter Tubbs, P.E. dated January 29, 2020. We also received verbal comments in a meeting with Roger Mosley, James Paul, Peter Tubbs and you on March 2, 2020. We have reviewed the comments and prepared the responses presented below. For clarity, each comment is repeated in italics, followed by our response.

**Sheet C-1.0 – Subdivision and Site Plan for Village Housing**

*Comment 1: The proposed land use of the undefined open spaces should be shown, i.e. the Clubhouse lot, the area occupied by the existing farmhouse, and other undefined spaces.*

Response: These areas are now noted on the plan as “common space”.

**Sheet C-1.1 – Subdivision and Site Plan for Village Housing**

*Comment 2: The proposed land use of the undefined open space northerly of Lot 5 should be shown.*

Response: This area is now noted as “common space”.

**Sheet C-1.2 – Subdivision and Site Plan for Village Housing**

*Comment 3: The proposed land use of the undefined open spaces should be shown, i.e. the lot northeasterly of Lot 18 should be labeled as Wetland and Stormwater Area.*

Response: This area is now labeled “common space – wetland & stormwater area”.

**Sheet C-2.0 – Highlands Drive Layout Plan**

*Comment 4: The radii of the curb line at the intersection with Route 25 is labeled as 20’ but scales as 30’, this discrepancy should be corrected.*

Response: Radius is redrawn at 30’ with the roadway revised to 26’ wide.

*Comment 5: The 20’ radii at the intersection of the residential side streets with Highlands Drive are likely adequate for service vehicles if the total width of the 22’ traveled way is utilized in the turn.*

Response: No Response Necessary.

*Comment 6: The dimensions and notes of the residential streets differ from the typical sections shown on sheet C-6.0 as the curbing is omitted.*

Response: Typical section, Sheet C-6.0 revised to match 22’ traveled way with 5’ shoulder as noted on plan.

**Sheet C-2.1 – Highlands Drive Layout Plan**

*Comment 7: Acknowledge 22’ traveled way with 5’ paved shoulder / walkway for a total paved width of 27’ for the side streets*

Response: No Response Necessary

**Sheet C-2.3 – Highlands Drive Layout Plan**

*Comment 8: We question if the 20’ radii at the Oak Hill intersection is adequate for service vehicles, as a minimum we suggest the radii be increased to 30’.*

Response: Revised to 30' radius

**Sheets C-3.0 thru C-3.8 – Highlands Drive Grading Plans, General**

*Comment 9: The lack of shoulder and immediate inslope to the ditch from Sta. 19+60 to Oak Hill Road is a matter of concern from a safety standpoint. We suggest a minimum of a 3' shoulder or curbing needs to be added to the section.*

Response: Plan is revised to a 3' gravel shoulder, while keeping the roadside ditch to intercept runoff from relatively large drainage areas uphill of the roadway. This design exceeds the Local Street standard in Ch. 252 which allows a 1.5' wide gravel shoulder with open ditch drainage.

*Comment 10: Some of the storm drain is difficult to find without shuffling back and forth between these sheets and the profile sheets. A tabulation of catch basins, storm manholes, and connecting piping; including, storm and underdrain pipe sizes, invert elevations, slopes, and rim elevations would enhance both review and construction so the contractor would have the pertinent information on a single sheet/ location.*

Response: Storm drain pipe and structure data are provided on both the plan and profile sheets. We have checked plans vs. profiles for consistency. In addition we are developing a separate tabulation of structures and pipes (Sheet C-7.0) that we will provide under separate cover after we cross-check it with the plans.

*Comment 11: Considering the large extent of riprap we wonder if one of the geo-textiles might be an adequate substitute in some locations.*

Response: The applicant prefers to use riprap for these locations since they will be producing it from blasting activity on the property.

*Comment 12: We have NOT checked these plans for utility conflicts with the stormdrain.*

Response: Comment acknowledged. Our office checked the storm drain / water main / water service crossings for adequate clearance.

**Sheet C-3.0 – Highlands Drive Grading Plan**

*Comment 13: We note the grading over the 15" storm drain (sidewalk) westerly of the entrance has been added, however there appears to be a lack of cover as approximately 10' of the top of the pipe will be exposed.*

Response: Grading and pipe invert elevations are revised to provide sufficient cover (> 2' just upstream from the outlet).

*Comment 14: We note the Dwg. notes concerning the underdrain.*

Response: Type B and Type C underdrain locations are now shown on the plans and a typical detail is included.

*Comment 15: The pipe under the Club House drive needs to be extended to accommodate the slope to the invert.*

Response: Lengthened pipe and added contours

**Sheet C-3.1 – Highlands Drive Grading Plan**

*Comment 16: Refer to General notes above concerning catch basins and piping.*

Response: See response to Comment 10.

**Sheet C-3.3 – Highlands Drive Grading Plan**

*Comment 17: Refer to General notes above concerning adequate cover and Catch Basin information.*

Response: See response to Comment 10.

*Comment 18: There are redundant notes concerning the cross pipes Stas. 36+75, 38+60, 42+75, 44+25, and 46+75.*

Response: Removed extra notes



**Sheet C-3.5 – Highlands Drive Grading Plan**

*Comment 19: Refer to General notes above concerning catch basins and piping.*

Response: See response to Comment 10.

*Comment 20: Approximately 10' of the 18" pipe outlet from CB –G1 will be exposed with the proposed grading.*

Response: Revised pipe inverts and grading to provide sufficient cover

**Sheet C-3.6 – Highlands Drive Grading Plan**

*Comment 21: Refer to General notes above concerning adequate cover and Catch Basin information.*

Response: See response to Comment 10.

*Comment 22: Approximately 100' of the 24" of the outlet end of the 24" pipe from CB-G-3 will be exposed or lack adequate cover with the proposed grading.*

Response: The area behind units 29-32 is regraded to provide sufficient cover (Sheet C-3.6).

**Sheet C-3.7 – Highlands Drive Grading Plan**

*Comment 23: Refer to General notes above concerning adequate cover and Catch Basin information.*

Response: See response to Comment 10.

**Sheet C-3.8 – Highlands Drive Grading Plan**

*Comment 24: Refer to General notes above concerning adequate cover and Catch Basin information.*

Response: See response to Comment 10.

**Sheet C-5.0 through C 5.4 – Highlands Drive and Village Housing Roadway Profiles**

*Comment 25: We note that some of the catch basins are larger than the standard 4' diameter to accommodate the number of drain pipes entering and outletting.*

Response: Comment acknowledged

*Comment 26: The elevations on the bottom of each sheet should be labeled as existing and centerline profile.*

Response: Done

**Sheet C- 6.0 Details.**

*Comment 27: The pavement width in the Typical Road Section - Private Road does not reflect the sum of the components. Where does this section apply??*

Response: Revised dimensions to add up to 27' total pavement width – applies to five private side roads into Village Housing.

*Comment 28: Where does the Typical Road Section – Town Residential Street with Gravel Shoulders apply?*

Response: We revised the typical road sections to note the specific road stations where they apply.

*Comment 29: Typical Road Section – Town Avenue Street reflects a curb, esplanade, and sidewalk on the right side while the plan does not. The section should be revised to reflect the current proposed section.*

Response: The Town Avenue Street section has been replaced by a Town Residential Street section with 2' shoulders total pavement width of 26'. Roger Mosley requested a narrower street section due to Town maintenance considerations.

*Comment 30: An additional typical road section is needed for the Town Residential Street beyond Sta. 19+60 where the sidewalk is on the right and the ditch*

*and slope is on the left. Refer to first bullet comment under Sheets C-3.0 thru C-3.8*

Response: This section has been added.

*Comment 31: The note for the fill below subgrade should be expanded to include grubbing for the entire width of the right-of-way and borrow refill to subgrade.*

Response: The typical cross sections are revised to require grubbing in fill sections where the depth of embankment measured vertically below subgrade is less than 5' per MDOT Specifications Section 203.09.

*Comment 32: The Typical Road Section at Wetland Crossings should reflect the curb and sidewalk on the right side instead of the left. The left side should reflect the inslope and ditch.*

Response: The typical road section at wetland crossing has been revised.

### **Sheet C- 6.2 Gravel Wetland Details and Notes**

*Comment 33: The stormwater treatment cells and filter basin are way to proximate to the residential building, leaving little or no space for maintenance at the perimeter of the buildings.*

Response: This sheet and the Grading Plans are revised to provide a 5' wide gently sloped area around all building for maintenance access.

*Comment 34: The 391 contours should connect on either side of the primary spillways on the interior berms.*

Response: Plan is revised.

*Comment 35: Ditto the 393 contours on either side of the Cell 2 spillway.*

Response: Plan is revised.

*Comment 36: We note there is only 0.35' of freeboard between the primary spillway and the top of the interior berm and question if this is adequate to pass the expected flows.*

Response: The plan is revised to extend turf reinforcement mat the full length of the berm and up to elevation 392.0, for 1.1' freeboard.

*Comment 37: The primary spillway should be shown in the Cross Section View.*

Response: The spillways are shown in the cross section view. The emergency spillway is located at Cell #1 as shown in the plan view to allow construction on native soil, not fill.

*Comment 38: There is a discrepancy in the elevations of the emergency spillway shown in the plan view from that shown in the Cross Section View.*

Response: Discrepancy corrected

*Comment 39: There is a discrepancy between the sectional view of Outlet Control Structure and the detail of the Weir Wall as the Outlet Control Structure does not show a base slab on a gravel base.*

Response: Discrepancy corrected

*Comment 40: There is also a discrepancy in the elevation of the 15" outlet pipe specified in the plan view and the Outlet Control Structure (OCS). The outlet piping of all (OCS) should be fitted with a grate to prohibit entry of small animals, including pets from entering the structure.*

Response: Elevation discrepancy corrected. Detail now notes animal guard.

*Comment 41: The sectional view of the (OCS) shows an 8.0' diameter structure, we question if a smaller diameter structure might be adequate.*

Response: Revised to 6' diameter

*Comment 42: We question where the 6" underdrain outlet shown in Outlet Control Structure detail at elevation 386.33 will outlet.*

Response: The underdrain outlet enters the outlet control structure at elevation 387.33 on the upstream side of the weir wall to maintain the required saturated depth in the gravel wetland per the Maine DEP BMP Manual.

*Comment 43: The arrow/leader for the note referring to the distribution line in Cell 1 does not connect to the pipe it's referring to. Ditto the arrow/leaders referring to the spillway crests in the Spillway Cross Sections.*

Response: Arrow/leaders now revised

*Comment 44: The length of the distribution pipe in the same note is shown as 26'. We believe it should be 56' as scaled.*

Response: Length corrected to 56'

*Comment 45: There is a discrepancy in the compaction requirement between the notes for the pond construction and the notes for the embankment construction.*

Response: All notes now state 90% compaction per the Maine DEP BMP Manual.

*Comment 46: A manufacturer should be specified for the P-300 LW Turf Reinforcement Mat.*

Response: Manufacturer is North American Green – now noted on plans.

### **Sheet C- 6.3 Filter Basin # 1 Details and Notes**

*Comment 47: We suggest the 4" underdrain outlet pipe terminate at the toe of the embankment with a shallow swale graded out to the elevation 387.0. The 1" diameter orifice (that will likely be plugged within a year) should be made in a cap installed on the outlet pipe inside the manhole.*

Response: The underdrain outlet pipe is revised to discharge to a shallow swale as suggested. We do not anticipate that the orifice drilled in the underdrain



outlet cap will plug since it will discharge clear filtered water. The stormwater maintenance plan requires that the outlet be inspected and kept clear of vegetation etc. that could cause a blockage.

*Comment 48: The 30 mil HDPE liner is difficult to work with considering the bends necessary to form the proposed section. A flexible liner like hypalon would be easier to work.*

Response: In our experience, the 30 mil HDPE material as noted on the detail is commonly used for lining stormwater ponds. The material generally comes in 20' +/- widths and can be cut and seam-sealed to conform to the pond bottom shape with reasonable care by the contractor. Hypalon is more commonly used for landfill liners and other more stringent applications.

*Comment 49: We suggest the 2" pressure treated plank would also be adequate for the inlet weir in lieu of the precast concrete, and might be less susceptible to frost action.*

Response: Plan is revised to show 2" PT boards

*Comment 50: We recognize the design of the stormwater basins are driven by DEP approved design; however some of the details are fundamentally flawed, i.e. the 6" of topsoil on top of the HDPE liner introduces a slip plane for a saturated top soil to slid into the bottom of the basin, the liner also inhibits penetration of the slope vegetation into the embankment sides. We suggest limiting the liner to the filter material area.*

Response: The top of the liner is set at 2' above the pond bottom as specifically required by the Maine DEP geologist review. We do not anticipate a significant risk of slip plane failure with 6 inches of loam on a shallow 3:1 slope if vegetation is fully established before any water is directed to the basin. For the limited slopes steeper than 3:1 we have specified erosion control mats in the detail.

#### **Sheet C- 6.4 Filter Basin # 2 Details and Notes**

*Comment 51: A note in the plan view specifies the HDPE liner extend up to elevation 400 which is lower than the bottom of the basin.*

Response: The plan is revised to set the top of liner 2' above the basin floor as noted above.

*Comment 52: The 6" pond underdrain at invert elevation 431.67 should be shown on the outlet side of the Outlet Control Structure (OCS) section/detail.*

Response: The 6" pond underdrain connects on the outlet side of the OCS. The 6" UD invert elevation is revised to 431.55 to provide positive slope.

*Comment 53: The 7.5" and 12" diameter orifices shown in the detail for the (OCS) weir wall should be shown in the (OCS) section/detail. We suggest these modifications would clarify the operation of the (OCS).*

Response: The OCS section/detail now has a note referring to the weir wall detail below for this information.

*Comment 54: Note 2 of the underdrain filter notes implies the filter soil bed material will be compacted. We suggest compaction of this material will inhibit infiltration, reducing the effectiveness of the filter.*

Response: Agreed. We removed notes requiring compaction of the soil filter bed material.

*Comment 55: What is the purpose of the emergency spillway at the southwesterly end of the end of the basin?*

Response: The emergency spillway is provided at this location to direct overflow away from proposed housing in the event the spillway were activated.

*Comment 56: Refer to bullet # 7 Sheet C- 6.3 concerning the details of the (OCS) and the weir wall.*

Response: The base slab for the OCS is removed from the detail.

**Sheet C- 6.5 Filter Basin # 3 & 4 Details and Notes**

**Filter Basin #3**

*Comment 57: The section of the Filter Basin shows the underdrain pipe to be 6" vs. the 4" shown in plan.*

Response: The filter basin section is revised to show 4" UD pipe, same as the plan view.

*Comment 58: The 382 contours should connect on the west side of the emergency spillway.*

Response: Done

*Comment 59: The 382 through 386 contours should connect to the existing contours on the easterly side of the spillway.*

Response: Done

*Comment 60: Refer to bullet notes under C-6.3 concerning the HDPE lining.*

Response: See response to Comment 48.

**Filter Basin # 4**

*Comment 61: We suggest the 4" underdrain outlet pipe terminate at the 378 contour with a shallow swale graded out to the elevation 374.0.*

Response: Plan is revised as suggested.

*Comment 62: Refer to bullet notes under C-6.3 concerning the HDPE lining.*

Response: See response to Comment 48.

*Comment 63: We question the need for the 1.0' sump as nothing but clear filtered water will contribute to the structure.*

Response: On further review of the plan have eliminated the UD outlet manhole.

**Sheets C- 6.6 through C- 6.9**

*Comment 64: These sheets reflect standard details of the various components of site construction. As standard details they are accepted /approved by most agencies, and are acceptable here.*

Response: No Response Necessary

**Sheets L-1.1 and L-1.2**

*Comment 65: These sheets reflect street trees along the length of the project. We question the trees planted in the esplanade, will impact the sidewalk due to the root system.*

Response: At Roger Mosley's request we have eliminated most of the street trees along the proposed Town Street.

**STORMWATER MANAGEMENT:**

*Comment 66: We have not reviewed the management facilities for the project as MDEP has reviewed this component of the Project.*

Response: No Response Necessary

**From Peter Tubbs e-mail on 2/3/2020**

*Comment 67: There is an additional significant issue that I failed to include in my comments i.e. the lack of a relatively flat perimeter area 4 to 6' wide adjacent to the buildings for maintenance of the structure, and access to the adjacent slope.*

Response: The grading plans are revised to provide a gently sloped maintenance area around all buildings.

**Comments Summarized from Meeting with Roger Mosley, Zach Mosher, J. Paul and Peter Tubbs on 3/2/2020**

Comments are summarized based on meeting notes by Larry Bastian:

*Comment 1: The Town Avenue street section at the Route 25 entrance is too wide at 44' wide and will be difficult for the Town to maintain. A narrower street section is recommended.*

Response: Highlands Avenue from Route 25 to the proposed driveway to the clubhouse and Leavitt Earthworks property is revised to a Town Residential street, upgraded with 2' paved shoulders for a total pavement width of 26'.

*Comment 2: Public Works would prefer to have the sidewalk located directly adjacent to the curb for ease of maintenance, instead of with a grass esplanade separating the curb and sidewalk.*

Response: The plans are revised to show the first section of Highlands Avenue off of Route 25 (as noted in Comment 1) with the sidewalk directly abutting the curb. On behalf of the applicant, we request that the Town Residential Street requirement for a grass esplanade between the sidewalk and curb be waived for the entire length of Highland Avenue. We will revise the rest of the plans after the waiver is approved.

*Comment 3: Does the MaineDOT Entrance Permit on Route 25 need to be amended if road width changes?*

Response: The recorded Entrance Permit is described as "entrance 28 feet in width plus radii". We would notify MaineDOT of the revised road width after this waiver is approved by the Planning Board.

*Comment 4: Need to provide a construction phasing plan*

Response: Added to plan set as Sheet 0.3

*Comment 5: J. Paul is reviewing fire hydrant locations and will provide proposed locations to Terradyn.*



Response: We will revise the plans when we receive the required locations.

*Comment 6: Sheet C-3.2 - CB H-24 at sta. 26+85 should be piped directly to CB H-23, not discharged into the ditch across the road.*

Response: Plan is revised as requested.

*Comment 7: Sheets C-3.1, C-3.2 & C-3.3 - From sta. 19+66 to Oak Hill Road, left side of road - Change from gravel shoulder with open ditch to a curbed section. Roger noted concern with road runoff getting into the ditch in the winter. Larry said we would review the design and discuss further with Roger if we have questions.*

Response: The typical section in this location is revised to a 3' gravel shoulder, while keeping the roadside ditch to intercept runoff from relatively large drainage areas uphill of the roadway. In our opinion, the open shoulder and >3' deep ditch will provide greater ability to clear snow compared to a 22' wide curbed road section. This design exceeds the Local Street standard in Ch. 252 which allows a 1.5' wide gravel shoulder with open ditch drainage. We hereby request to waive curbing on one side of the street (curb required both sides by Town Residential Street section).

*Comment 8: Label proposed access easements across from Lots 12 and 13 consistently where they appear on the various plan sheets – currently labeled easement on subdivision plan and right-of-way on site plan.*

Response: Plans are revised

*Comment 9: Subdivision Plan Sheet C-1.1 – Remove reference to Homeowners' Association maintenance of fire protection system, since the main within the Town ROW will be owned by Portland Water District.*

Response: Notes 17 & 18 are updated. The fire protection system outside of the Town ROW (serving condominiums) will be maintained by the HO Association.

*Comment 10: The Town requires granite monuments on one side of the ROW only, with pins on the opposite side.*

Response: Plans now show granite monuments on the right side and pins on the left side of the ROW.

*Comment 11: Add crosswalk at entrance on Route 25.*

Response: Done

*Comment 12: Most of the proposed street names may conflict with existing street names in Town. Zach will provide the existing Town street inventory list.*

Response: Street names will be submitted separately for confirmation by Town Officials. We will then revise names on the plan set.

*Comment 13: Provide road name for driveway to clubhouse. Note maintenance of this driveway by homeowners' association (front portion) and by others (past driveway to parking lot).*

Response: See response to comment 12. Maintenance responsibility is noted on the Site Plan C-2.0.

*Comment 14: Sheet C-3.0 - CB-H-7B is located in a sidewalk – should be a drain manhole.*

Response: Revised

*Comment 15: Sheet C-3.1 – CB-H-12 – Invert elevation out is higher than invert in. CB-H-19 – Invert out is higher than next downstream structure.*

Response: Revised plan

*Comment 16: Sheet C-3.3 – It appears grassed swale on Lot 18 should be in a drainage easement.*

Response: This swale is only collects runoff from Lot 18 and is needed for phosphorus treatment. An easement is not needed.

**Comment 17:**

***Sheets L-1.0 to L-1.3, Landscaping Plan:***

- *The number of street trees shown along Highland Avenue is excessive and will be difficult for the Town to maintain. They also pose potential future conflicts with underground utilities. It is recommended to remove the street trees and place trees in clusters at the entrances to each of the condo access drives, and at the clubhouse.*
- *The Town does not want to use Oaks as street trees because of the acorns.*
- *Additional trees could be provided within each of the condo housing areas.*
- *Assuming the sidewalk is built directly abutting the curb under the waiver as noted in Comment 2 above, standard Town light poles and fixtures should be located in the ROW behind the sidewalk. Roger provided the vendor detail for the Town's standard light pole and fixture. Light poles should be placed up to 100' apart along the entire length of Highland Avenue.*
- *The plans should note that street lighting will be on a metered CMP control box, and that the lighting plan will be submitted for Town approval prior to construction.*
- *The light poles shown on the plan opposite each of the five condo access drives and at the intersections with Oak Hill Road and Route 25 are OK. .*

Response: The landscape plans are revised with the changes noted above.

**Attachments**

- Revised Plan Set dated March 25, 2020

**Waiver Requests**

As noted within this letter, we request the following waivers on behalf of the applicant:

- Waive the Town Residential Street requirement for sidewalk to be separated from curb by a 6' wide grassed esplanade, for the entire length of Highlands Drive.
- Waive the Town Residential Street requirement for curbing on the left side of Highlands Drive from +/- station 19+66 to Oak Hill Road, to be replaced by a 3' wide gravel shoulder and ditch conforming to Local Street Standards in Chapter 252.

Mr. Zach Mosher  
March 26, 2020

1804

We trust that the above responses and attached materials address the comments.  
Please contact me directly with any additional questions.

Sincerely,  
**TERRADYN CONSULTANTS LLC**



Larry Bastian, P.E.

Attachments:

cc.

## ATTACHMENT 4

---

SEPTIC SYSTEM COMMENT RESPONSE

APRIL 13, 2020



#### Pineland

Cumberland Hall  
41 Campus Drive, Suite 101  
New Gloucester, ME 04260

#### Portland

565 Congress Street, Suite 310  
Portland, ME 04101

April 13, 2020

Mr. Zach Mosher Planner  
Town of Standish  
175 Northeast Road  
Standish, Maine 04085

**Subject: Highlands Subdivision Final Subdivision & Site Plan  
Response to Septic System Peer Review Comments**

Dear Zach:

Our office received peer review comments for proposed septic systems from Peter Tubbs, P.E. dated January 31, 2020. We have reviewed the comments and prepared the responses presented below. For clarity, each comment is repeated in italics, followed by our response.

#### **General**

*Comment 1: The treatment and disposal of the wastewater is addressed in Section 5 of the supplemental information. The location of the proposed systems are shown on the utility plans.*

Response: No response necessary

#### **Individual Systems**

*Comment 2: The following areas reflected on the utility plans do not conform to the dimensions specified in the HHE-200 forms (the disposal areas on the plans are generally smaller than specified.):*

*System Numbers 25-32, (mis-labeled as 29-32), 1-4 & 9-12, 45-48 & 57-60, 49-56, and 61-68.*

Response: These disposal areas are redrawn so that the dimensions match the HHE-200 forms. The system for units 49-56 is revised to 31' x 52' (104 Elgin Indrain units) which has the same capacity as the previous layout (23' x 68' and 102 Elgin units).



### **Nitrate Assessment**

*Comment 3: The nitrate plumes are shown on the plans N-1.0 thru N-1.3 in Section 7 of the supplemental information.*

Response: No response necessary

*Comment 4: A number of plumes extend into the stormwater treatment systems or drainage channels. We question if there is a possibility the nitrite effluent will contaminate the treated stormwater?*

Response: See below

*Comment 5: A substantial number of the plumes are shown entering the building footprints. Does this fact have the potential of entering the foundation drains and ultimately contaminating the treated stormwater?*

Response: Please see the attached letter from Mark Cenci Geologic, Inc. which responds to these questions.

### **Attachments:**


- Revised Utility Plans, Sheets C-4.0 and C-4.1
- Letter from Mark Cenci Geologic, Inc.

Mr. Zach Mosher  
April 13, 2020

1804

We trust that the above responses and attached materials address the comments.  
Please contact me directly with any additional questions.

Sincerely,  
**TERRADYN CONSULTANTS LLC**

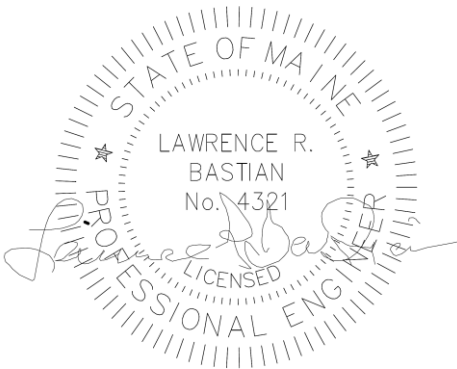

Larry Bastian, P.E.

Attachments:

cc.



**Date:** February 4, 2020

**To:** Larry Bastian  
Terradyn Consultants, LLC  
41 Campus Drive, Suite 101  
New Gloucester, ME 04260

**RE:** Review comments of Highlands Subdivision, by P.B. Tubbs Consulting, dated 1/31/20

Larry:

P.B. Tubbs questions the possibility of adverse effects on treated stormwater by nitrate nitrogen in groundwater entering stormwater treatment systems, drainage channels and/or perimeter drains of buildings.

In short, there are no adverse effects, because nitrate-nitrogen in wastewater is regulated as a component of groundwater, not surface water, as groundwater is a possible source of potable water for human consumption. There are no regulations at the Federal, State or local levels concerning nitrate-nitrogen concentrations in storm water or surface water.

The Maine Subsurface Wastewater Disposal Rules do regulate the minimum separation distances between building foundations, open channels and stormwater control features, and all the septic systems on this site comply with those setback requirements.

Please contact me if I can be of further assistance.

Mark Cenci, CG # 467

## ATTACHMENT 5

---

PEER REVIEW & PUBLIC WORKS COMMENT RESPONSE

APRIL 15, 2020



#### Pineland

Cumberland Hall  
41 Campus Drive, Suite 101  
New Gloucester, ME 04260

#### Portland

565 Congress Street, Suite 310  
Portland, ME 04101

April 15, 2020

Mr. Zach Mosher Planner  
Town of Standish  
175 Northeast Road  
Standish, Maine 04085

**Subject: Highlands Subdivision Final Subdivision & Site Plan  
Response to Peer Review Comments**

Dear Zach:

Our office received peer review comments for the above referenced project from Peter Tubbs, P.E. dated April 8, 2020, as well as comments from Public Works dated April 6, 2020. We have reviewed the comments and prepared the responses presented below. For clarity, each comment is repeated in italics, followed by our response.

**Response to Comments from Peter Tubbs, P.E.**

**Sheet C-3.0 – Highlands Drive Grading Plan**

*Comment 1: The contours at the inlet of the pipe under the Club House drive do not reflect the grading needed to accommodate the slope to the invert.*

Response: We revised the pipe inlet elevation and the contours in this area to accommodate the slope to the invert.

*Comment 2: The note concerning regrading the Oak Hill Road ditch northwesterly of the intersection should specify the channel lining to prevent erosion northwesterly of the riprap protection.*

Response: The note is revised to specify erosion control mesh in the ditch that is regraded to improve sight distance to the left of the new intersection.

**Sheet C-3.6 – Whitney Drive Grading Plan**

*Comment 3: Approximately 110' of the westerly end of the 24" storm drain westerly of units 29 to 32 still reflects shallow cover (1.0' to 1.5'), shouldn't this be a*

*concern from the standpoint of frost heaving and damage from maintenance equipment?*

Response: We added a drain manhole and adjusted the storm drain invert elevations to provide adequate cover.

### **Sheet C- 6.0 Details.**

*Comment 4: Typical Road Sections with curb should reflect underdrain.*

Response: Underdrain is now noted on the typical road sections with curbing.

*Comment 5: All Typical Road Sections should reflect grubbing and refill below subgrade.*

Response: The note concerning grubbing and refill is now on all the Town road sections.

*Comment 6: The note under the Wetland Crossing specifies granular borrow for fill below all driving surfaces (we presume reference to roadway paved area) while the section show common borrow.*

Response: The typical section is revised to clarify the requirement for granular borrow below pavement.

*Comment 7: The aggregate subbase on the left (ditch side) in the Typical Road Section from Sta. 19+65 to Oak Hill Road should extend out to the slope line.*

Response: The typical section is revised to show this.

### **Sheet C- 6.2 Gravel Wetland Details and Notes**

*Comment 8: We understand why the 6" underdrain outlet is at the level specified but it's still not clear where it ultimately outlets. Is the outlet the 1" diameter orifice in the control panel?*

Response: We revised the 6" underdrain to discharge on the outlet side of the concrete baffle wall inside the outlet control structure (OCS). The detail requires a cap on the 6" UD with a 1" hole drilled at the invert. The 15" outlet pipe from the OCS maintains the water level 4" below the gravel wetland surface as required by DEP. The 1" orifice in the control panel is eliminated.



*Comment 9: We've noted plugging of the smaller sized orifices (2"- 4") in the control panel with algae. So we expect plugging of the 1" orifice here also, defeating the purpose of slowly draining the filtration beds. We don't have a good solution but are willing to listen to, and work with you on any alternative. This comment applies to the remainder of the structures/outlet piping in the other stormwater management devices.*

Response: We eliminated the 1" orifice in the gravel wetland control panel as noted above to avoid the potential for clogging. The 6" underdrain with a 1" orifice outlet flows with filtered water from the underdrain system in the gravel wetland, so we do not anticipate clogging. Routine maintenance of the outlet control structure should minimize any potential clogging due to sediment or debris buildup on the outlet side of the underdrain.

The underdrain outlets for filter basins FB-1, FB-2, FB-3 and FB-4 also use a 1" drilled orifice in the UD outlet cap. These outlets receive filtered water from each basin underdrain system so we do not anticipate clogging. Routine maintenance of each outlet should minimize potential clogging due to vegetation or sediment buildup on the outlet side.

## **Response to Comments from Public Works**

### **Sheets C-2.2, C-3.2 and C-4.2**

*Comment 1: The Station numbers 33+00 to 35+00 are upside down.*

Response: The plan is revised.

### **Sheet 0.3**

*Comment 2: Construction Phase Plan. The Temporary Turnaround for Phase 2 is well laid out using a Section of the Future Right-of-Way. If possible, move the turnaround to the North side of Highlands Drive. This enables the plow truck to have a snow dump on the right. The leader for the Temporary Turnaround for Phase I points to the travel lane of Highlands Drive. The proposed terminus for Phase I is Sta: 35+75. At this point and from Sta: 41+00 to 31+00 the road has a 7% incline. With this incline it is not acceptable for a Plow Truck turnaround. I recommend the Phase I minus be moved to Sta: 31+50 and use the 50' Access Easement for the turnaround. The incline is better and having the snow dump on the right is preferred.*

Response: We acknowledge Public Works' concerns as noted above. Relocating the temporary turnaround for Phase 2 to the north side of Highlands Drive at the future ROW location would place it in wetlands, which is not allowable under the Maine DEP and Army Corps permit for the project. Relocating the temporary turnaround for Phase 1 to station 31+50 would require extending the roadway about 500' into the area which requires significant blasting for road and utility construction.

We propose a condition of approval be included on the plans that requires the applicant to submit design of the Phase 1 and Phase 2 temporary turnarounds for approval by Public Works prior to starting construction of each phase. We have added a note to this effect to Sheet 0.3. We are confident that a mutually agreeable solution can be achieved to address Public Works' concerns.

#### **Sheet C-1.0**

*Comment 3: At the existing entrance to Leavitt Earthworks, the Property Line N34° 06'53" E/96.24' would appear to create an under sized lot cutting off the old entrance.*

Response: The plan is revised to note conveyance of this area to Leavitt Earthworks.

#### **Sheet C-1.1**

*Comment 4: #2 in the General Note references York County Registry. I believe it should be Cumberland County.*

Response: We have updated this plan to include the most recent recorded deed information from Cumberland County Registry of Deeds.

*Comment 5: #19 in the General Notes. Allows the Town to acquire areas for future ROW's for \$1.00. Is that \$1.00 for all areas or for each?*

Response: We would defer to the Town to provide the answer to this question.

#### **Sheet C-2.0**

*Comment 6: Shouldn't both ends of the sidewalk at the intersection of Highlands Drive and Route 25 have the Detectable Warning Panel?*

Response: The plan is revised to note warning panels at each end of the crosswalk.

*Comment 7: At the end of Kayli Susan Drive by the Stormwater Area there is a section shaded but I don't see this type in the Legend.*

Response: This is the stabilized access path to the gravel wetland. We added a note to refer to the detail sheet where this is shown.

*Comment 8: What is the width of the walkway to the Club House – shouldn't it have a Detectable Warning Panel at Highlands Drive?*

Response: The width is now noted as 5' and we have added a detectable warning panel.

### **Sheet 3.3**

*Comment 9: At the Wetlands Crossing what is the length of the 42" High Fence. Sta: # to Sta: #'s. Should there be details for the type of fence?*

Response: We changed the fence to a wooden guardrail which provides a barrier to both pedestrian and vehicular traffic. Stations are now noted on the plan and there is a detail on Sheet C-6.1.

### **Sheet C-6**

*Comment 10: I think the Typical Road Section should label the underdrain as "Perf. Underdrain see plan for Type, Size and Locations" the 6" is misleading as other sizes are proposed. The Typical Road Sections for Sta: 19+65 to Sta: 43+67 should also include the detail for the underdrain.*

Response: We revised the plan to label the underdrain as noted above, and added it to the typical section for station 19+65 to station 43+67.

*Comment 11: The details for the Light Pole Base references a 5/8" dia x 8' Ground Rod. It should be "Rod".*

Response: The plan is revised as noted.

*Comment 12: On March 26, 2020 I received a text from Jamie Tompson regarding some of the road names. He asked to change Whitney Drive to Waylon Drive. He will also be changing Inverness to something else but hasn't forwarded anything. He states that Stacey Leavitt is going to address Jesse Daniel and Stonehaven. Jamie was also checking on the time frame that these names changes need to be done. I will be texting him back to remind him that Highlands Drive will also have to be changed and the road to Leavitt Earthworks will need a name.*


Response: Comment acknowledged. We will revise the road names on the plans after they are confirmed by the Town.

**Attachments**

- Revised Plan Set dated April 15, 2020

We trust that the above responses and attached materials address the comments. We are hopeful that the Planning Board will consider final approval of the plans with appropriate conditions at the upcoming remote meeting on May 4<sup>th</sup>. Please contact me directly with any additional questions.

Sincerely,  
**TERRADYN CONSULTANTS LLC**

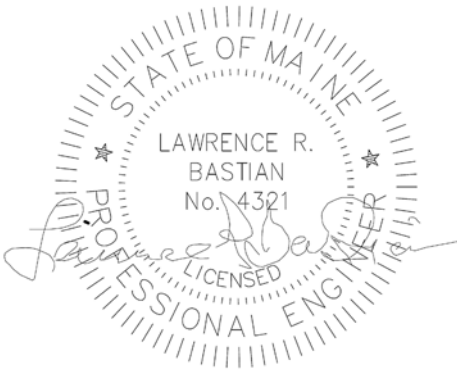

Larry Bastian, P.E.

Attachments:

cc.

# ATTACHMENT 6

---

PLAN SET

APRIL 15, 2020

**PREPARED BY:**

CIVIL ENGINEER:  
TERRADYN CONSULTANTS, LLC  
41 CAMPUS DR. SUITE 101  
NEW GLOUCESTER, MAINE 04260  
(207)926-5111

SURVEYOR:  
BOUNDARY ENGINEERING  
SURVEYING TECHNOLOGY  
25 TUBROS LANE  
BUXTON, MAINE 04093  
(207) 929-2378

HIGH INTENSITY SOIL SURVEY & WETLAND DELINEATION:  
MARK HAMPTON ASSOCIATES  
PO BOX 1931  
PORTLAND, MAINE 04104  
(207) 757-2900

SEPTIC EVALUATION:  
MARK CENCI GEOLOGIC INC.  
NORTH YARMOUTH, MAINE 04097  
(207) 329-3524

**APPLICANT:**  
LEAVITT - TOMPSON, LLC.  
P.O. BOX 703  
STANDISH, MAINE 04084

**OWNERS:**  
LEVITT EARTHWORKS, LLC. TOMPSON DEVELOPMENT, INC.  
191 OSSIPEE TRAIL 85 HI VU DRIVE  
STANDISH, MAINE 04084 STANDISH, MAINE 04084

**PROJECT PARCEL SITE**  
TOWN OF STANDISH TAX ASSESSOR'S MAP & LOT NUMBERS  
MAP 10 LOTS 11 & 19C

**LEGEND**


- EXISTING SETBACK LINE
- - - EXISTING EASEMENT
- - - PROPOSED EASEMENT
- ROAD CENTERLINE
- 124 --- EXISTING MINOR CONTOUR
- 124 --- EXISTING MAJOR CONTOUR
- 124 --- PROPOSED CONTOUR
- SD --- EXISTING STORMDRAIN
- SD --- PROPOSED STORMDRAIN
- S --- PROPOSED SANITARY SEWER
- W --- EXISTING WATER LINE
- W --- PROPOSED WATER LINE
- PROPOSED UNDERDRAIN
- OHE --- EXISTING OVERHEAD ELECTRIC & TEL.
- OHE --- PROPOSED OVERHEAD ELECTRIC & TEL.
- UGE --- EXISTING UNDERGROUND ELECTRIC & TEL.
- UGE --- PROPOSED UNDERGROUND ELECTRIC & TEL.
- EXISTING EDGE OF PAVEMENT
- PROPOSED EDGE OF PAVEMENT
- EXISTING EDGE OF GRAVEL
- PROPOSED EDGE OF GRAVEL
- EXISTING CURB
- PROPOSED CURB
- EDGE OF WATER
- EXISTING TREE LINE
- PROPOSED TREE LINE
- CHAIN LINK FENCE
- PROPOSED FENCE
- EXISTING GUARDRAIL
- PROPOSED GUARDRAIL
- SF --- SILT FENCE
- EXISTING VALVE
- PROPOSED VALVE
- EXISTING HYDRANT
- PROPOSED HYDRANT
- EXISTING TRANSFORMER
- PROPOSED TRANSFORMER
- EXISTING LIGHT POLE
- PROPOSED LIGHT POLE
- EXISTING UTILITY POLE
- PROPOSED UTILITY POLE
- EXISTING CATCH BASIN
- PROPOSED CATCH BASIN
- EXISTING SEWER MANHOLE
- PROPOSED SEWER MANHOLE
- +30.20 --- EXISTING SPOT GRADE
- x30.20 --- PROPOSED SPOT GRADE
- EXISTING SIGN
- PROPOSED SIGN
- TP-A --- TEST PIT
- P-1 --- SOIL PROBE

**LEGEND CONT.**


- EXISTING BUILDING
- PROPOSED BUILDING
- WETLAND AREA
- PROPOSED PAVEMENT
- RIPRAP
- PROPOSED WETLAND ALTERATION AREA
- FUTURE RIGHT OF WAY EASEMENT
- PROPOSED DRAINAGE EASEMENT
- EXISTING PROPERTY LINE
- PROPOSED PROPERTY LINE
- PROPOSED SETBACK LINE

# HIGHLANDS SUBDIVISION

## OSSIPEE TRAIL, STANDISH, MAINE

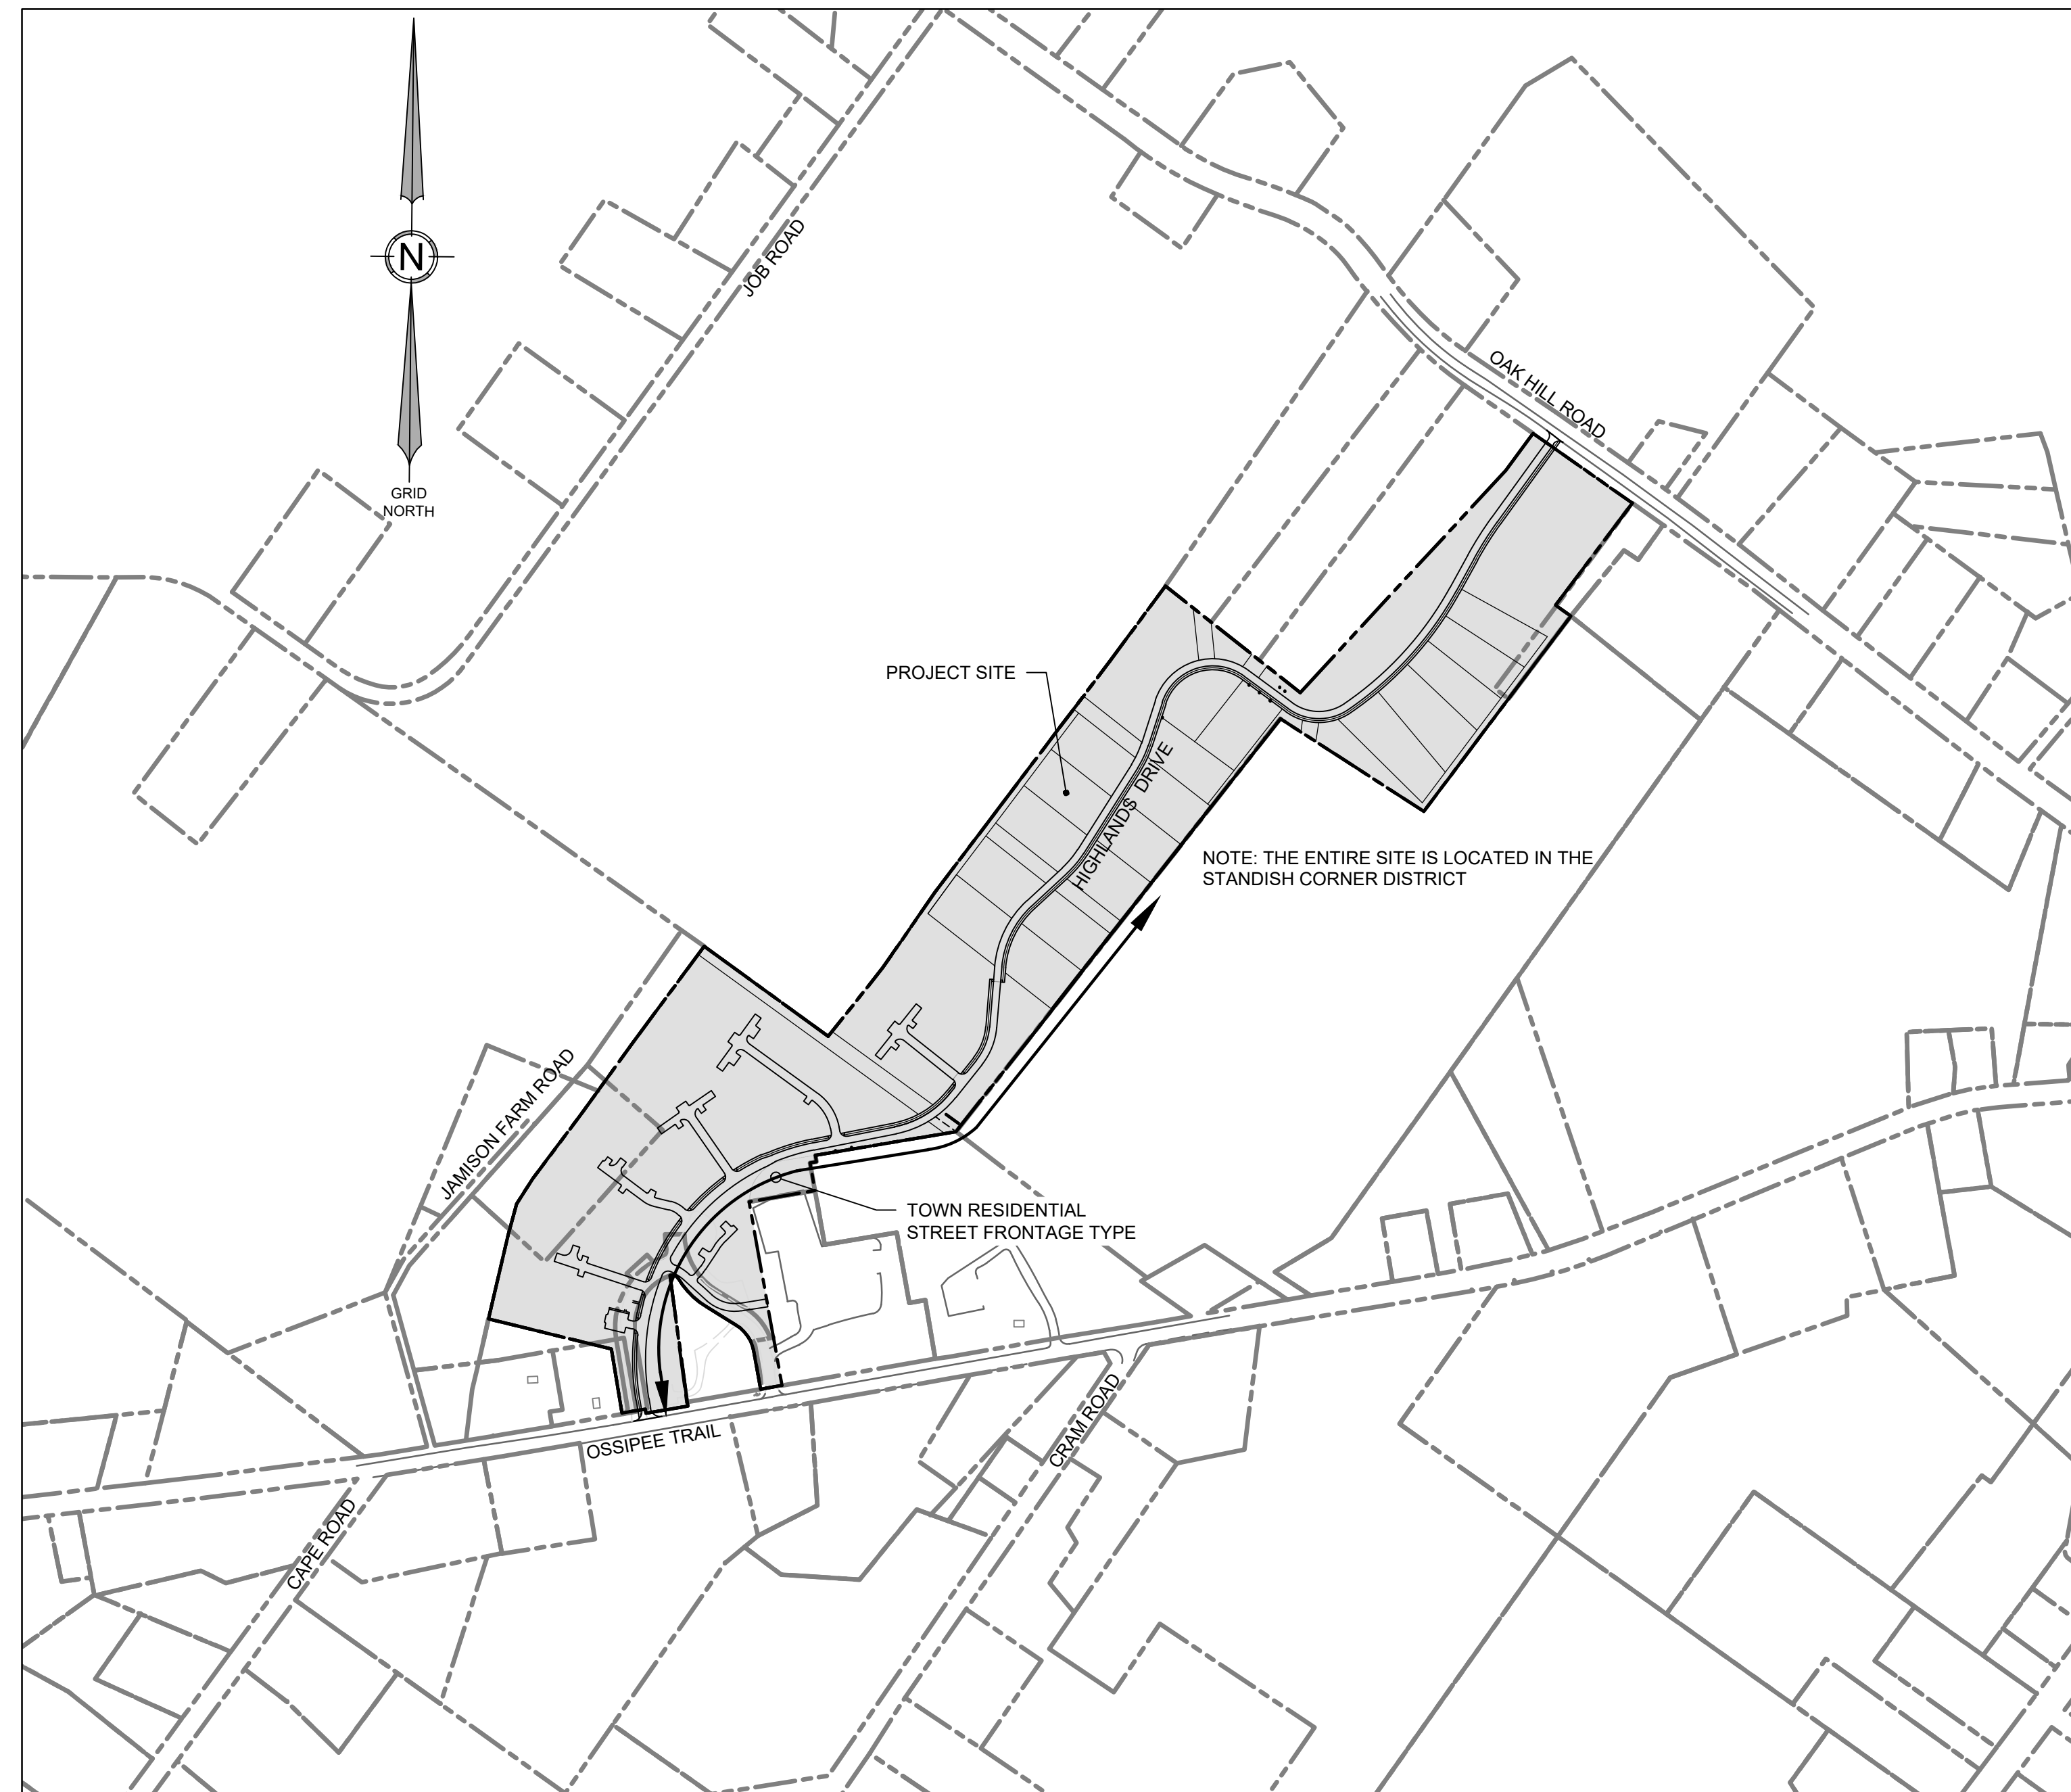


**LOCATION MAP**

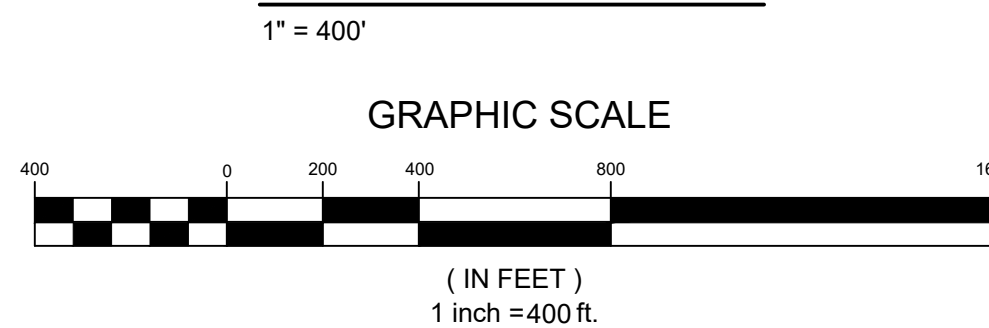

**SHEET INDEX**

0.0	COVER SHEET & LOCATION MAP
0.1	OVERALL PLAN & GENERAL NOTES
0.2	CONNECTIVITY MASTER PLAN
0.3	CONSTRUCTION PHASE PLAN
S-1.0	BOUNDARY SURVEY
S-1.1	BOUNDARY SURVEY
C-1.0	SUBDIVISION PLAN AND SITE PLAN FOR VILLAGE HOUSING
C-1.1	SUBDIVISION PLAN AND SITE PLAN FOR VILLAGE HOUSING
C-1.2	SUBDIVISION PLAN AND SITE PLAN FOR VILLAGE HOUSING
C-2.0	HIGHLANDS DRIVE LAYOUT PLAN
C-2.1	HIGHLANDS DRIVE LAYOUT PLAN
C-2.2	HIGHLANDS DRIVE LAYOUT PLAN
C-2.3	HIGHLANDS DRIVE LAYOUT PLAN
C-3.0	HIGHLANDS DRIVE GRADING PLAN
C-3.1	HIGHLANDS DRIVE GRADING PLAN
C-3.2	HIGHLANDS DRIVE GRADING PLAN
C-3.3	HIGHLANDS DRIVE GRADING PLAN
C-3.4	KAYLI SUSAN DRIVE GRADING PLAN
C-3.5	JESSE DANIEL DRIVE GRADING PLAN
C-3.6	WHITNEY DRIVE GRADING PLAN
C-3.7	INVERNESS DRIVE GRADING PLAN
C-3.8	STONEHAVEN DRIVE GRADING PLAN
C-4.0	HIGHLANDS DRIVE UTILITY PLAN
C-4.1	HIGHLANDS DRIVE UTILITY PLAN
C-4.2	HIGHLANDS DRIVE UTILITY PLAN
C-4.3	HIGHLANDS DRIVE UTILITY PLAN
C-5.0	HIGHLANDS DRIVE ROADWAY PROFILE
C-5.1	HIGHLANDS DRIVE ROADWAY PROFILE
C-5.2	HIGHLANDS DRIVE ROADWAY PROFILE
C-5.3	HIGHLANDS DRIVE ROADWAY PROFILE
C-5.4	VILLAGE HOUSING ROADWAY PROFILES
C-6.0	DETAILS
C-6.1	DETAILS
C-6.2	GRAVEL WETLAND DETAILS AND NOTES
C-6.3	FILTER BASIN #1 DETAILS AND NOTES
C-6.4	FILTER BASIN #2 DETAILS AND NOTES
C-6.5	FILTER BASIN #3 & #4 DETAILS AND NOTES
C-6.6	DRAINAGE DETAILS
C-6.7	EROSION CONTROL DETAILS AND NOTES
C-6.8	STANDARD WATER DETAILS
C-6.9	STANDARD WATER DETAILS
L-1.0	LANDSCAPING PLAN
L-1.1	LANDSCAPING PLAN
L-1.2	LANDSCAPING PLAN
L-1.3	LANDSCAPING PLAN

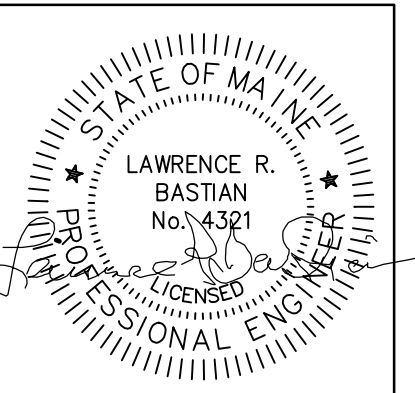

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS	BY
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN	LRB
2	12/12/2019	PRELIMINARY SUBDIVISION & SITE PLAN	LRB
3	3/29/2019	PRELIMINARY SUBDIVISION & SITE PLAN	LRB
4	11/26/2019	MIDEP SITE LOCATION APPLICATION	LRB
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW	LRB
6	2/13/2020	FINAL SUBDIVISION & SITE PLAN REVIEW	LRB
7	3/25/2020	PEER REVIEW COMMENT RESPONSE	LRB
8	4/15/2020	FINAL REVIEW	LRB

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
www.terradynconsultants.com

**TERRADYN CONSULTANTS, LLC**

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
COVER/LOCATION MAP  
PREPARED FOR  
LEAVITT-TOMPSON, LLC  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE: 3/15/2019  
SCALE: AS SHOWN  
DESIGNED: JDA  
JOB NO: 1804  
FILE: 1811 COVER.DWG  
SHEET **0.0**












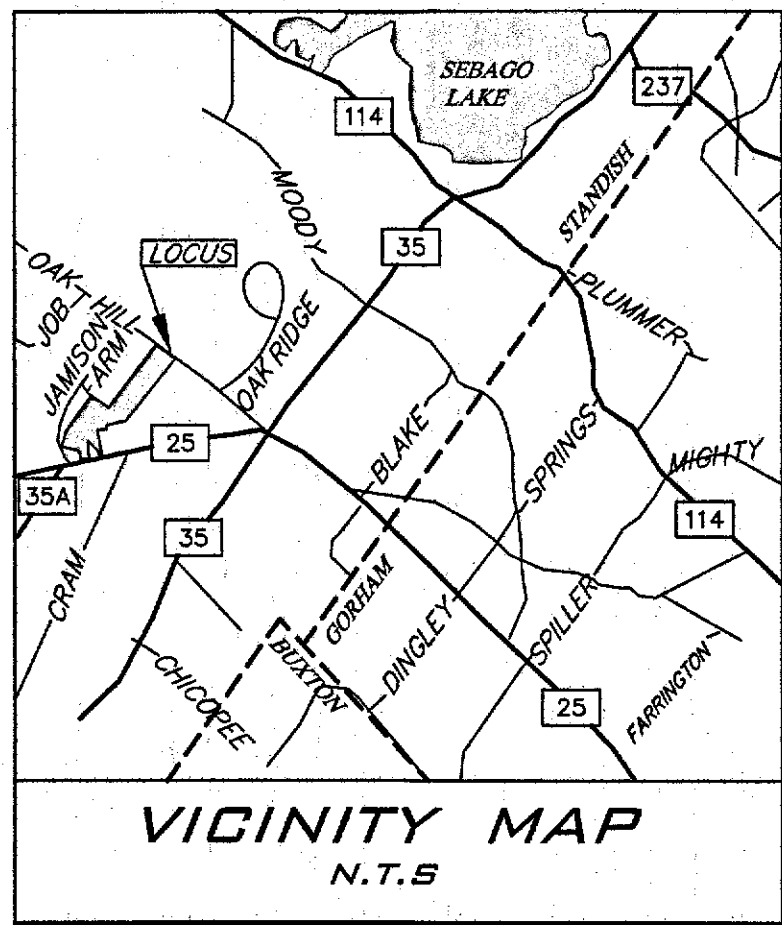

N/F  
FLOYD JAMISON  
&  
DONNA JAMISON  
11924/323  
6-31

N/F  
LEAVITT EARTHWORKS, INC.  
33450/41  
10-11  
41.0 Ac ±

N/F  
LISA M. PRATT  
8056/269  
6-31A

N/F  
KIMBERLY LAROCHE  
&  
JASON VETTERLINE  
32681/85  
10-11D

N/F  
CHRISTOPHER W. COFFIN  
&  
JASON VETTERLINE  
32216/142  
10-11C

ACCESS AND UTILITY EASEMENT AS  
CONVEYED TO OAK HILL ASSOCIATES  
AS DESCRIBED IN DEED BOOK 32934, PAGE 90  
SEE NOTE #4b & #5

60' PRIVATE WAY AS SHOWN  
ON PLAN REFERENCED IN  
NOTE 3b. SEE NOTE #5.


APPARENT FIRE TANK  
SEE NOTE #6

N/F  
OAK HILL ASSOCIATES  
32934/90  
10-11E

N/F  
LEAVITT DEVELOPMENT LLC  
21628/337  
10-11A


N/F  
STANDISH BAPTIST CHURCH  
9138/175  
10-11B

OSSIPPEE TRAIL

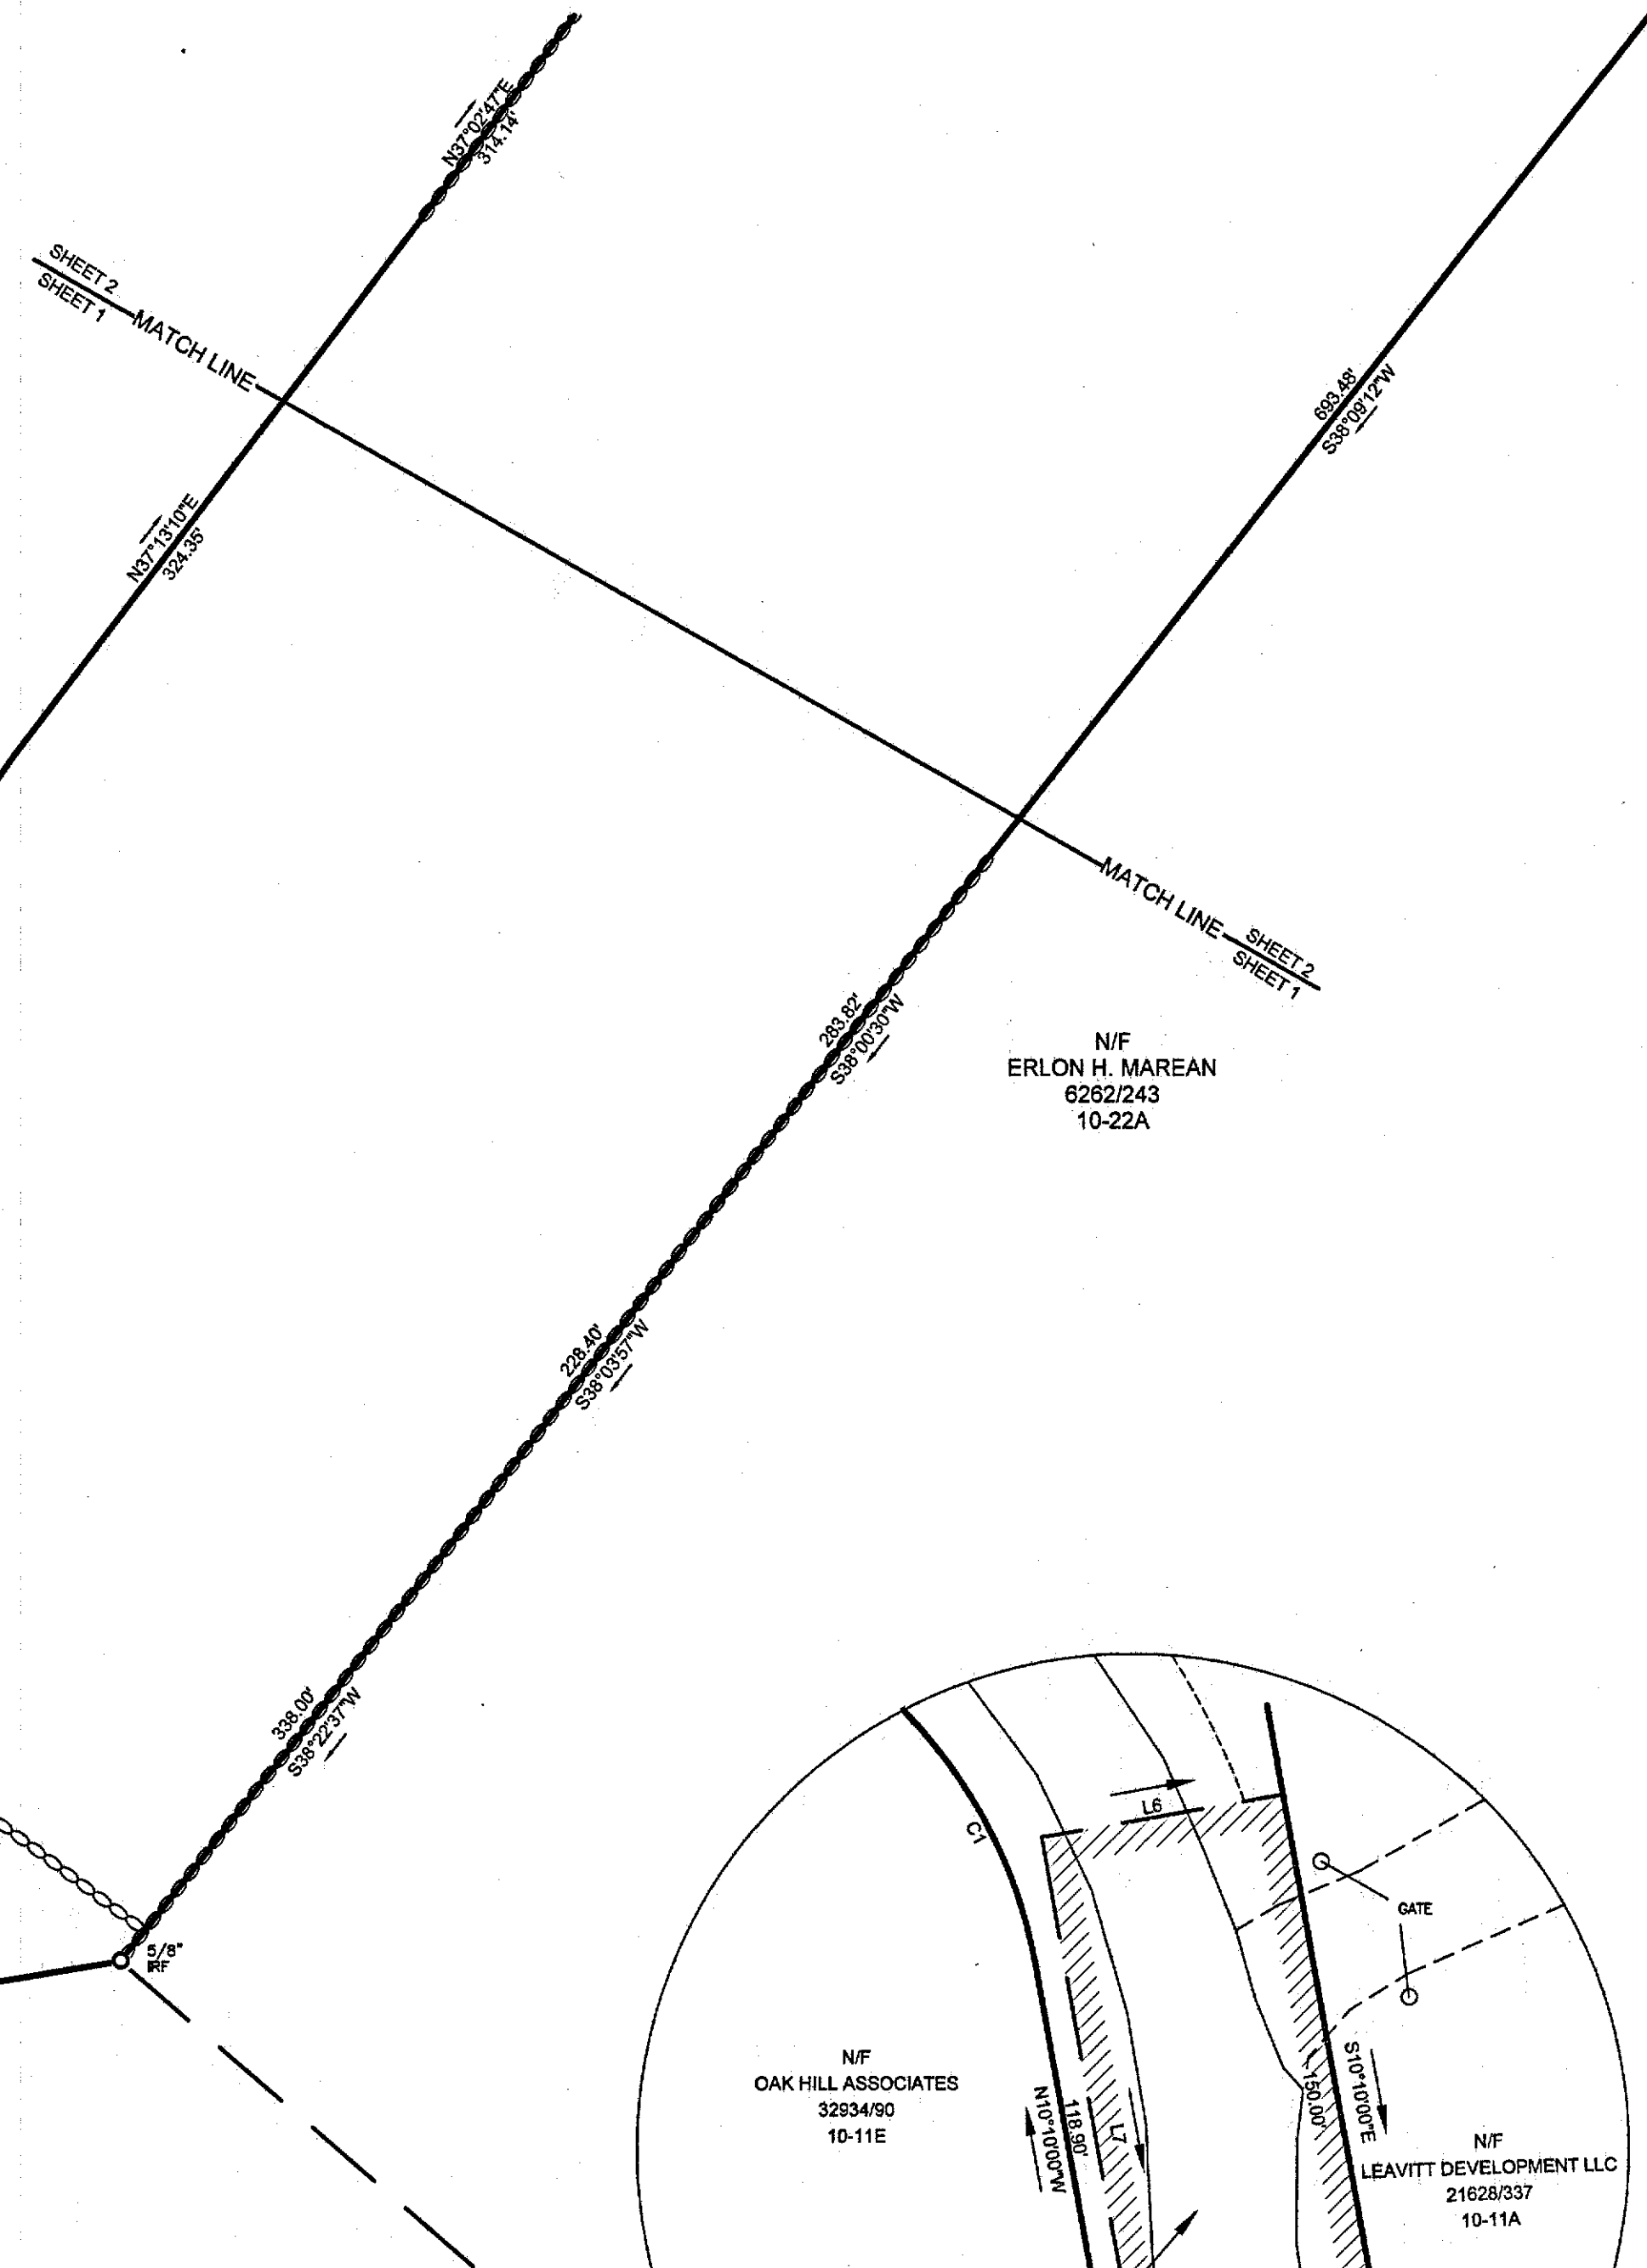

LINE	LENGTH	BEARING
L1	13.13	S09°51'56"E
L2	13.13	N09°25'27"W
L3	16.50	N35°35'45"E
L4	16.50	S37°00'34"W
L5	57.75	S54°56'01"E
L6	60.00	N73°50'00"E
L7	149.88	S10°10'00"E
L8	6.88	S80°08'05"W
L9	20.00	S10°10'00"E
L10	20.00	S80°25'40"W

CURVE	LENGTH	RADIUS	CHORD	CHORD BEARING
C1	101.15	120.00	98.18	N34°18'32"W
C2	128.08	265.00	124.89	S44°49'51"E
C3	27.87	20.00	25.67	N71°07'19"W

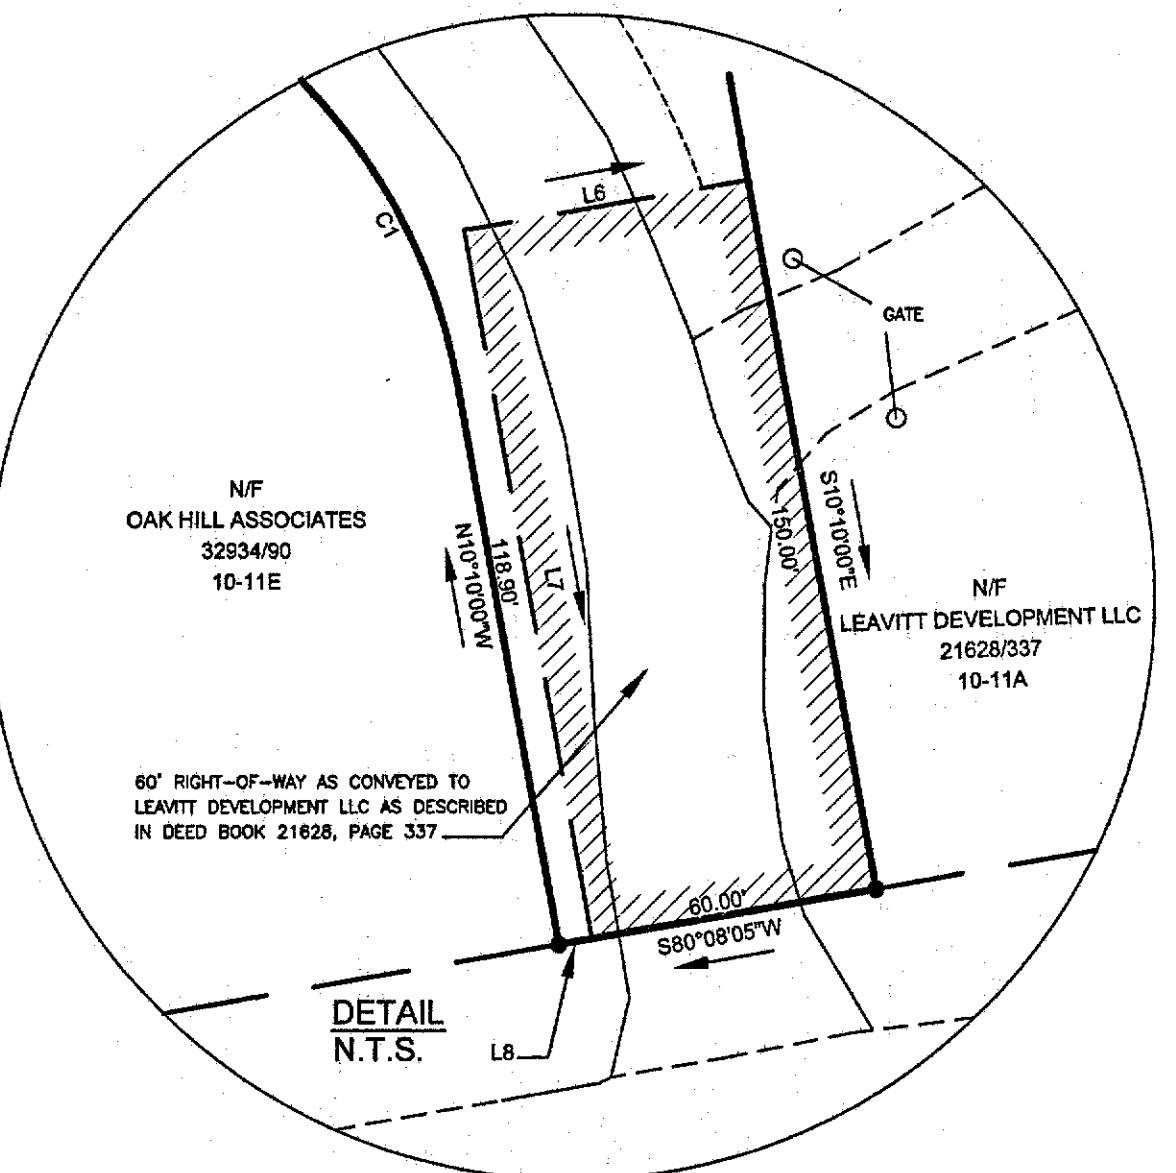

LEGEND

- #5 REBAR WITH PLASTIC CAP STAMPED BEST 2336 TO BE SET
- FOUND REBAR WITH CAP (RBC) STAMPING AS NOTED
- FOUND IRON PIPE (IPF) IRON ROD (IRF) SIZE AS NOTED
- UTILITY POLE (NUMBERED AS SHOWN)
- (123.45) PARENTHESES DENOTE RECORD DATA
- ○ ○ ○ ○ STONE WALL
- ABUTTER OR RIGHT-OF-WAY LINE
- BOUNDARY LINE
- N/F NOW OR FORMERLY OWNED BY
- TRAVELED WAY
- 1234/567 DEED BOOK AND PAGE CUMBERLAND COUNTY REGISTRY OF DEEDS
- 45-6-78 TAX MAP-BLOCK-LOT

NOTES

1. BEARINGS BASED UPON GRID NORTH AS ESTABLISHED BY STATIC GPS OBSERVATIONS AND POST PROCESSING.
2. OWNERSHIP OF THE PROPERTY'S SHOWN CAN BE FOUND IN THE FOLLOWING DEEDS OF RECORD:
  - a. DEED OF #1 NORTHEAST ROAD, LLC TO LEAVITT EARTHWORKS DATED SEPTEMBER 28, 2016 AND RECORDED IN DEED BOOK 33450, PAGE 41 AT THE CUMBERLAND COUNTY REGISTRY OF DEEDS (CCRD).
  - b. DEED OF MICHAEL A. KENISON TO TOMPSON DEVELOPMENT INC. DATED JULY 20, 2016 AND RECORDED IN DEED BOOK 33284, PAGE 157 CCRD.
  - c. DEED OF THE TOWN OF STANDISH TO TOMPSON DEVELOPMENT, INC. DATED MARCH 22, 2017 AND RECORDED IN DEED BOOK 33929, PAGE 157 CCRD.
3. PLAN REFERENCES:
  - a. PLAN ENTITLED STATE OF MAINE DEPARTMENT OF TRANSPORTATION RIGHT-OF-WAY MAP STATE HIGHWAY "12" (ROUTE 25) STANDISH CUMBERLAND COUNTY. FEDERAL AID PROJECT NO. STP-2847(12)X. D.O.T. FILE NO. 3-474, DATED JULY 2001.
  - b. PLAN ENTITLED RT. 25 BUSINESS PARK ROUTE 25 STANDISH, MAINE, DATED NOVEMBER 17, 2008. PREPARED BY SYTDESIGN CONSULTANTS. UNRECORDED, ON FILE AT THE TOWN OF STANDISH.
4. THE PARCEL OF LAND AS DESCRIBED IN NOTE 2a IS SUBJECT TO CERTAIN EASEMENTS AS DESCRIBED IN THE FOLLOWING DEEDS:
  - a. ACCESS AND UTILITY EASEMENT GRANTED TO LEAVITT DEVELOPMENT, LLC DATED JULY 29, 2004 AND DESCRIBED IN DEED BOOK 21628, PAGE 337.
  - b. ACCESS AND UTILITY EASEMENT GRANTED TO OAK HILL ASSOCIATES, LLC DATED FEBRUARY 23, 2016 AND DESCRIBED IN DEED BOOK 32934, PAGE 90 CCRD. THIS EASEMENT IS DESCRIBED AS "THIS CONVEYANCE IS MADE WITH RIGHTS IN COMMON WITH OTHERS IN AND TO A PRIVATE RIGHT OF WAY RUNNING NORTHERLY AND NORTHWESTERLY FROM SAID OSSIPPEE TRAIL ALONG THE ENTIRE EASTERLY AND NORTHEASTERLY SIDELINE OF THE ABOVE DESCRIBED LOT. THIS RIGHT OF WAY IS INTENDED TO BE USED FOR ANY AND ALL PURPOSES FOR WHICH A TOWN ROAD WOULD BE USED INCLUDING UTILITIES." OUR RESEARCH DID NOT FIND ADDITIONAL DOCUMENTS REGARDING THIS PRIVATE WAY. IT IS OUR OPINION THAT A PORTION OF THE PRIVATE RIGHT OF WAY AS SHOWN ON PLAN REFERENCED IN NOTE 3b WAS INTENDED TO SERVE AS THIS EASEMENT. WE ARE UNABLE TO DETERMINE THE EXACT SIZE OR LIMITS OF THIS EASEMENT.
5. THIS 60' PRIVATE WAY AS SHOWN IS DEPICTED ON THE PLAN REFERENCED IN NOTE 3b. OUR RESEARCH INDICATES THAT THIS PLAN WAS NOT APPROVED BY THE TOWN OF STANDISH PLANNING BOARD AND NO ADDITIONAL DOCUMENTS WERE FOUND REGARDING THE STATUS OF THIS PRIVATE WAY.
6. THE TOWN OF STANDISH PLANNING DEPARTMENT INDICATES THAT THE FIRE TANK WAS INSTALLED AS A REQUIREMENT FOR A PRIOR PROPOSED DEVELOPMENT AS SHOWN ON PLAN REFERENCED IN NOTE 3b. THIS PROPOSED DEVELOPMENT DID NOT RECEIVE APPROVAL FROM THE TOWN OF STANDISH PLANNING BOARD. OUR RESEARCH DID NOT REVEAL ANY DOCUMENTS REGARDING THE USE OF THE FIRE TANK.


BOUNDARY SURVEY  
ON  
ROUTE 25 & OAK HILL ROAD  
IN  
STANDISH  
CUMBERLAND COUNTY  
MAINE

SCALE: 1"=100' AUGUST 25, 2017

OWNERS OF RECORD:  
LEAVITT EARTHWORKS, LLC TOMPSON DEVELOPMENT, INC.  
191 OSSIPPEE TRAIL 85 HI VU DRIVE  
STANDISH, MAINE 04084 STANDISH, MAINE 04084


BOUNDARY ENGINEERING SURVEY TECHNOLOGY  
25 TUBROG LANE  
BUXTON, MAINE 04093  
TELEPHONE 929-BEST  
FAX 929-2379


JOB NUMBER: 016-029 DRAWING FILE: FINAL BOUNDARY



CERTIFICATION

THIS SURVEY COMPLIES WITH THE MAINE BOARD OF LICENSURE FOR PROFESSIONAL LAND SURVEYORS RULES AS OUTLINED IN CHAPTER 90, PART 2 (TECHNICAL STANDARDS) WITH THE FOLLOWING EXCEPTIONS:  
1- NO WRITTEN REPORT PREPARED.  
2- MONUMENTS NOT SET AS OF THE DATE OF THIS PLAN.  
3- NO LEGAL DESCRIPTION PREPARED

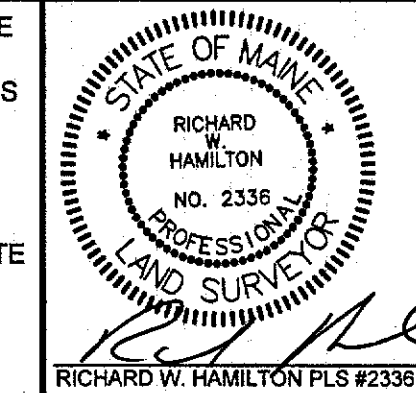

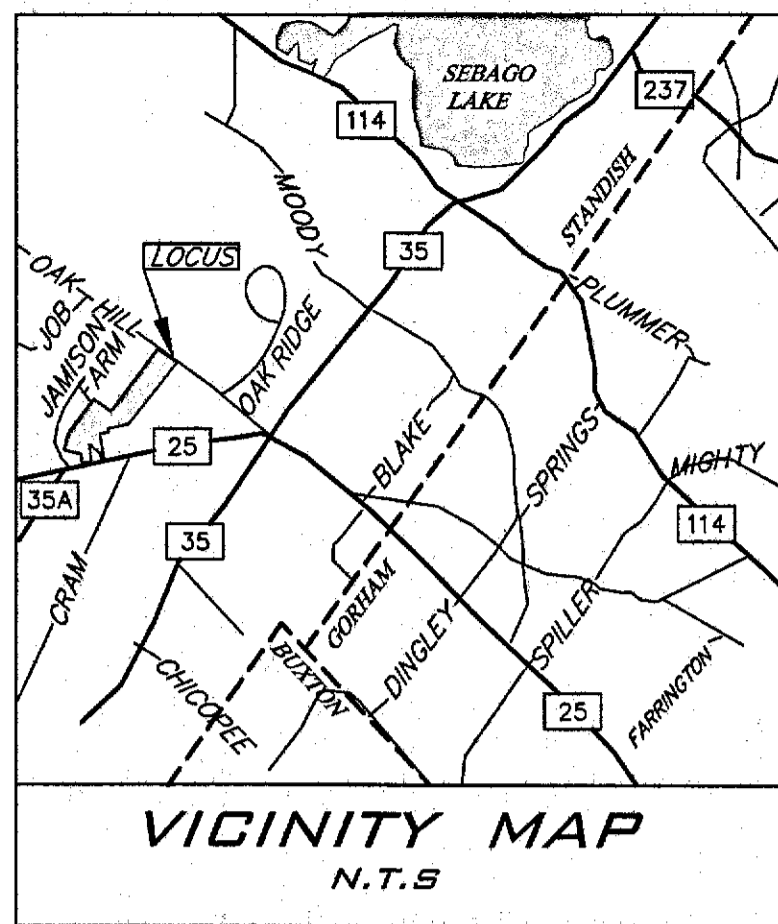


**LEGEND**

- #5 REBAR WITH PLASTIC CAP STAMPED  
BEST 2336" TO BE SET
- FOUND REBAR WITH CAP (RBC) STAMPING AS NOTED
- FOUND IRON PIPE (IP) IRON ROD (IR) SIZE AS NOTED
- UTILITY POLE (NUMBERED AS SHOWN)
- (123.45) PARENTHESES DENOTE RECORD DATA
- STONE WALL
- ABUTTER OR RIGHT-OF-WAY LINE
- BOUNDARY LINE
- N/F NOW OR FORMERLY OWNED BY
- TRAVELED WAY
- 1234/567 DEED BOOK AND PAGE CUMBERLAND COUNTY REGISTRY OF DEEDS
- 45-6-78 TAX MAP-BLOCK-LOT

**NOTES**

SEE SHEET 1 FOR COMPLETE NOTES PERTAINING TO THIS PLAN

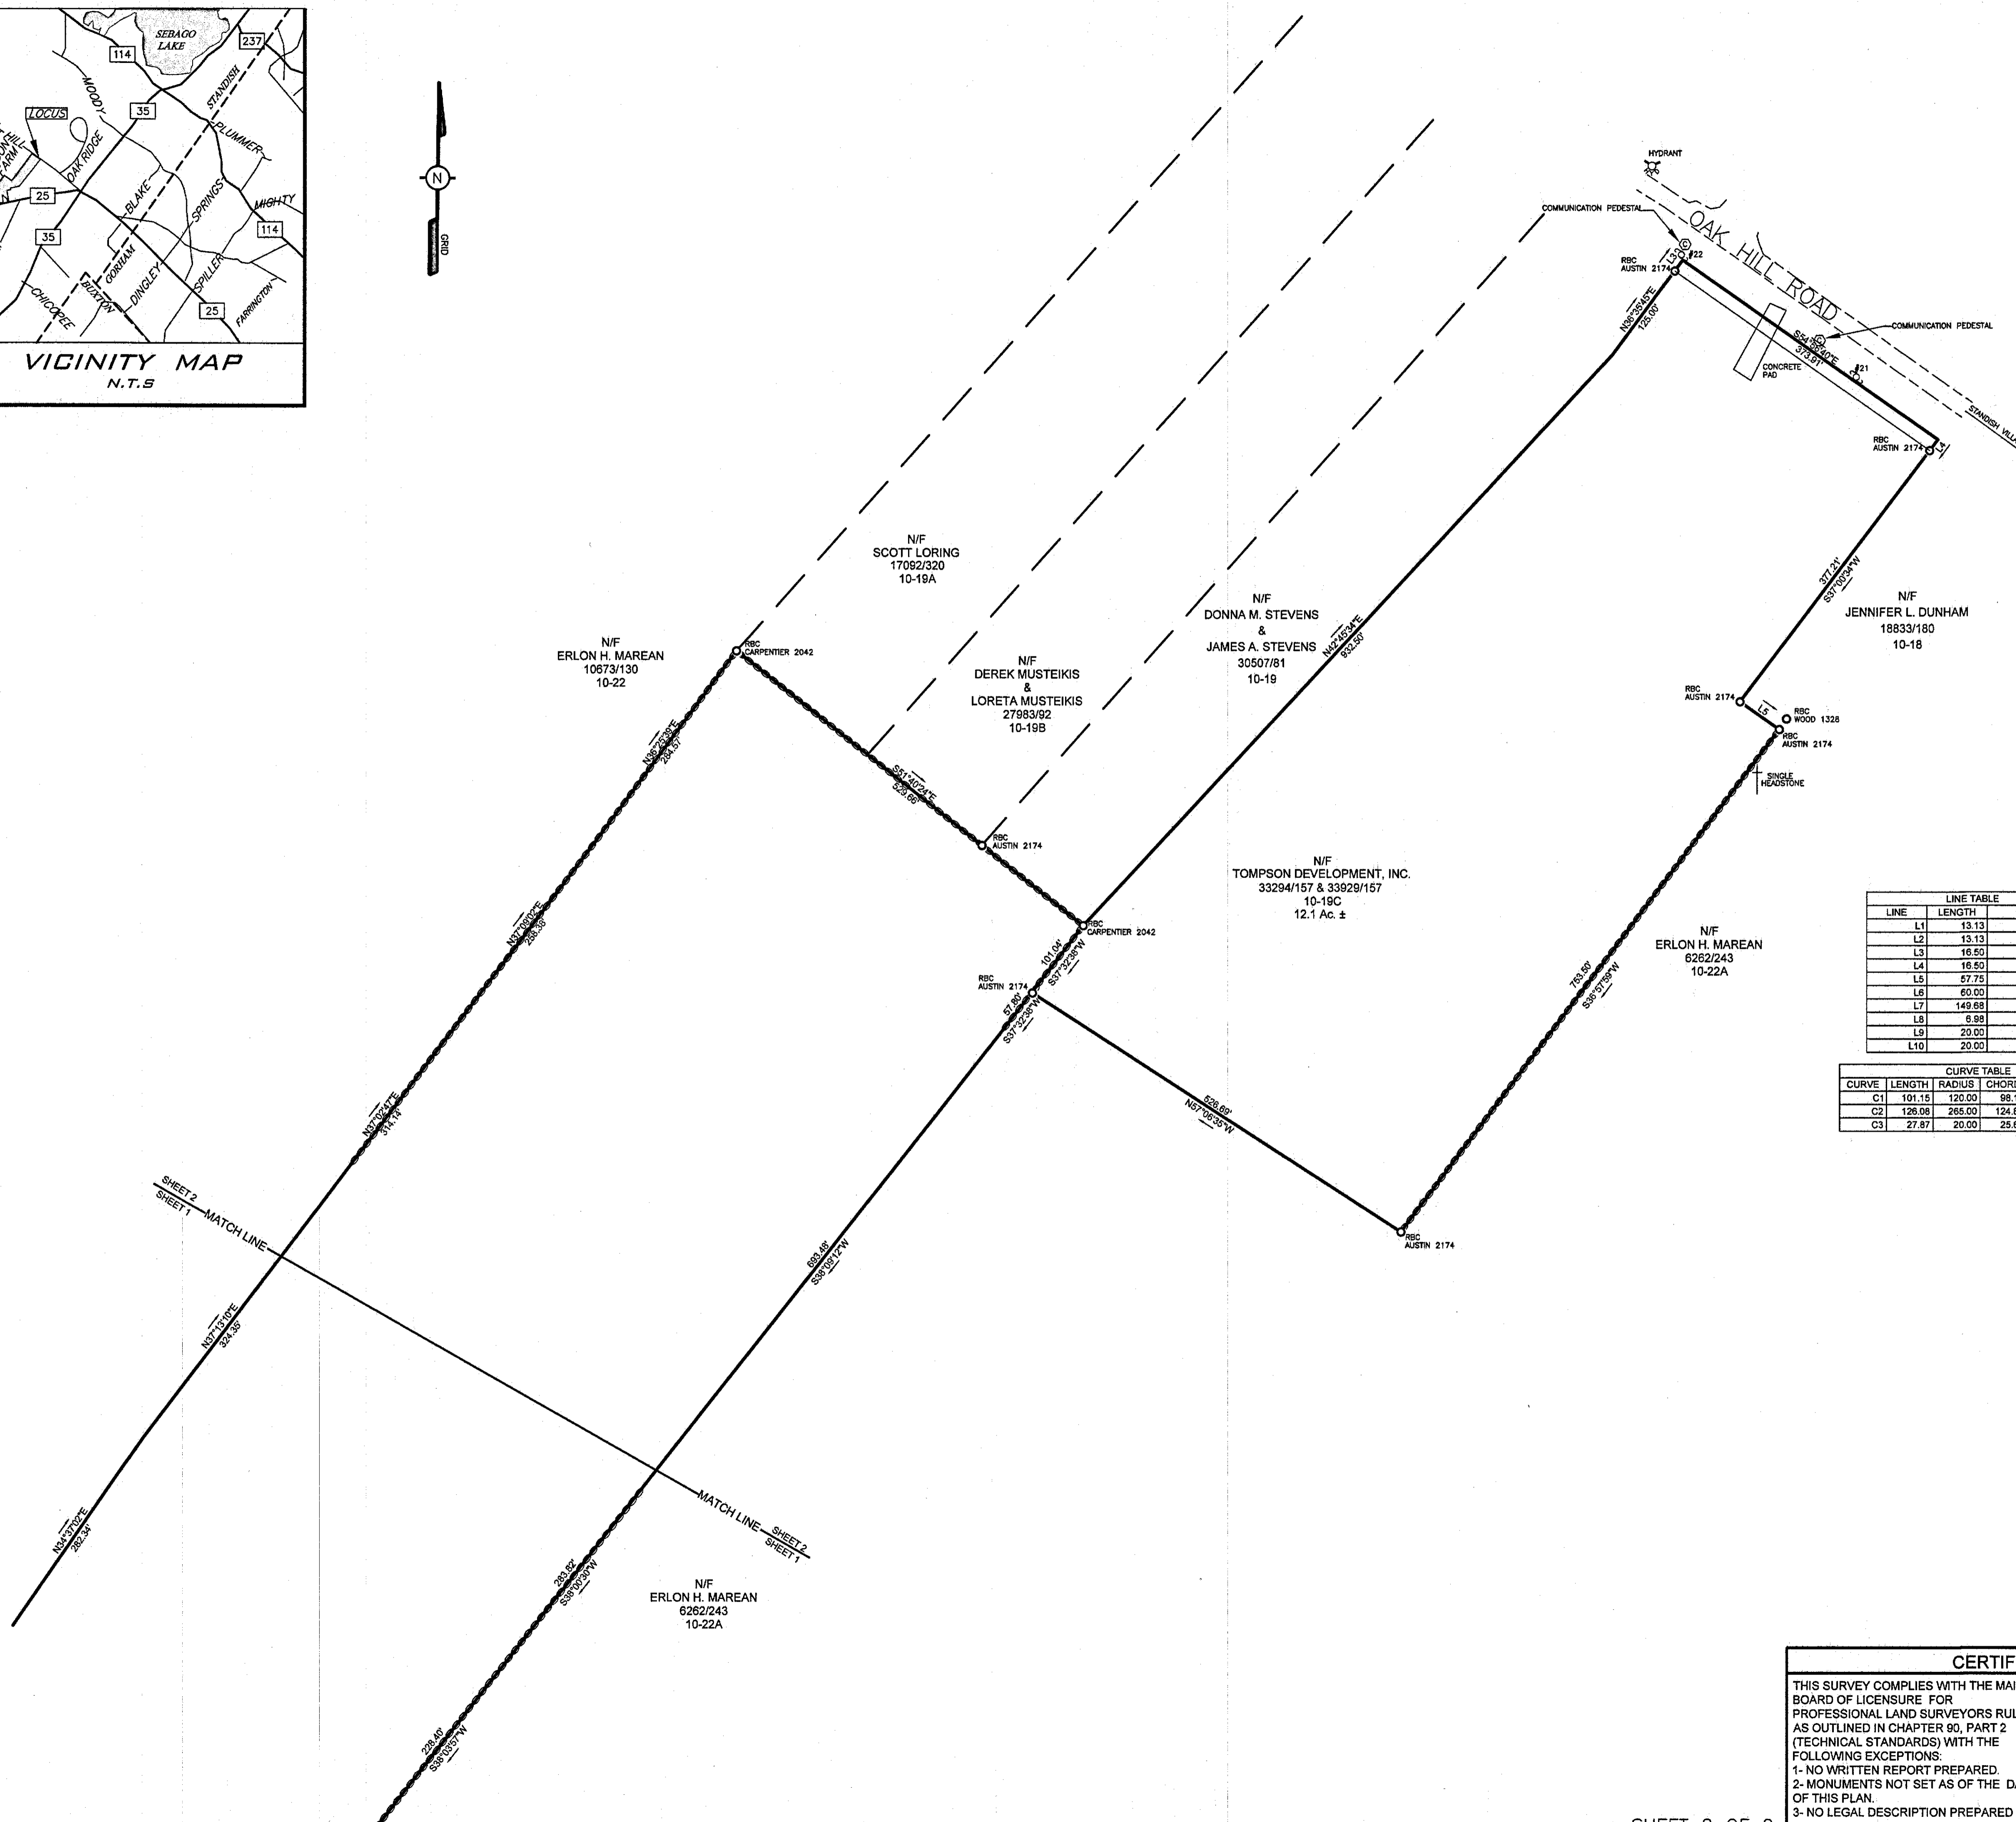

LINE TABLE		
LINE	LENGTH	BEARING
L1	13.13	S09°51'55"E
L2	13.13	N03°25'27"W
L3	16.60	N38°35'45"E
L4	16.60	S37°00'34"W
L5	57.75	S54°56'01"E
L6	60.00	N79°50'00"E
L7	149.68	S10°10'00"E
L8	6.98	S80°08'05"W
L9	20.00	S10°10'00"E
L10	20.00	S80°25'40"W

CURVE TABLE				
CURVE	LENGTH	RADIUS	CHORD	CHORD BEARING
C1	101.15	120.00	98.18	N34°18'52"W
C2	128.08	265.00	124.89	S44°49'51"E
C3	27.87	20.00	25.67	N71°07'19"W


BOUNDARY SURVEY  
ON  
ROUTE 25 & OAK HILL ROAD  
IN  
STANDISH  
CUMBERLAND COUNTY  
MAINE

SCALE: 1"=100' AUGUST 25, 2017

OWNERS OF RECORD:  
LEAVITT EARTHWORKS, LLC 191 OSSIPEE TRAIL STANDISH, MAINE 04084  
TOMPSON DEVELOPMENT, INC. 85 H VU DRIVE STANDISH, MAINE 04084

**CERTIFICATION**

THIS SURVEY COMPLIES WITH THE MAINE BOARD OF LICENSURE FOR PROFESSIONAL LAND SURVEYORS RULES AS OUTLINED IN CHAPTER 90, PART 2 (TECHNICAL STANDARDS) WITH THE FOLLOWING EXCEPTIONS:  
1- NO WRITTEN REPORT PREPARED.  
2- MONUMENTS NOT SET AS OF THE DATE OF THIS PLAN.  
3- NO LEGAL DESCRIPTION PREPARED

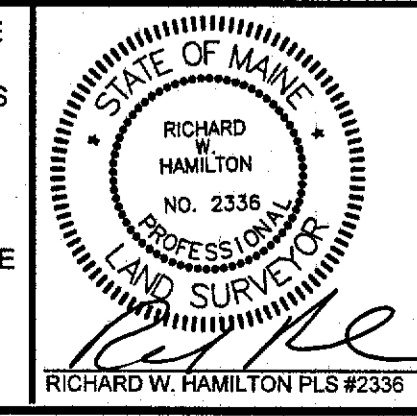


BOUNDARY ENGINEERING SURVEY TECHNOLOGY  
25 TUBROS LANE  
BUXTON, MAINE 04093  
TELEPHONE 929-9587  
FAX 929-2379

JOB NUMBER: 016-029 DRAWING FILE: FINAL BOUNDARY





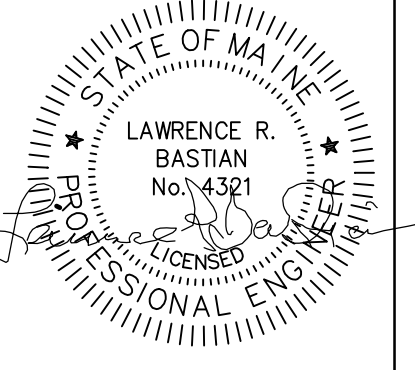

SIGNATURE DATE: 1/15/2020

LRB	BY	NO.	DATE
FINAL REVIEW		8	4/15/2020
REVISED PER TOWN COMMENTS		7	3/25/2020
PEER REVIEW COMMENT RESPONSE		6	2/13/2020
FINAL SUBDIVISION & SITE PLAN REVIEW		5	1/15/2020
REVISED PER MDEP REVIEW COMMENTS		4	11/26/2019
MDEP SITE LOCATION APPLICATION		3	3/29/2019
PRELIMINARY SUBDIVISION & SITE PLAN		2	1/21/2019
PRELIMINARY SUBDIVISION & SITE PLAN		1	11/13/2018

NO.	DATE
8	4/15/2020
7	3/25/2020
6	2/13/2020
5	1/15/2020
4	11/26/2019
3	3/29/2019
2	1/21/2019
1	11/13/2018

585 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
www.terradync consultants.com




CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
**HIGHLANDS SUBDIVISION  
STANDISH, MAINE**  
SUBDIVISION AND SITE PLAN FOR VILLAGE HOUSING

PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE:	3/15/2019
SCALE:	
DESIGNED:	JDA
JOB NO:	1804
FILE:	1804 B.DWG
SHEET	<b>C-1.0</b>

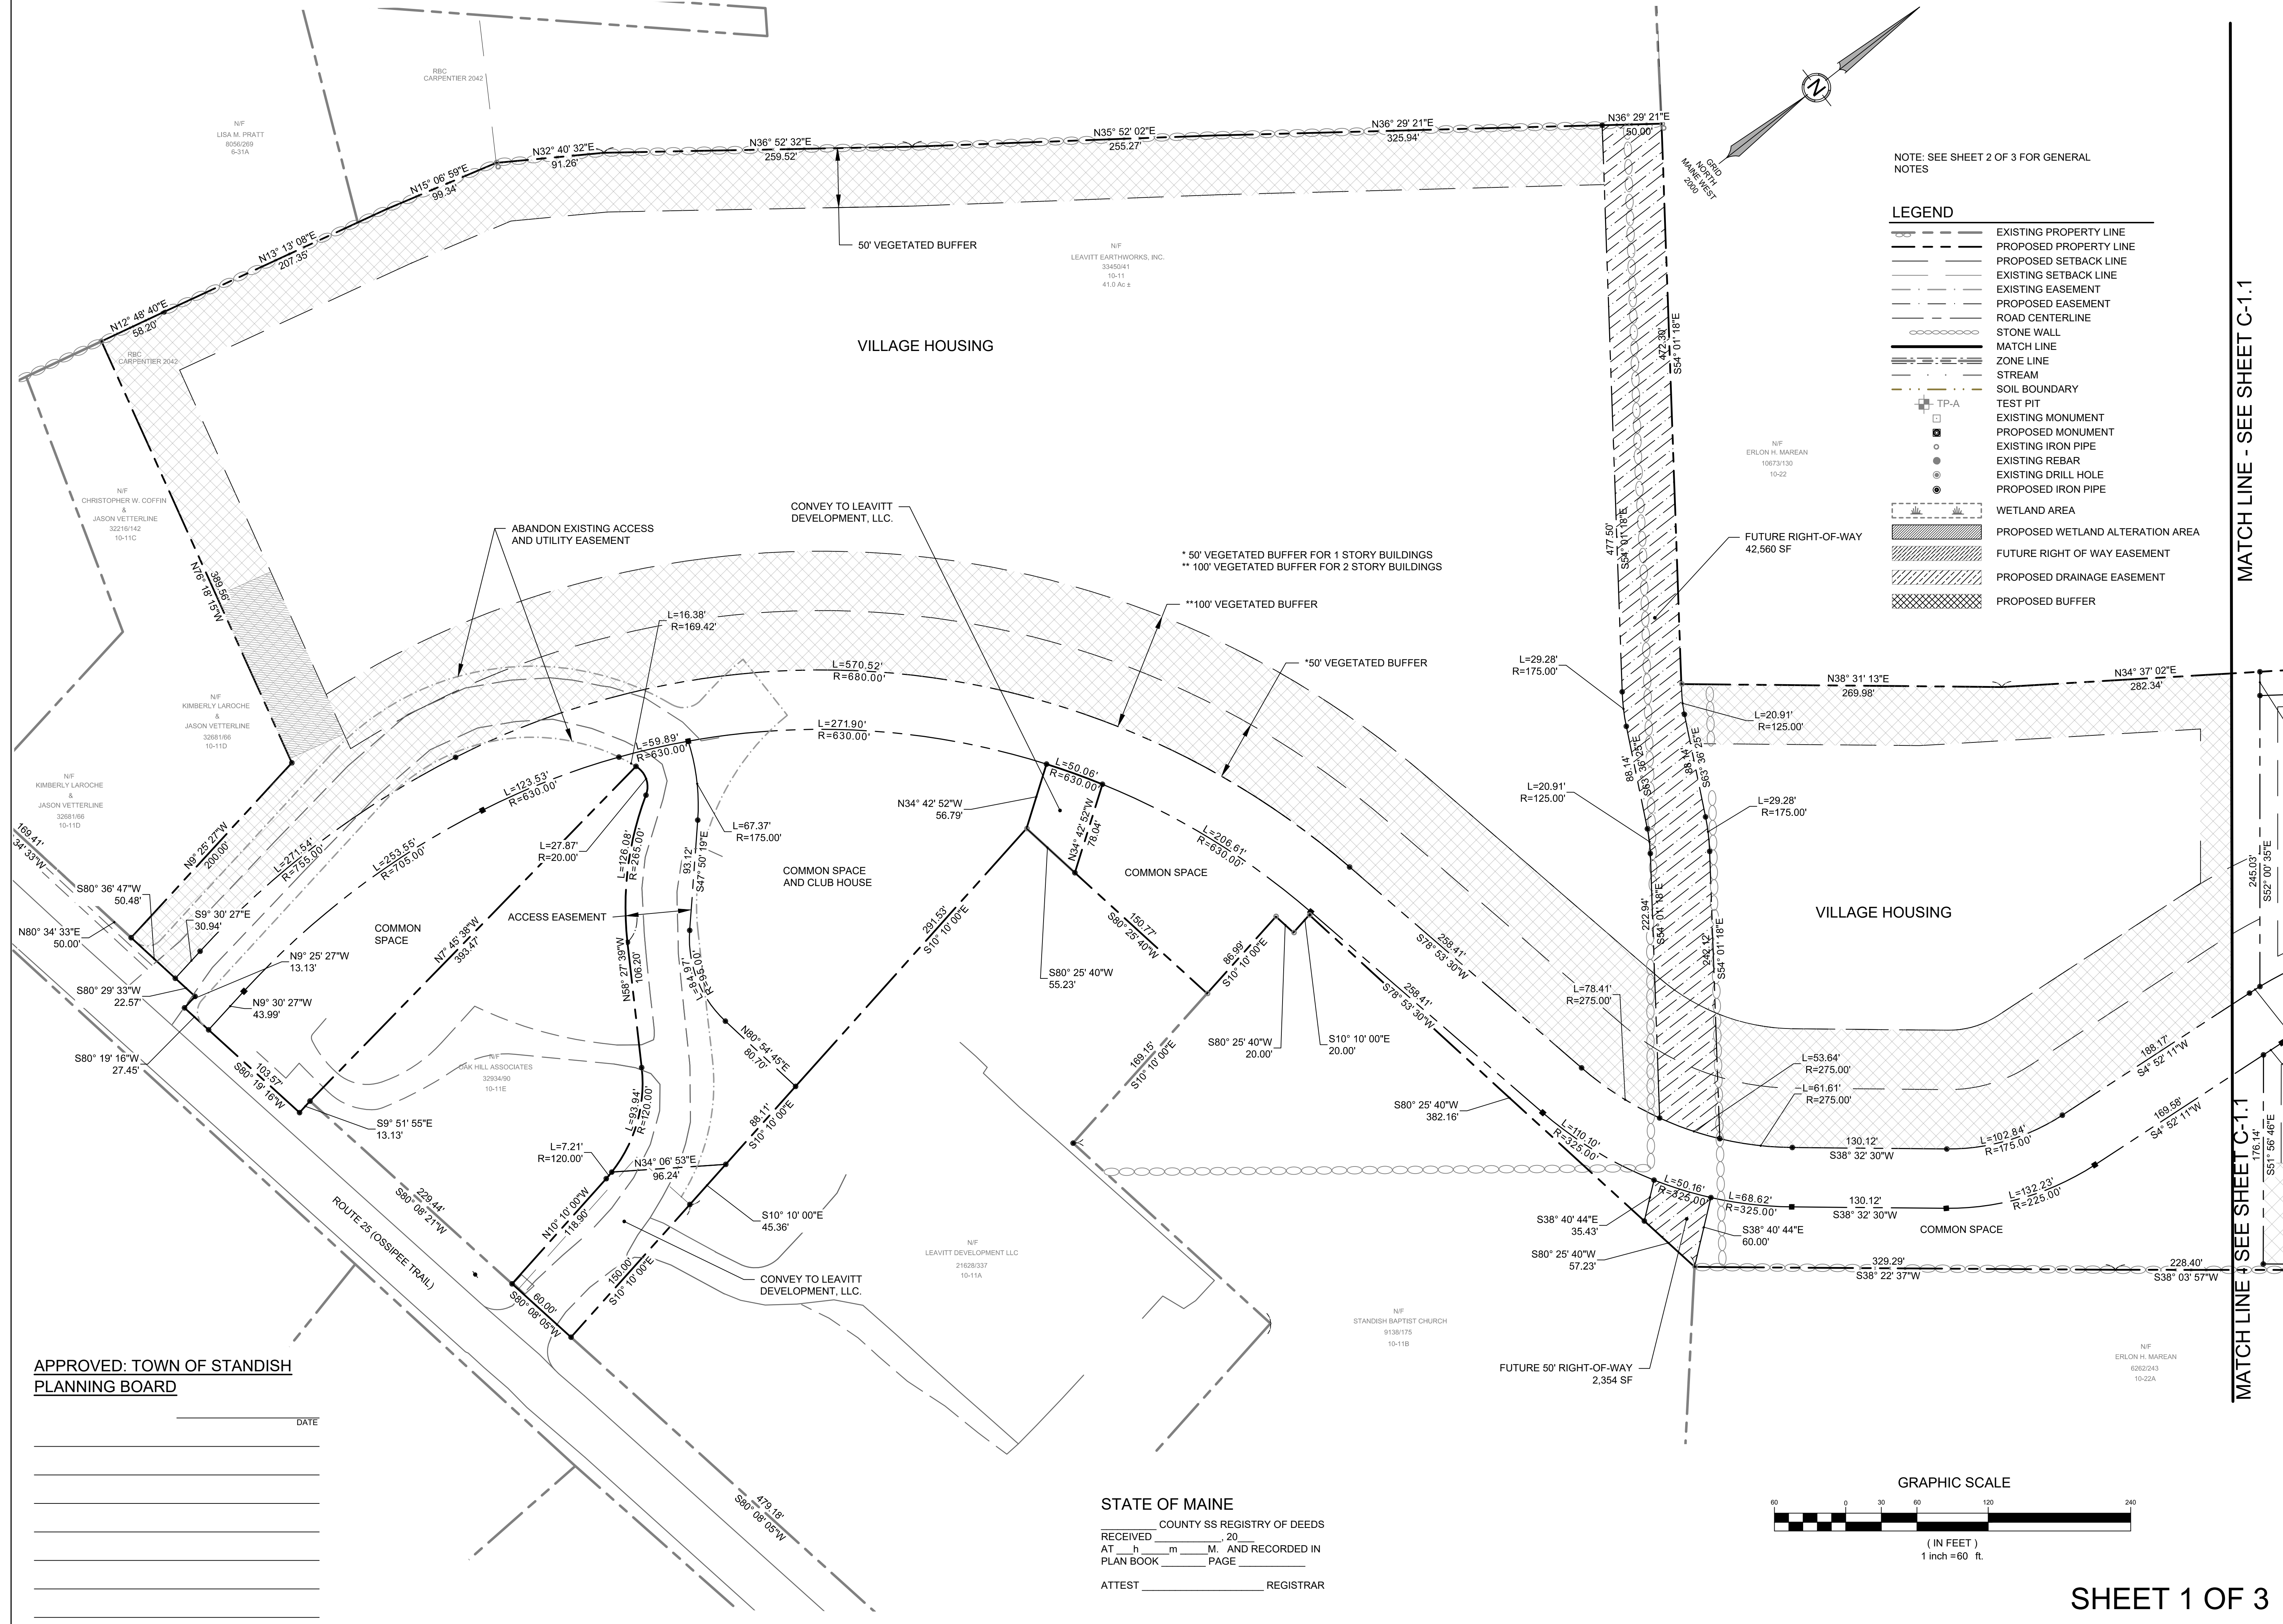

NOTE: SEE SHEET 2 OF 3 FOR GENERAL NOTES

**LEGEND**

- EXISTING PROPERTY LINE
- PROPOSED PROPERTY LINE
- PROPOSED SETBACK LINE
- EXISTING SETBACK LINE
- EXISTING EASEMENT
- PROPOSED EASEMENT
- ROAD CENTERLINE
- STONE WALL
- MATCH LINE
- ZONE LINE
- STREAM
- SOIL BOUNDARY
- TEST PIT
- EXISTING MONUMENT
- PROPOSED MONUMENT
- EXISTING IRON PIPE
- EXISTING REBAR
- EXISTING DRILL HOLE
- PROPOSED IRON PIPE
- WETLAND AREA
- PROPOSED WETLAND ALTERATION AREA
- FUTURE RIGHT OF WAY EASEMENT
- PROPOSED DRAINAGE EASEMENT
- PROPOSED BUFFER


MATCH LINE - SEE SHEET C-1.1

MATCH LINE - SEE SHEET C-1.1

APPROVED: TOWN OF STANDISH PLANNING BOARD

DATE	

STATE OF MAINE  
COUNTY SS REGISTRY OF DEEDS  
RECEIVED \_\_\_\_\_ 20\_\_\_\_  
AT \_\_\_\_\_ h \_\_\_\_\_ m \_\_\_\_\_ M. AND RECORDED IN  
PLAN BOOK \_\_\_\_\_ PAGE \_\_\_\_\_  
ATTEST \_\_\_\_\_ REGISTRAR


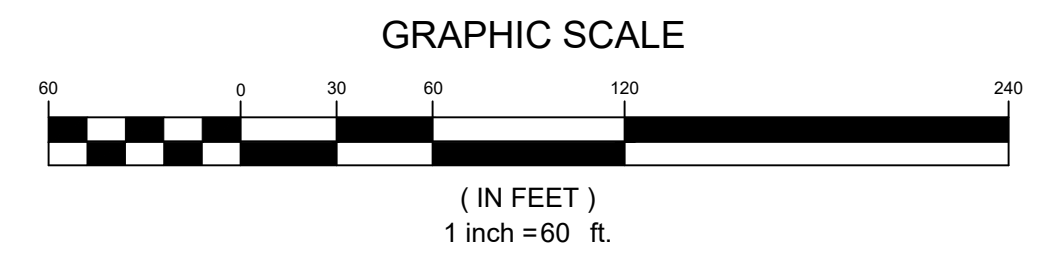










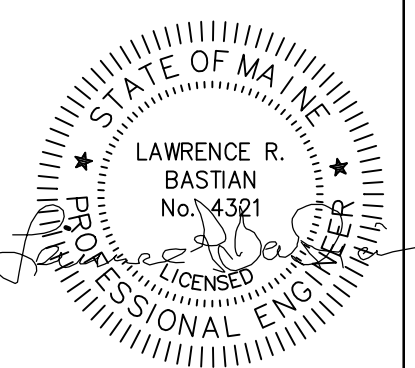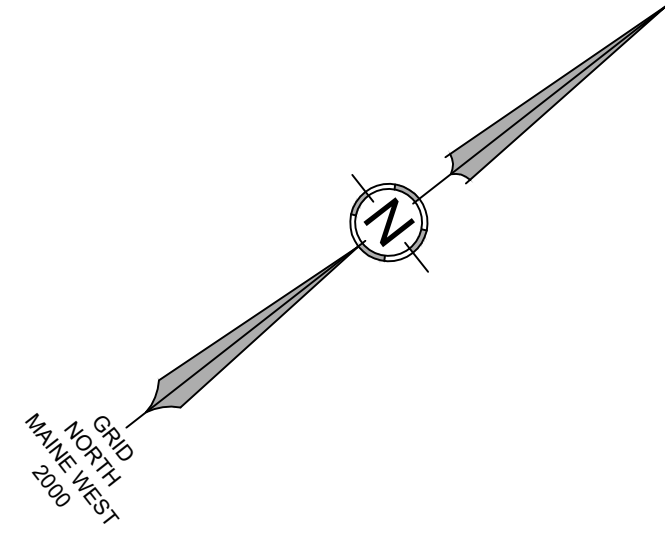

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	12/17/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	12/17/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
www.terradynconsultants.com


**TERRADYN**  
CONSULTANTS, LLC

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
**HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
HIGHLANDS DRIVE LAYOUT PLAN**

PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE: 3/15/2019  
SCALE: 1"=40'  
DESIGNED: JDA  
JOB NO: 1804  
FILE: 1804 S.DWG  
SHEET **C-2.0**

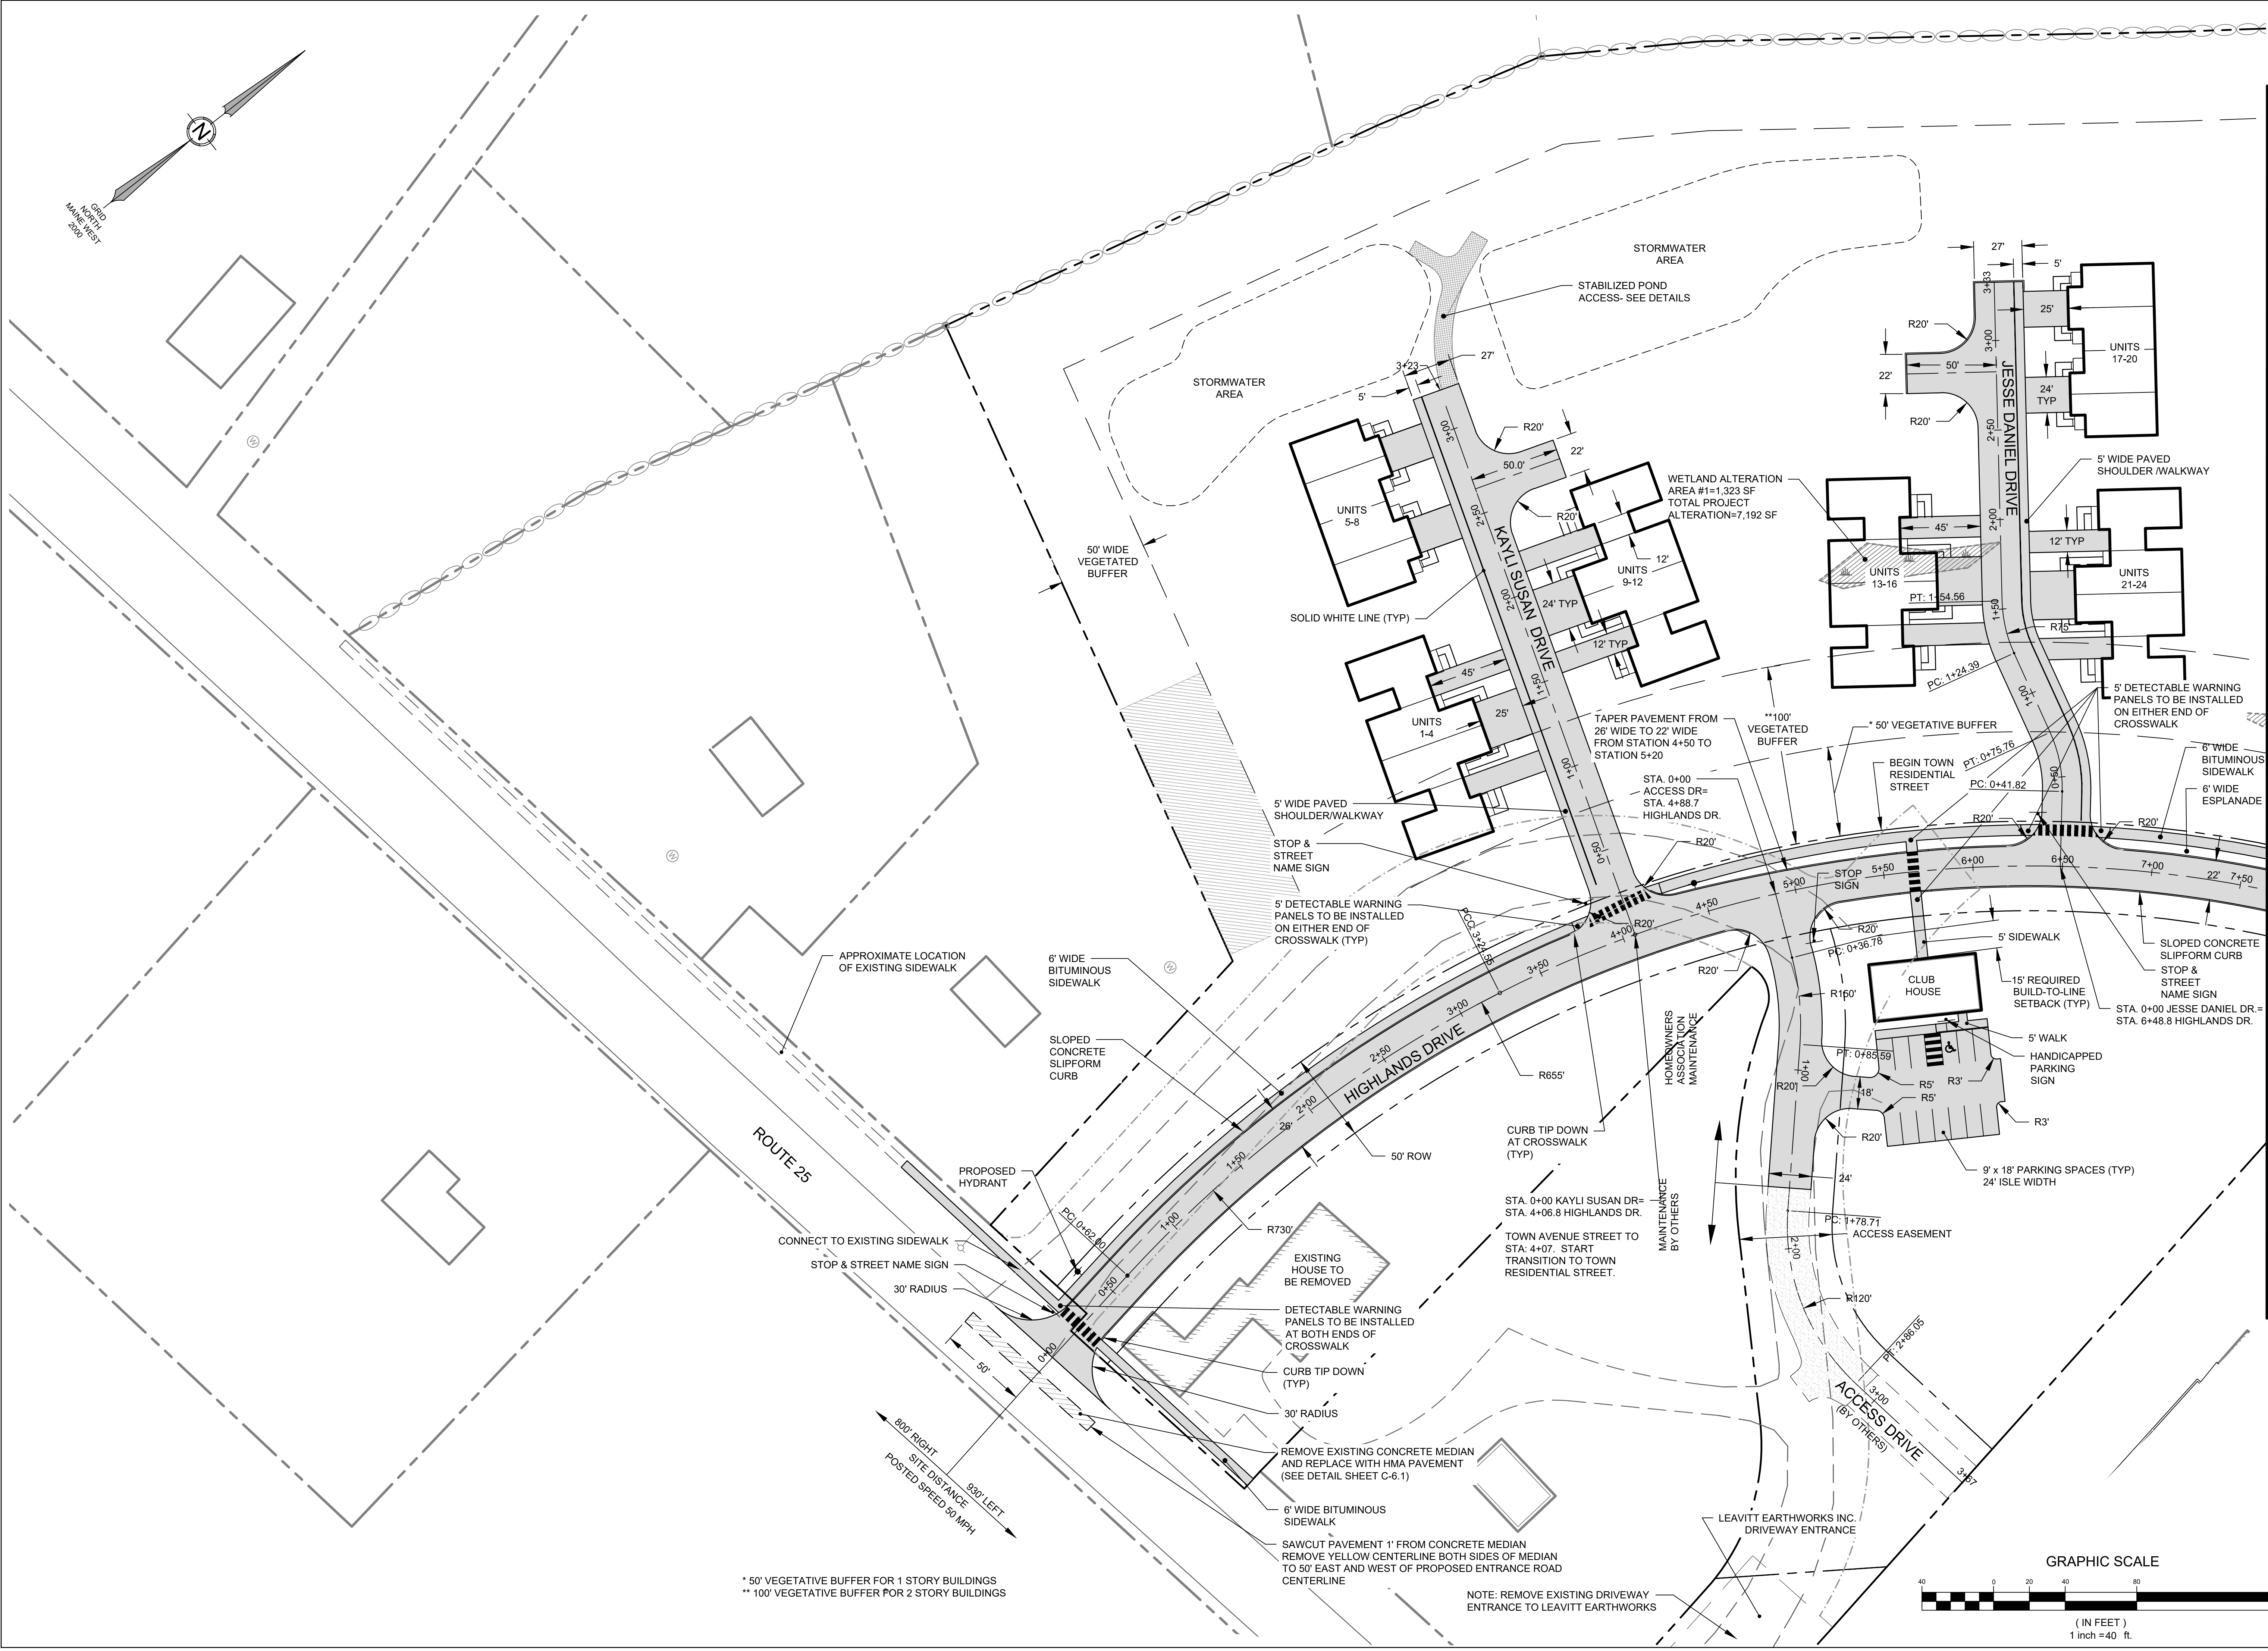



MATCH LINE - SEE SHEET C-2.1

MATCH LINE - SEE SHEET C-2.1

\* 50' VEGETATIVE BUFFER FOR 1 STORY BUILDINGS  
\*\* 100' VEGETATIVE BUFFER FOR 2 STORY BUILDINGS

NOTE: REMOVE EXISTING DRIVEWAY ENTRANCE TO LEAVITT EARTHWORKS

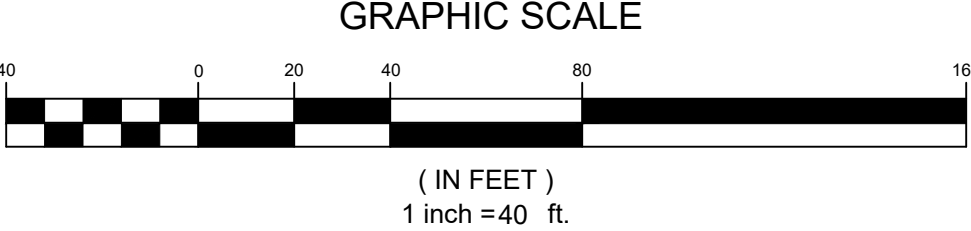

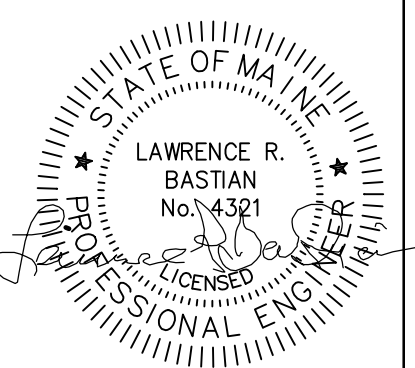

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
www.terradynconsultants.com




CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
HIGHLANDS DRIVE LAYOUT PLAN

PREPARED FOR  
LEAVITT-TOMPSON, LLC  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE: 3/15/2019  
SCALE: 1"=40'  
DESIGNED: JDA  
JOB NO: 1804  
FILE: 1804 S.DWG  
SHEET C-2.1

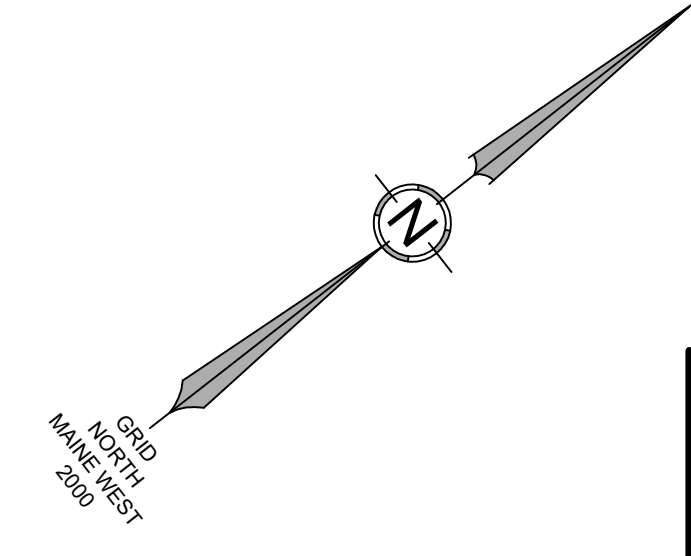


MATCH LINE - SEE SHEET C-2.0

MATCH LINE - SEE SHEET C-2.0

MATCH LINE - SEE SHEET C-2.2



MATCH LINE - SEE SHEET C-2.2

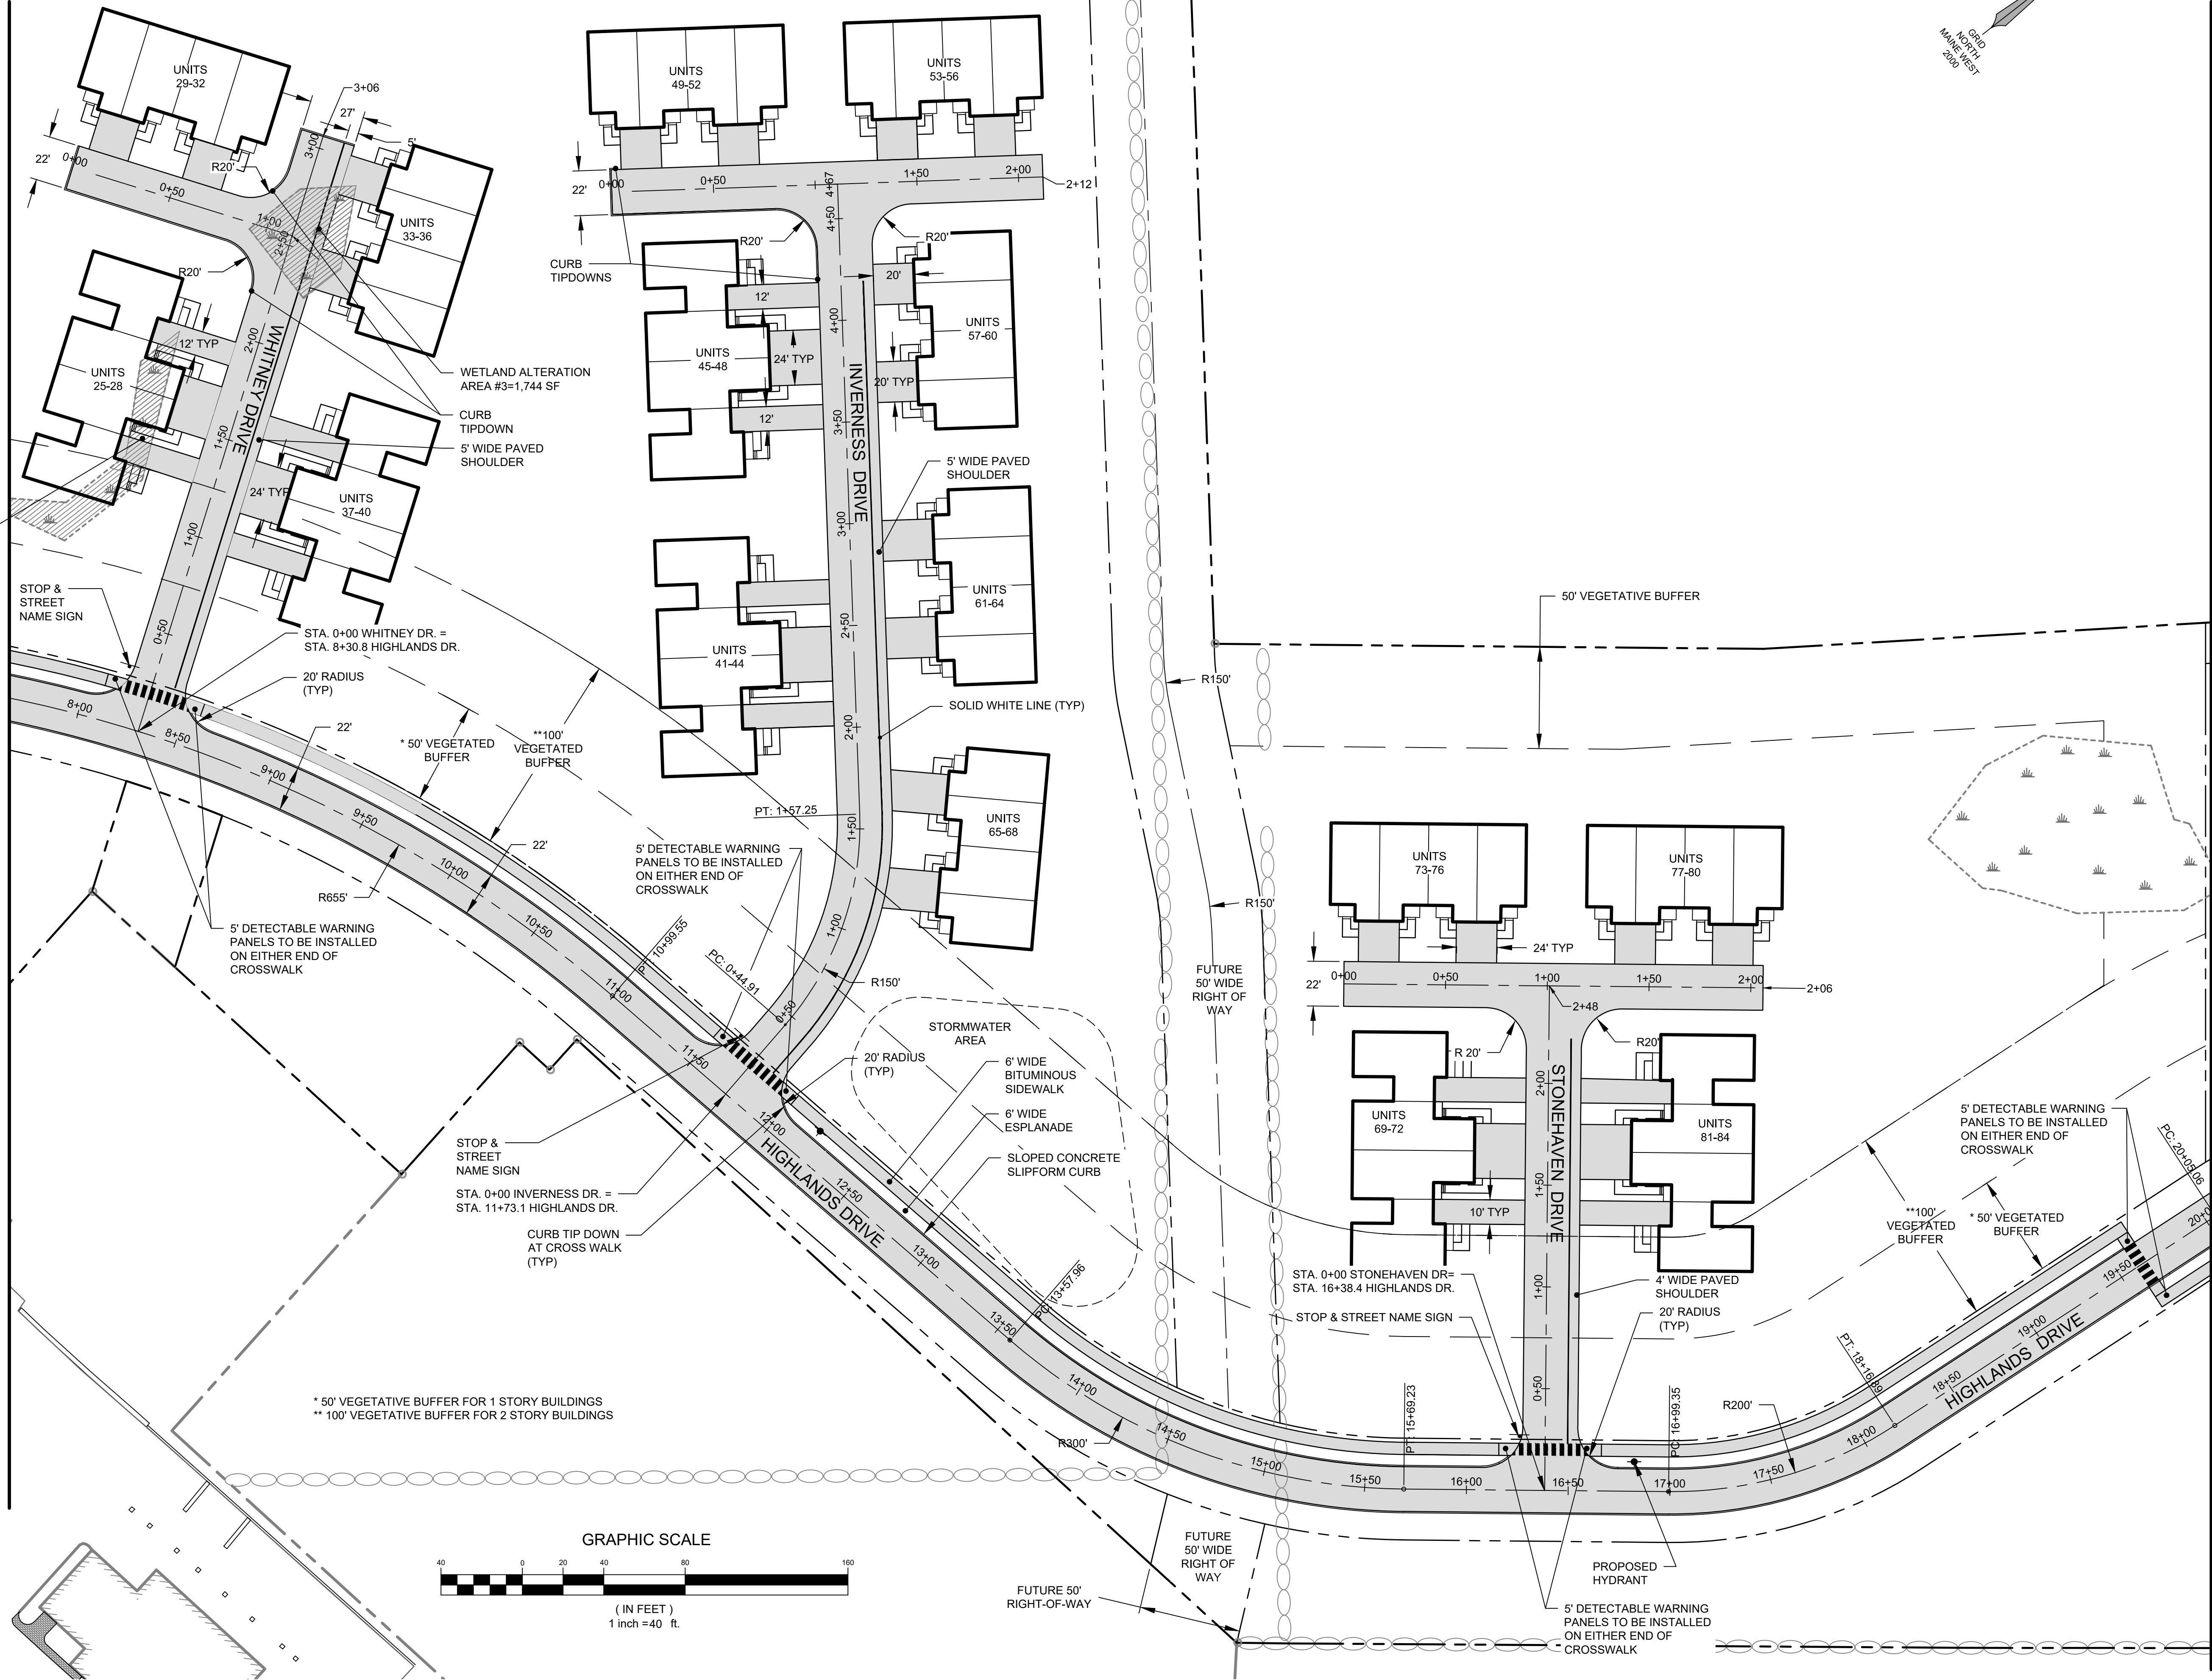



MATCH LINE - SEE SHEET C-2.1

MATCH LINE - SEE SHEET C-2.1

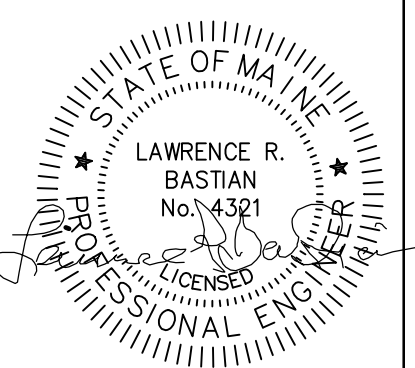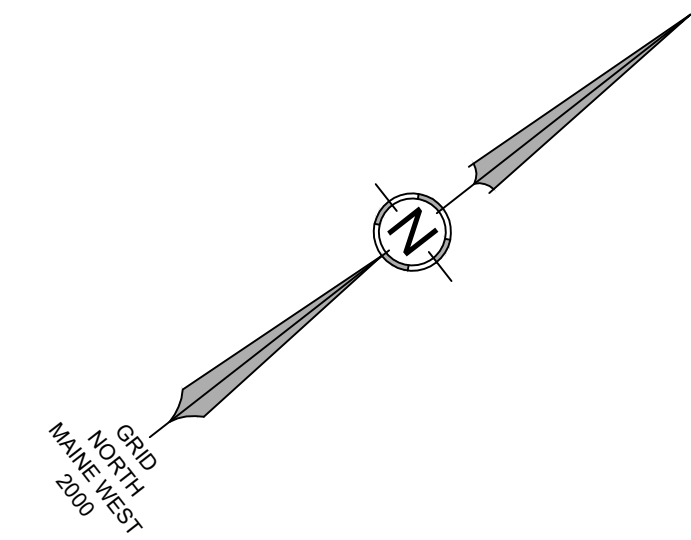

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
www.terradynconsultants.com

**TERRADYN**  
CONSULTANTS, LLC

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING



SHEET DESCRIPTION  
HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
HIGHLANDS DRIVE LAYOUT PLAN


PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE: 3/15/2019  
SCALE: 1"=40'  
DESIGNED: JDA  
JOB NO: 1804  
FILE: 1804 S.DWG  
SHEET **C-2.2**

MATCH LINE - SEE SHEET C-2.3

MATCH LINE - SEE SHEET C-2.3

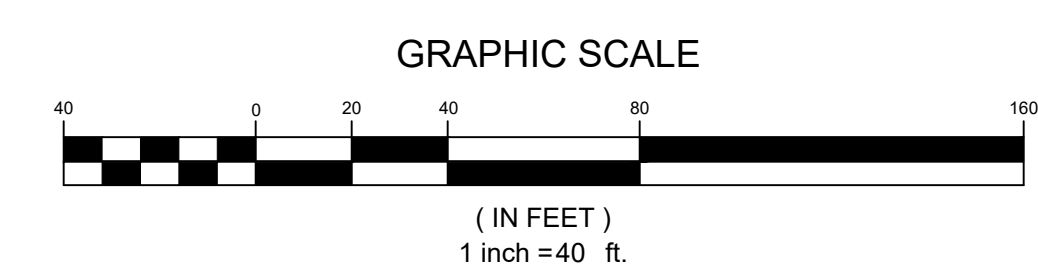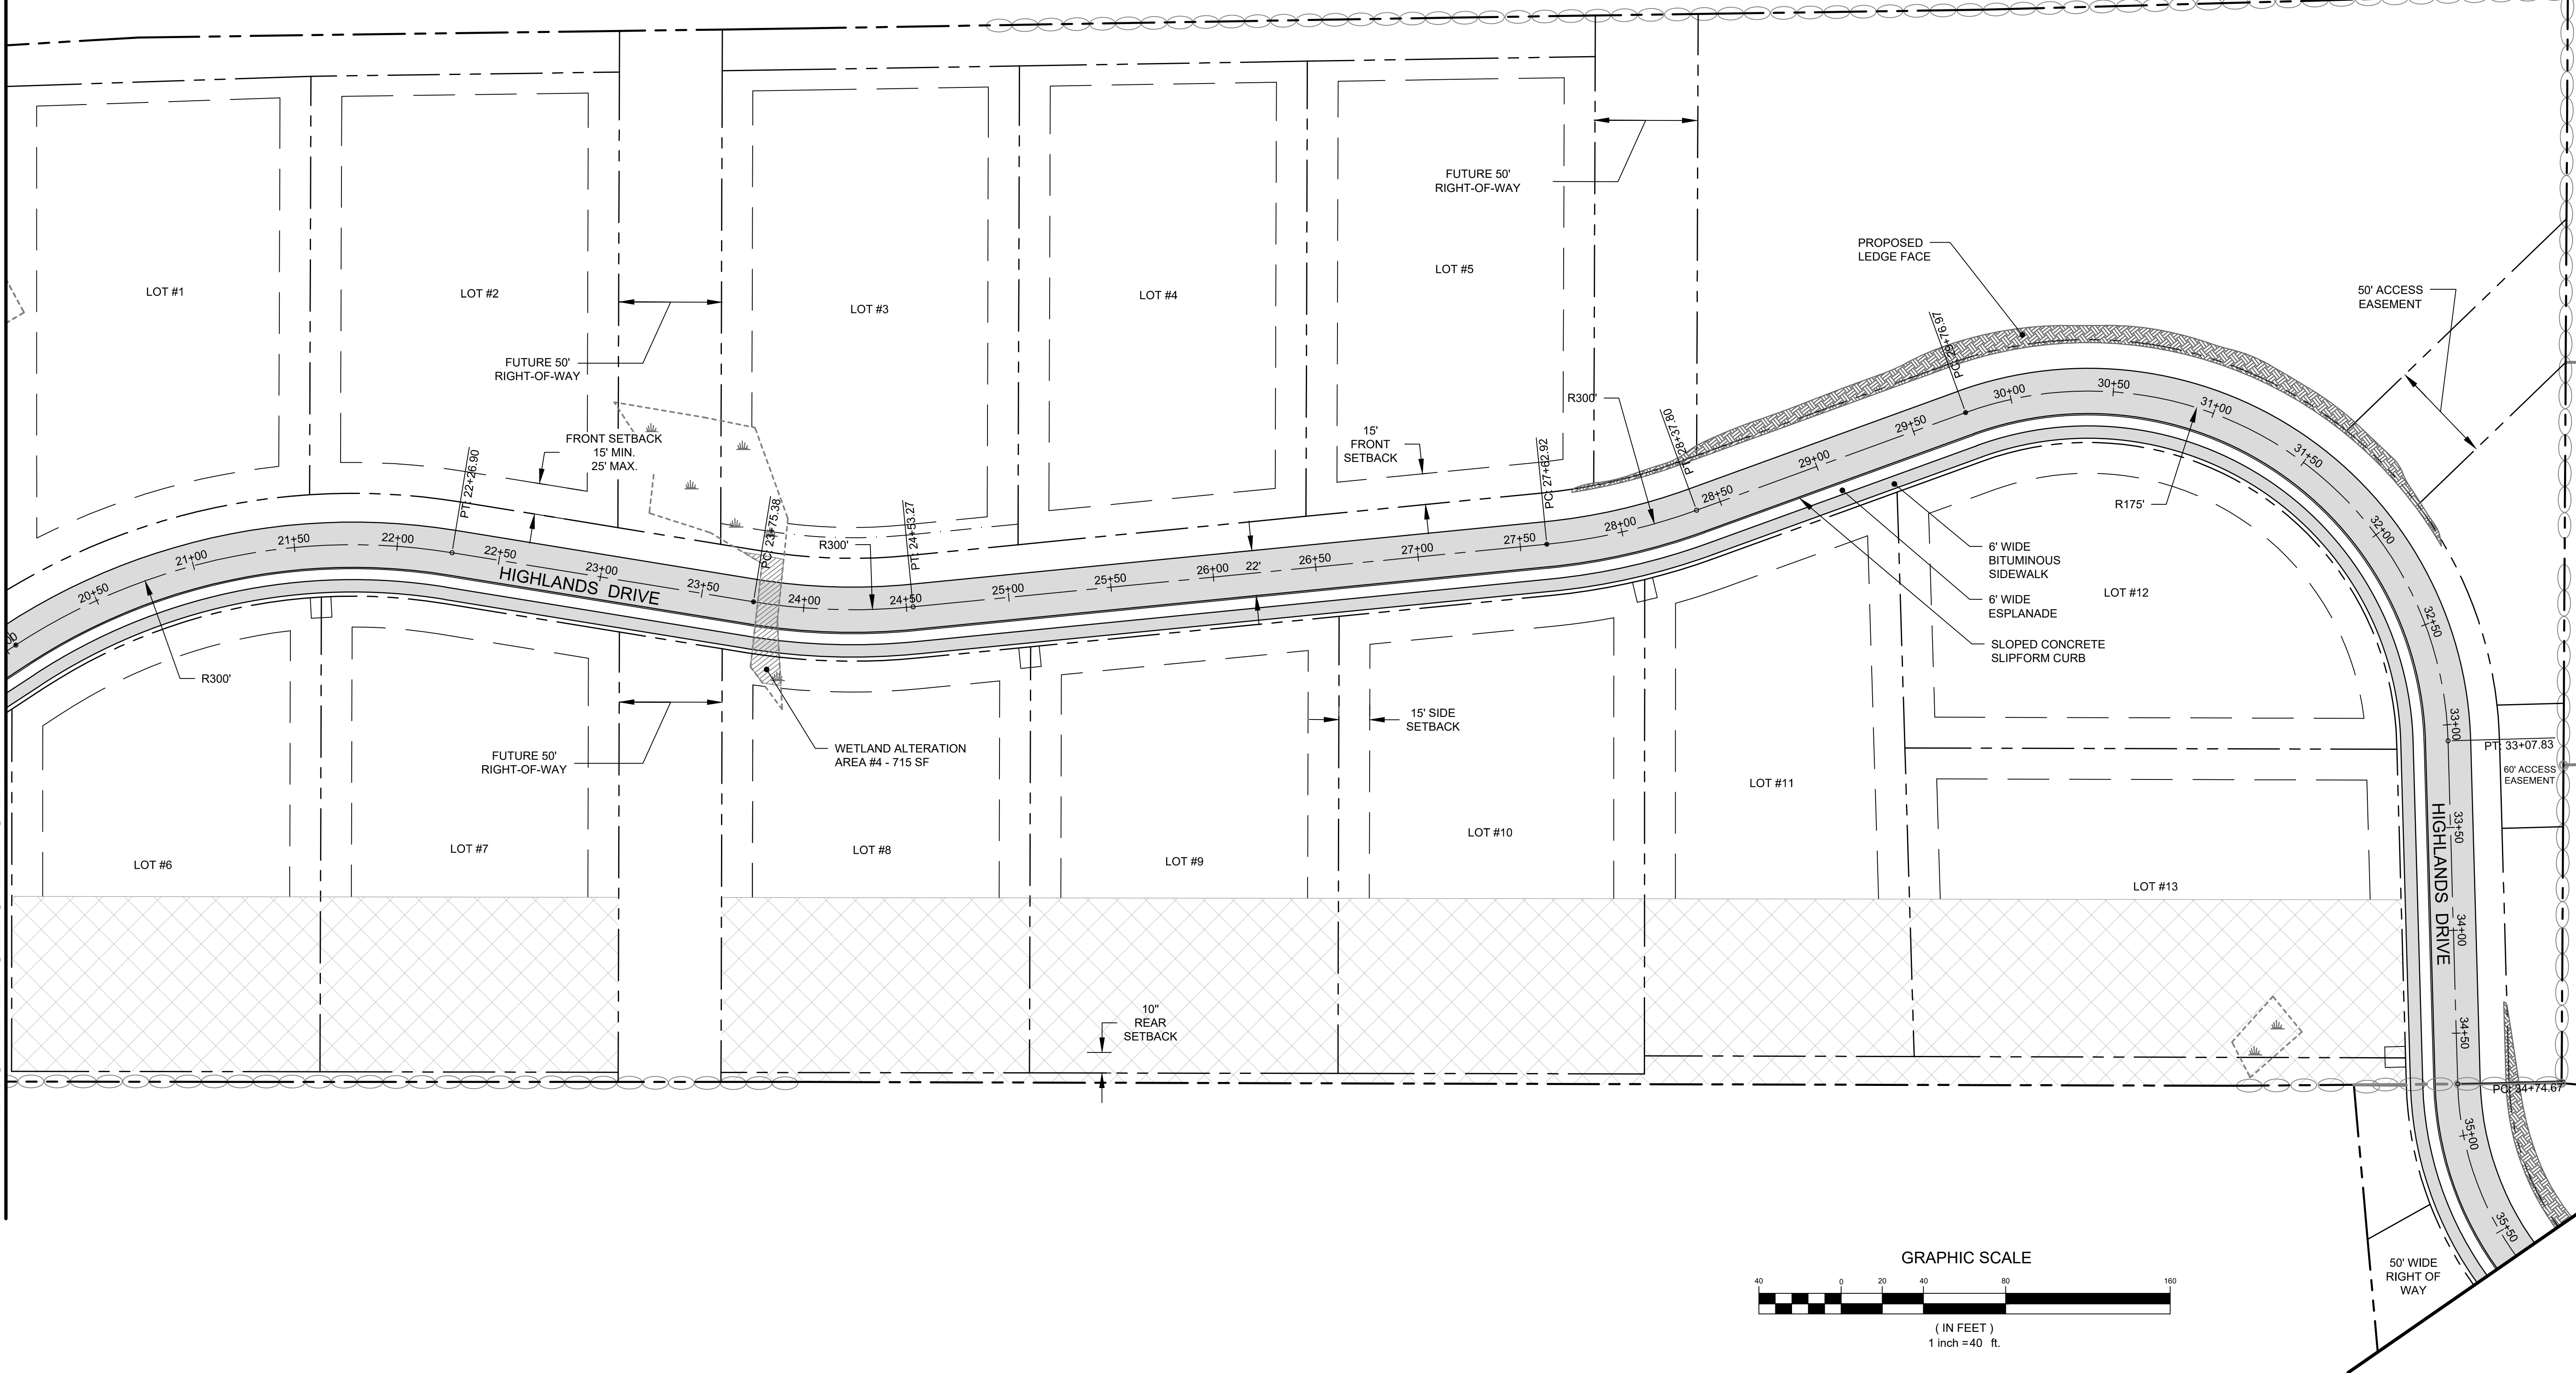

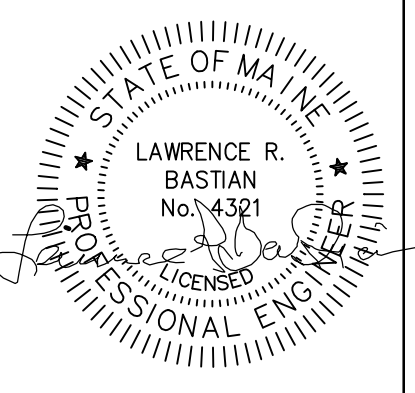

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEWS
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
www.terradyniconsultants.com



**TERRADYN**  
CONSULTANTS, LLC

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
**HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
HIGHLANDS DRIVE LAYOUT PLAN**


PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE: 3/15/2019  
SCALE: 1"=40'  
DESIGNED: JDA  
JOB NO: 1804  
FILE: 1804 S.DWG  
SHEET **C-2.3**

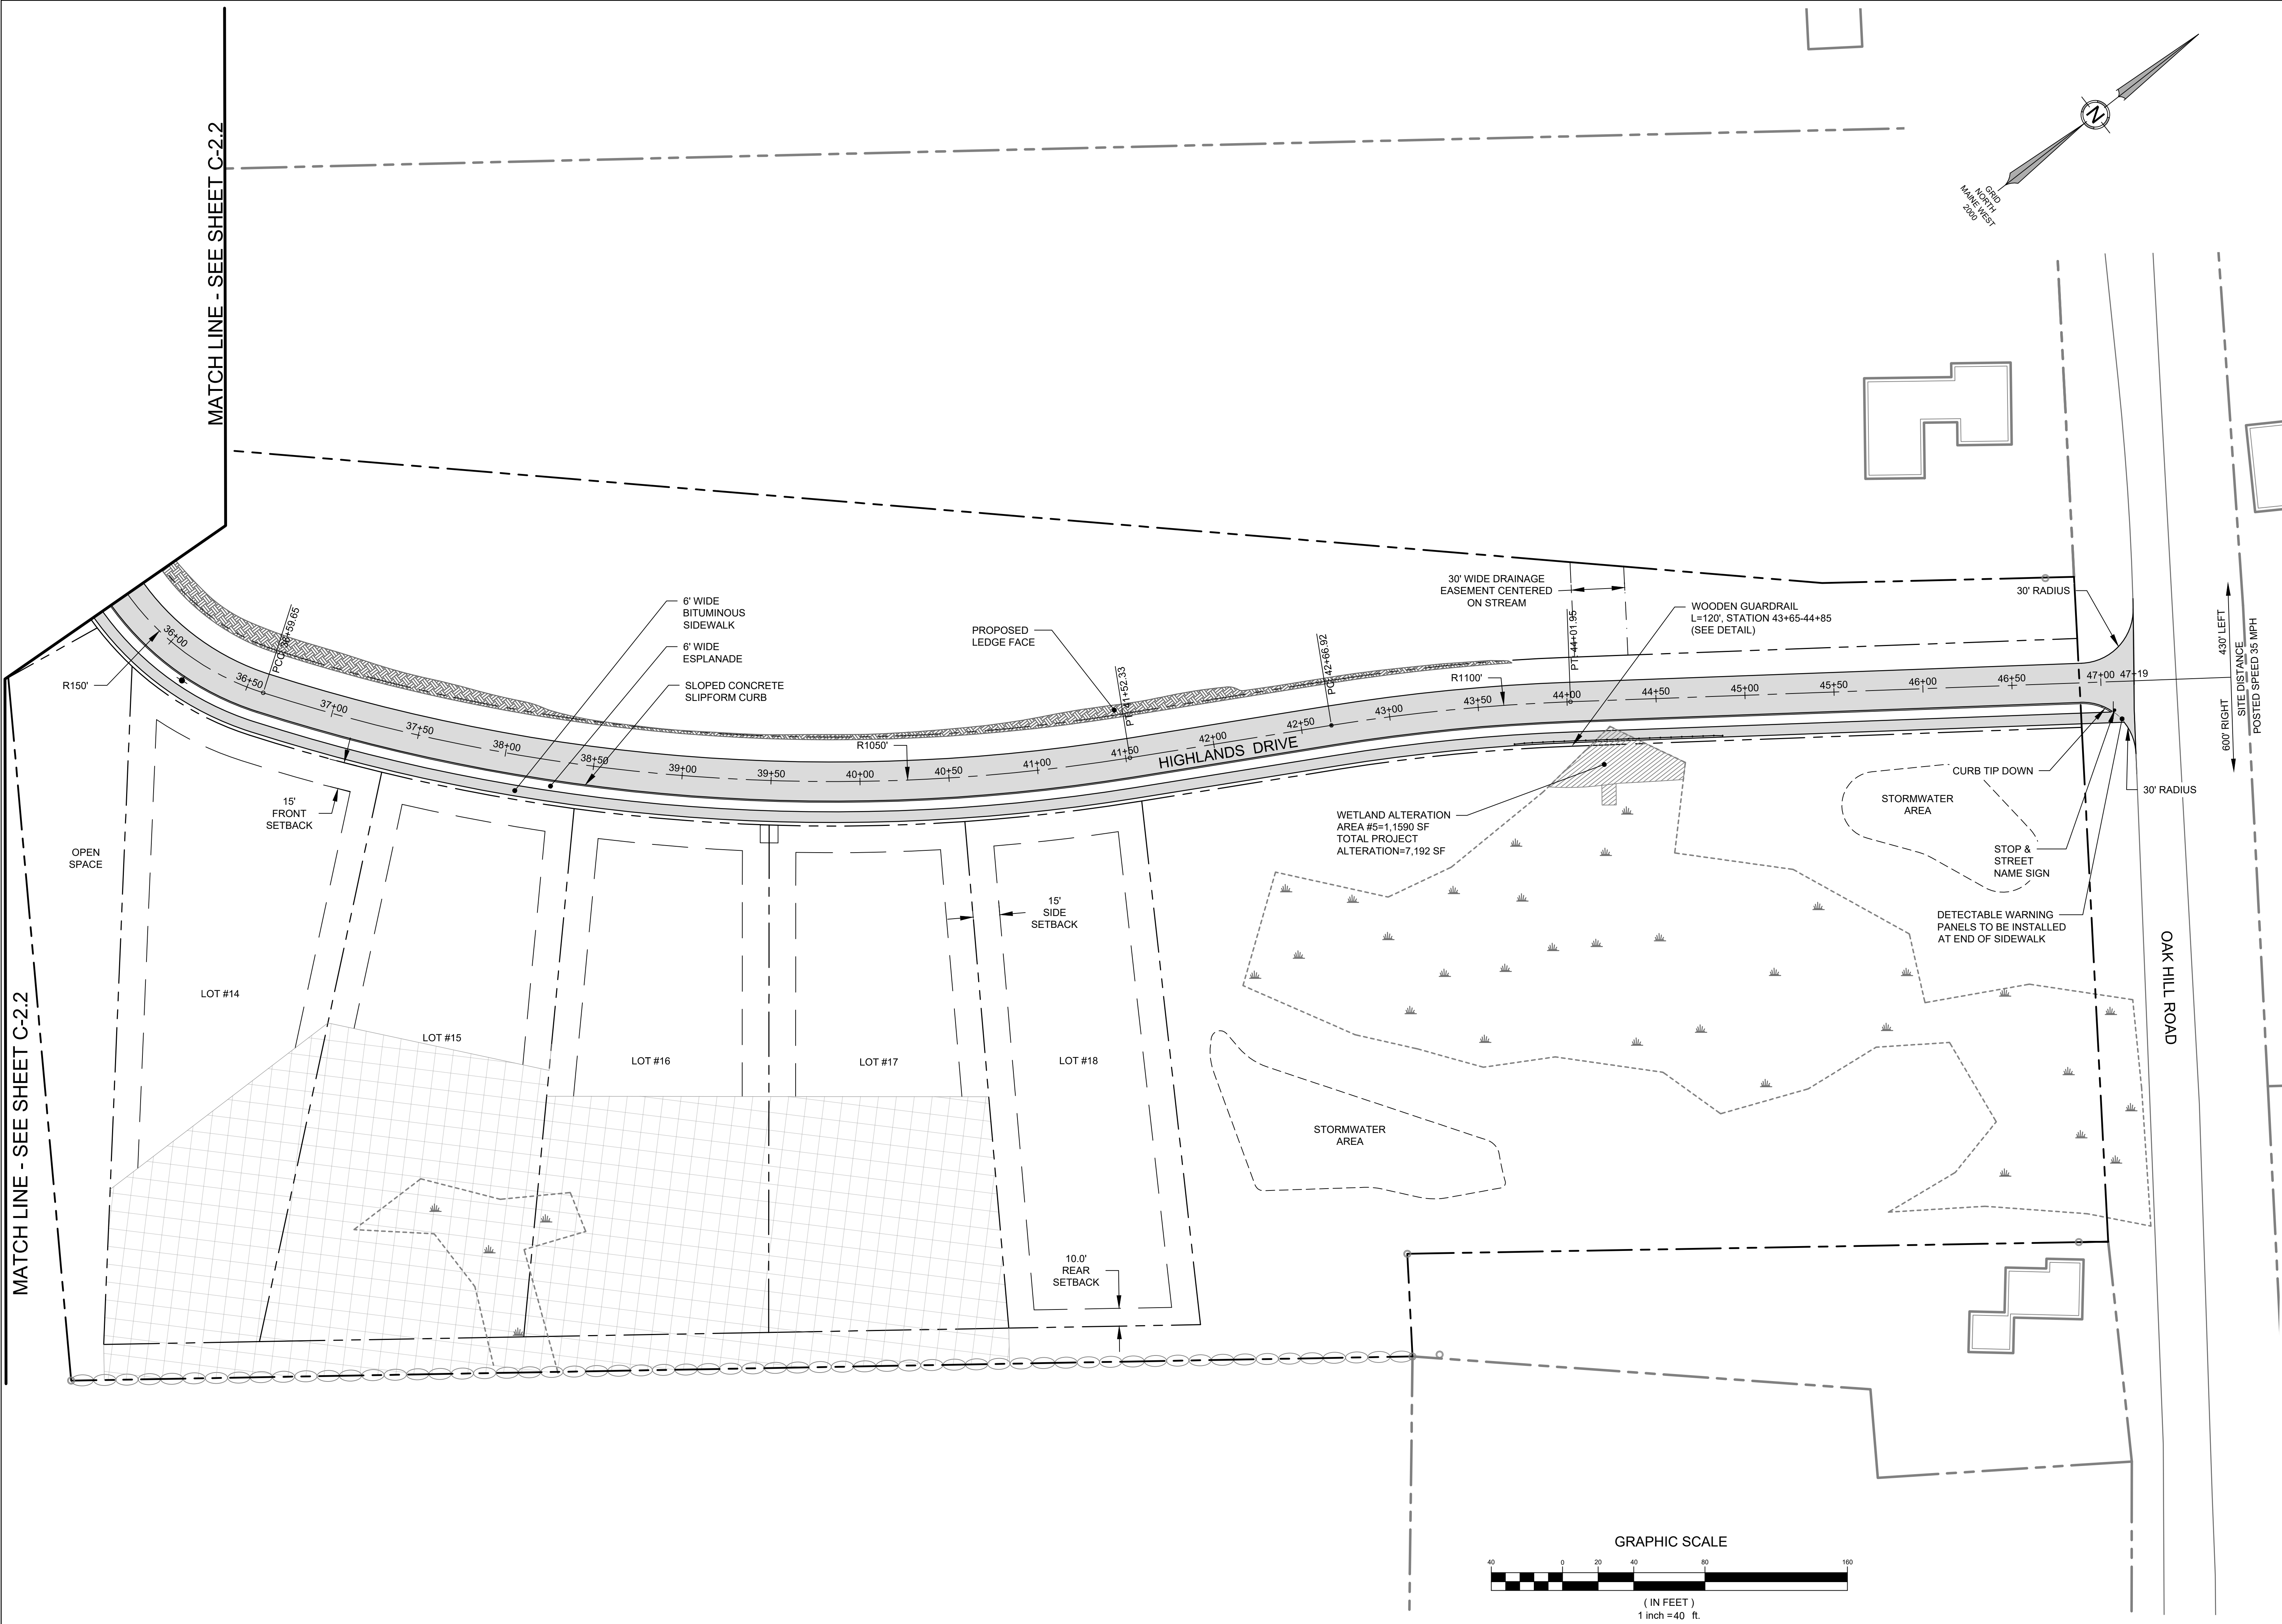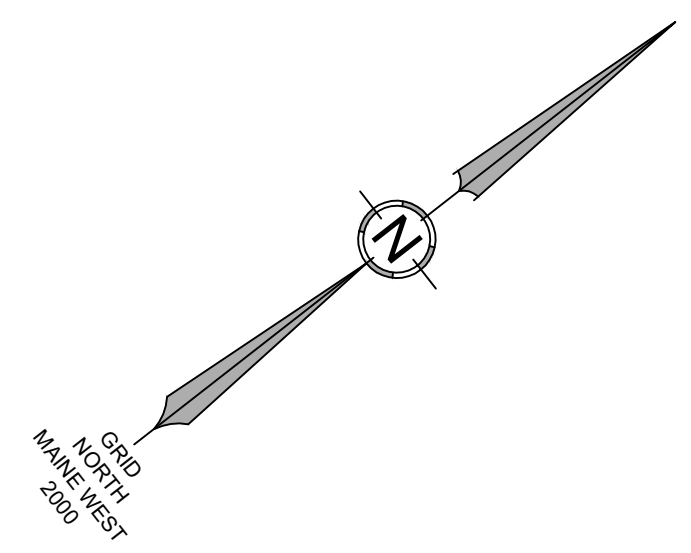


MATCH LINE - SEE SHEET C-2.2

MATCH LINE - SEE SHEET C-2.2

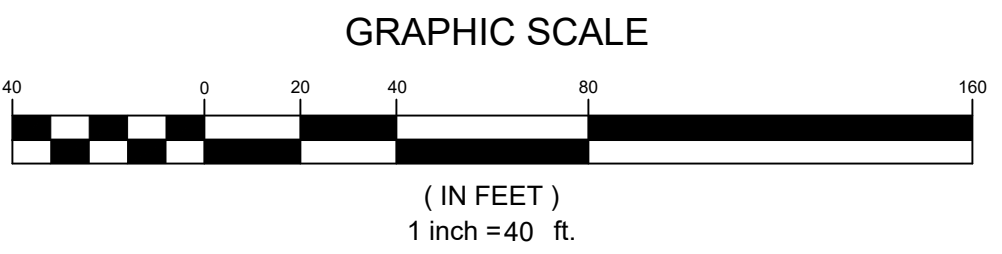




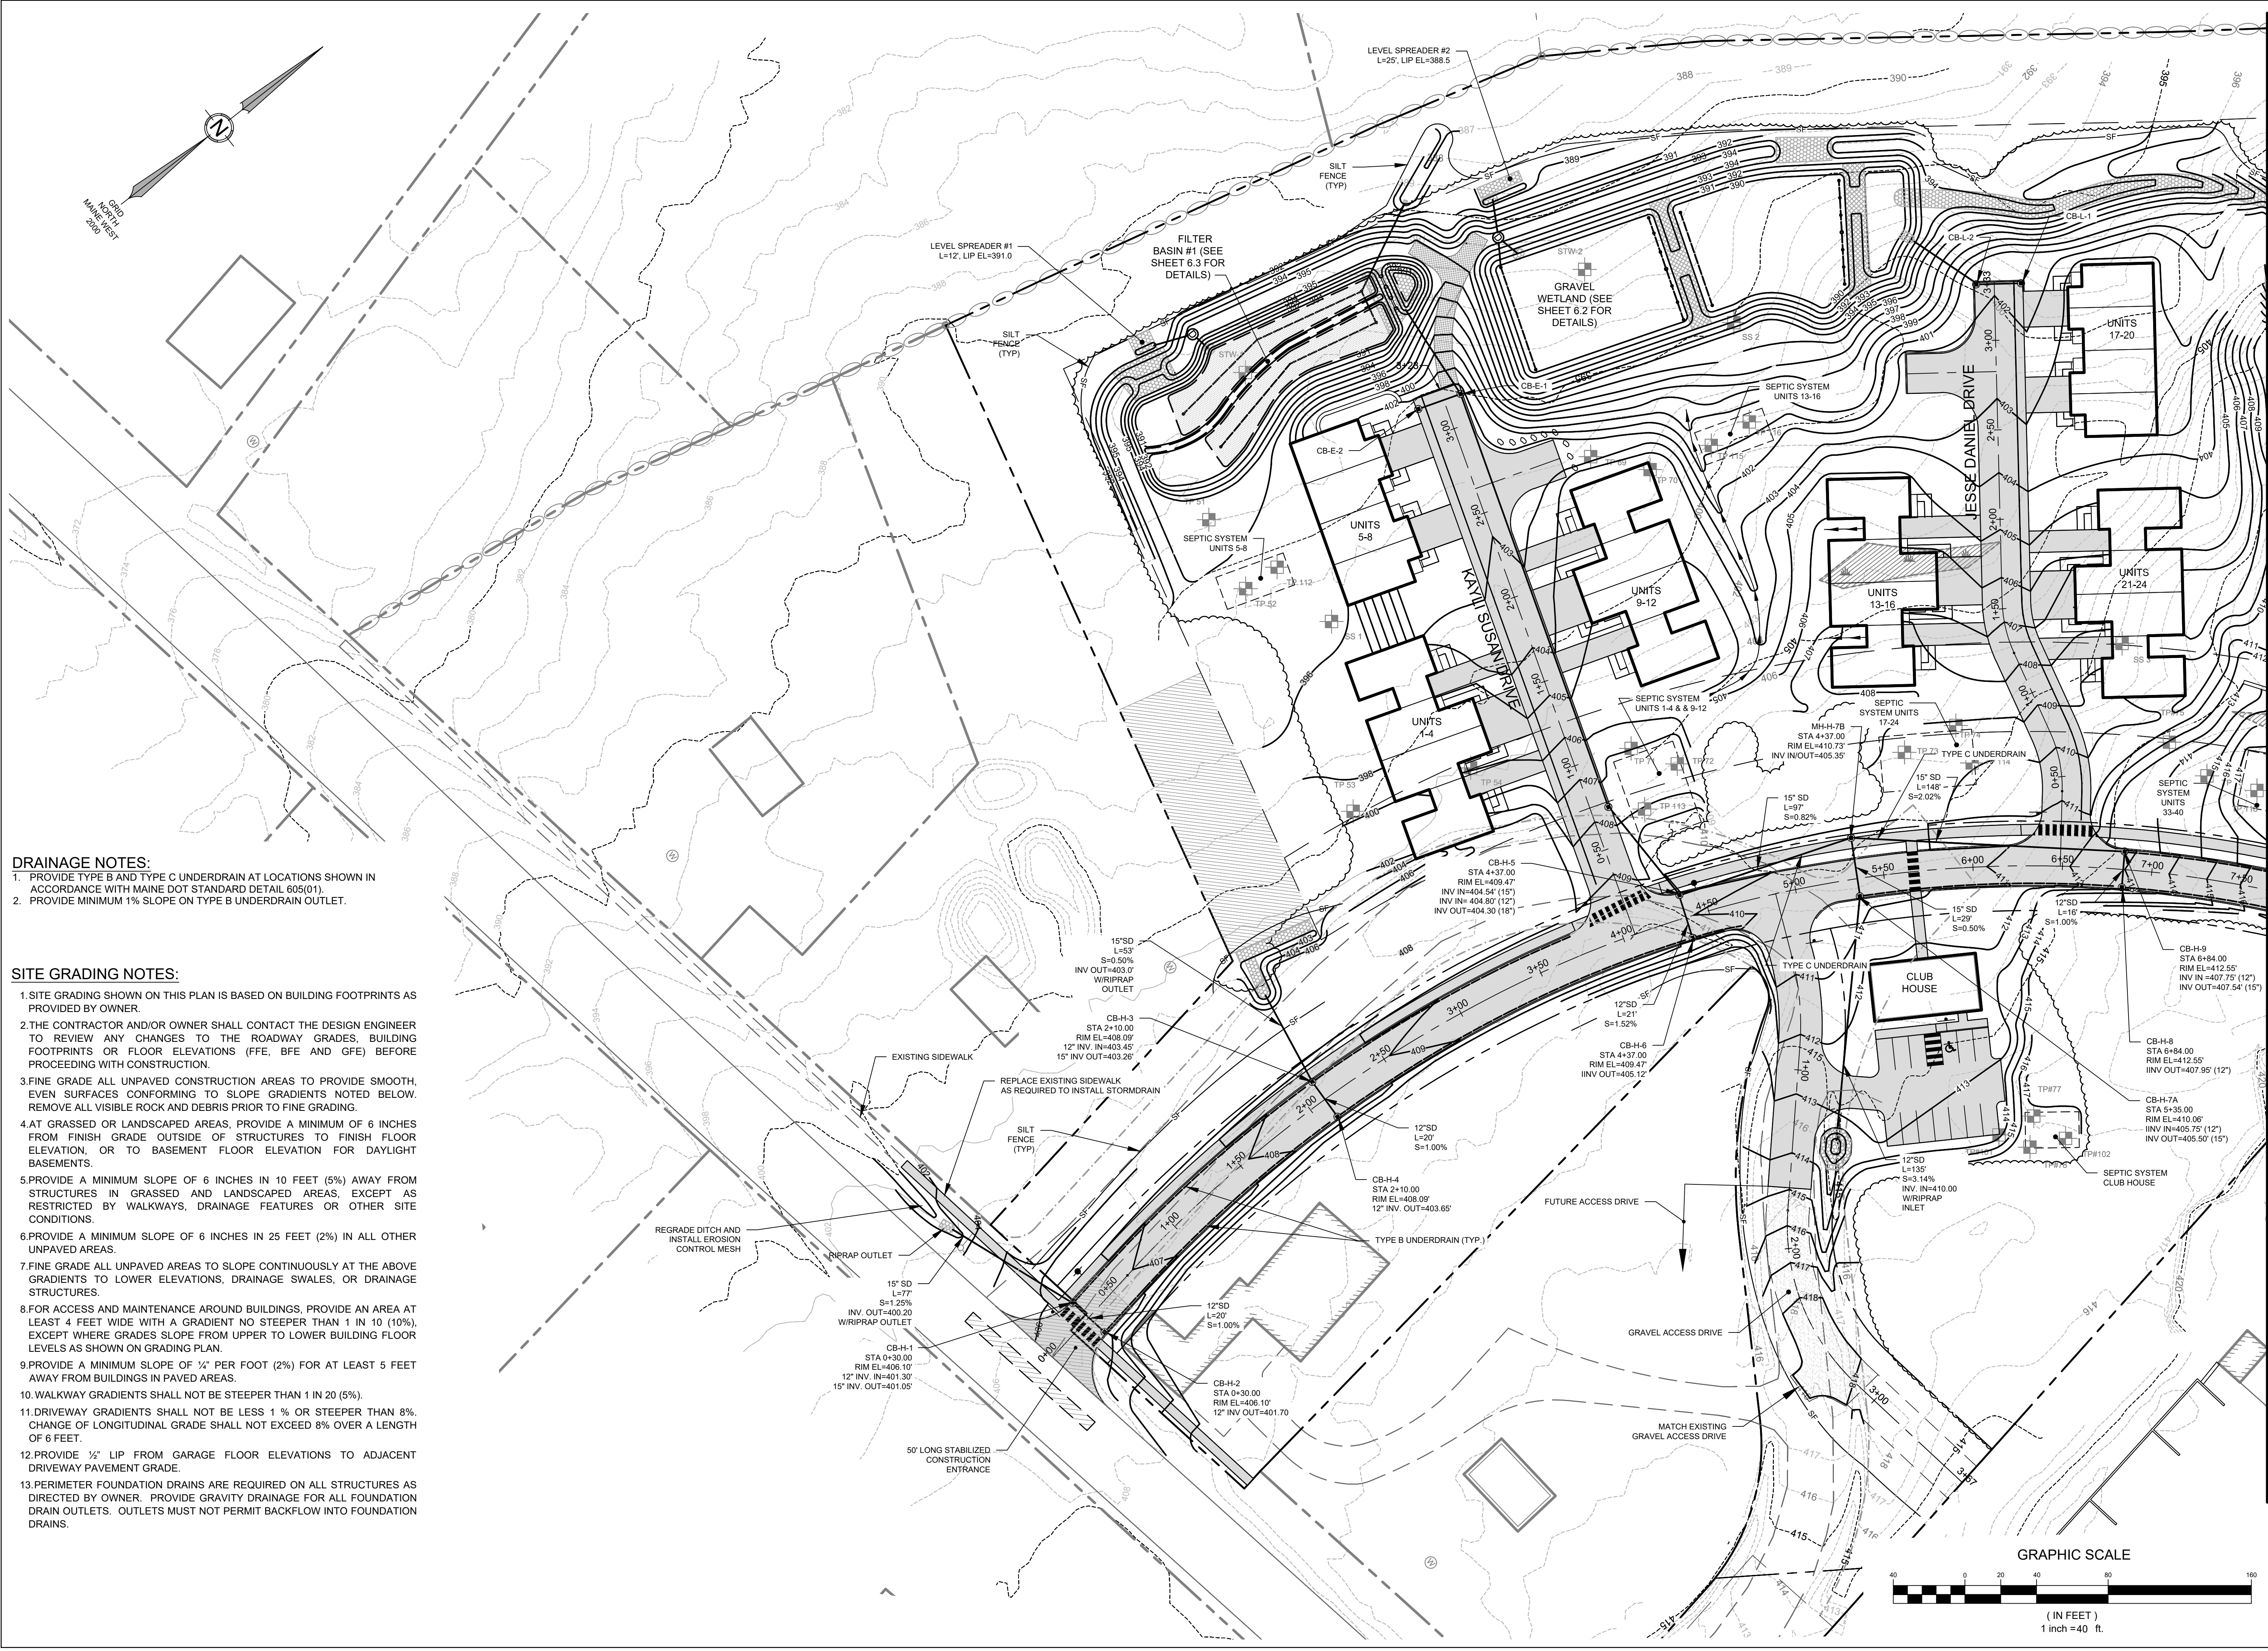


- DRAINAGE NOTES:**
1. PROVIDE TYPE B AND TYPE C UNDERDRAIN AT LOCATIONS SHOWN IN ACCORDANCE WITH MAINE DOT STANDARD DETAIL 605(01).
  2. PROVIDE MINIMUM 1% SLOPE ON TYPE B UNDERDRAIN OUTLET.

- SITE GRADING NOTES:**
1. SITE GRADING SHOWN ON THIS PLAN IS BASED ON BUILDING FOOTPRINTS AS PROVIDED BY OWNER.
  2. THE CONTRACTOR AND/OR OWNER SHALL CONTACT THE DESIGN ENGINEER TO REVIEW ANY CHANGES TO THE ROADWAY GRADES, BUILDING FOOTPRINTS OR FLOOR ELEVATIONS (FFE, BFE AND GFE) BEFORE PROCEEDING WITH CONSTRUCTION.
  3. FINE GRADE ALL UNPAVED CONSTRUCTION AREAS TO PROVIDE SMOOTH, EVEN SURFACES CONFORMING TO SLOPE GRADIENTS NOTED BELOW. REMOVE ALL VISIBLE ROCK AND DEBRIS PRIOR TO FINE GRADING.
  4. AT GRASSED OR LANDSCAPED AREAS, PROVIDE A MINIMUM OF 6 INCHES FROM FINISH GRADE OUTSIDE OF STRUCTURES TO FINISH FLOOR ELEVATION, OR TO BASEMENT FLOOR ELEVATION FOR DAYLIGHT BASEMENTS.
  5. PROVIDE A MINIMUM SLOPE OF 6 INCHES IN 10 FEET (5%) AWAY FROM STRUCTURES IN GRASSED AND LANDSCAPED AREAS, EXCEPT AS RESTRICTED BY WALKWAYS, DRAINAGE FEATURES OR OTHER SITE CONDITIONS.
  6. PROVIDE A MINIMUM SLOPE OF 6 INCHES IN 25 FEET (2%) IN ALL OTHER UNPAVED AREAS.
  7. FINE GRADE ALL UNPAVED AREAS TO SLOPE CONTINUOUSLY AT THE ABOVE GRADIENTS TO LOWER ELEVATIONS, DRAINAGE SWALES, OR DRAINAGE STRUCTURES.
  8. FOR ACCESS AND MAINTENANCE AROUND BUILDINGS, PROVIDE AN AREA AT LEAST 4 FEET WIDE WITH A GRADIENT NO STEEPER THAN 1 IN 10 (10%), EXCEPT WHERE GRADES SLOPE FROM UPPER TO LOWER BUILDING FLOOR LEVELS AS SHOWN ON GRADING PLAN.
  9. PROVIDE A MINIMUM SLOPE OF 1/2" PER FOOT (2%) FOR AT LEAST 5 FEET AWAY FROM BUILDINGS IN PAVED AREAS.
  10. WALKWAY GRADIENTS SHALL NOT BE STEEPER THAN 1 IN 20 (5%).
  11. DRIVEWAY GRADIENTS SHALL NOT BE LESS 1% OR STEEPER THAN 8%. CHANGE OF LONGITUDINAL GRADE SHALL NOT EXCEED 8% OVER A LENGTH OF 6 FEET.
  12. PROVIDE 1/2" LIP FROM GARAGE FLOOR ELEVATIONS TO ADJACENT DRIVEWAY PAVEMENT GRADE.
  13. PERIMETER FOUNDATION DRAINS ARE REQUIRED ON ALL STRUCTURES AS DIRECTED BY OWNER. PROVIDE GRAVITY DRAINAGE FOR ALL FOUNDATION DRAIN OUTLETS. OUTLETS MUST NOT PERMIT BACKFLOW INTO FOUNDATION DRAINS.

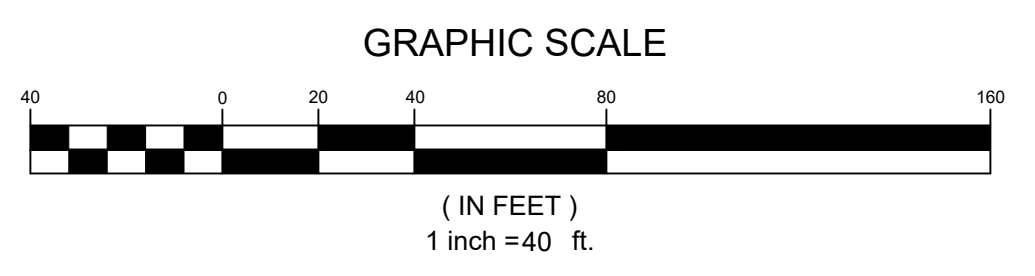

MATCH LINE - SEE SHEET C-3.1

MATCH LINE - SEE SHEET C-3.1

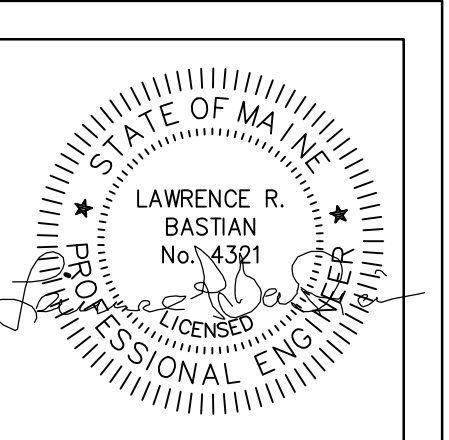

NO.	DATE	REVISIONS
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN
2	12/17/2019	PRELIMINARY SUBDIVISION & SITE PLAN
3	3/29/2019	PRELIMINARY SUBDIVISION & SITE PLAN
4	11/26/2019	REVIS PER MDEP REVIEW COMMENTS
5	11/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
7	3/25/2020	REVISED PER TOWN COMMENTS
8	4/15/2020	FINAL REVIEW

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
www.terradynconsultants.com

**TERRADYN**  
CONSULTANTS, LLC  
CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
HIGHLANDS DRIVE GRADING PLAN  
PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE: 3/15/2019  
SCALE: 1"=40'  
DESIGNED: JDA  
JOB NO: 1804  
FILE: 1804 S.DWG  
SHEET **C-3.0**



MATCH LINE - SEE SHEET C-3.0




MATCH LINE - SEE SHEET C-3.0

MATCH LINE - SEE SHEET C-3.2

MATCH LINE - SEE SHEET C-3.2

NOTE: SEE SITE GRADING NOTES SHEET C-3.0

- DRAINAGE NOTES:**
1. PROVIDE TYPE B AND TYPE C UNDERDRAIN AT LOCATIONS SHOWN IN ACCORDANCE WITH MAINE DOT STANDARD DETAIL 605(01).
  2. PROVIDE MINIMUM 1% SLOPE ON TYPE B UNDERDRAIN OUTLET.

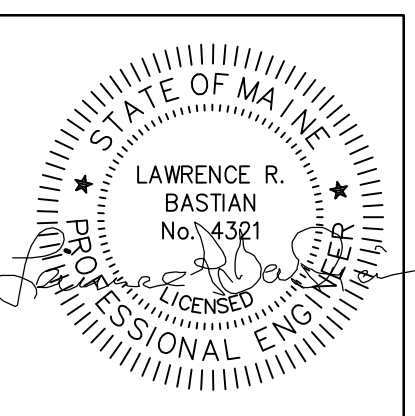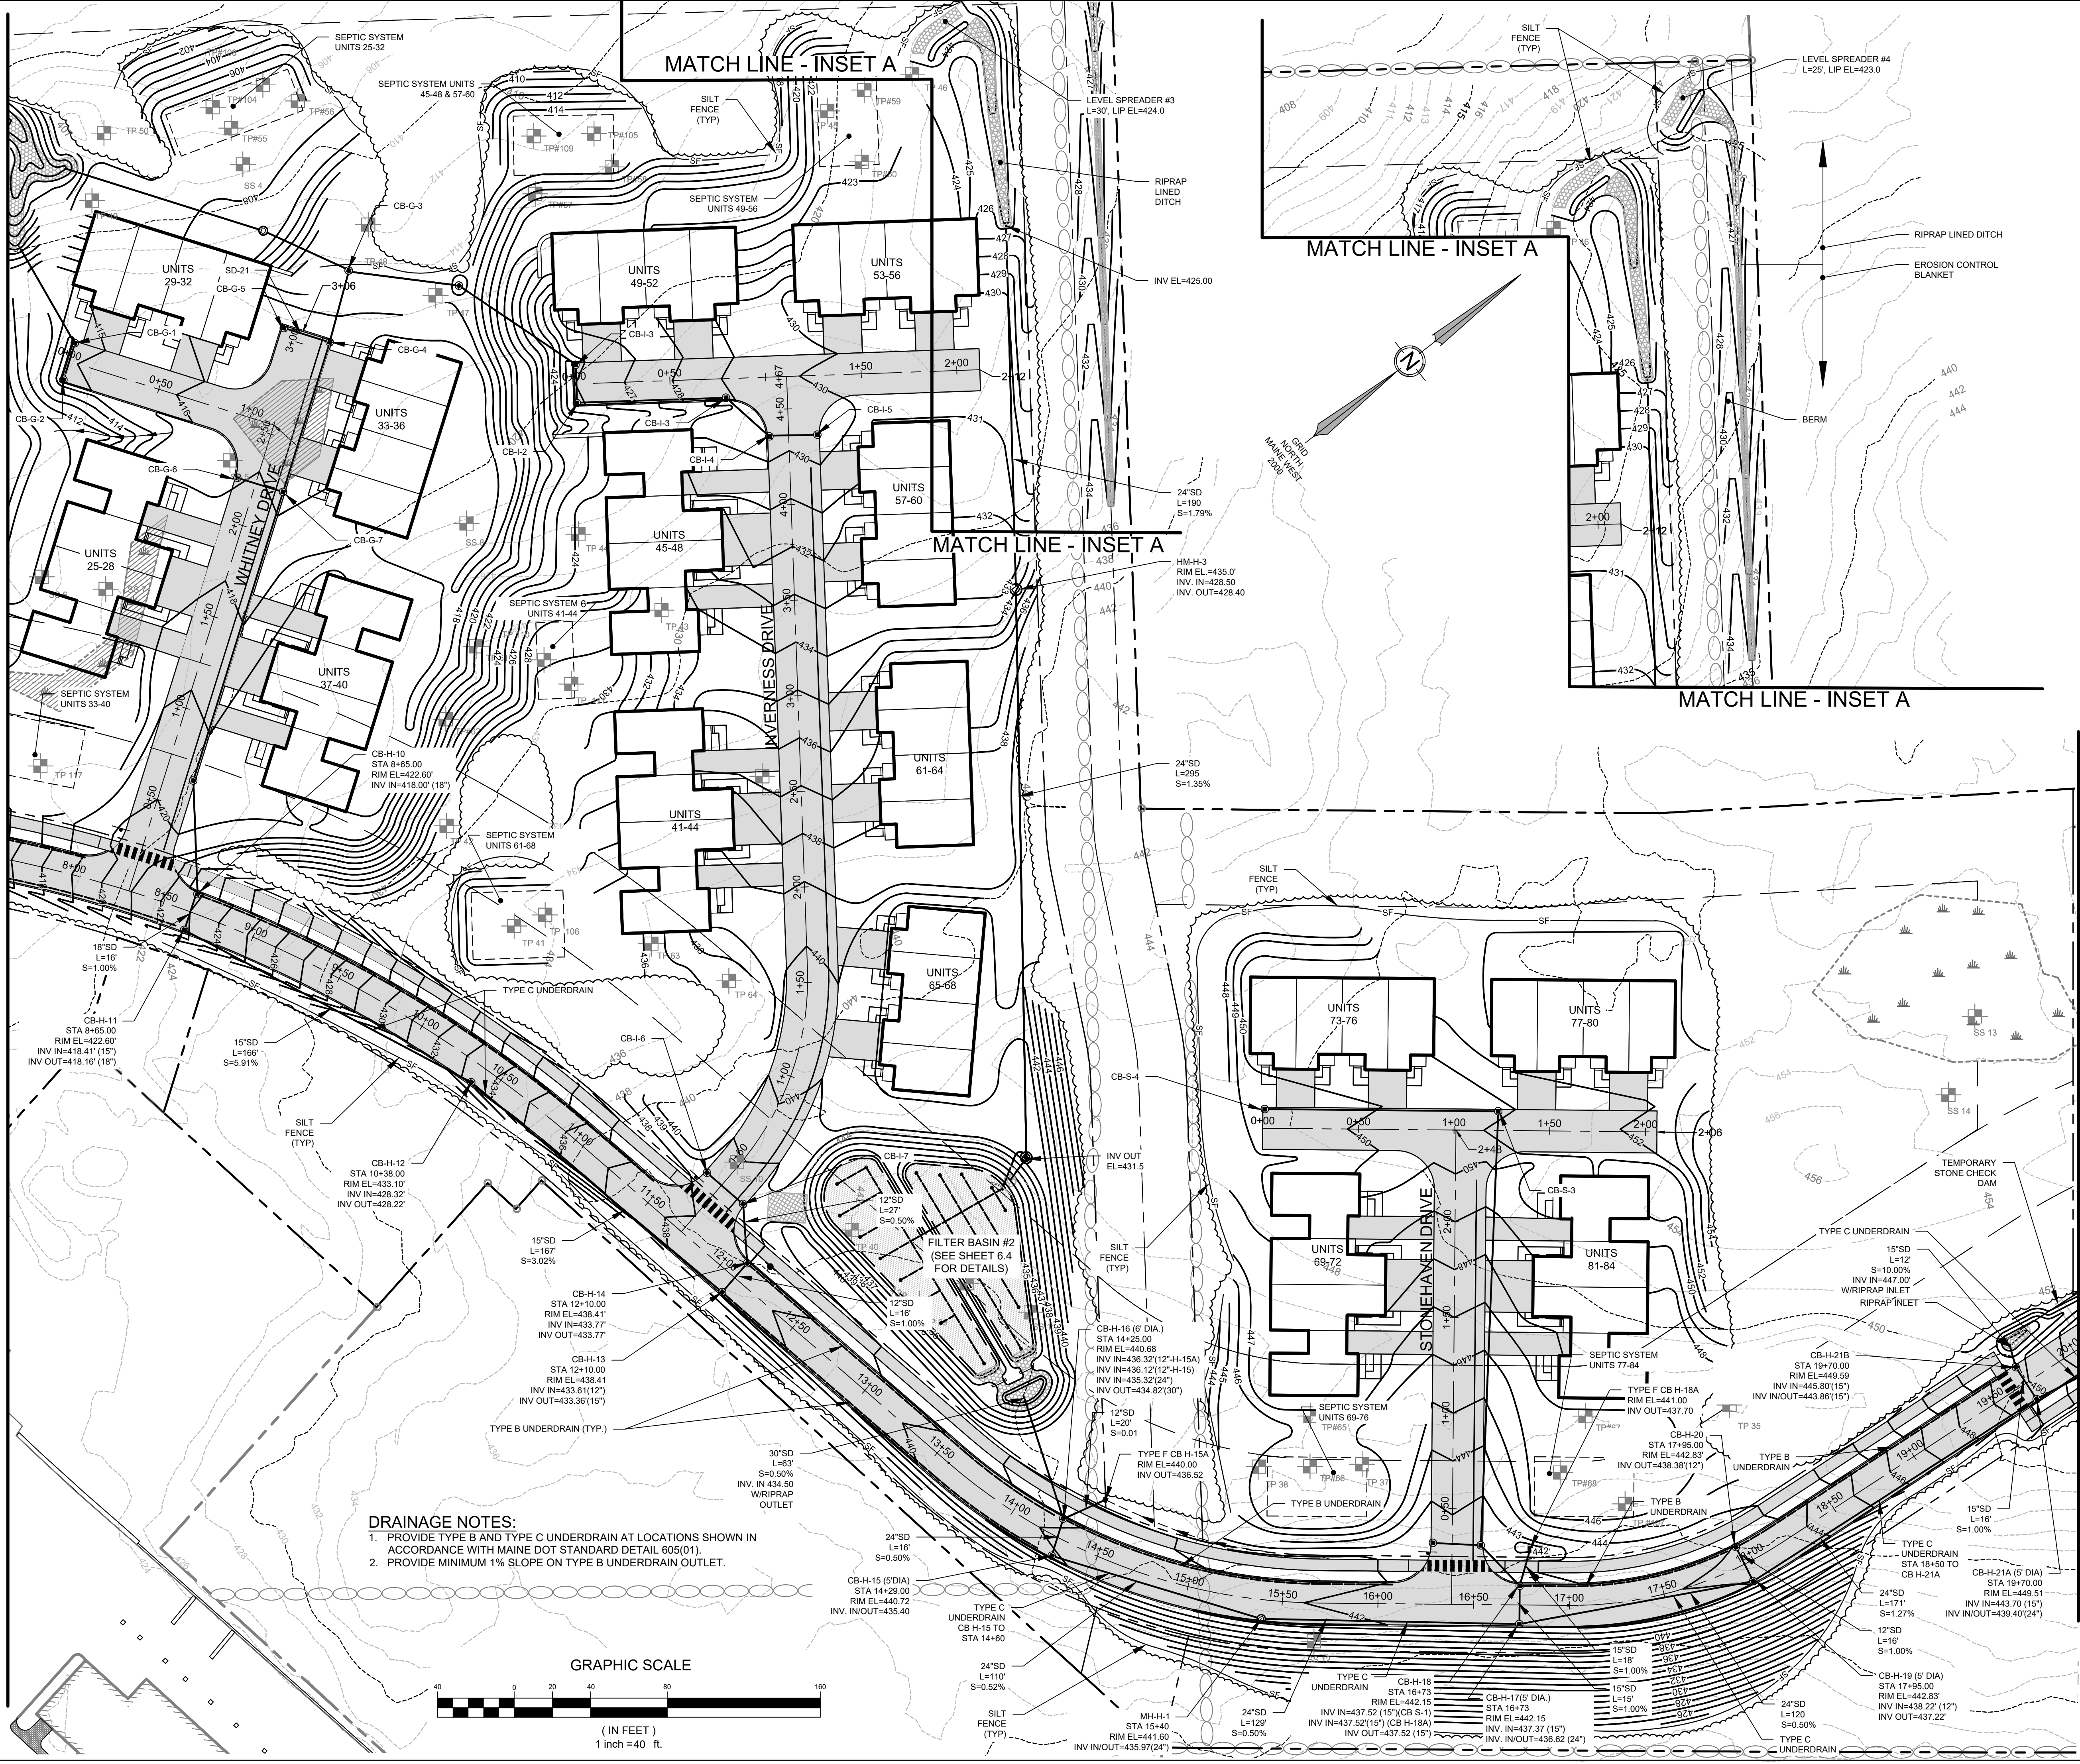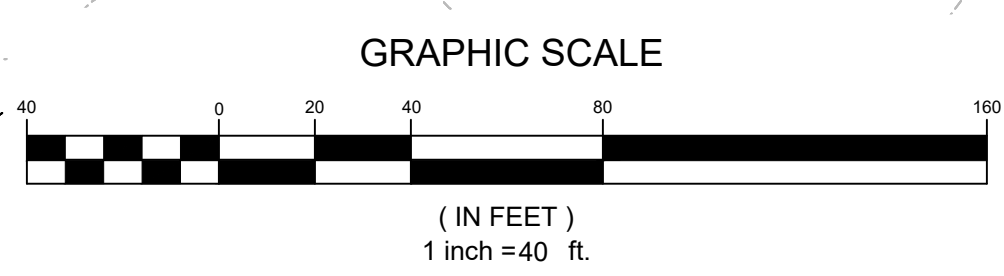

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260



CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING


OFFICE: (207) 926-5111  
www.terradynconsultants.com

PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
P.O. BOX 703  
STANDISH, MAINE 04084

SHEET **C-3.1**



NOTE: SEE SITE GRADING NOTES SHEET C-3.0

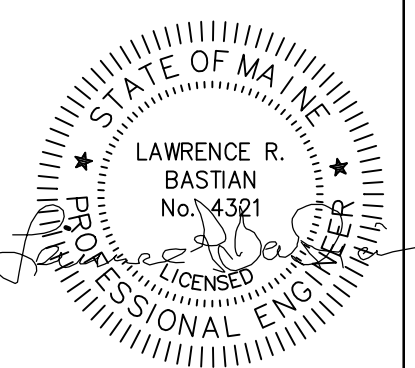

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN
2	12/1/2019	PRELIMINARY SUBDIVISION & SITE PLAN
3	3/29/2019	PRELIMINARY SUBDIVISION & SITE PLAN
4	11/26/2019	REVIS PER MDEP REVIEW COMMENTS
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEWS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
7	3/25/2020	REVISED PER TOWN COMMENTS
8	4/15/2020	FINAL REVIEW

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
NEW GLOUCESTER, ME 04260



OFFICE: (207) 926-5111  
www.terradynconsultants.com

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
HIGHLANDS DRIVE GRADING PLAN  
PREPARED FOR  
LEAVITT-TOMPSON, LLC  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE: 3/15/2019  
SCALE: 1"=40'  
DESIGNED: JDA  
JOB NO: 1804  
FILE: 1804 S.DWG  
SHEET

C-3.2



MATCH LINE - SEE SHEET C-3.1

MATCH LINE - SEE SHEET C-3.1


MATCH LINE - SEE SHEET C-3.3

MATCH LINE - SEE SHEET C-3.3

- DRAINAGE NOTES:**
1. PROVIDE TYPE B AND TYPE C UNDERDRAIN AT LOCATIONS SHOWN IN ACCORDANCE WITH MAINE DOT STANDARD DETAIL 605(01).
  2. PROVIDE MINIMUM 1% SLOPE ON TYPE B UNDERDRAIN OUTLET.

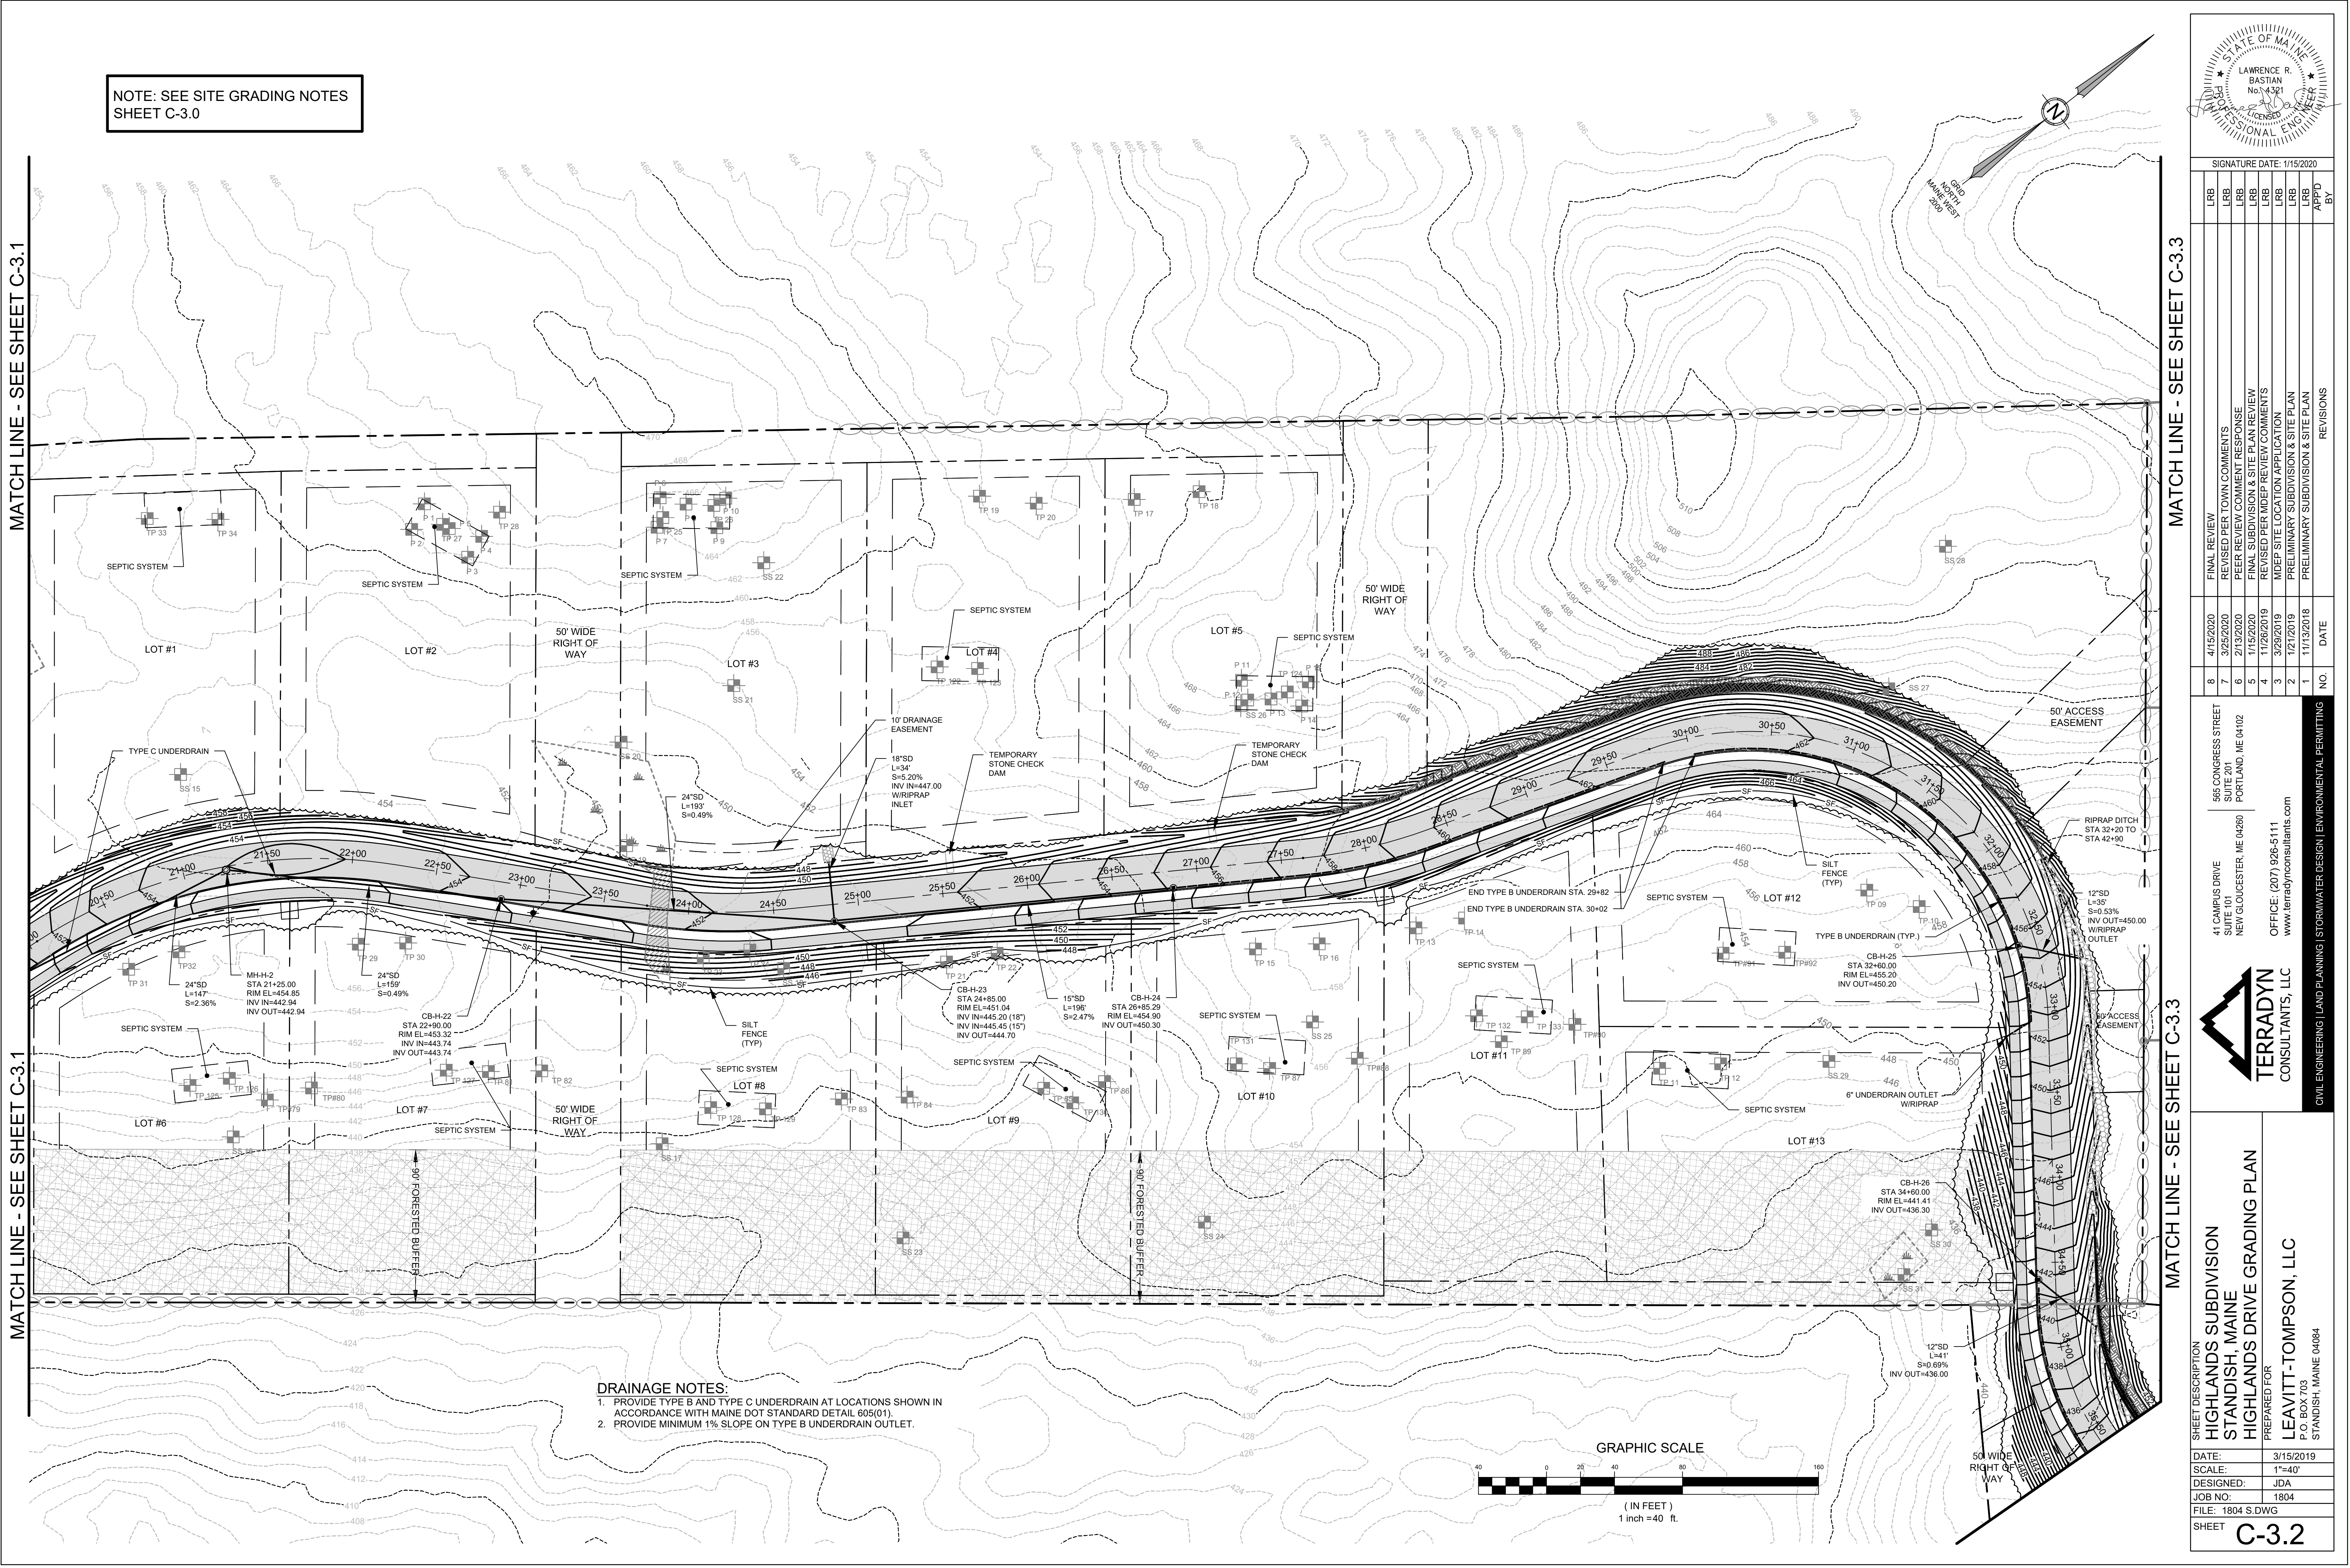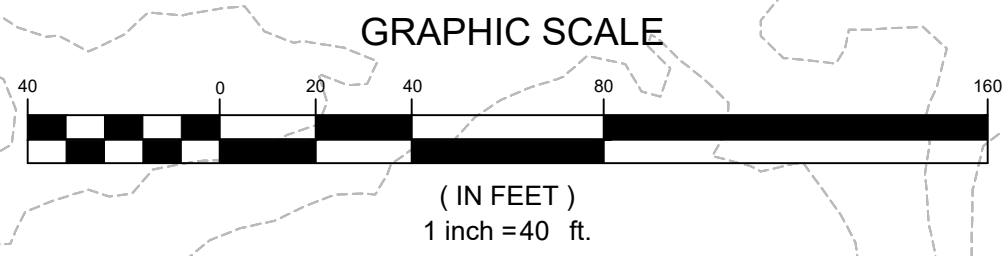



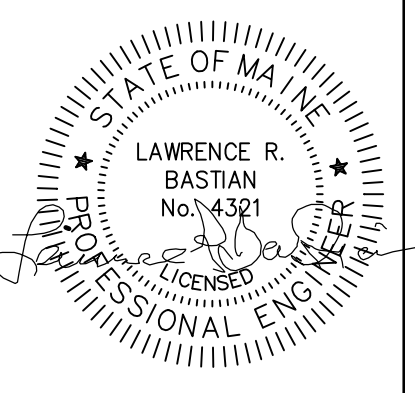

SIGNATURE DATE: 1/15/2020


NO.	DATE	REVISIONS
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
3	3/29/2019	MDEP SITE LOCATION APPLICATION
4	11/26/2019	FINAL SUBDIVISION & SITE PLAN REVIEW
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
7	3/25/2020	REVISED PER TOWN COMMENTS
8	4/15/2020	FINAL REVIEW

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

OFFICE: (207) 926-5111  
www.terradynconsultants.com

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

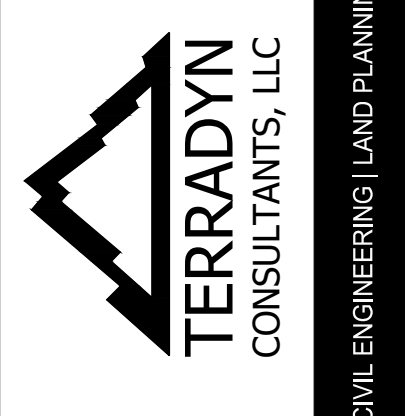




SHEET DESCRIPTION  
HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
HIGHLANDS DRIVE GRADING PLAN  
PREPARED FOR  
LEAVITT-TOMPSON, LLC  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE:	3/15/2019
SCALE:	1"=40'
DESIGNED:	JDA
JOB NO:	1804
FILE:	1804 S.DWG
SHEET	<b>C-3.3</b>

NOTE: SEE SITE GRADING NOTES SHEET C-3.0

MATCH LINE - SEE SHEET C-3.2


MATCH LINE - SEE SHEET C-3.2

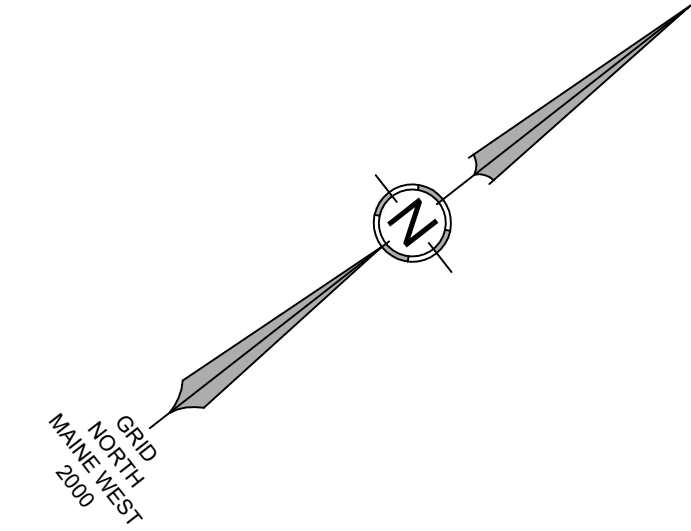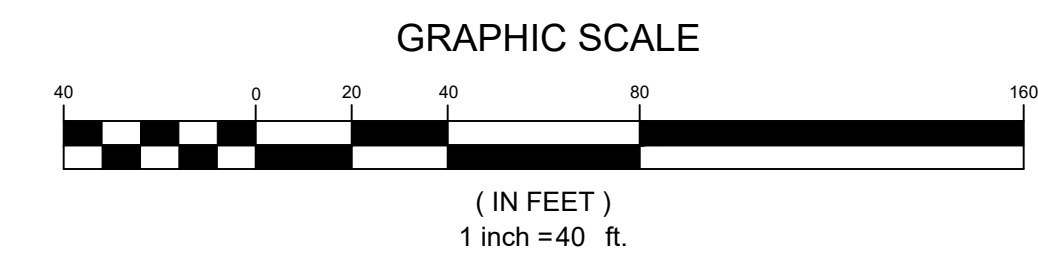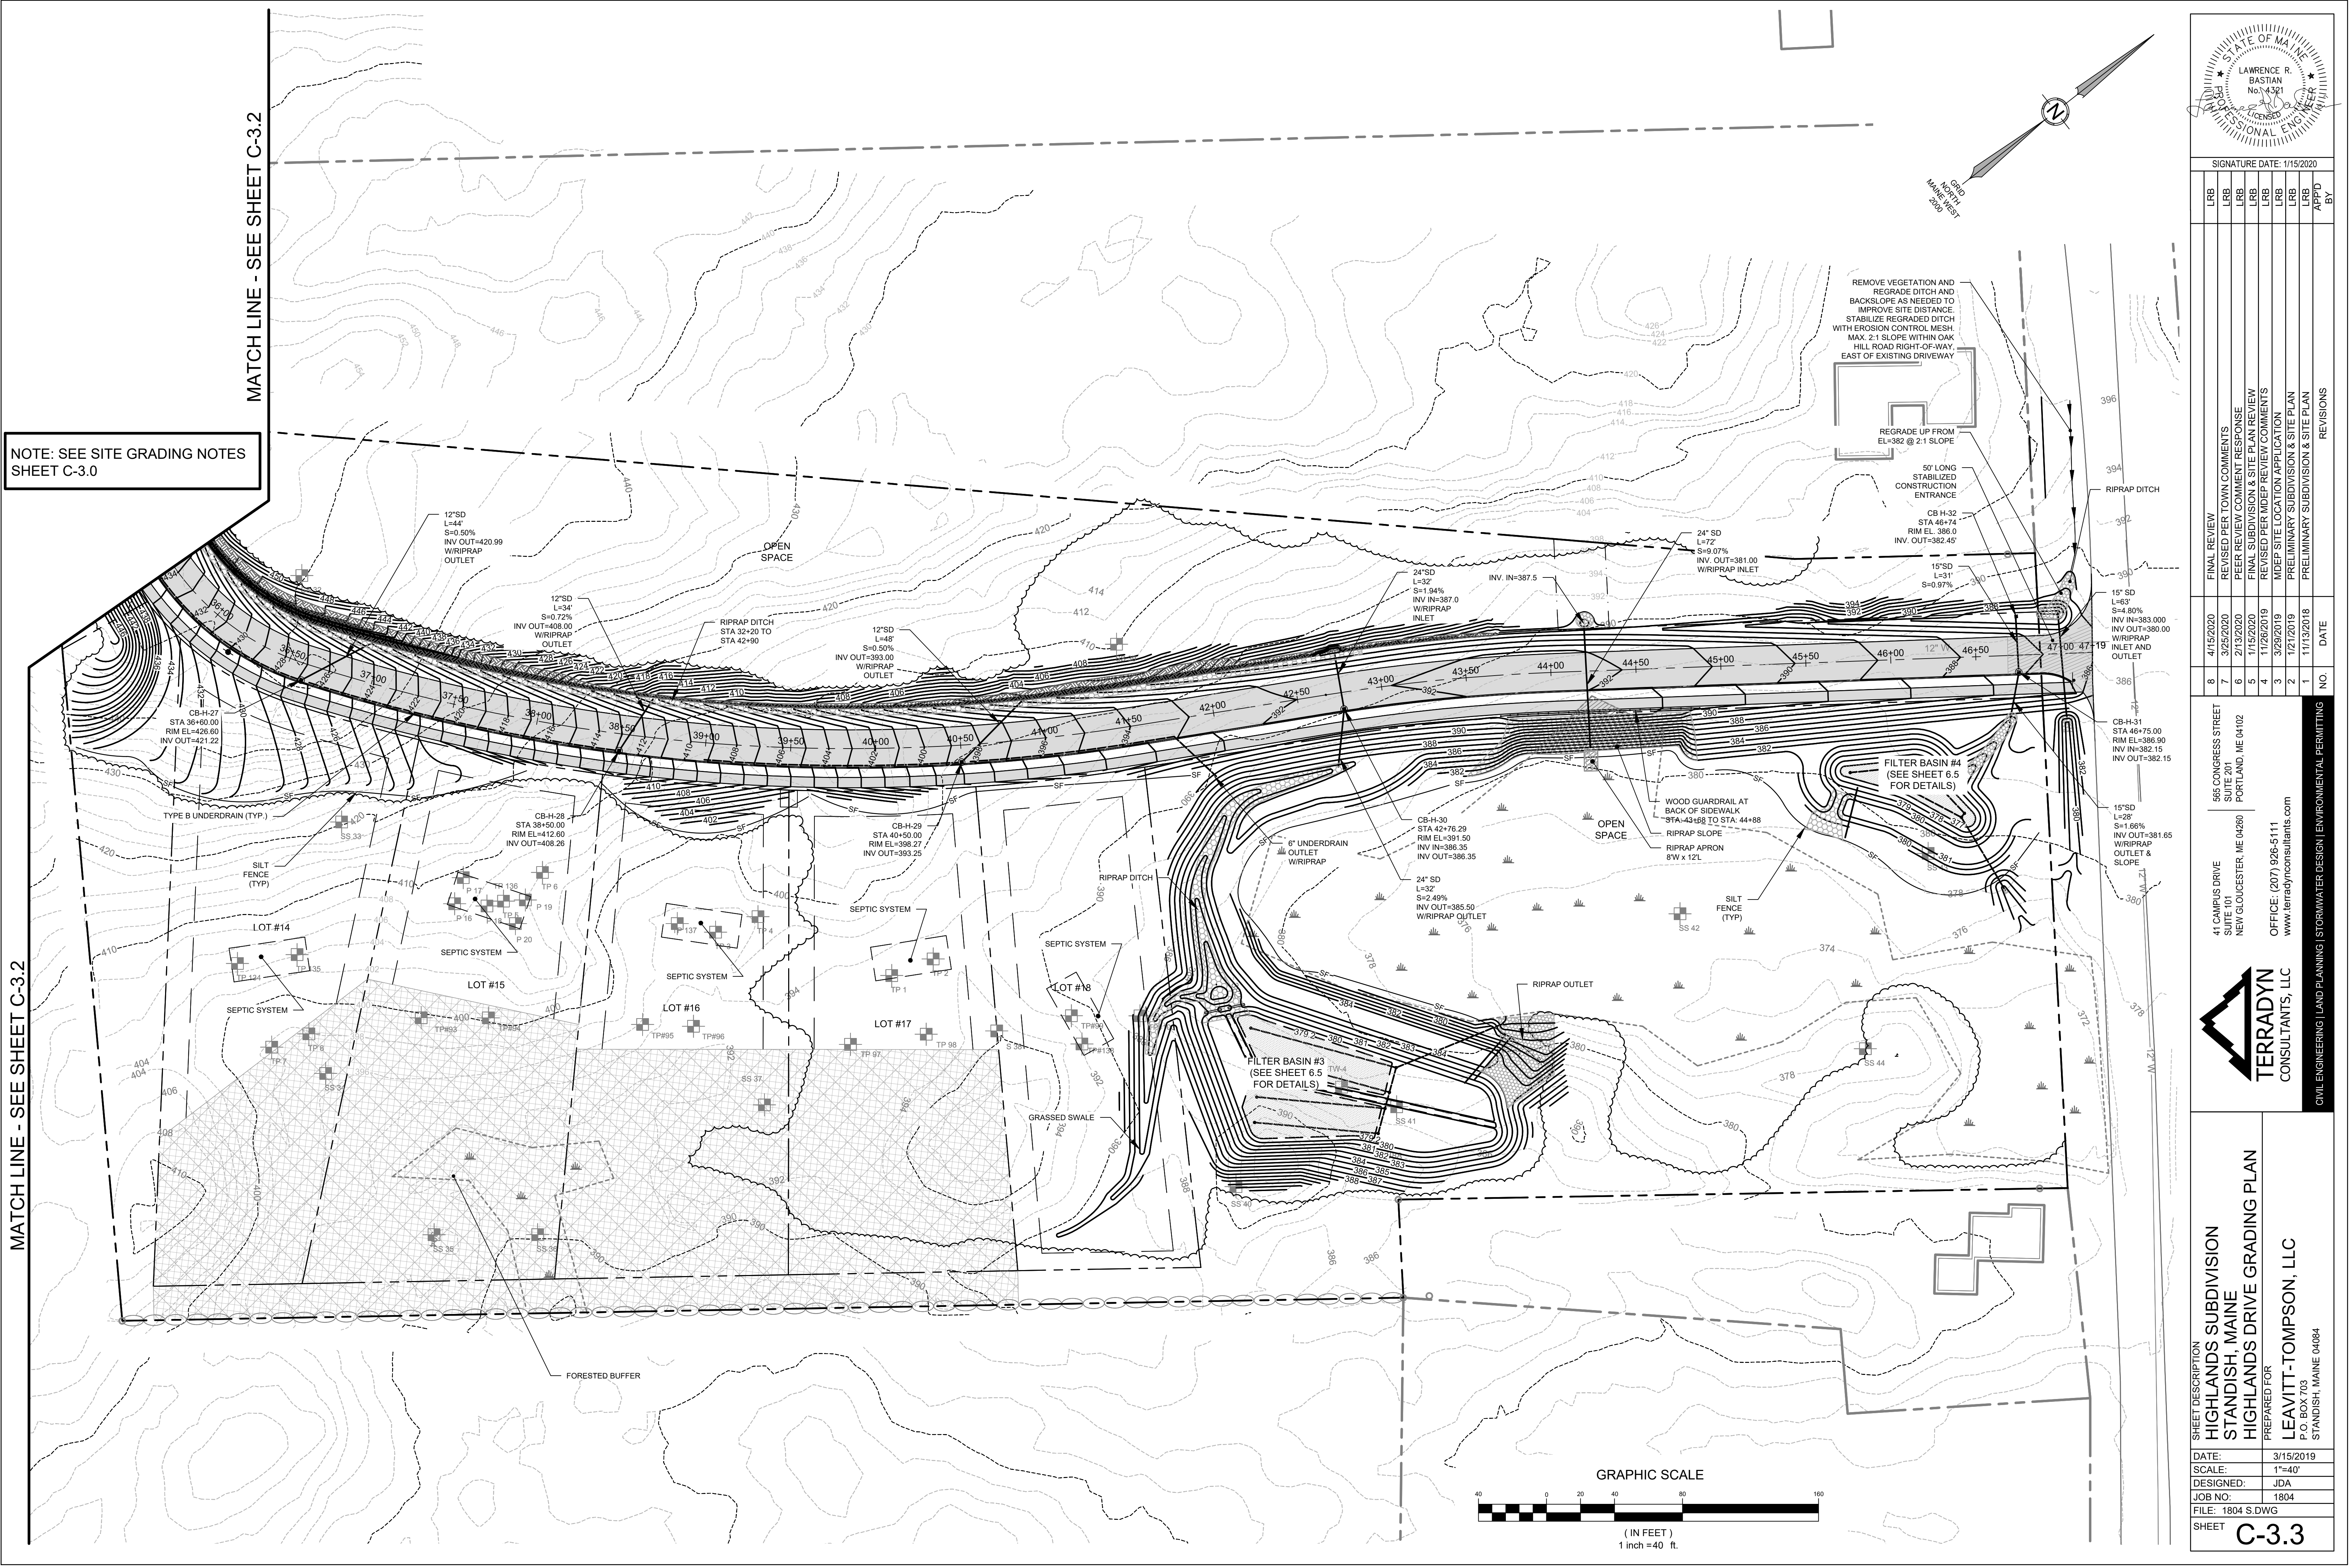



SEE SHEET C-3.5

SEE SHEET C-3.5

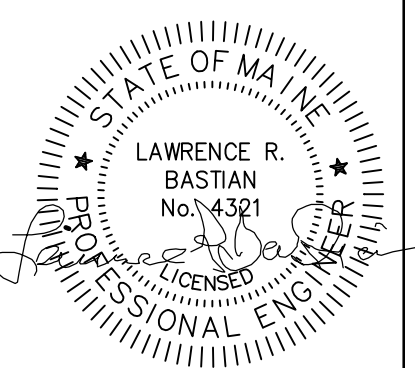

SIGNATURE DATE: 1/15/2020


NO.	DATE	REVISIONS
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN
2	12/17/2019	PRELIMINARY SUBDIVISION & SITE PLAN
3	3/29/2019	MDEP SITE LOCATION APPLICATION
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
7	3/25/2020	FINAL REVIEW
8	4/15/2020	FINAL REVIEW

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
www.terradynconsultants.com


CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

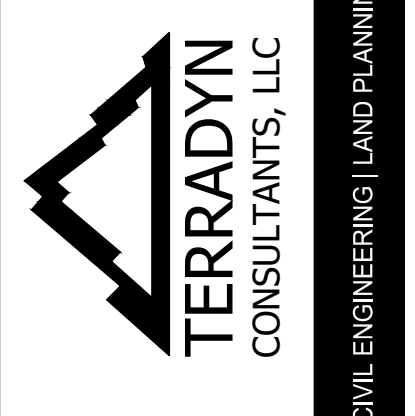

SHEET DESCRIPTION  
HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
KAYLI SUSAN DRIVE GRADING PLAN

PREPARED FOR  
LEAVITT-TOMPSON, LLC  
P.O. BOX 703  
STANDISH, MAINE 04084


DATE: 3/15/2019  
SCALE: 1"=20'  
DESIGNED: JDA  
JOB NO: 1804  
FILE: 1804 S.DWG  
SHEET C-3.4

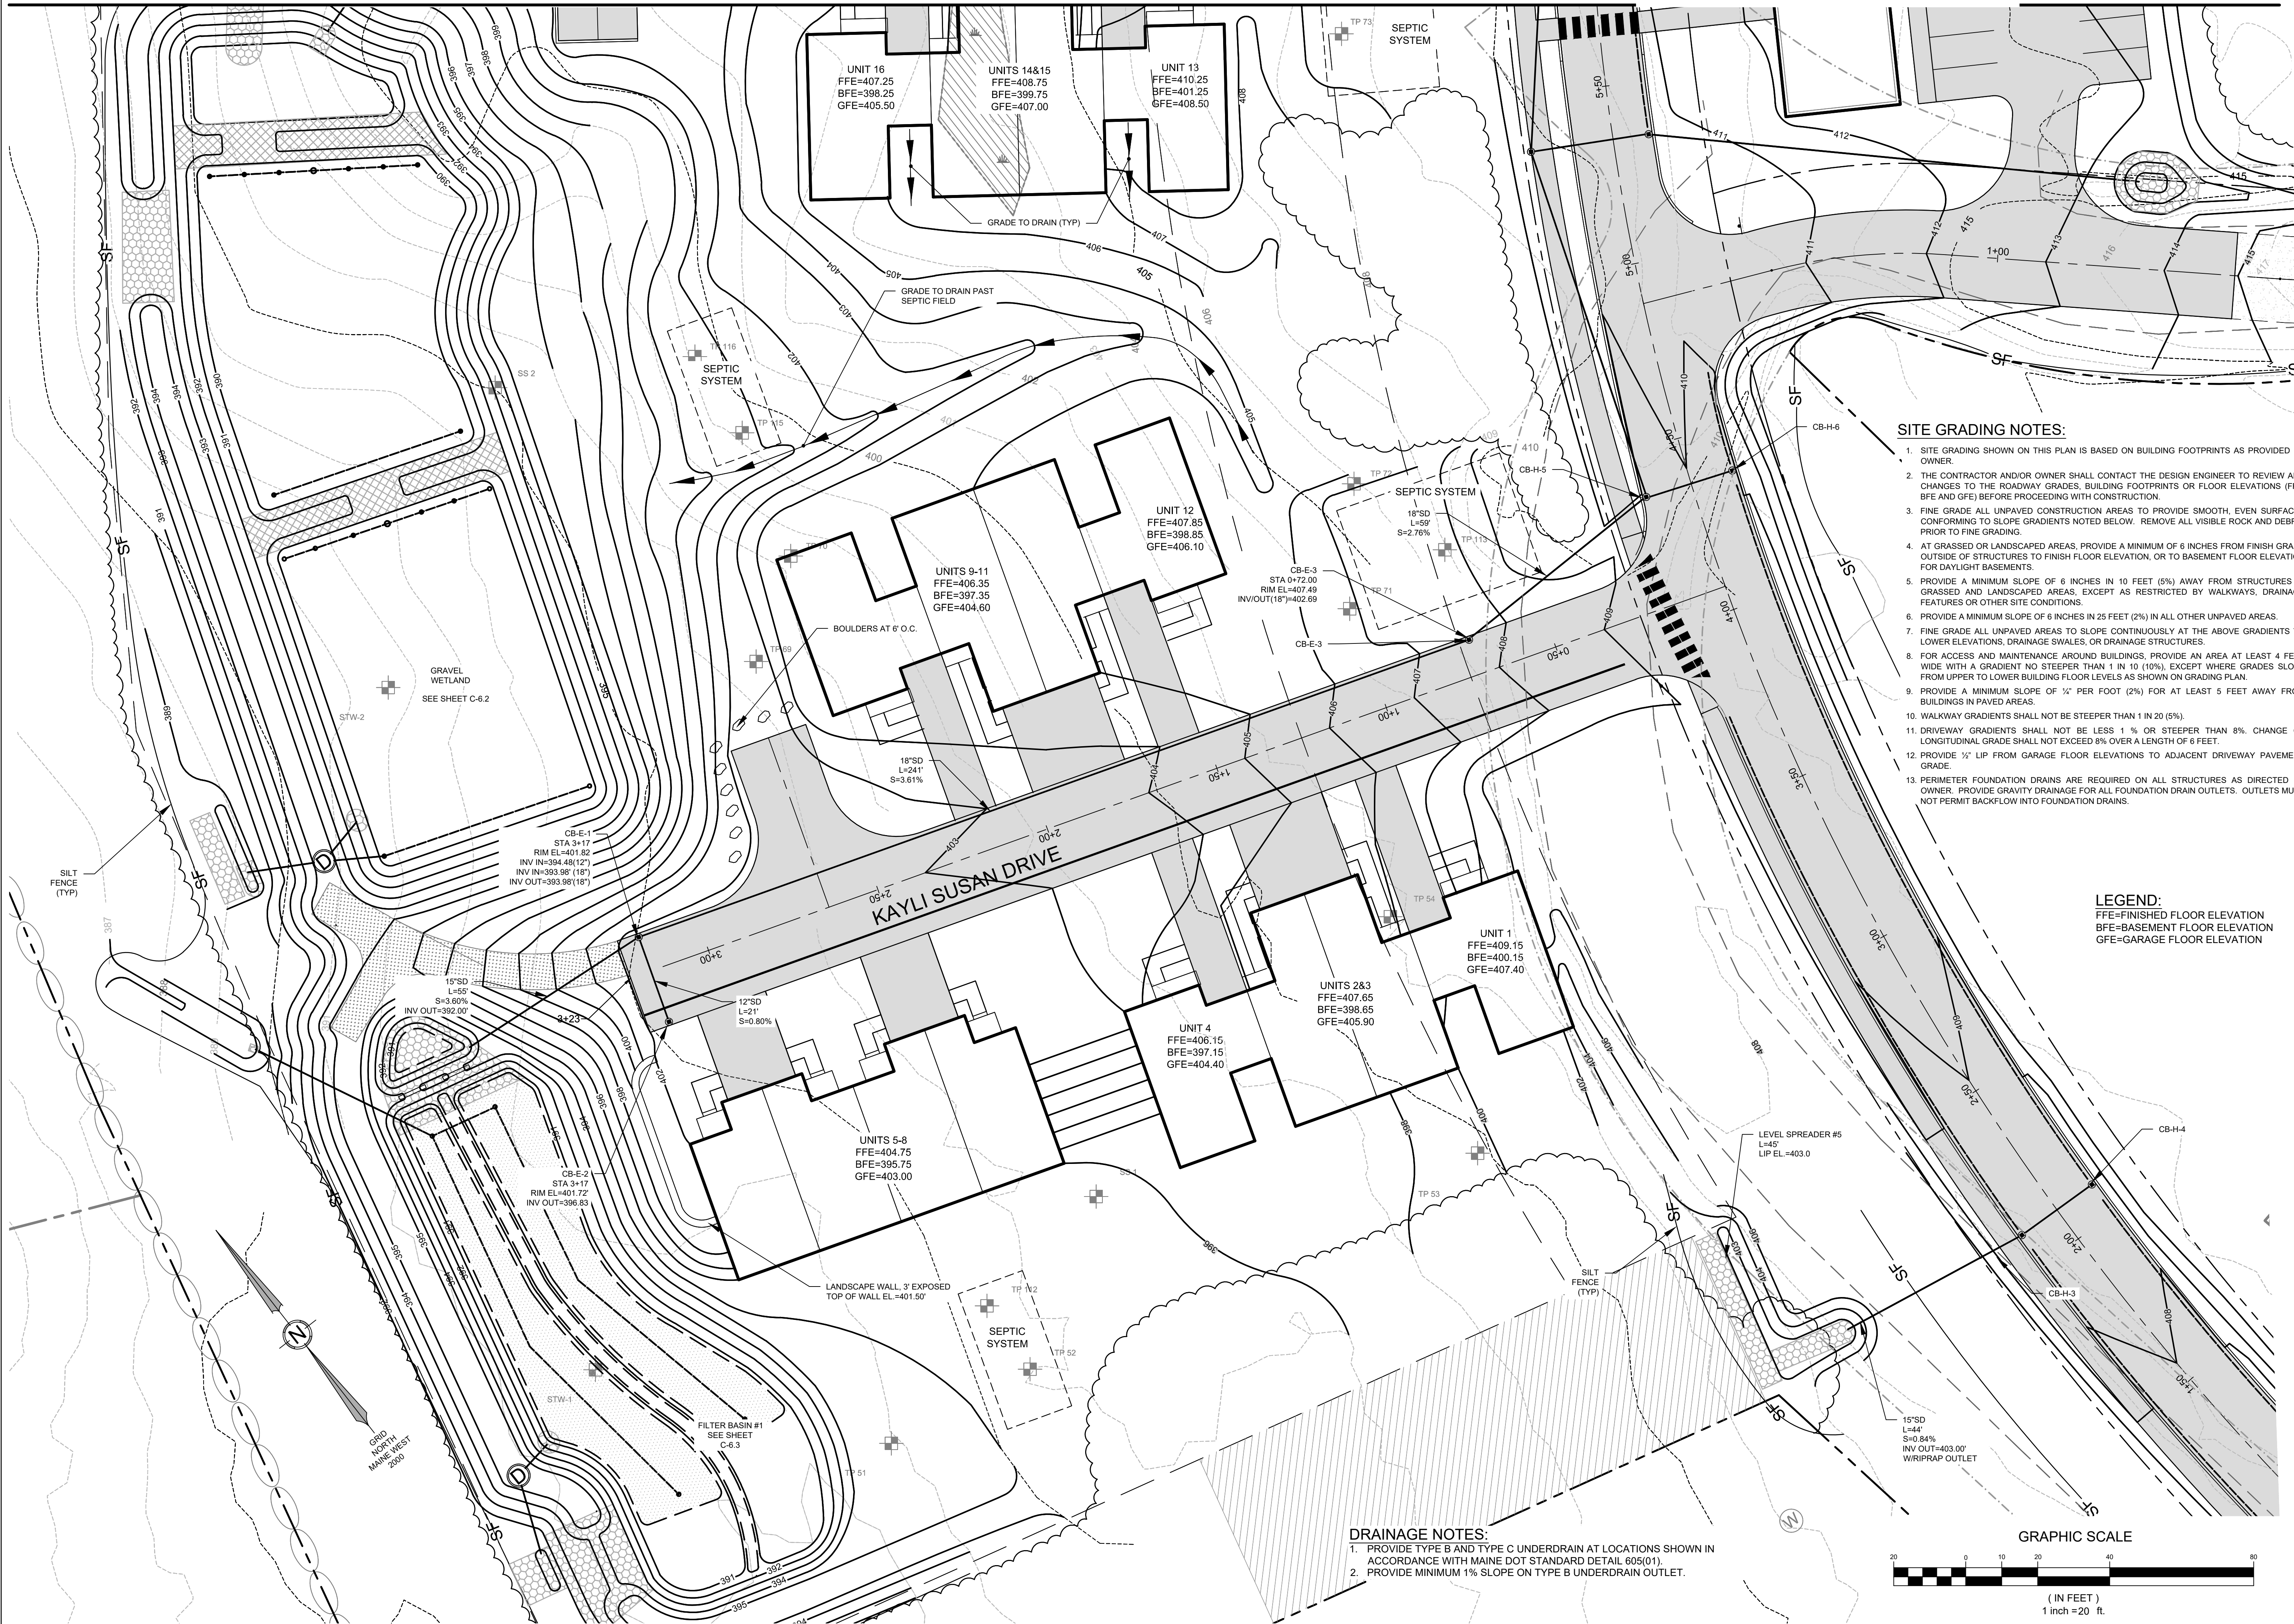

- SITE GRADING NOTES:**
- SITE GRADING SHOWN ON THIS PLAN IS BASED ON BUILDING FOOTPRINTS AS PROVIDED BY OWNER.
  - THE CONTRACTOR AND/OR OWNER SHALL CONTACT THE DESIGN ENGINEER TO REVIEW ANY CHANGES TO THE ROADWAY GRADES, BUILDING FOOTPRINTS OR FLOOR ELEVATIONS (FFE, BFE AND GFE) BEFORE PROCEEDING WITH CONSTRUCTION.
  - FINE GRADE ALL UNPAVED CONSTRUCTION AREAS TO PROVIDE SMOOTH, EVEN SURFACES CONFORMING TO SLOPE GRADIENTS NOTED BELOW. REMOVE ALL VISIBLE ROCK AND DEBRIS PRIOR TO FINE GRADING.
  - AT GRASSED OR LANDSCAPED AREAS, PROVIDE A MINIMUM OF 6 INCHES FROM FINISH GRADE OUTSIDE OF STRUCTURES TO FINISH FLOOR ELEVATION, OR TO BASEMENT FLOOR ELEVATION FOR DAYLIGHT BASEMENTS.
  - PROVIDE A MINIMUM SLOPE OF 6 INCHES IN 10 FEET (5%) AWAY FROM STRUCTURES IN GRASSED AND LANDSCAPED AREAS, EXCEPT AS RESTRICTED BY WALKWAYS, DRAINAGE FEATURES OR OTHER SITE CONDITIONS.
  - PROVIDE A MINIMUM SLOPE OF 6 INCHES IN 25 FEET (2%) IN ALL OTHER UNPAVED AREAS.
  - FINE GRADE ALL UNPAVED AREAS TO SLOPE CONTINUOUSLY AT THE ABOVE GRADIENTS TO LOWER ELEVATIONS, DRAINAGE SWALES, OR DRAINAGE STRUCTURES.
  - FOR ACCESS AND MAINTENANCE AROUND BUILDINGS, PROVIDE AN AREA AT LEAST 4 FEET WIDE WITH A GRADIENT NO STEEPER THAN 1 IN 10 (10%), EXCEPT WHERE GRADES SLOPE FROM UPPER TO LOWER BUILDING FLOOR LEVELS AS SHOWN ON GRADING PLAN.
  - PROVIDE A MINIMUM SLOPE OF 1/4" PER FOOT (2%) FOR AT LEAST 5 FEET AWAY FROM BUILDINGS IN PAVED AREAS.
  - WALKWAY GRADIENTS SHALL NOT BE STEEPER THAN 1 IN 20 (5%).
  - DRIVEWAY GRADIENTS SHALL NOT BE LESS 1% OR STEEPER THAN 8%. CHANGE OF LONGITUDINAL GRADE SHALL NOT EXCEED 8% OVER A LENGTH OF 6 FEET.
  - PROVIDE 1/2" LIP FROM GARAGE FLOOR ELEVATIONS TO ADJACENT DRIVEWAY PAVEMENT GRADE.
  - PERIMETER FOUNDATION DRAINS ARE REQUIRED ON ALL STRUCTURES AS DIRECTED BY OWNER. PROVIDE CRAWTY DRAINAGE FOR ALL FOUNDATION DRAIN OUTLETS. OUTLETS MUST NOT PERMIT BACKFLOW INTO FOUNDATION DRAINS.

**LEGEND:**  
FFE=FINISHED FLOOR ELEVATION  
BFE=BASEMENT FLOOR ELEVATION  
GFE=GARAGE FLOOR ELEVATION

- DRAINAGE NOTES:**
- PROVIDE TYPE B AND TYPE C UNDERDRAIN AT LOCATIONS SHOWN IN ACCORDANCE WITH MAINE DOT STANDARD DETAIL 605(01).
  - PROVIDE MINIMUM 1% SLOPE ON TYPE B UNDERDRAIN OUTLET.

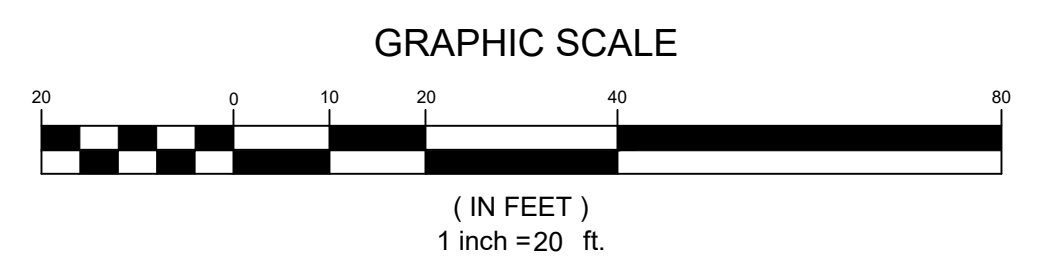



SEE SHEET C-3.6


SEE SHEET C-3.6



**SITE GRADING NOTES:**

1. SITE GRADING SHOWN ON THIS PLAN IS BASED ON BUILDING FOOTPRINTS AS PROVIDED BY OWNER.
2. THE CONTRACTOR AND/OR OWNER SHALL CONTACT THE DESIGN ENGINEER TO REVIEW ANY CHANGES TO THE ROADWAY GRADES, BUILDING FOOTPRINTS OR FLOOR ELEVATIONS (FFE, BFE AND GFE) BEFORE PROCEEDING WITH CONSTRUCTION.
3. FINE GRADE ALL UNPAVED CONSTRUCTION AREAS TO PROVIDE SMOOTH, EVEN SURFACES CONFORMING TO SLOPE GRADIENTS NOTED BELOW. REMOVE ALL VISIBLE ROCK AND DEBRIS PRIOR TO FINE GRADING.
4. AT GRASSED OR LANDSCAPED AREAS, PROVIDE A MINIMUM OF 6 INCHES FROM FINISH GRADE OUTSIDE OF STRUCTURES TO FINISH FLOOR ELEVATION, OR TO BASEMENT FLOOR ELEVATION FOR DAYLIGHT BASEMENTS.
5. PROVIDE A MINIMUM SLOPE OF 6 INCHES IN 10 FEET (5%) AWAY FROM STRUCTURES IN GRASSED AND LANDSCAPED AREAS, EXCEPT AS RESTRICTED BY WALKWAYS, DRAINAGE FEATURES OR OTHER SITE CONDITIONS.
6. PROVIDE A MINIMUM SLOPE OF 6 INCHES IN 25 FEET (2%) IN ALL OTHER UNPAVED AREAS.
7. FINE GRADE ALL UNPAVED AREAS TO SLOPE CONTINUOUSLY AT THE ABOVE GRADIENTS TO LOWER ELEVATIONS, DRAINAGE SWALES, OR DRAINAGE STRUCTURES.
8. FOR ACCESS AND MAINTENANCE AROUND BUILDINGS, PROVIDE AN AREA AT LEAST 4 FEET WIDE WITH A GRADIENT NO STEEPER THAN 1 IN 10 (10%), EXCEPT WHERE GRADES SLOPE FROM UPPER TO LOWER BUILDING FLOOR LEVELS AS SHOWN ON GRADING PLAN.
9. PROVIDE A MINIMUM SLOPE OF 1/2" PER FOOT (2%) FOR AT LEAST 5 FEET AWAY FROM BUILDINGS IN PAVED AREAS.
10. WALKWAY GRADIENTS SHALL NOT BE STEEPER THAN 1 IN 20 (5%).
11. DRIVEWAY GRADIENTS SHALL NOT BE LESS 1% OR STEEPER THAN 8%. CHANGE OF LONGITUDINAL GRADE SHALL NOT EXCEED 8% OVER A LENGTH OF 6 FEET.
12. PROVIDE 1/2" LIP FROM GARAGE FLOOR ELEVATIONS TO ADJACENT DRIVEWAY PAVEMENT GRADE.
13. PERIMETER FOUNDATION DRAINS ARE REQUIRED ON ALL STRUCTURES AS DIRECTED BY OWNER. PROVIDE GRAVITY DRAINAGE FOR ALL FOUNDATION DRAIN OUTLETS. OUTLETS MUST NOT PERMIT BACKFLOW INTO FOUNDATION DRAINS.

**LEGEND:**  
 FFE=FINISHED FLOOR ELEVATION  
 BFE=BASEMENT FLOOR ELEVATION  
 GFE=GARAGE FLOOR ELEVATION

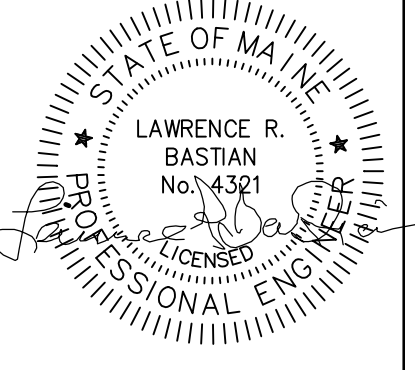

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
3	3/29/2019	PRELIMINARY SUBDIVISION & SITE PLAN
4	11/26/2019	REVISION PER MDP REVIEW COMMENTS
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
7	3/25/2020	REVISION PER TOWN COMMENTS
8	4/15/2020	FINAL REVIEW

41 CAMPUS DRIVE  
 SUITE 101  
 NEW GLOUCESTER, ME 04260  
 OFFICE: (207) 926-5111  
 www.terradynconsultants.com




CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
**HIGHLANDS SUBDIVISION**  
**STANDISH, MAINE**  
**JESSE DANIEL DRIVE GRADING PLAN**  
 PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
 P.O. BOX 703  
 STANDISH, MAINE 04084

DATE:	3/15/2019
SCALE:	1"=20'
DESIGNED:	JDA
JOB NO.:	1804
FILE:	1804 S.DWG
SHEET	<b>C-3.5</b>

SEE SHEET C-3.4


SEE SHEET C-3.4

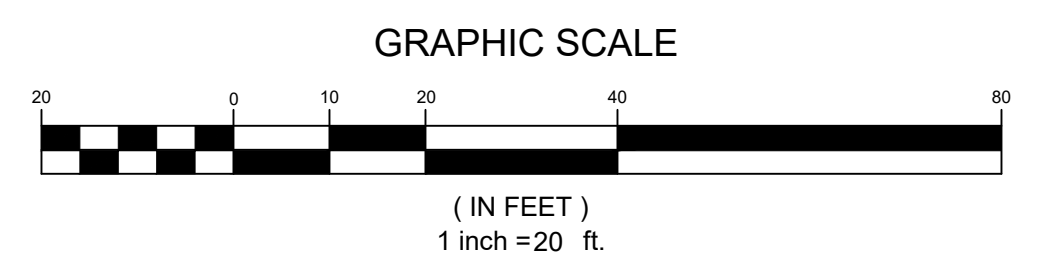



SEE SHEET C-3.7

SEE SHEET C-3.7

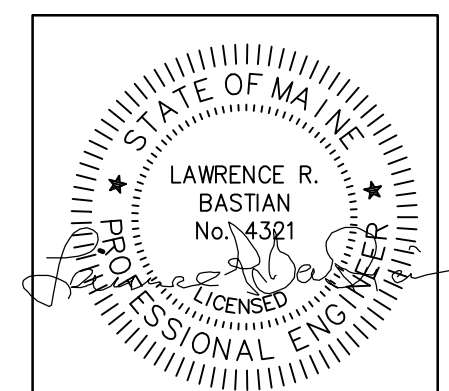

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
6	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
8	2/13/2020	PEER REVIEW COMMENT RESPONSE
9	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
10	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
11	3/29/2019	MDEP SITE LOCATION APPLICATION
12	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
13	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
www.terradynconsultants.com




CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

**LEGEND:**  
FFE=FINISHED FLOOR ELEVATION  
BFE=BASEMENT FLOOR ELEVATION  
GFE=GARAGE FLOOR ELEVATION

**SITE GRADING NOTES:**

- SITE GRADING SHOWN ON THIS PLAN IS BASED ON BUILDING FOOTPRINTS AS PROVIDED BY OWNER.
- THE CONTRACTOR AND/OR OWNER SHALL CONTACT THE DESIGN ENGINEER TO REVIEW ANY CHANGES TO THE ROADWAY GRADES, BUILDING FOOTPRINTS OR FLOOR ELEVATIONS (FFE, BFE AND GFE) BEFORE PROCEEDING WITH CONSTRUCTION.
- FINE GRADE ALL UNPAVED CONSTRUCTION AREAS TO PROVIDE SMOOTH, EVEN SURFACES CONFORMING TO SLOPE GRADIENTS NOTED BELOW. REMOVE ALL VISIBLE ROCK AND DEBRIS PRIOR TO FINE GRADING.
- AT GRASSED OR LANDSCAPED AREAS, PROVIDE A MINIMUM OF 6 INCHES FROM FINISH GRADE OUTSIDE OF STRUCTURES TO FINISH FLOOR ELEVATION, OR TO BASEMENT FLOOR ELEVATION FOR DAYLIGHT BASEMENTS.
- PROVIDE A MINIMUM SLOPE OF 6 INCHES IN 10 FEET (5%) AWAY FROM STRUCTURES IN GRASSED AND LANDSCAPED AREAS, EXCEPT AS RESTRICTED BY WALKWAYS, DRAINAGE FEATURES OR OTHER SITE CONDITIONS.
- PROVIDE A MINIMUM SLOPE OF 6 INCHES IN 25 FEET (2%) IN ALL OTHER UNPAVED AREAS.
- FINE GRADE ALL UNPAVED AREAS TO SLOPE CONTINUOUSLY AT THE ABOVE GRADIENTS TO LOWER ELEVATIONS, DRAINAGE SWALES, OR DRAINAGE STRUCTURES.
- FOR ACCESS AND MAINTENANCE AROUND BUILDINGS, PROVIDE AN AREA AT LEAST 4 FEET WIDE WITH A GRADIENT NO STEEPER THAN 1 IN 10 (10%), EXCEPT WHERE GRADES SLOPE FROM UPPER TO LOWER BUILDING FLOOR LEVELS AS SHOWN ON GRADING PLAN.
- PROVIDE A MINIMUM SLOPE OF 1/2" PER FOOT (2%) FOR AT LEAST 5 FEET AWAY FROM BUILDINGS IN PAVED AREAS.
- WALKWAY GRADIENTS SHALL NOT BE STEEPER THAN 1 IN 20 (5%).
- DRIVEWAY GRADIENTS SHALL NOT BE LESS 1% OR STEEPER THAN 8%. CHANGE OF LONGITUDINAL GRADE SHALL NOT EXCEED 8% OVER A LENGTH OF 6 FEET.
- PROVIDE 1/2" LIP FROM GARAGE FLOOR ELEVATIONS TO ADJACENT DRIVEWAY PAVEMENT GRADE.
- PERMETTER FOUNDATION DRAINS ARE REQUIRED ON ALL STRUCTURES AS DIRECTED BY OWNER. PROVIDE GRAVITY DRAINAGE FOR ALL FOUNDATION DRAIN OUTLETS. OUTLETS MUST NOT PERMIT BACKFLOW INTO FOUNDATION DRAINS.

**GRAPHIC SCALE**

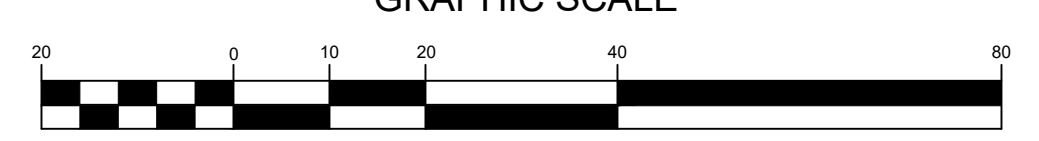

SEE SHEET C-3.5

SEE SHEET C-3.5

SHEET DESCRIPTION  
**HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
WHITNEY DRIVE GRADING PLAN**

PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
P.O. BOX 703  
STANDISH, MAINE 04084


DATE: 3/15/2019  
SCALE: 1"=20'  
DESIGNED: JDA  
JOB NO: 1804  
FILE: 1804 S.DWG  
SHEET **C-3.6**



SEE SHEET C-3.8

SEE SHEET C-3.8

LEGEND:  
FFE=FINISHED FLOOR ELEVATION  
BFE=BASEMENT FLOOR ELEVATION  
GFE=GARAGE FLOOR ELEVATION

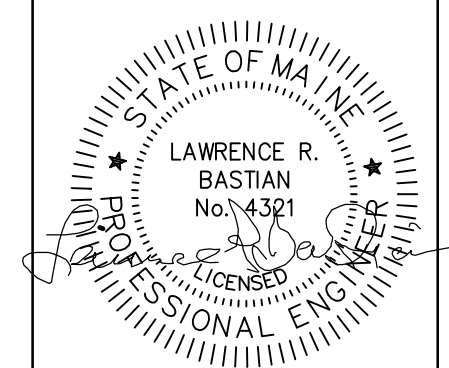

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	12/17/2018	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
www.terradynteam.com

**TERRADYN**  
CONSULTANTS, LLC

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
**HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
INVERNESS DRIVE GRADING PLAN**

PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
P.O. BOX 703  
STANDISH, MAINE 04084


DATE: 3/15/2019  
SCALE: 1"=20'  
DESIGNED: JDA  
JOB NO.: 1804  
FILE: 1804 S.DWG  
SHEET **C-3.7**



- SITE GRADING NOTES:**
- SITE GRADING SHOWN ON THIS PLAN IS BASED ON BUILDING FOOTPRINTS AS PROVIDED BY OWNER.
  - THE CONTRACTOR AND/OR OWNER SHALL CONTACT THE DESIGN ENGINEER TO REVIEW ANY CHANGES TO THE ROADWAY GRADES, BUILDING FOOTPRINTS OR FLOOR ELEVATIONS (FFE, BFE AND GFE) BEFORE PROCEEDING WITH CONSTRUCTION.
  - FINE GRADE ALL UNPAVED CONSTRUCTION AREAS TO PROVIDE SMOOTH, EVEN SURFACES CONFORMING TO SLOPE GRADIENTS NOTED BELOW. REMOVE ALL VISIBLE ROCK AND DEBRIS PRIOR TO FINE GRADING.
  - AT GRASSED OR LANDSCAPED AREAS, PROVIDE A MINIMUM OF 6 INCHES FROM FINISH GRADE OUTSIDE OF STRUCTURES TO FINISH FLOOR ELEVATION, OR TO BASEMENT FLOOR ELEVATION FOR DAYLIGHT BASEMENTS.
  - PROVIDE A MINIMUM SLOPE OF 6 INCHES IN 10 FEET (6%) AWAY FROM STRUCTURES IN GRASSED AND LANDSCAPED AREAS, EXCEPT AS RESTRICTED BY WALKWAYS, DRAINAGE FEATURES OR OTHER SITE CONDITIONS.
  - PROVIDE A MINIMUM SLOPE OF 6 INCHES IN 25 FEET (2%) IN ALL OTHER UNPAVED AREAS.
  - FINE GRADE ALL UNPAVED AREAS TO SLOPE CONTINUOUSLY AT THE ABOVE GRADIENTS TO LOWER ELEVATIONS, DRAINAGE SWALES, OR DRAINAGE STRUCTURES.
  - FOR ACCESS AND MAINTENANCE AROUND BUILDINGS, PROVIDE AN AREA AT LEAST 4 FEET WIDE WITH A GRADIENT NO STEEPER THAN 1 IN 10 (10%), EXCEPT WHERE GRADES SLOPE FROM UPPER TO LOWER BUILDING FLOOR LEVELS AS SHOWN ON GRADING PLAN.
  - PROVIDE A MINIMUM SLOPE OF 1/2" PER FOOT (2%) FOR AT LEAST 5 FEET AWAY FROM BUILDINGS IN PAVED AREAS.
  - WALKWAY GRADIENTS SHALL NOT BE STEEPER THAN 1 IN 20 (5%).
  - DRIVEWAY GRADIENTS SHALL NOT BE LESS 1% OR STEEPER THAN 8%. CHANGE OF LONGITUDINAL GRADE SHALL NOT EXCEED 8% OVER A LENGTH OF 6 FEET.
  - PROVIDE 1/2" LIP FROM GARAGE FLOOR ELEVATIONS TO ADJACENT DRIVEWAY PAVEMENT GRADE.
  - PERIMETER FOUNDATION DRAINS ARE REQUIRED ON ALL STRUCTURES AS DIRECTED BY OWNER. PROVIDE GRAVITY DRAINAGE FOR ALL FOUNDATION DRAIN OUTLETS. OUTLETS MUST NOT PERMIT BACKFLOW INTO FOUNDATION DRAINS.

SEE SHEET C-3.6

SEE SHEET C-3.6

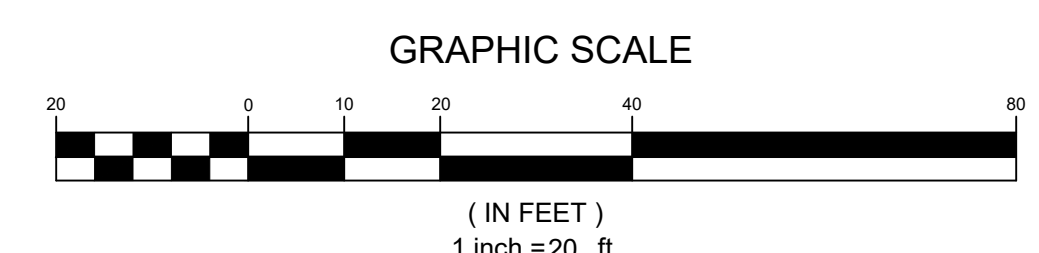



**SITE GRADING NOTES:**



1. SITE GRADING SHOWN ON THIS PLAN IS BASED ON BUILDING FOOTPRINTS AS PROVIDED BY OWNER.
2. THE CONTRACTOR AND/OR OWNER SHALL CONTACT THE DESIGN ENGINEER TO REVIEW ANY CHANGES TO THE ROADWAY GRADES, BUILDING FOOTPRINTS OR FLOOR ELEVATIONS (FFE, BFE AND GFE) BEFORE PROCEEDING WITH CONSTRUCTION.
3. FINE GRADE ALL UNPAVED CONSTRUCTION AREAS TO PROVIDE SMOOTH, EVEN SURFACES CONFORMING TO SLOPE GRADIENTS NOTED BELOW. REMOVE ALL VISIBLE ROCK AND DEBRIS PRIOR TO FINE GRADING.
4. AT GRASSED OR LANDSCAPED AREAS, PROVIDE A MINIMUM OF 6 INCHES FROM FINISH GRADE OUTSIDE OF STRUCTURES TO FINISH FLOOR ELEVATION, OR TO BASEMENT FLOOR ELEVATION FOR DAYLIGHT BASEMENTS.
5. PROVIDE A MINIMUM SLOPE OF 6 INCHES IN 10 FEET (5%) AWAY FROM STRUCTURES IN GRASSED AND LANDSCAPED AREAS, EXCEPT AS RESTRICTED BY WALKWAYS, DRAINAGE FEATURES OR OTHER SITE CONDITIONS.
6. PROVIDE A MINIMUM SLOPE OF 6 INCHES IN 25 FEET (2%) IN ALL OTHER UNPAVED AREAS.
7. FINE GRADE ALL UNPAVED AREAS TO SLOPE CONTINUOUSLY AT THE ABOVE GRADIENTS TO LOWER ELEVATIONS, DRAINAGE SWALES, OR DRAINAGE STRUCTURES.
8. FOR ACCESS AND MAINTENANCE AROUND BUILDINGS, PROVIDE AN AREA AT LEAST 4 FEET WIDE WITH A GRADIENT NO STEEPER THAN 1 IN 10 (10%), EXCEPT WHERE GRADES SLOPE FROM UPPER TO LOWER BUILDING FLOOR LEVELS AS SHOWN ON GRADING PLAN.
9. PROVIDE A MINIMUM SLOPE OF 1/4 PER FOOT (2%) FOR AT LEAST 5 FEET AWAY FROM BUILDINGS IN PAVED AREAS.
10. WALKWAY GRADIENTS SHALL NOT BE STEEPER THAN 1 IN 20 (5%).
11. DRIVEWAY GRADIENTS SHALL NOT BE LESS 1% OR STEEPER THAN 8%. CHANGE OF LONGITUDINAL GRADE SHALL NOT EXCEED 8% OVER A LENGTH OF 6 FEET.
12. PROVIDE 1/2" LIP FROM GARAGE FLOOR ELEVATIONS TO ADJACENT DRIVEWAY PAVEMENT GRADE.
13. PERIMETER FOUNDATION DRAINS ARE REQUIRED ON ALL STRUCTURES AS DIRECTED BY OWNER. PROVIDE GRAVITY DRAINAGE FOR ALL FOUNDATION DRAIN OUTLETS. OUTLETS MUST NOT PERMIT BACKFLOW INTO FOUNDATION DRAINS.

**LEGEND:**  
 FFE=FINISHED FLOOR ELEVATION  
 BFE=BASEMENT FLOOR ELEVATION  
 GFE=GARAGE FLOOR ELEVATION



SEE SHEET C-3.7


SEE SHEET C-3.7

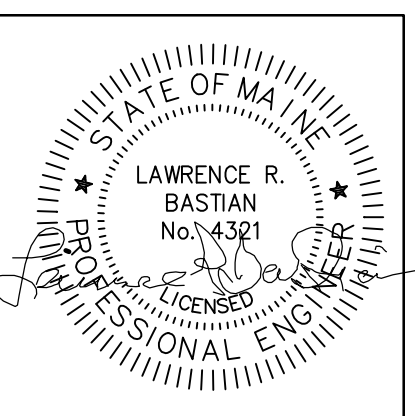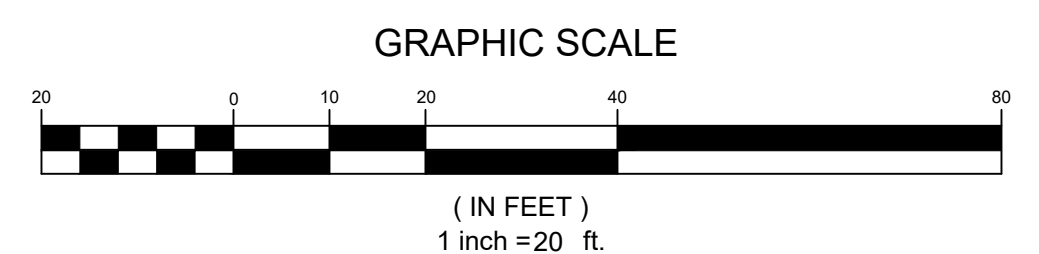

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
3	3/29/2019	PRELIMINARY SUBDIVISION & SITE PLAN
4	11/26/2019	MDP REVIEW COMMENTS
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
7	3/25/2020	REVISED PER TOWN COMMENTS
8	4/15/2020	FINAL REVIEW

41 CAMPUS DRIVE  
 SUITE 101  
 NEW GLOUCESTER, ME 04260  
 OFFICE: (207) 926-5111  
 www.terradynconsultants.com

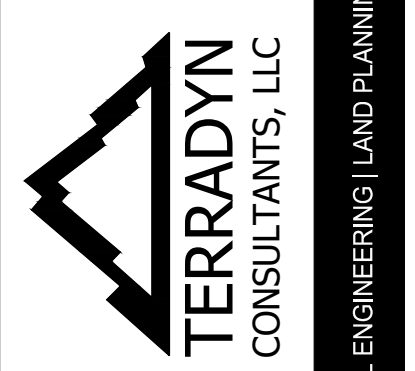

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING



SHEET DESCRIPTION  
 HIGHLANDS SUBDIVISION  
 STANDISH, MAINE  
 STONEHAVEN DRIVE GRADING PLAN  
 PREPARED FOR  
 LEAVITT-TOMPSON, LLC  
 P.O. BOX 703  
 STANDISH, MAINE 04084

DATE:	3/15/2019
SCALE:	1"=20'
DESIGNED:	JDA
JOB NO.:	1804
FILE:	1804 S.DWG
SHEET	<b>C-3.8</b>



**WATER MAIN CONSTRUCTION NOTES:**

1. CURB STOPS LOCATED WITHIN PAVED AREAS SHALL BE IN A VALVE BOX TO SECTION.
2. (2) LAYERS OF RIGID INSULATION BETWEEN SERVICE(S) AND CULVERT (TYPICAL ALL CROSSINGS).
3. 6 FEET OF COVER ON ALL WATER MAINS & SERVICES (TYP)
4. MINIMUM 12" SEPARATION BETWEEN STORM DRAIN AND WATER MAIN. INSTALL 2" RIGID FOAM INSULATION ABOVE WATER MAIN (TYP).
5. TESTABLE DCVA ON ALL FIRE SERVICES BEFORE RISER PIPE (TYP)

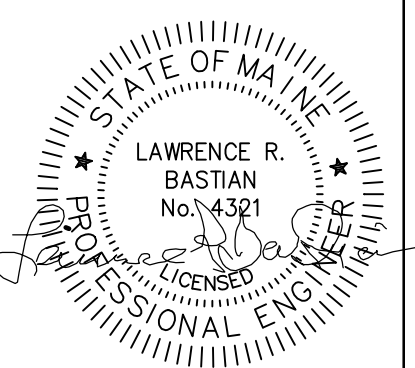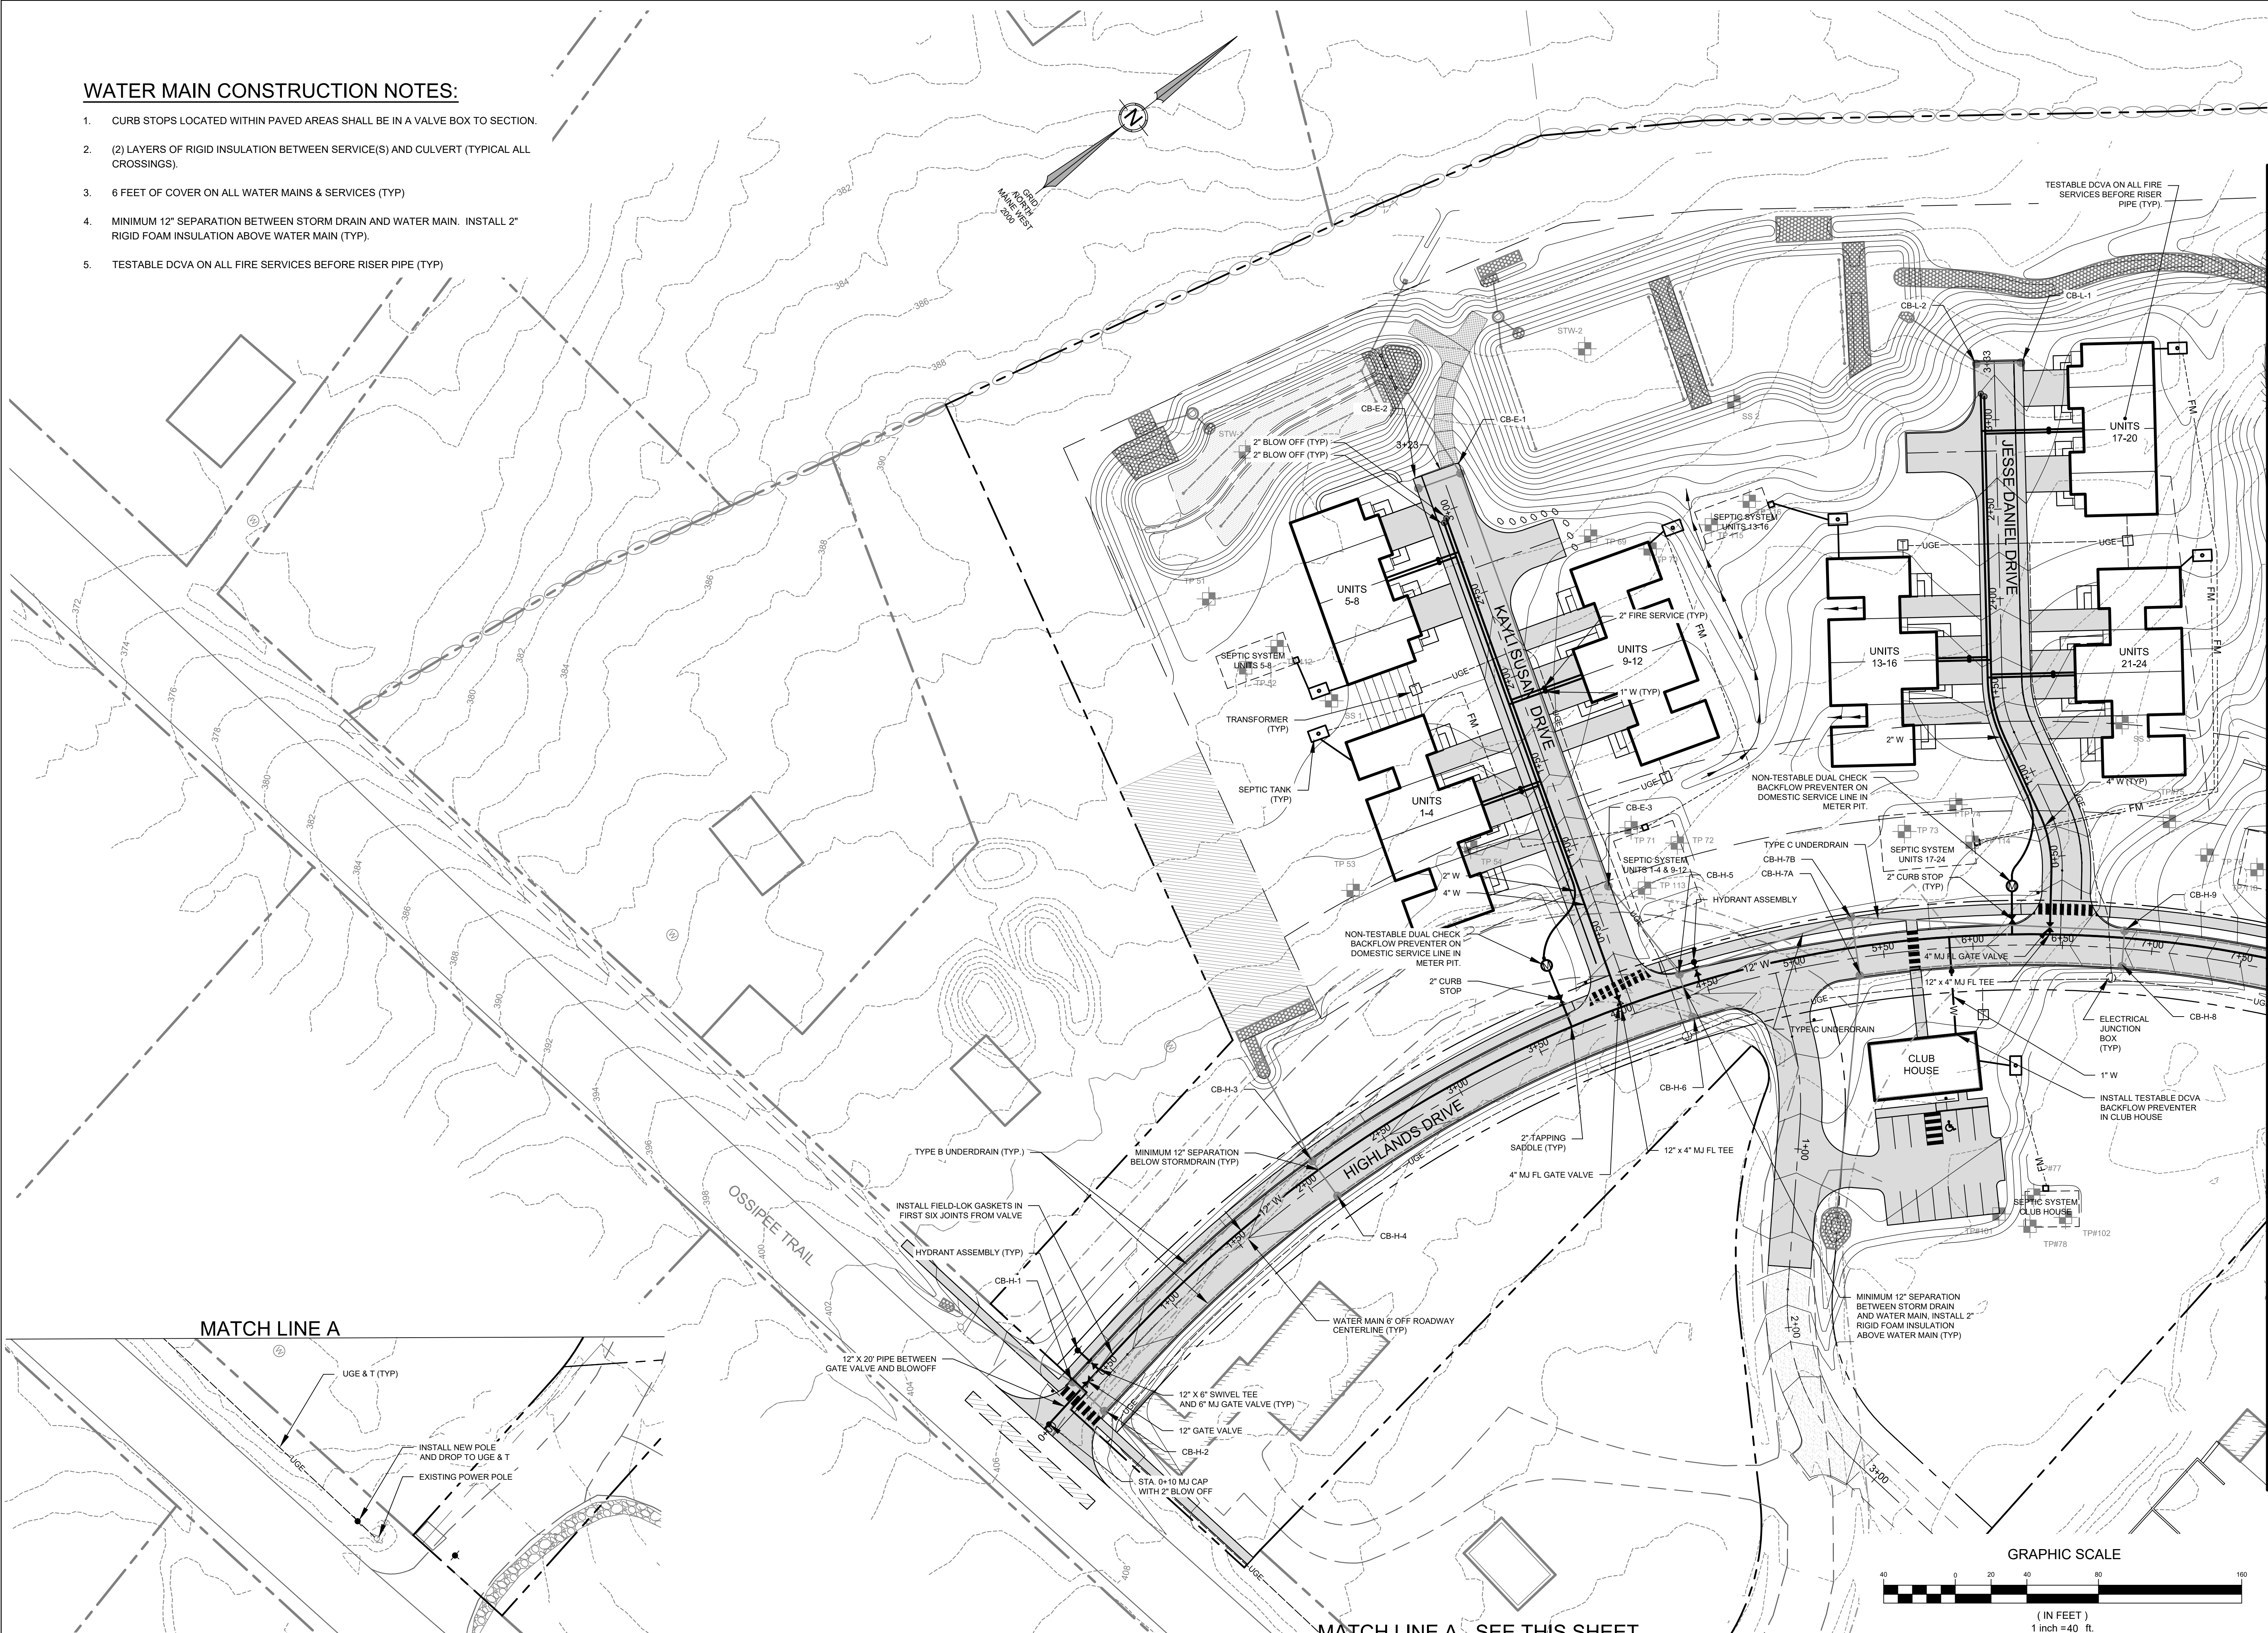

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
www.terradynconsultants.com



CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING


SHEET DESCRIPTION  
HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
HIGHLANDS DRIVE UTILITY PLAN  
PREPARED FOR  
LEAVITT-TOMPSON, LLC  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE:	3/15/2019
SCALE:	1"=40'
DESIGNED:	JDA
JOB NO:	1804
FILE:	1804 U.DWG
SHEET	<b>C-4.0</b>


MATCH LINE - SEE SHEET C-4.1

MATCH LINE - SEE SHEET C-4.1

MATCH LINE A - SEE THIS SHEET

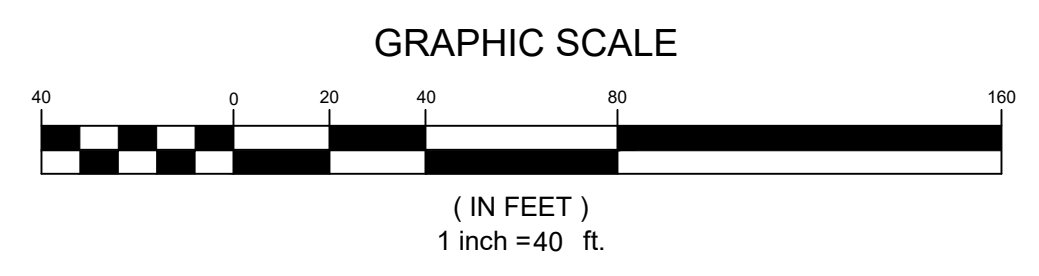

MATCH LINE A

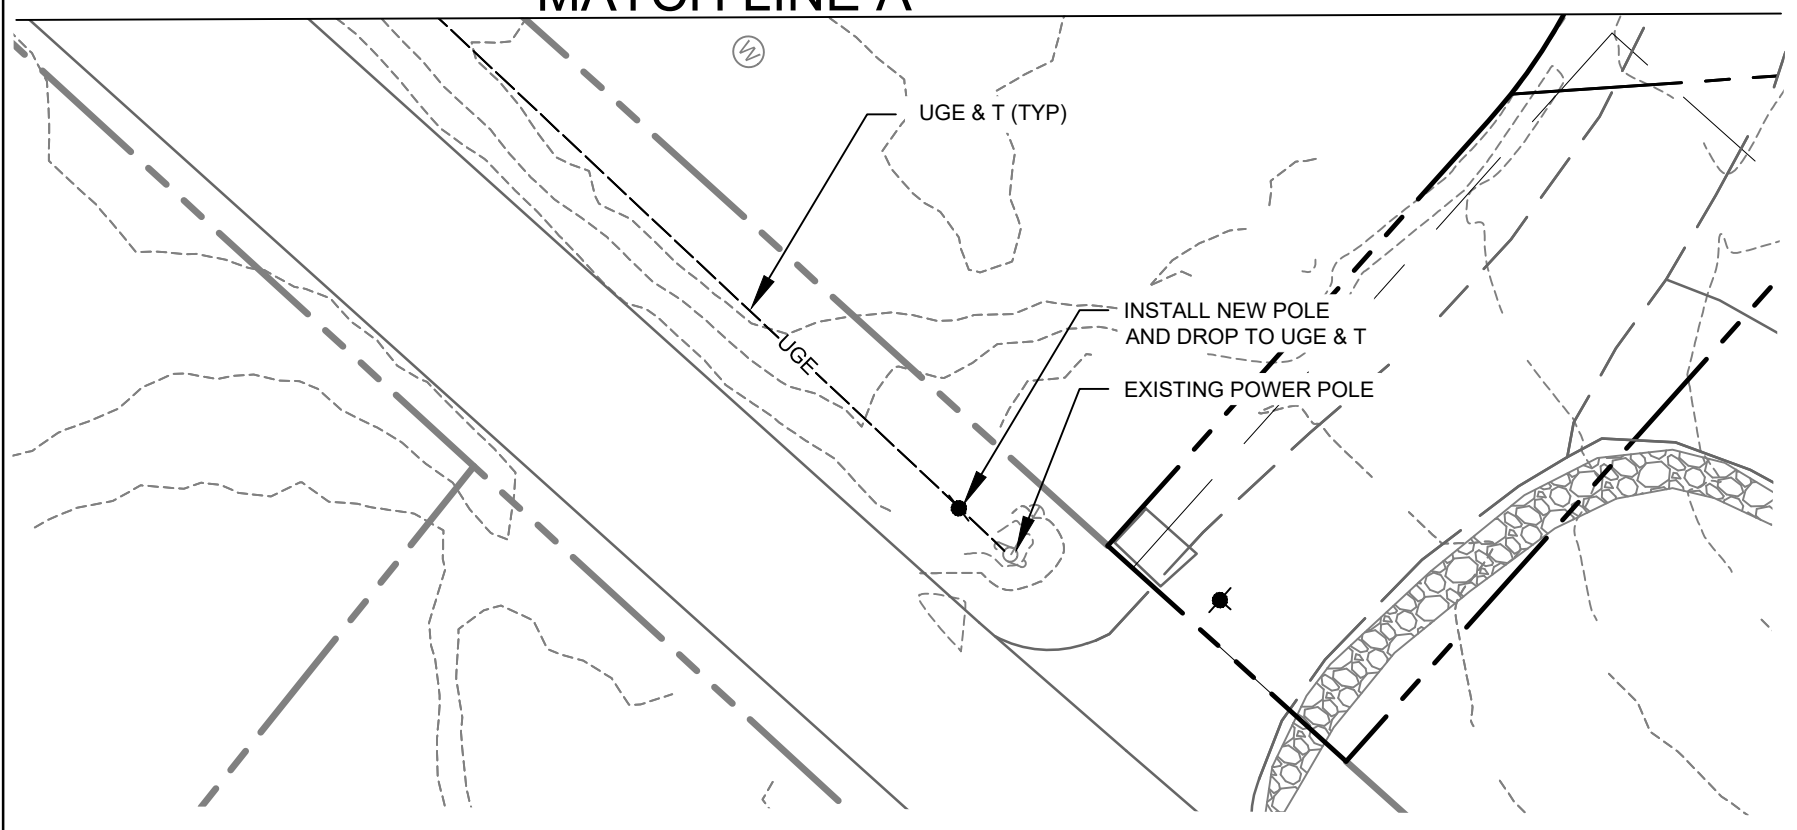




MATCH LINE - SEE SHEET C-4.0

MATCH LINE - SEE SHEET C-4.0

MATCH LINE - SEE SHEET C-4.2

MATCH LINE - SEE SHEET C-4.2

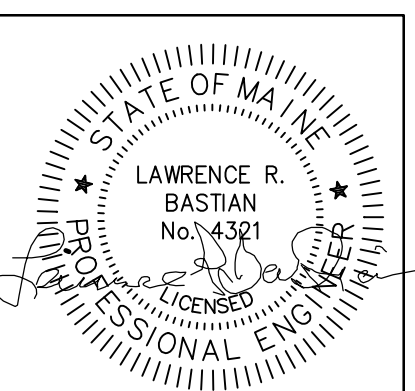


SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
3	3/29/2019	MDEP SITE LOCATION APPLICATION
4	11/26/2019	REVISOR PER MDEP REVIEW COMMENTS
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
7	3/25/2020	REVISED PER TOWN COMMENTS
8	4/15/2020	FINAL REVIEW

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
NEW GLOUCESTER, ME 04260




OFFICE: (207) 926-5111  
www.terradynconsultants.com

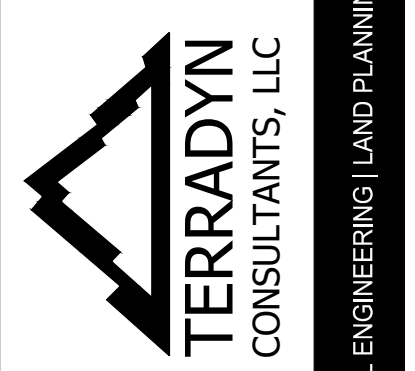

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
HIGHLANDS DRIVE UTILITY PLAN  
PREPARED FOR  
LEAVITT-TOMPSON, LLC  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE: 3/15/2019  
SCALE: 1"=40'  
DESIGNED: JDA  
JOB NO: 1804  
FILE: 1804 U.DWG  
SHEET C-4.1

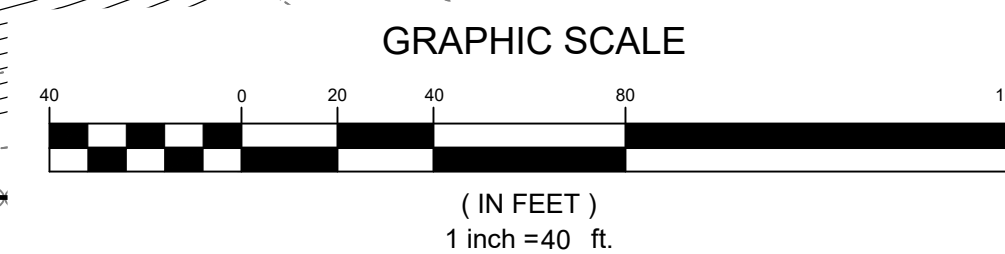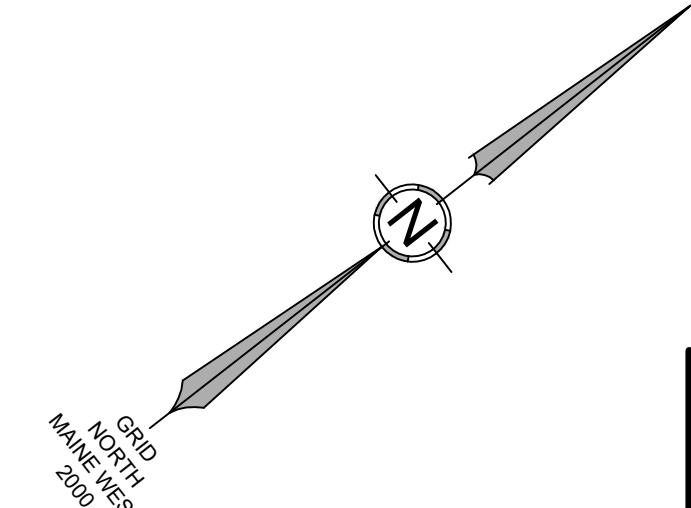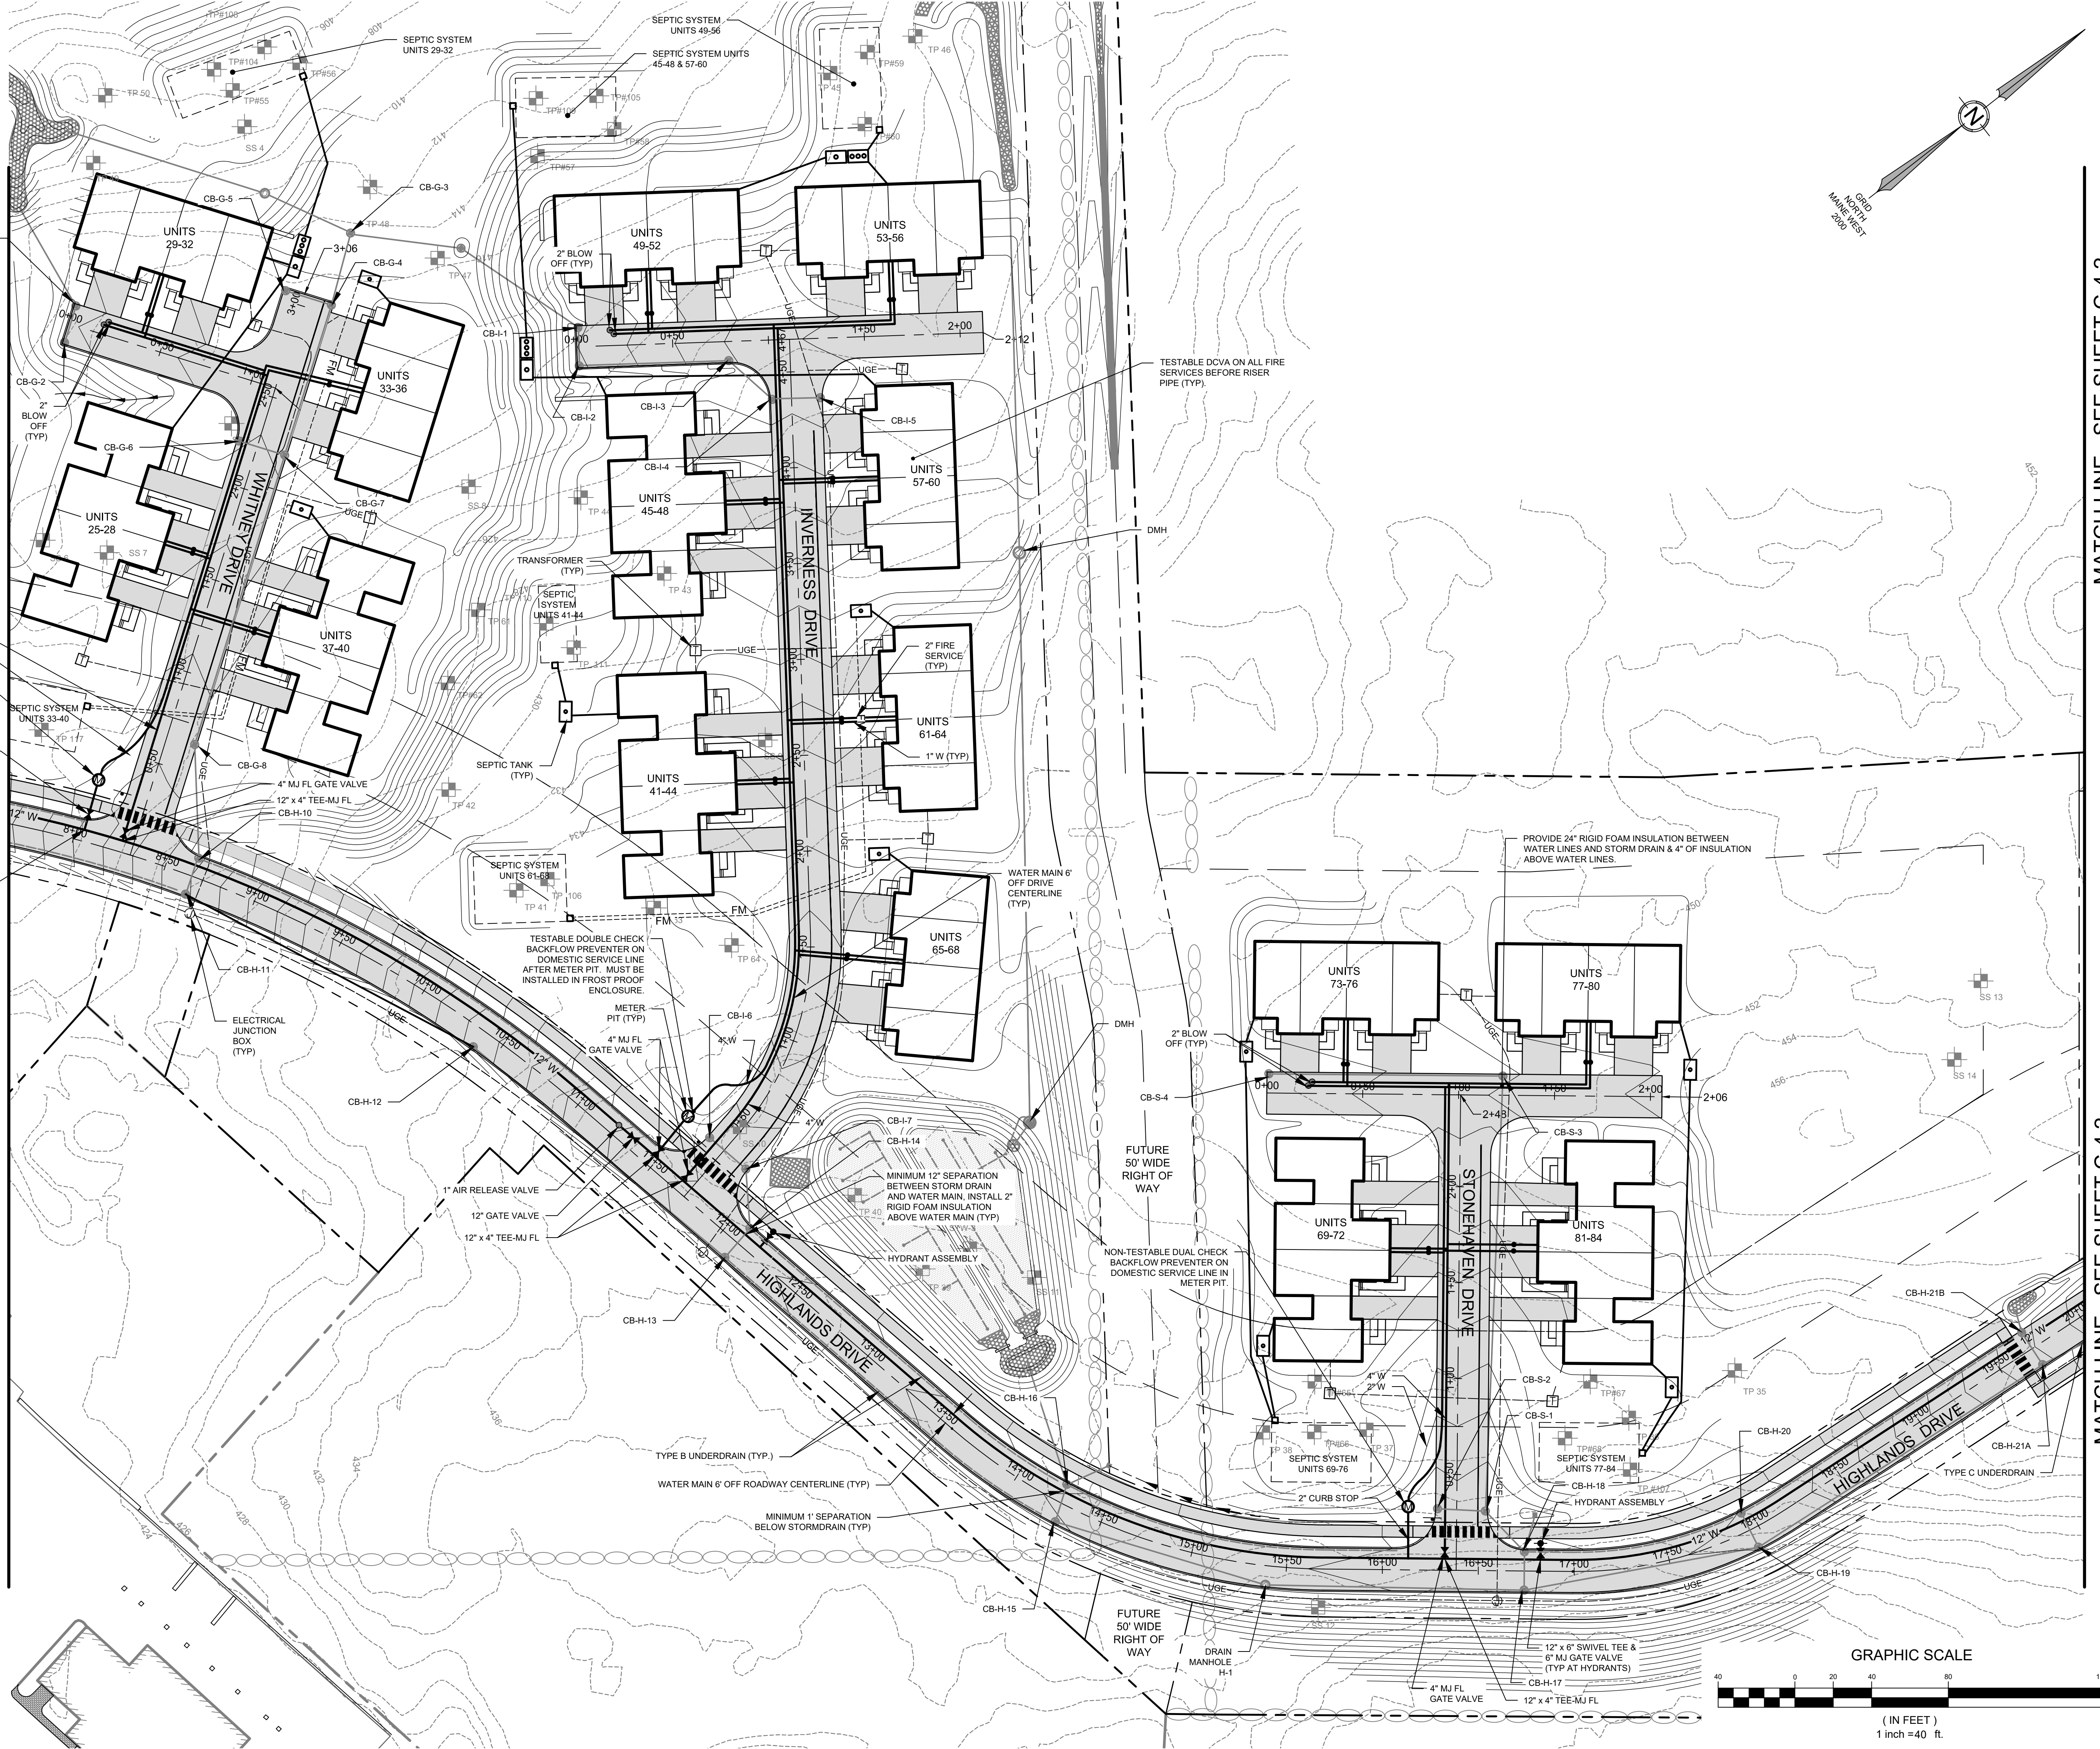






MATCH LINE - SEE SHEET C-4.1

MATCH LINE - SEE SHEET C-4.1

MATCH LINE - SEE SHEET C-4.3

MATCH LINE - SEE SHEET C-4.3

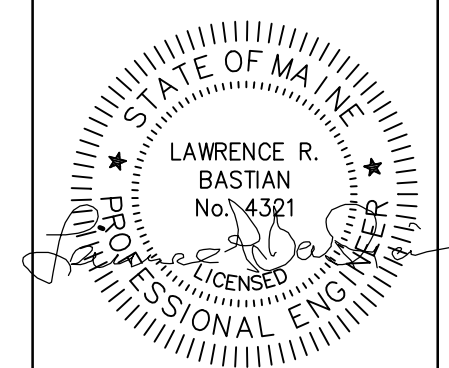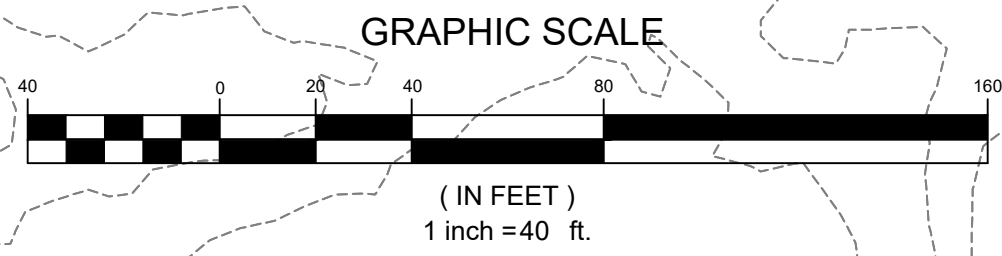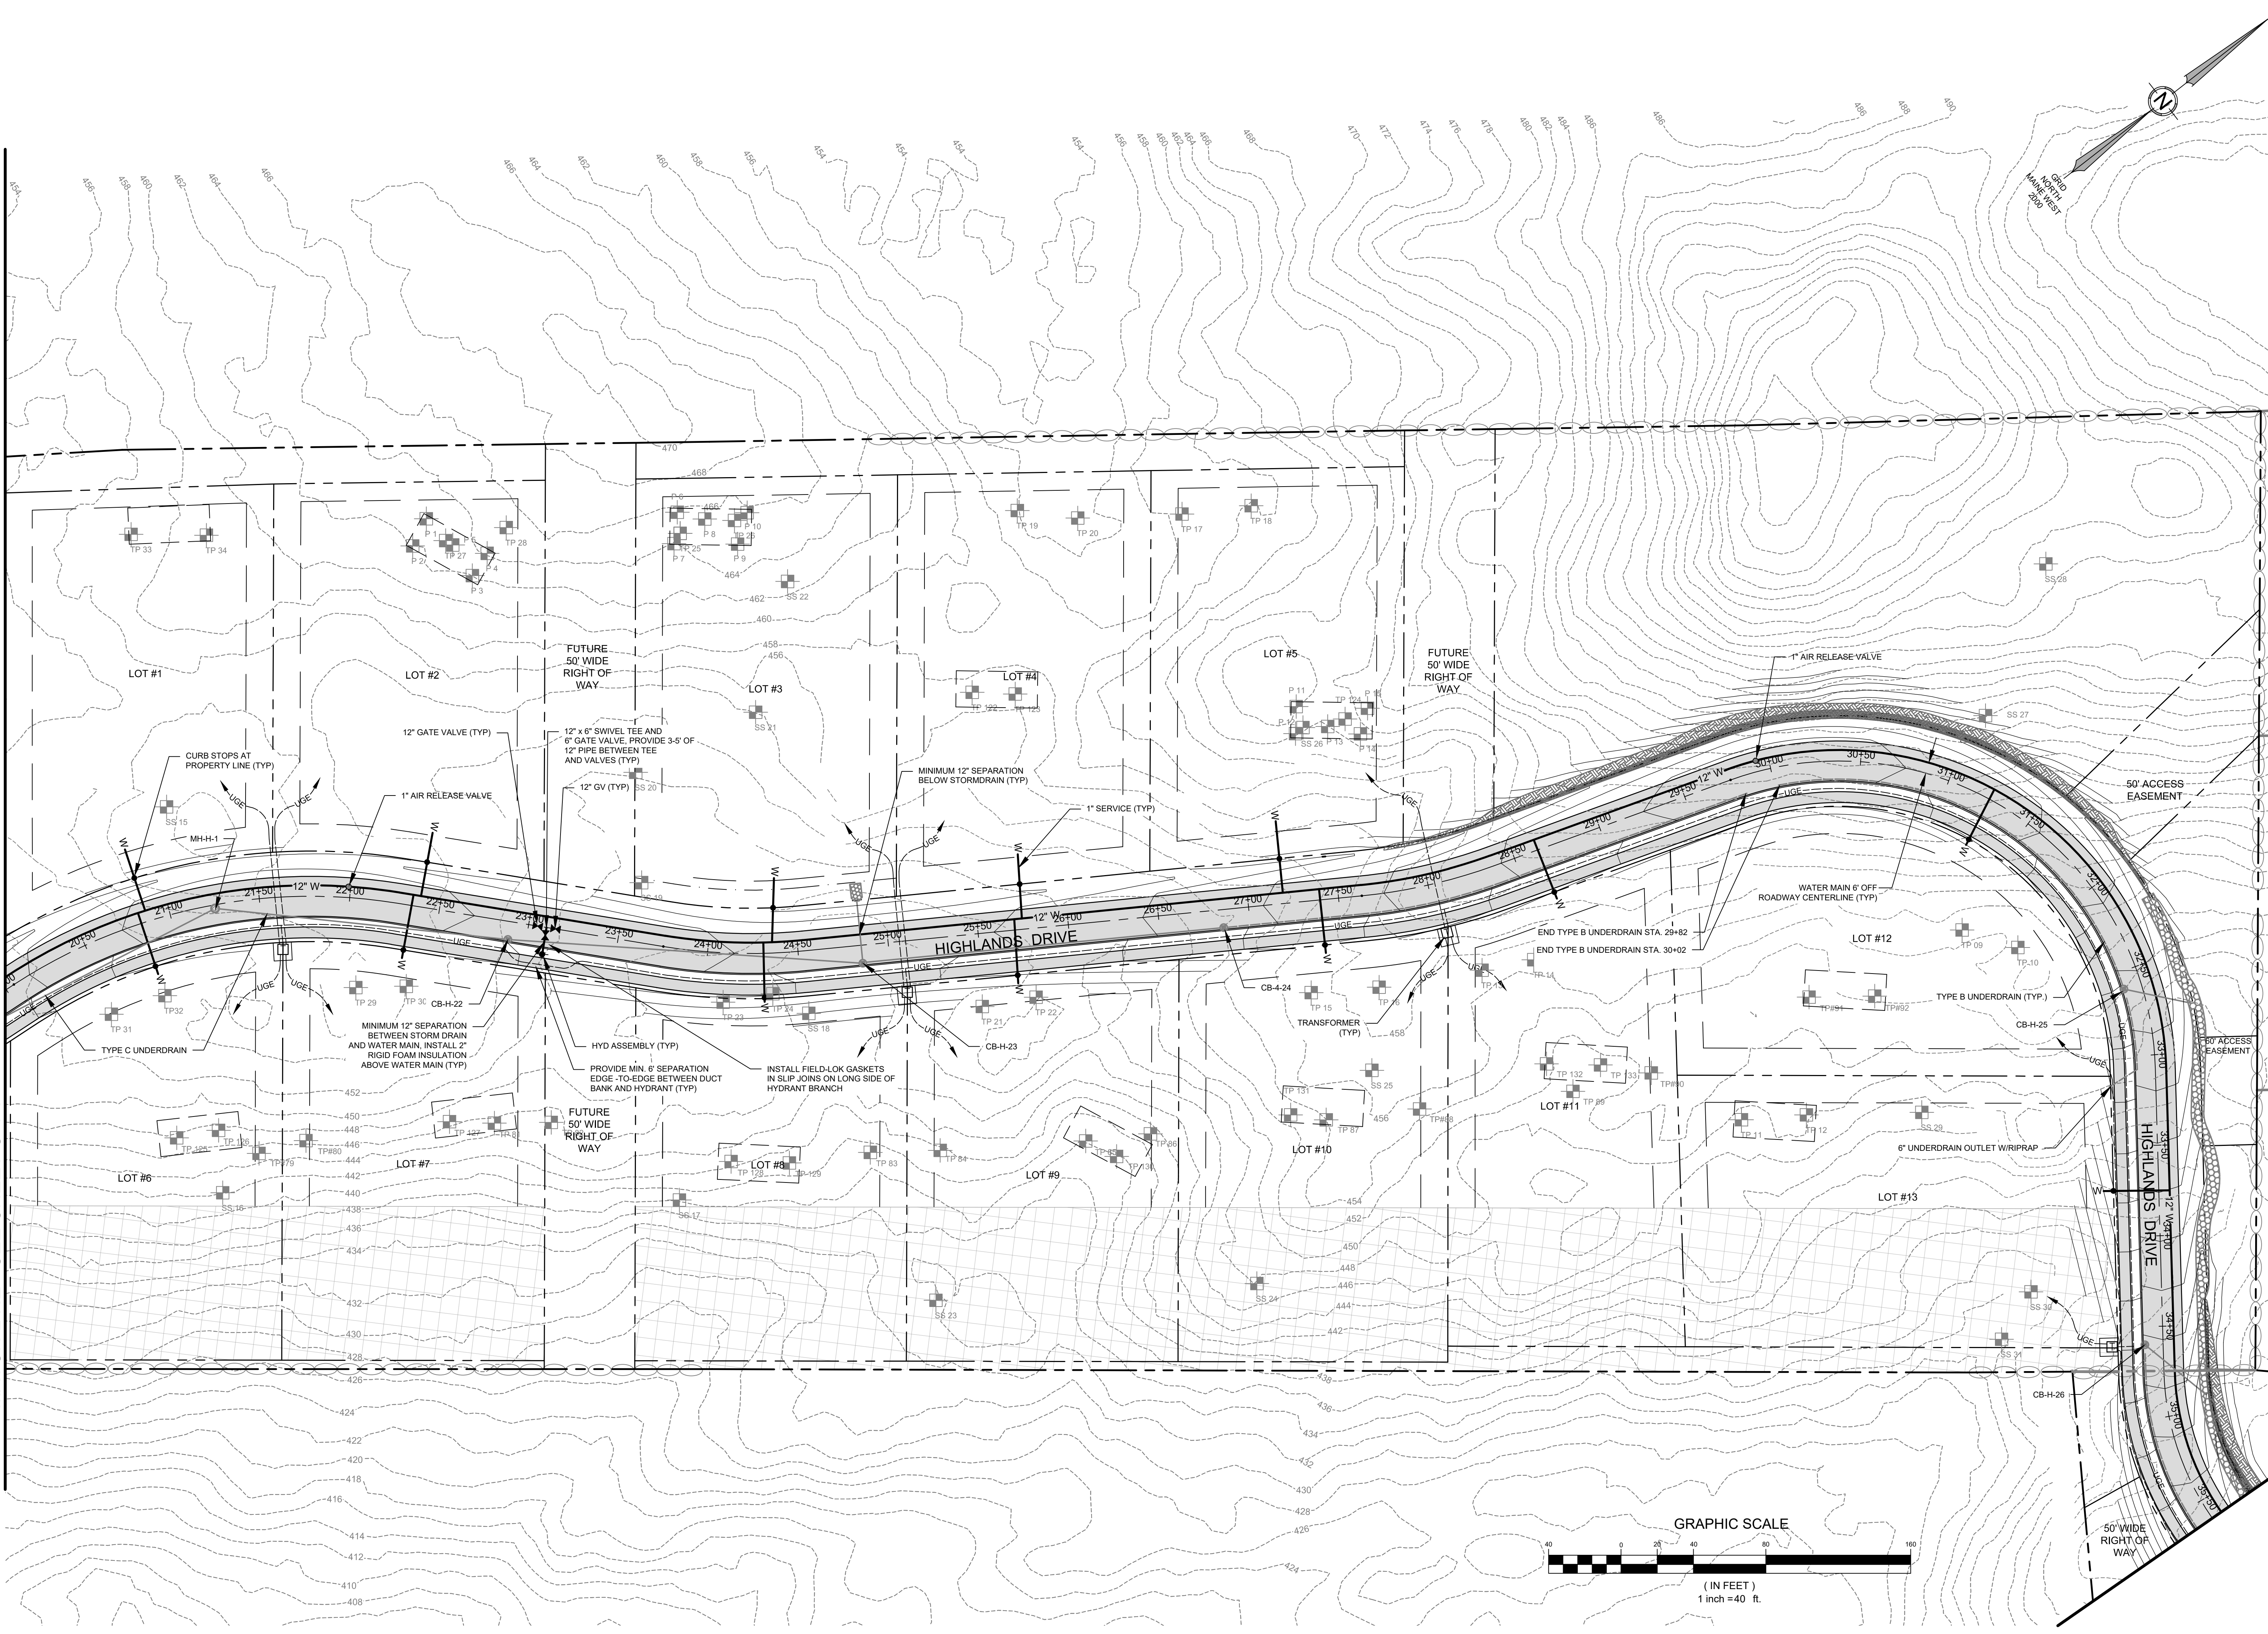

SIGNATURE DATE: 1/15/2020

LRB	DATE	BY	REVISIONS
1	11/13/2018	APPD	PRELIMINARY SUBDIVISION & SITE PLAN
2	3/29/2019	LRB	PRELIMINARY SUBDIVISION & SITE PLAN
3	1/21/2019	LRB	PRELIMINARY SUBDIVISION & SITE PLAN
4	11/26/2019	LRB	MDEP SITE LOCATION APPLICATION
5	11/15/2020	LRB	FINAL SUBDIVISION & SITE PLAN REVIEWS
6	2/13/2020	LRB	PEER REVIEW COMMENT RESPONSE
7	3/25/2020	LRB	REVISED PER TOWN COMMENTS
8	4/15/2020	LRB	FINAL REVIEW

565 CONGRESS STREET  
 SUITE 201  
 PORTLAND, ME 04102

41 CAMPUS DRIVE  
 SUITE 101  
 NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
 www.terradyndesign.com

**TERRADYN**  
 CONSULTANTS, LLC

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING



SHEET DESCRIPTION  
 HIGHLANDS SUBDIVISION  
 STANDISH, MAINE  
 HIGHLANDS DRIVE UTILITY PLAN  
 PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
 P.O. BOX 703  
 STANDISH, MAINE 04084

DATE: 3/15/2019  
 SCALE: 1"=40'  
 DESIGNED: JDA  
 JOB NO: 1804  
 FILE: 1804 U.DWG  
 SHEET **C-4.2**



MATCH LINE - SEE SHEET C-4.2

MATCH LINE - SEE SHEET C-4.2

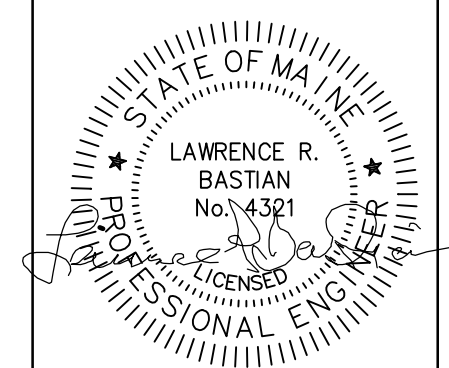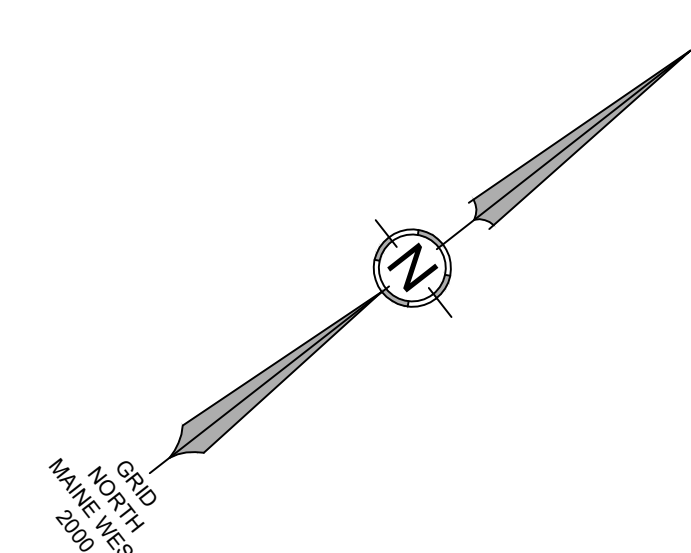

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
3	3/29/2019	MDEP SITE LOCATION APPLICATION
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
7	3/25/2020	REVISED PER TOWN COMMENTS
8	4/15/2020	FINAL REVIEW

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
www.terradynconsultants.com


**TERRADYN**  
CONSULTANTS, LLC


CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
**HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
HIGHLANDS DRIVE UTILITY PLAN**

PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE: 3/15/2019  
SCALE: 1"=40'  
DESIGNED: JDA  
JOB NO: 1804  
FILE: 1804 U.DWG  
SHEET **C-4.3**

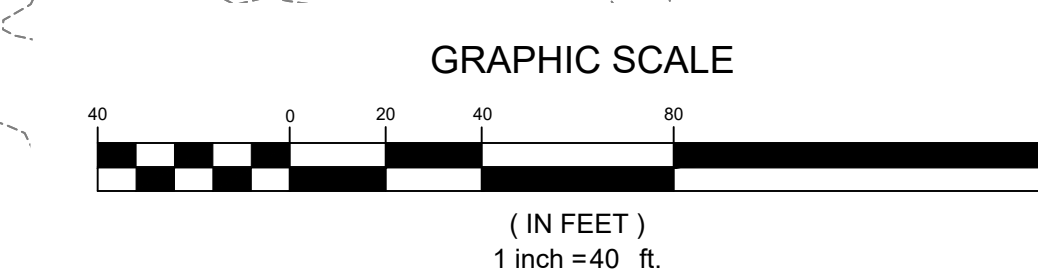


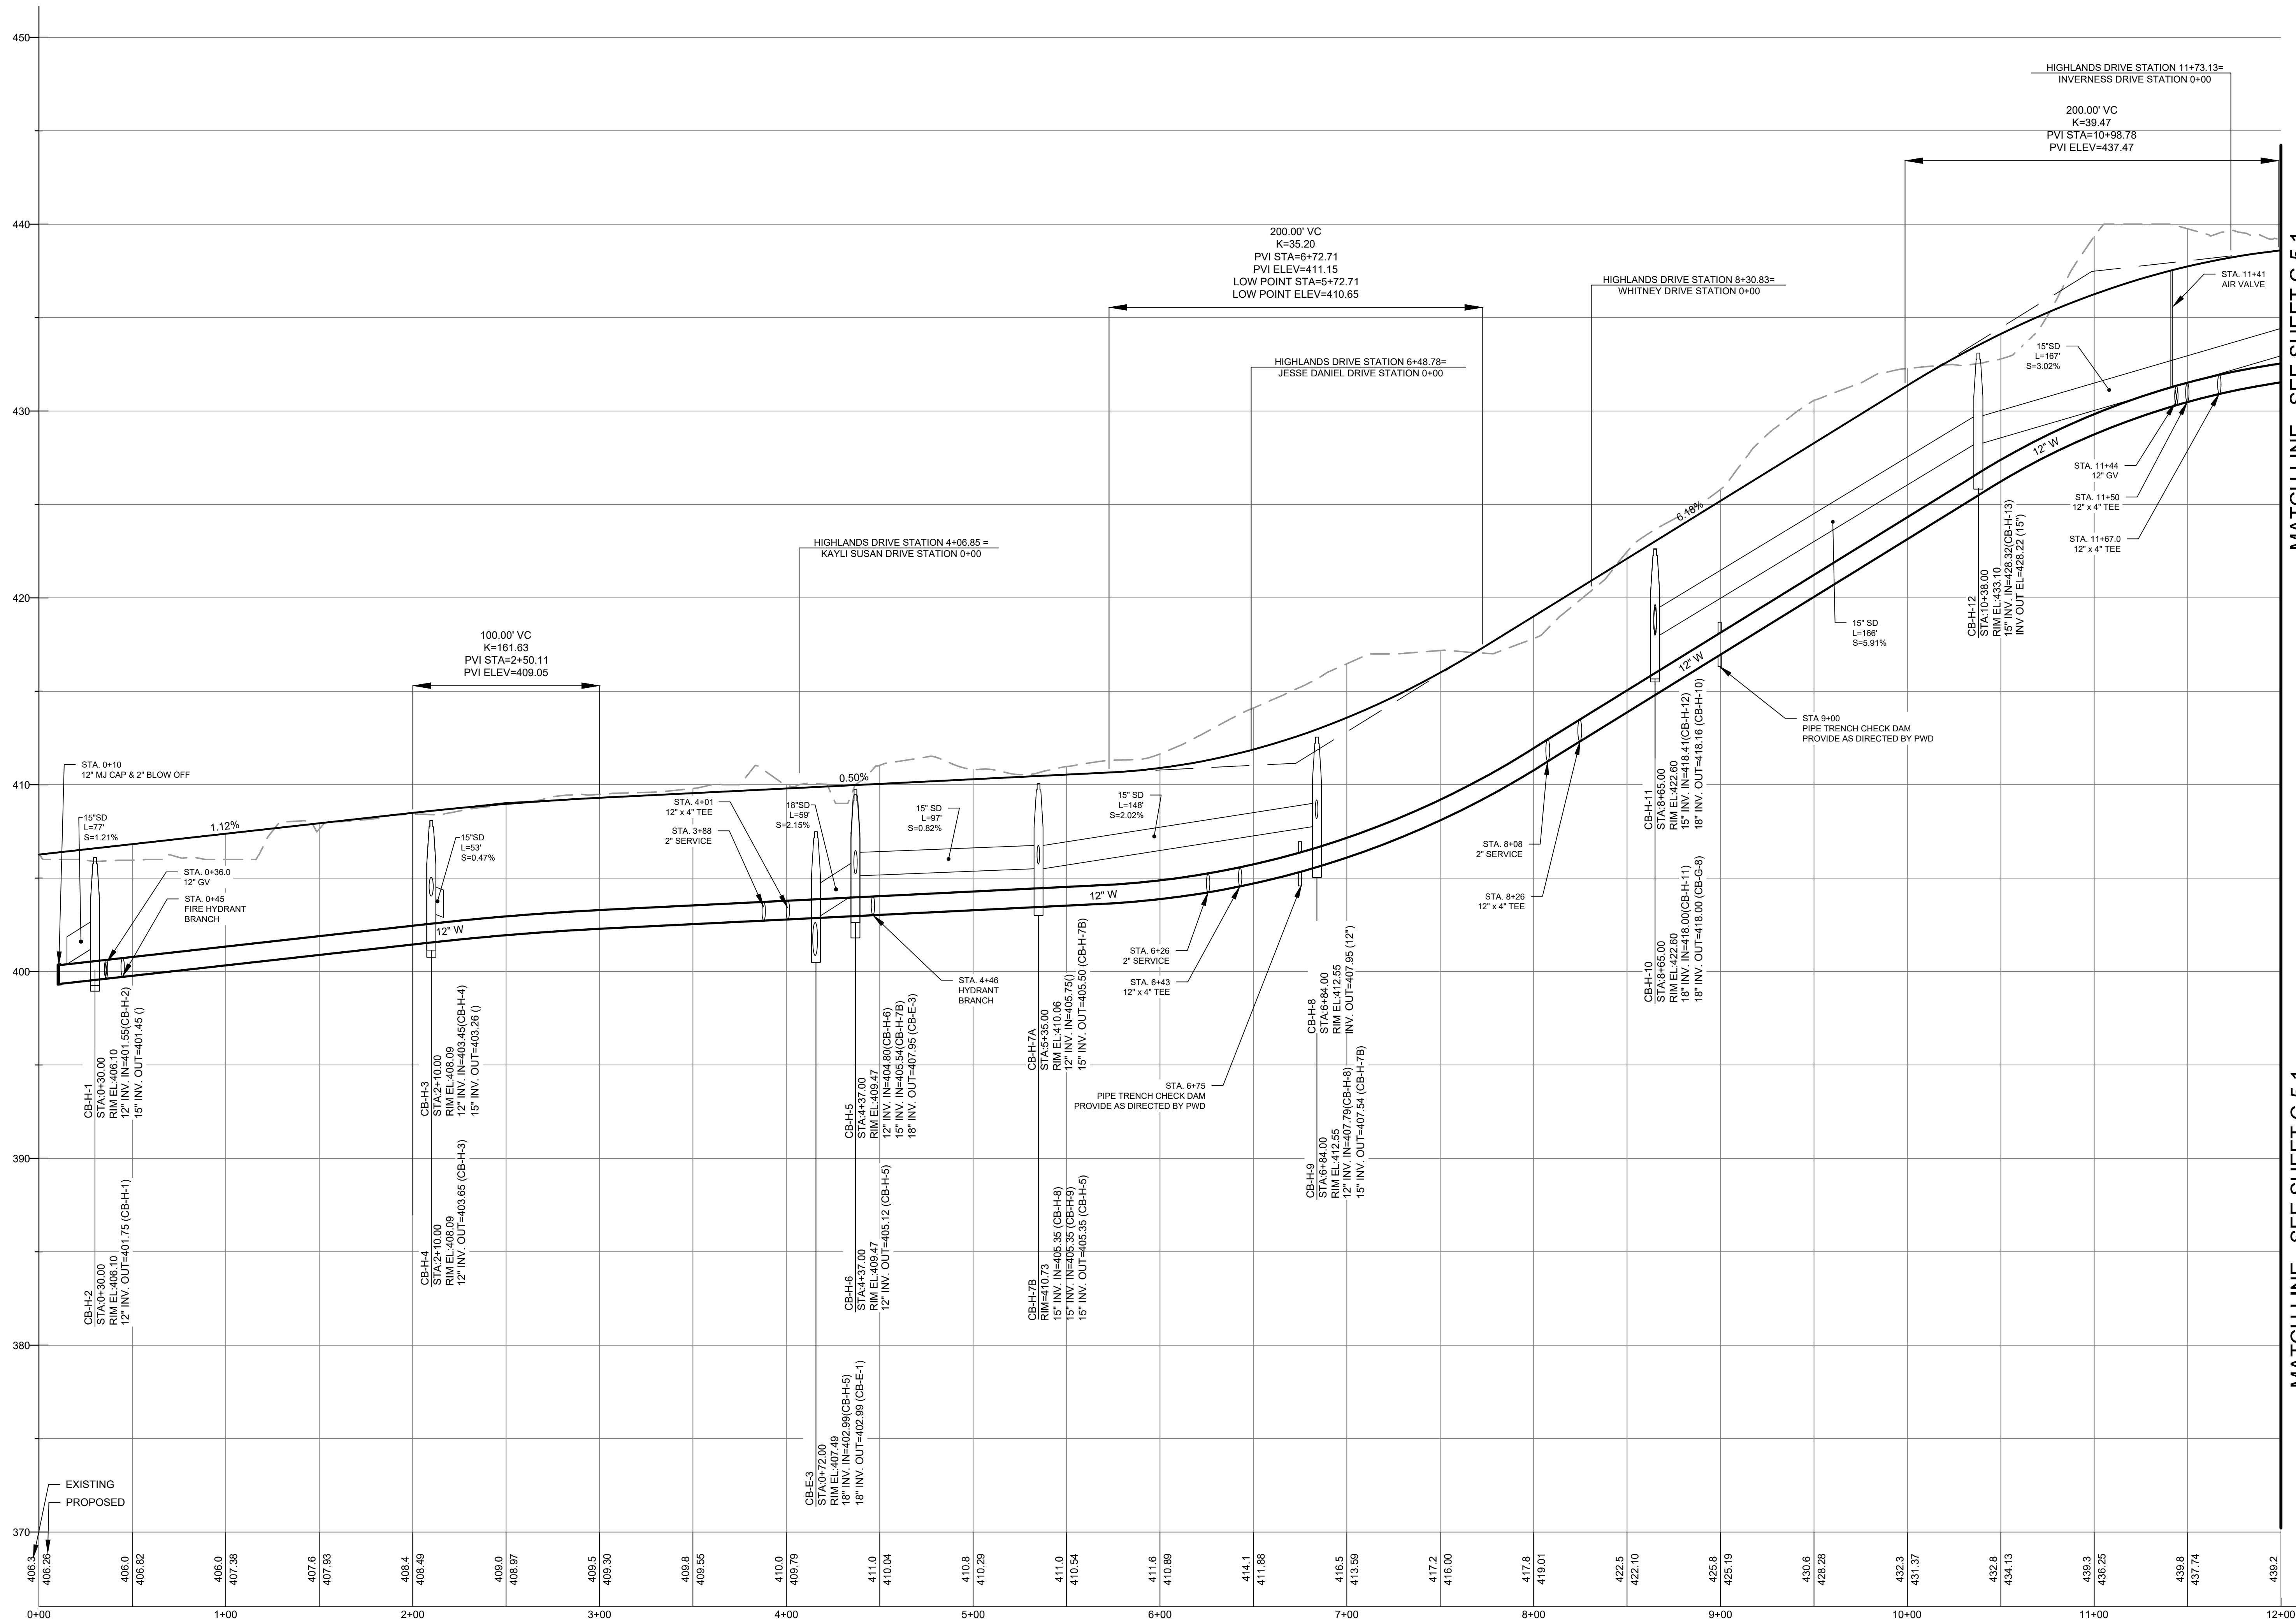

PROFILE: HIGHLANDS DRIVE - STA 0+00 - 12+00  
 SCALE: 1"=4' HORIZONTAL  
 1"=40' VERTICAL

MATCH LINE - SEE SHEET C-5.1

MATCH LINE - SEE SHEET C-5.1

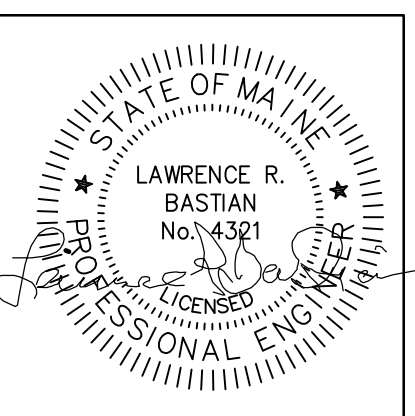

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
 SUITE 201  
 PORTLAND, ME 04102

41 CAMPUS DRIVE  
 SUITE 101  
 NEW GLOUCESTER, ME 04260



CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING


OFFICE: (207) 926-5111  
 www.terradynconsultants.com

SHEET DESCRIPTION  
 HIGHLANDS SUBDIVISION  
 STANDISH, MAINE  
 HIGHLANDS DRIVE ROADWAY PROFILE  
 PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
 P.O. BOX 703  
 STANDISH, MAINE 04084

DATE: 3/15/2019  
 SCALE: AS SHOWN  
 DESIGNED: JDA  
 JOB NO: 1804  
 FILE: 1804 S.DWG  
 SHEET: **C-5.0**

MATCH LINE - SEE SHEET C-5.0


MATCH LINE - SEE SHEET 5.0

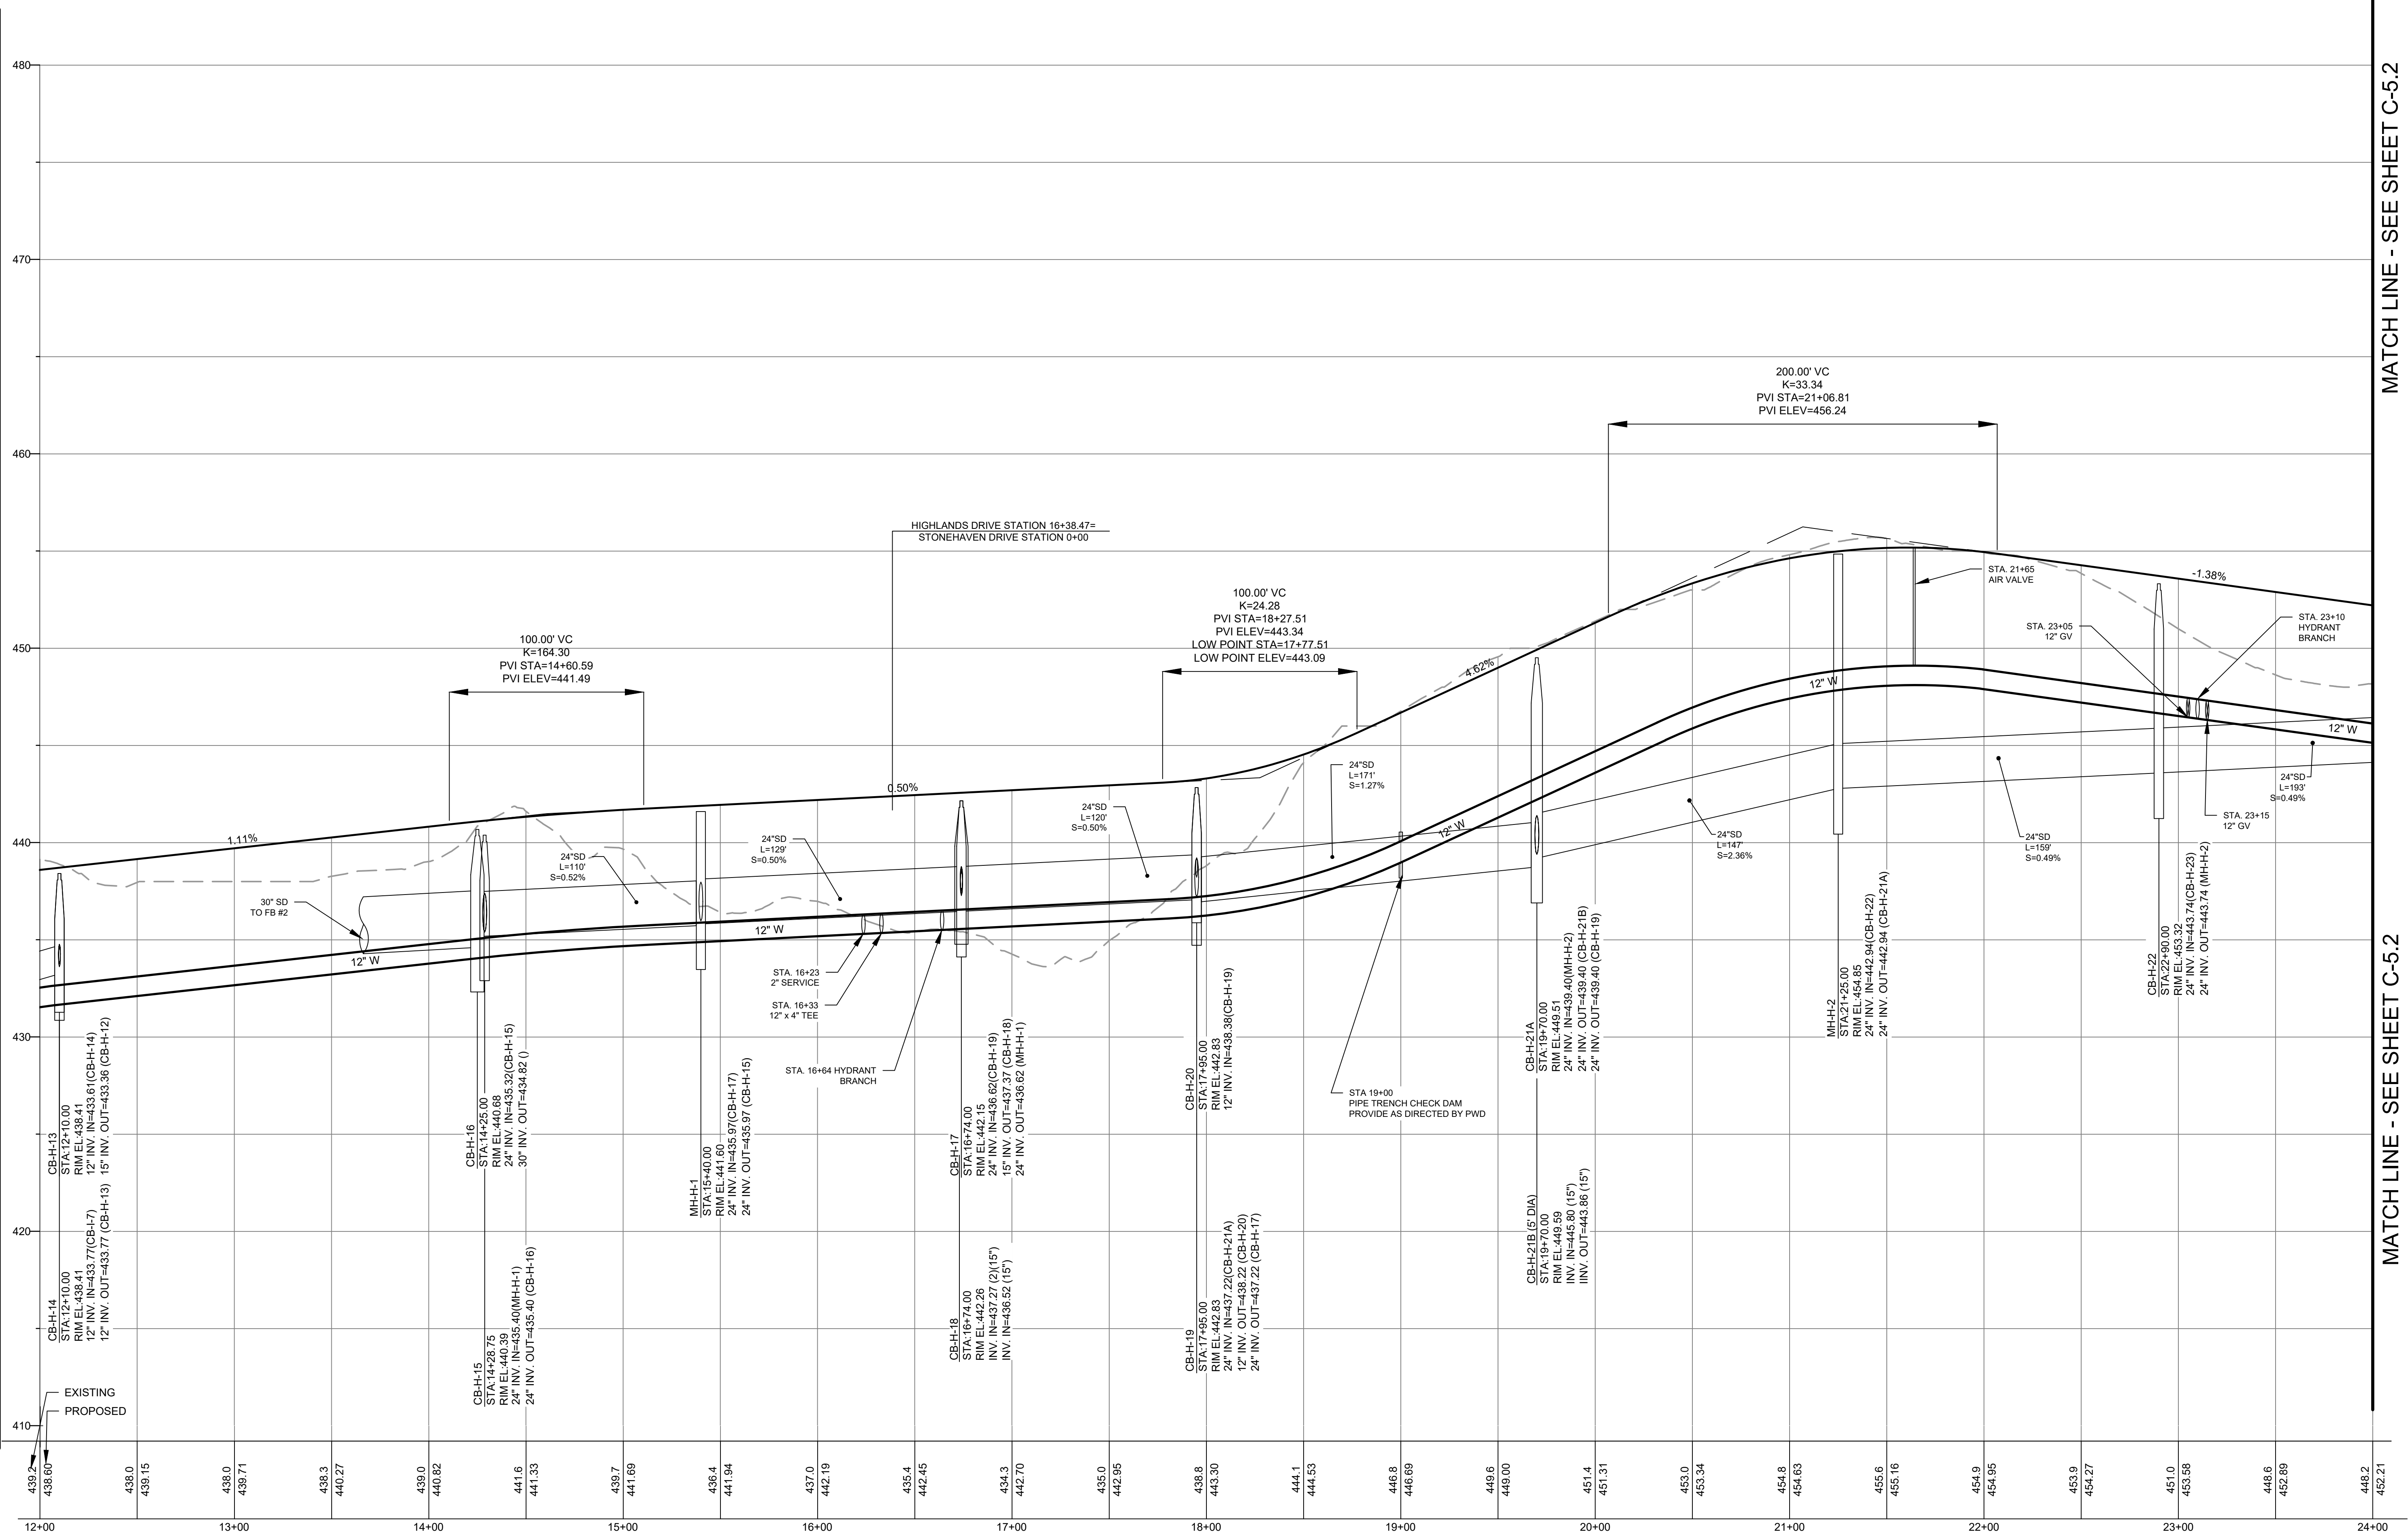

PROFILE: HIGHLANDS DRIVE - STA 12+00 - 24+00  
 SCALE: 1"=4' HORIZONTAL  
 1"=40' VERTICAL

MATCH LINE - SEE SHEET C-5.2

MATCH LINE - SEE SHEET C-5.2

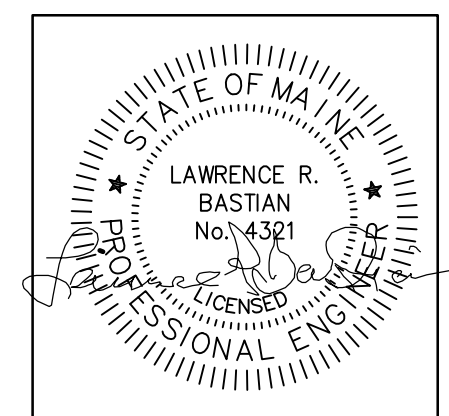

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
 SUITE 201  
 PORTLAND, ME 04102

41 CAMPUS DRIVE  
 SUITE 101  
 NEW GLOUCESTER, ME 04260

**TERRADYN**  
 CONSULTANTS, LLC

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

OFFICE: (207) 926-5111  
 www.terradynconsultants.com

SHEET DESCRIPTION	HIGHLANDS SUBDIVISION STANDISH, MAINE HIGHLANDS DRIVE ROADWAY PROFILE
DATE:	3/15/2019
SCALE:	AS SHOWN
DESIGNED:	JDA
JOB NO:	1804
FILE:	1804 S.DWG
SHEET	<b>C-5.1</b>

PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
 P.O. BOX 703  
 STANDISH, MAINE 04084




MATCH LINE - SEE SHEET C-5.1


MATCH LINE - SEE SHEET 5.1

MATCH LINE - SEE SHEET C-5.3

MATCH LINE - SEE SHEET C-5.3

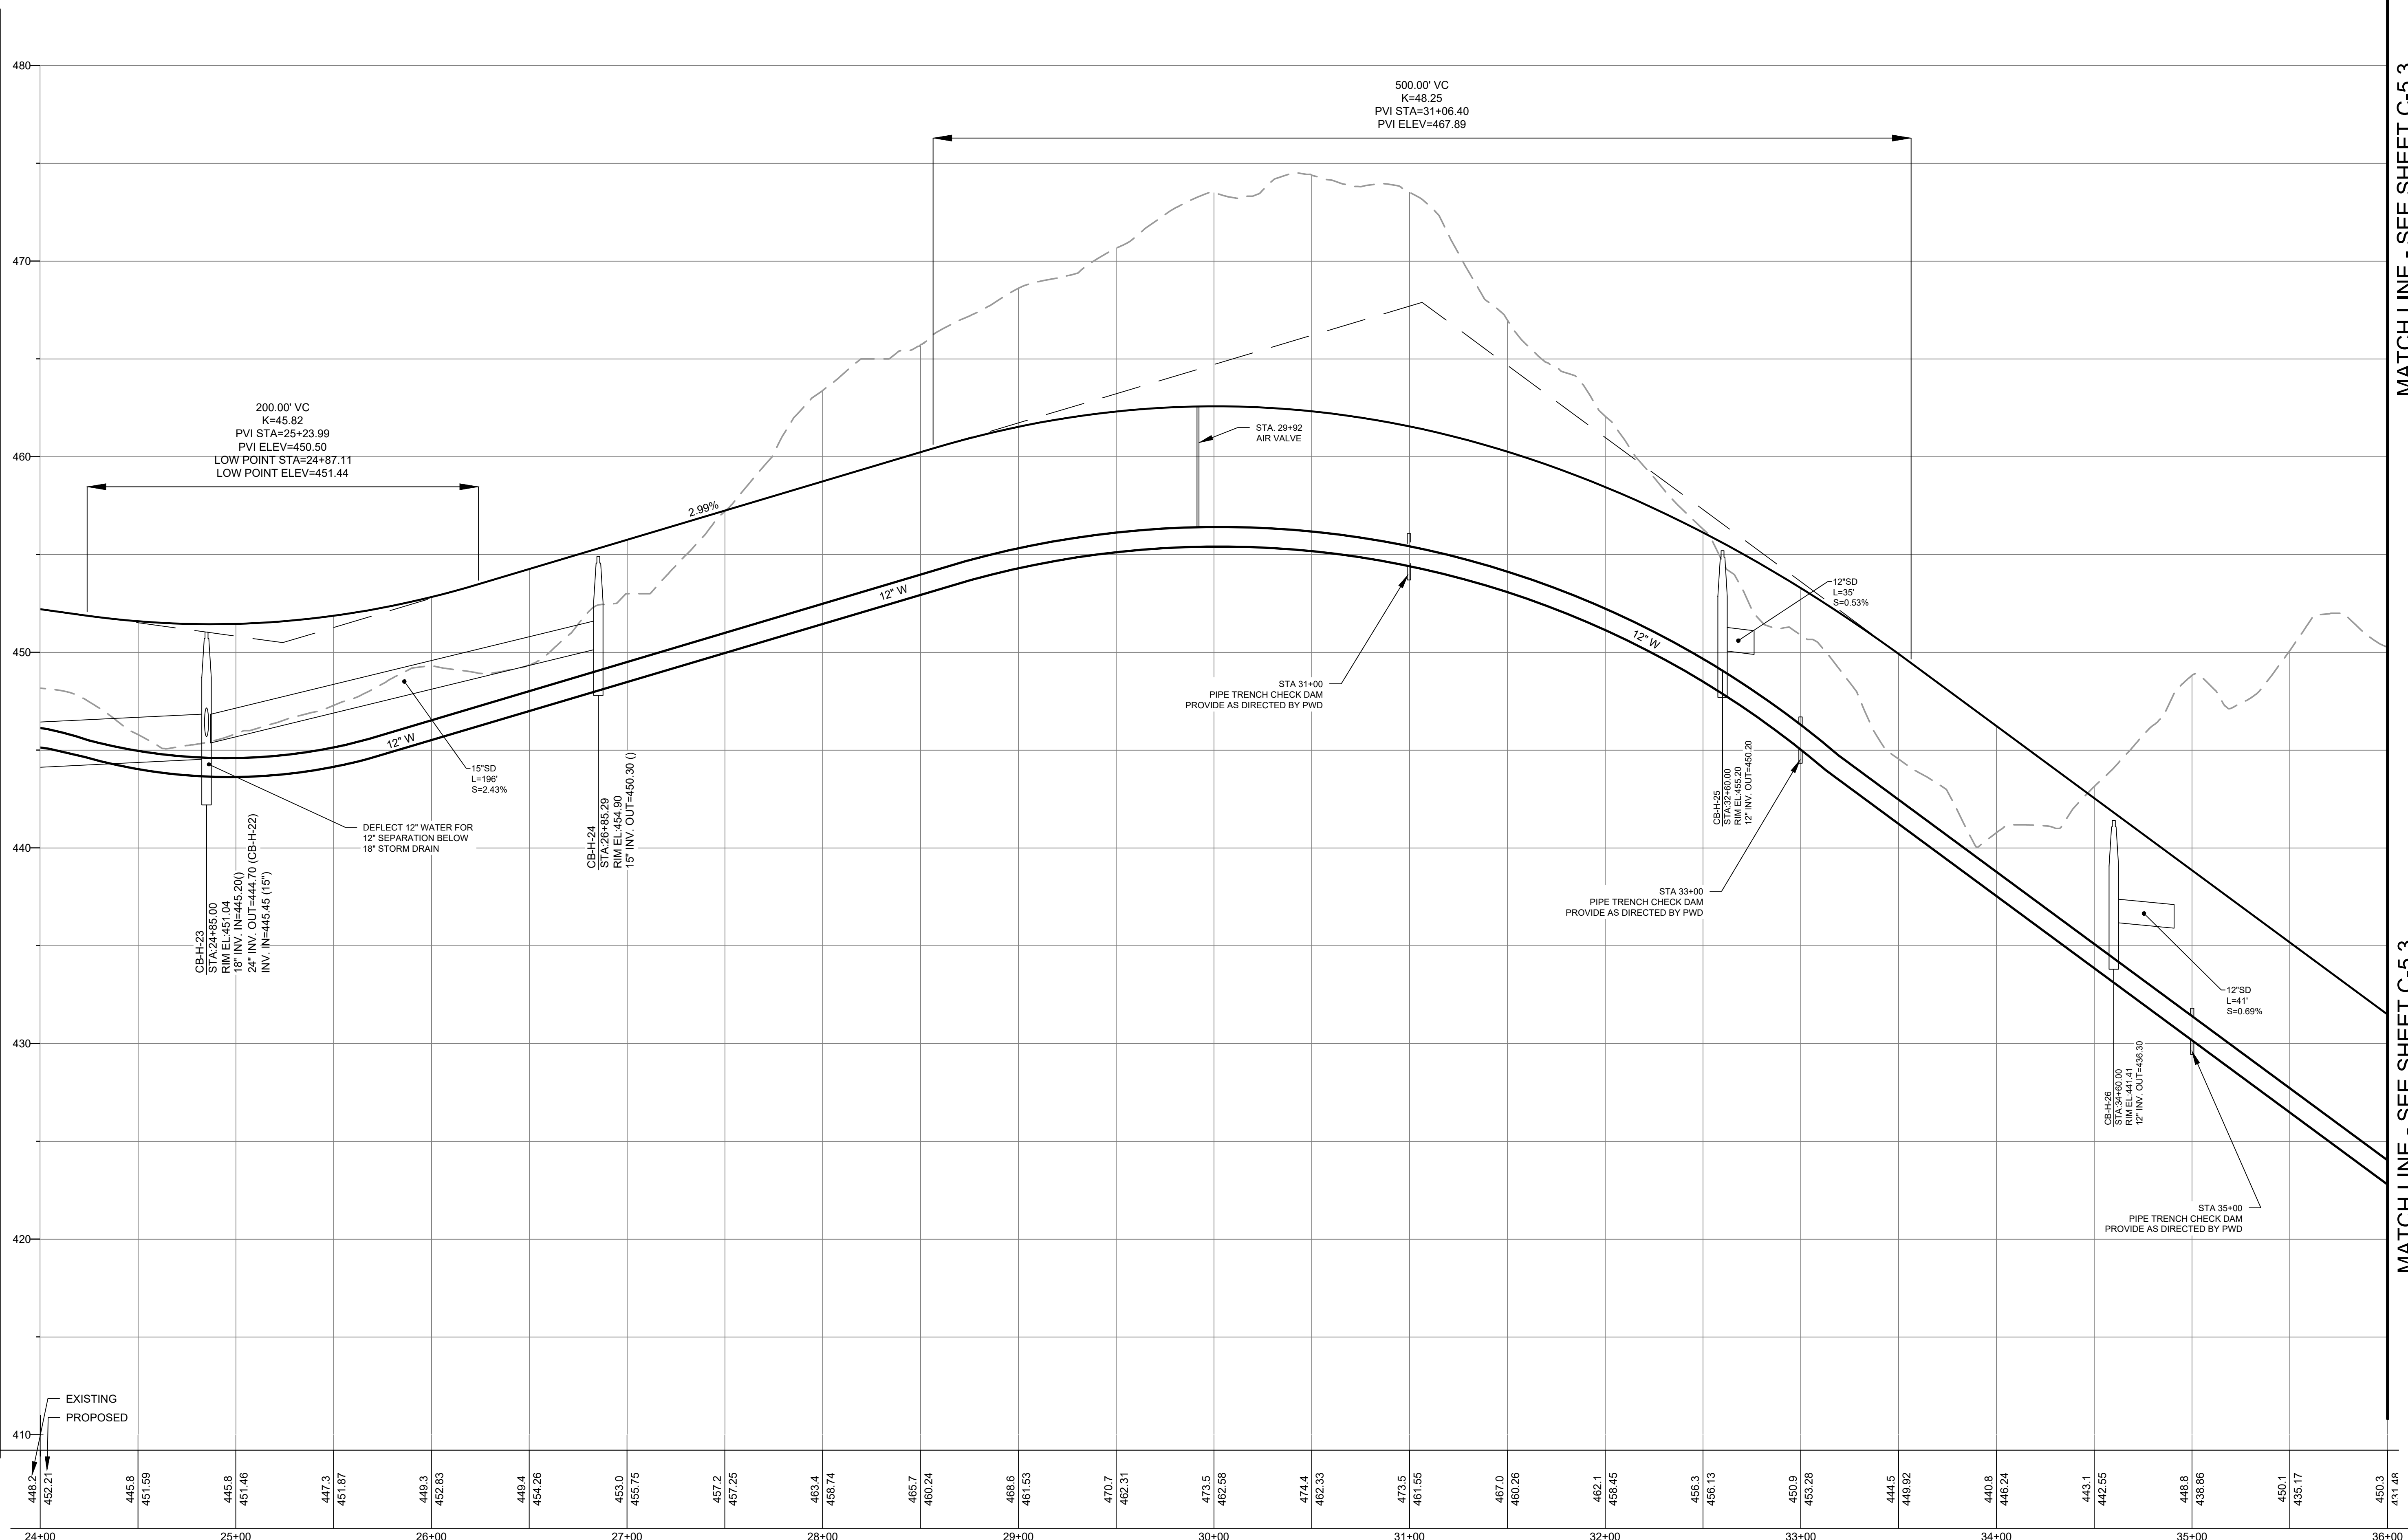

PROFILE: HIGHLANDS DRIVE - STA 24+00 - 36+00  
 SCALE: 1"=4' HORIZONTAL  
 1"=40' VERTICAL

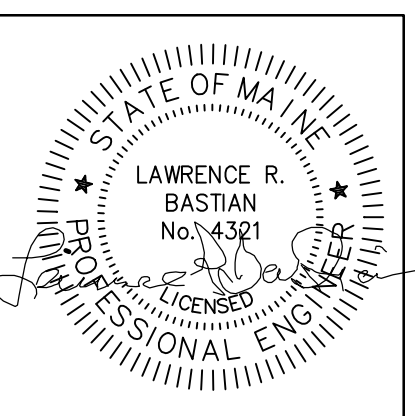

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
 SUITE 201  
 PORTLAND, ME 04102

41 CAMPUS DRIVE  
 SUITE 101  
 NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
 www.terradynconsultants.com


**TERRADYN**  
 CONSULTANTS, LLC

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING


SHEET DESCRIPTION	HIGHLANDS SUBDIVISION
	STANDISH, MAINE
	HIGHLANDS DRIVE ROADWAY PROFILE
PREPARED FOR	LEAVITT-TOMPSON, LLC
	P.O. BOX 703
	STANDISH, MAINE 04084
DATE:	3/15/2019
SCALE:	AS SHOWN
DESIGNED:	JDA
JOB NO:	1804
FILE:	1804 S.DWG
SHEET	<b>C-5.2</b>

MATCH LINE - SEE SHEET C-4.2

MATCH LINE - SEE SHEET C-5.2

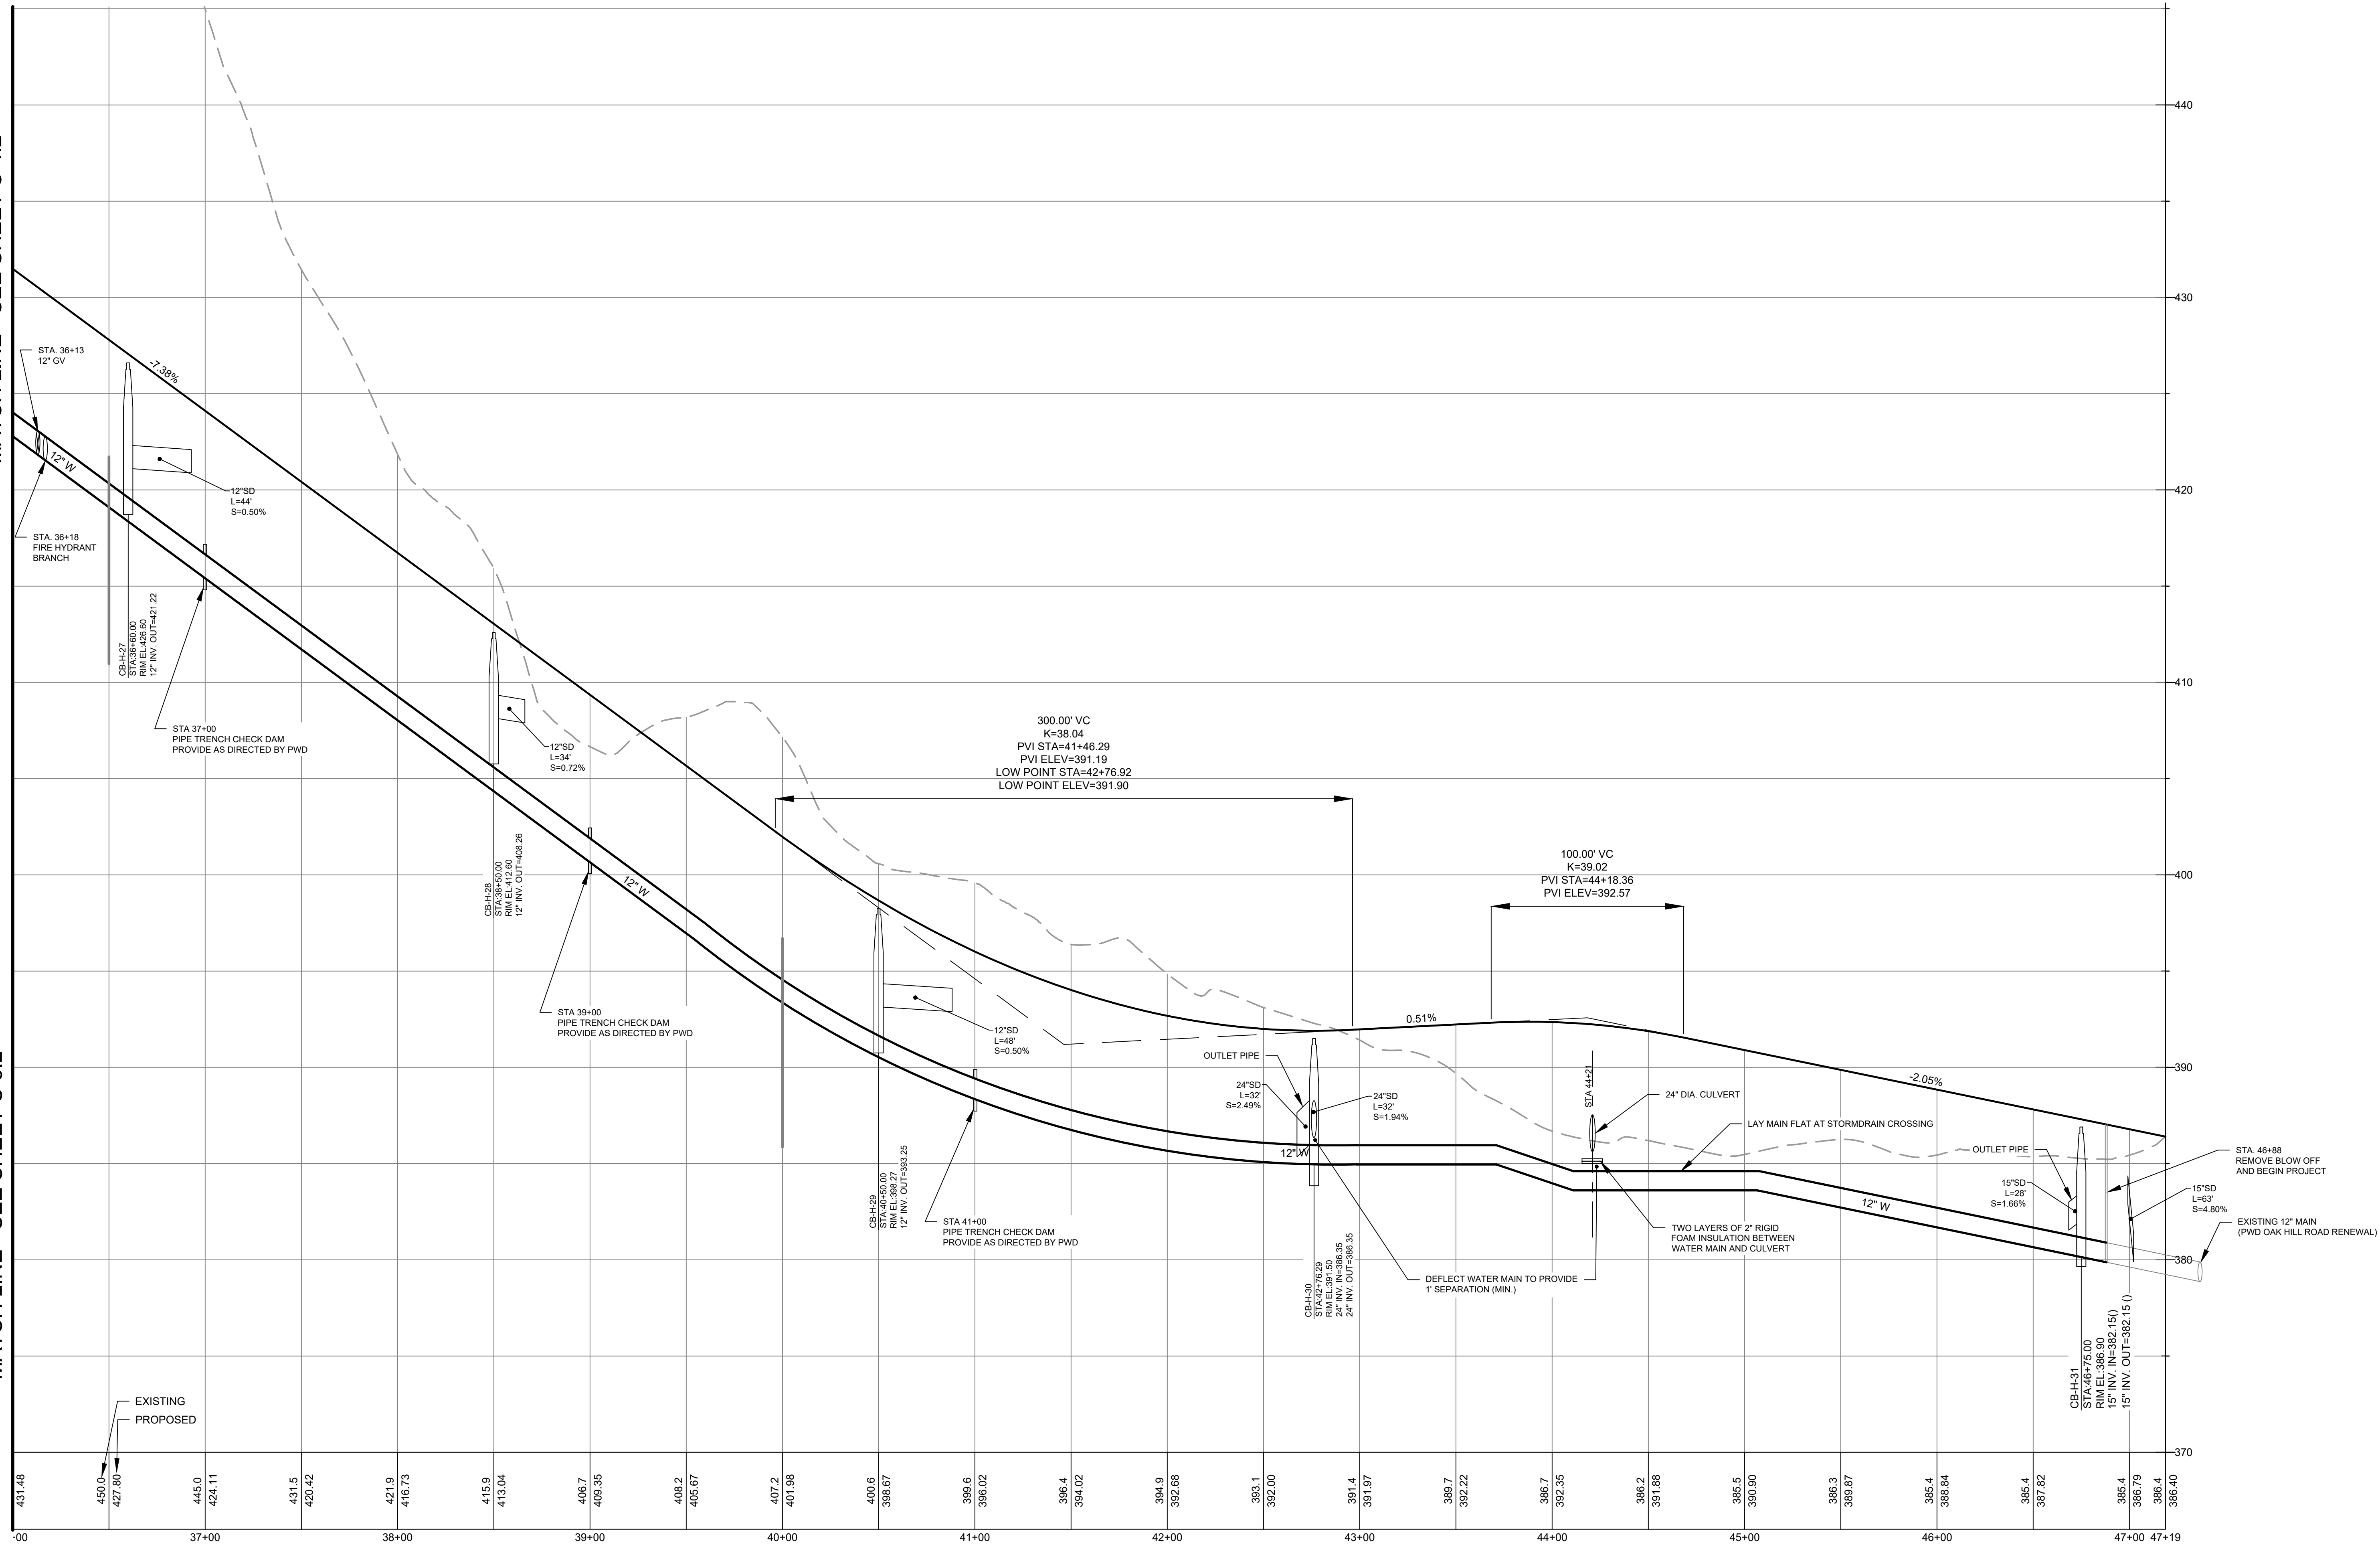

PROFILE: HIGHLANDS DRIVE - STA 36+00 - END  
 SCALE: 1"=4' HORIZONTAL  
 1"=40' VERTICAL

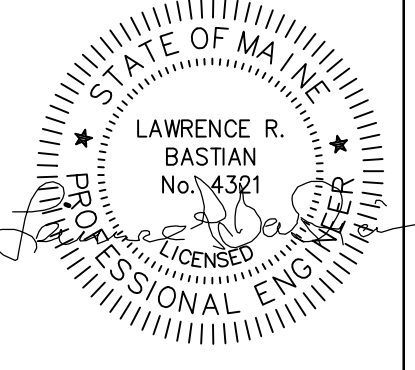

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
 SUITE 201  
 PORTLAND, ME 04102

41 CAMPUS DRIVE  
 SUITE 101  
 NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
 www.terradynconsultants.com


**TERRADYN**  
 CONSULTANTS, LLC

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
 HIGHLANDS SUBDIVISION  
 STANDISH, MAINE  
 HIGHLANDS DRIVE ROADWAY PROFILE


PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
 P.O. BOX 703  
 STANDISH, MAINE 04084

DATE: 3/15/2019  
 SCALE: AS SHOWN  
 DESIGNED: JDA  
 JOB NO: 1804  
 FILE: 1804 S.DWG  
 SHEET **C-5.3**

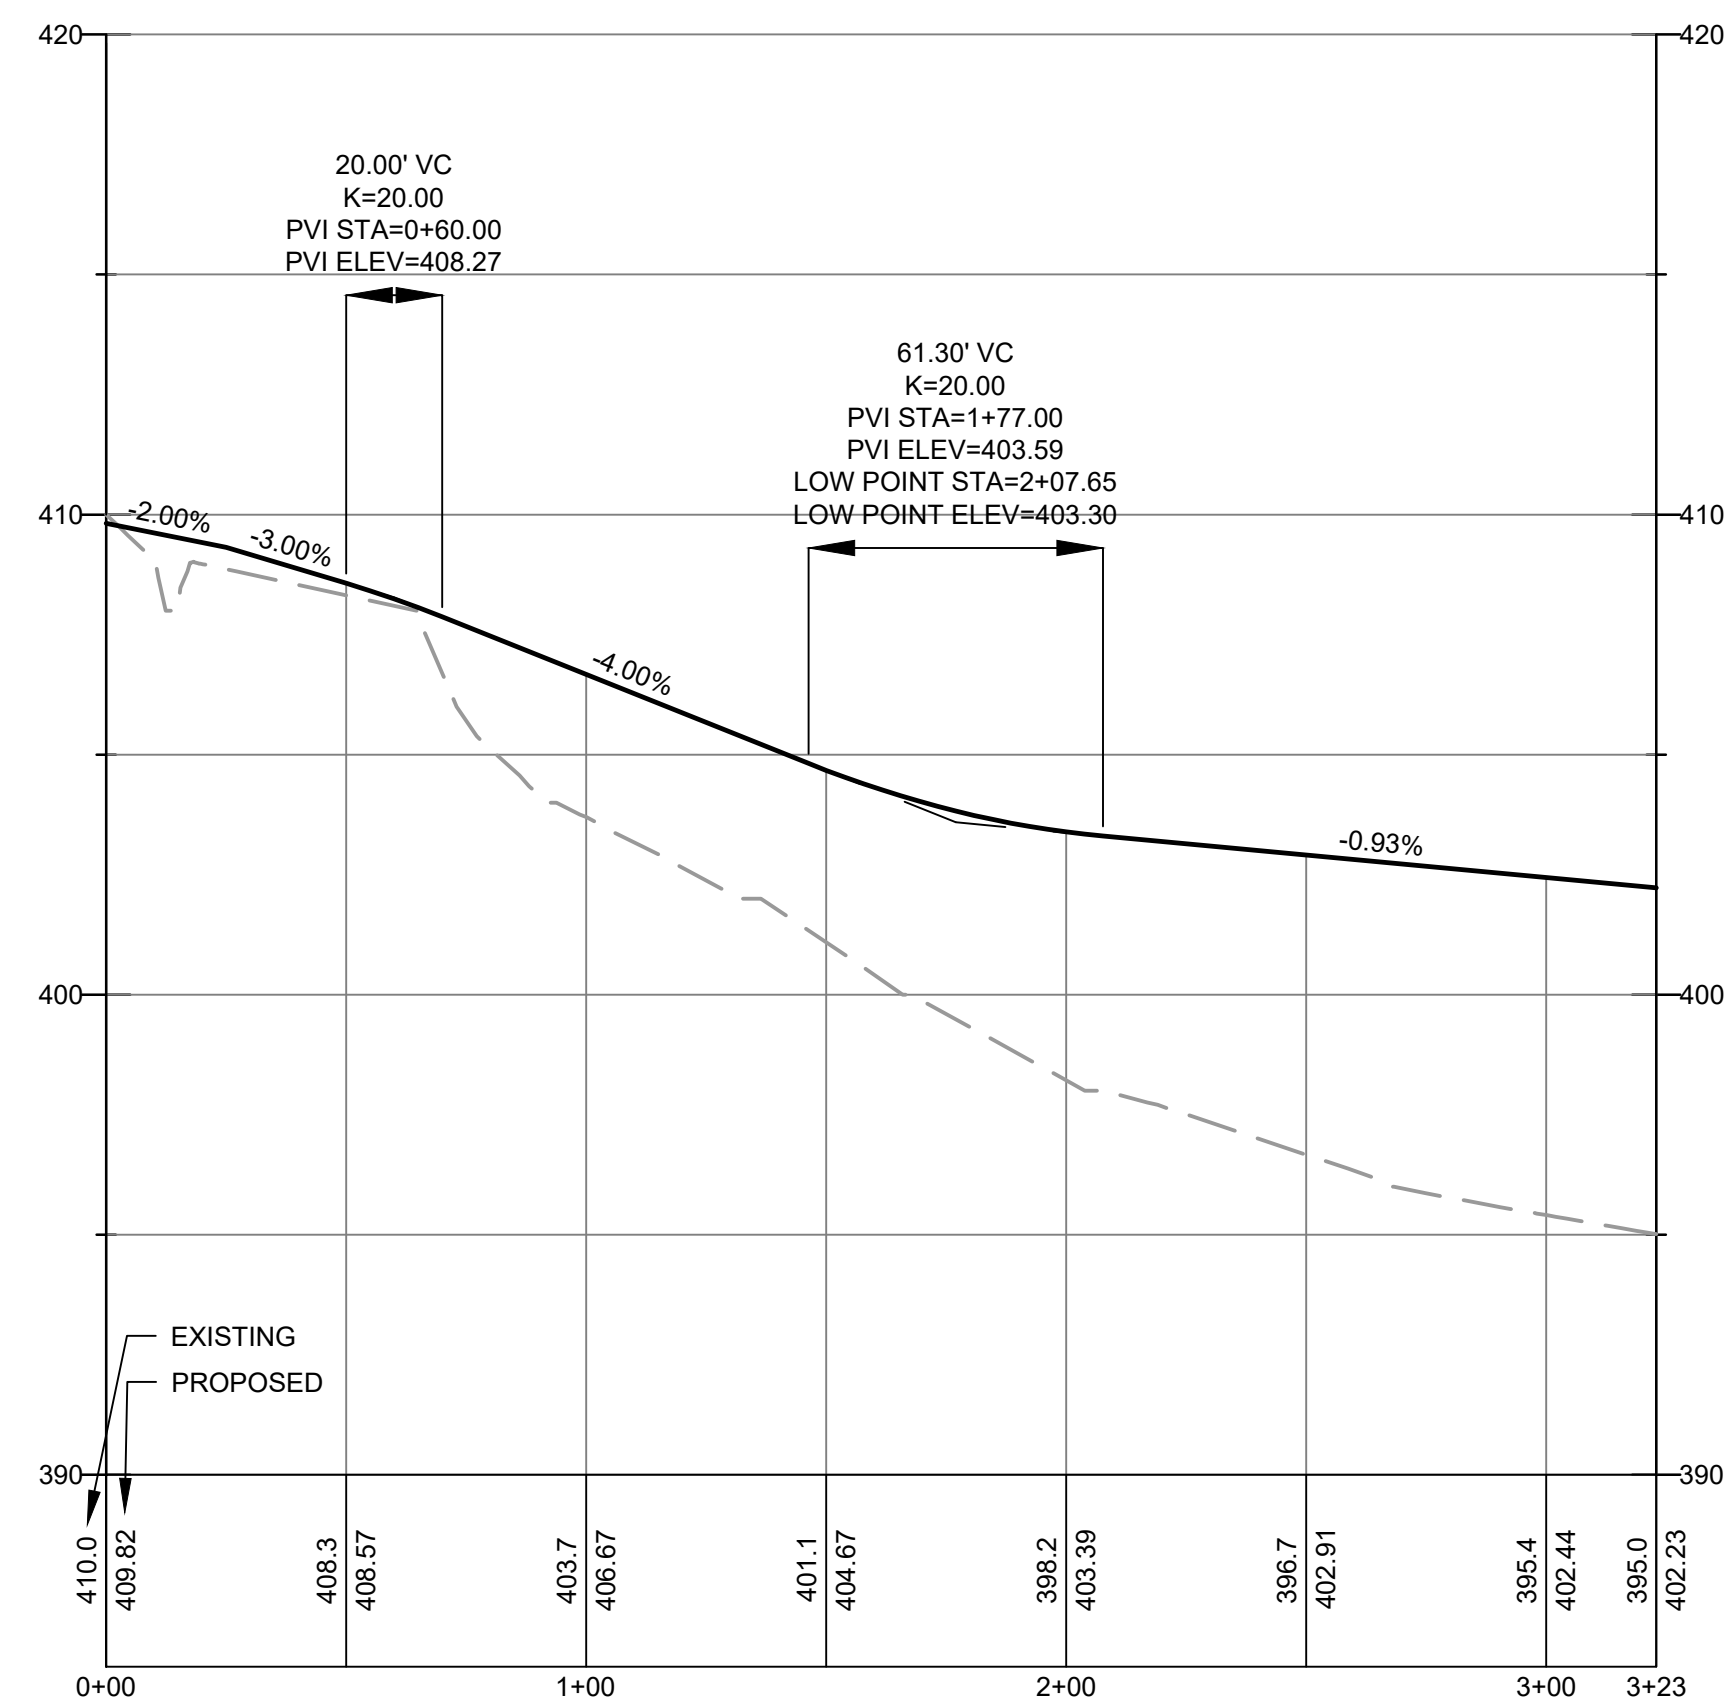


**PROFILE OF KAYLI SUSAN DRIVE**

SCALE: 1"=4' HORIZONTAL  
1"=40' VERTICAL

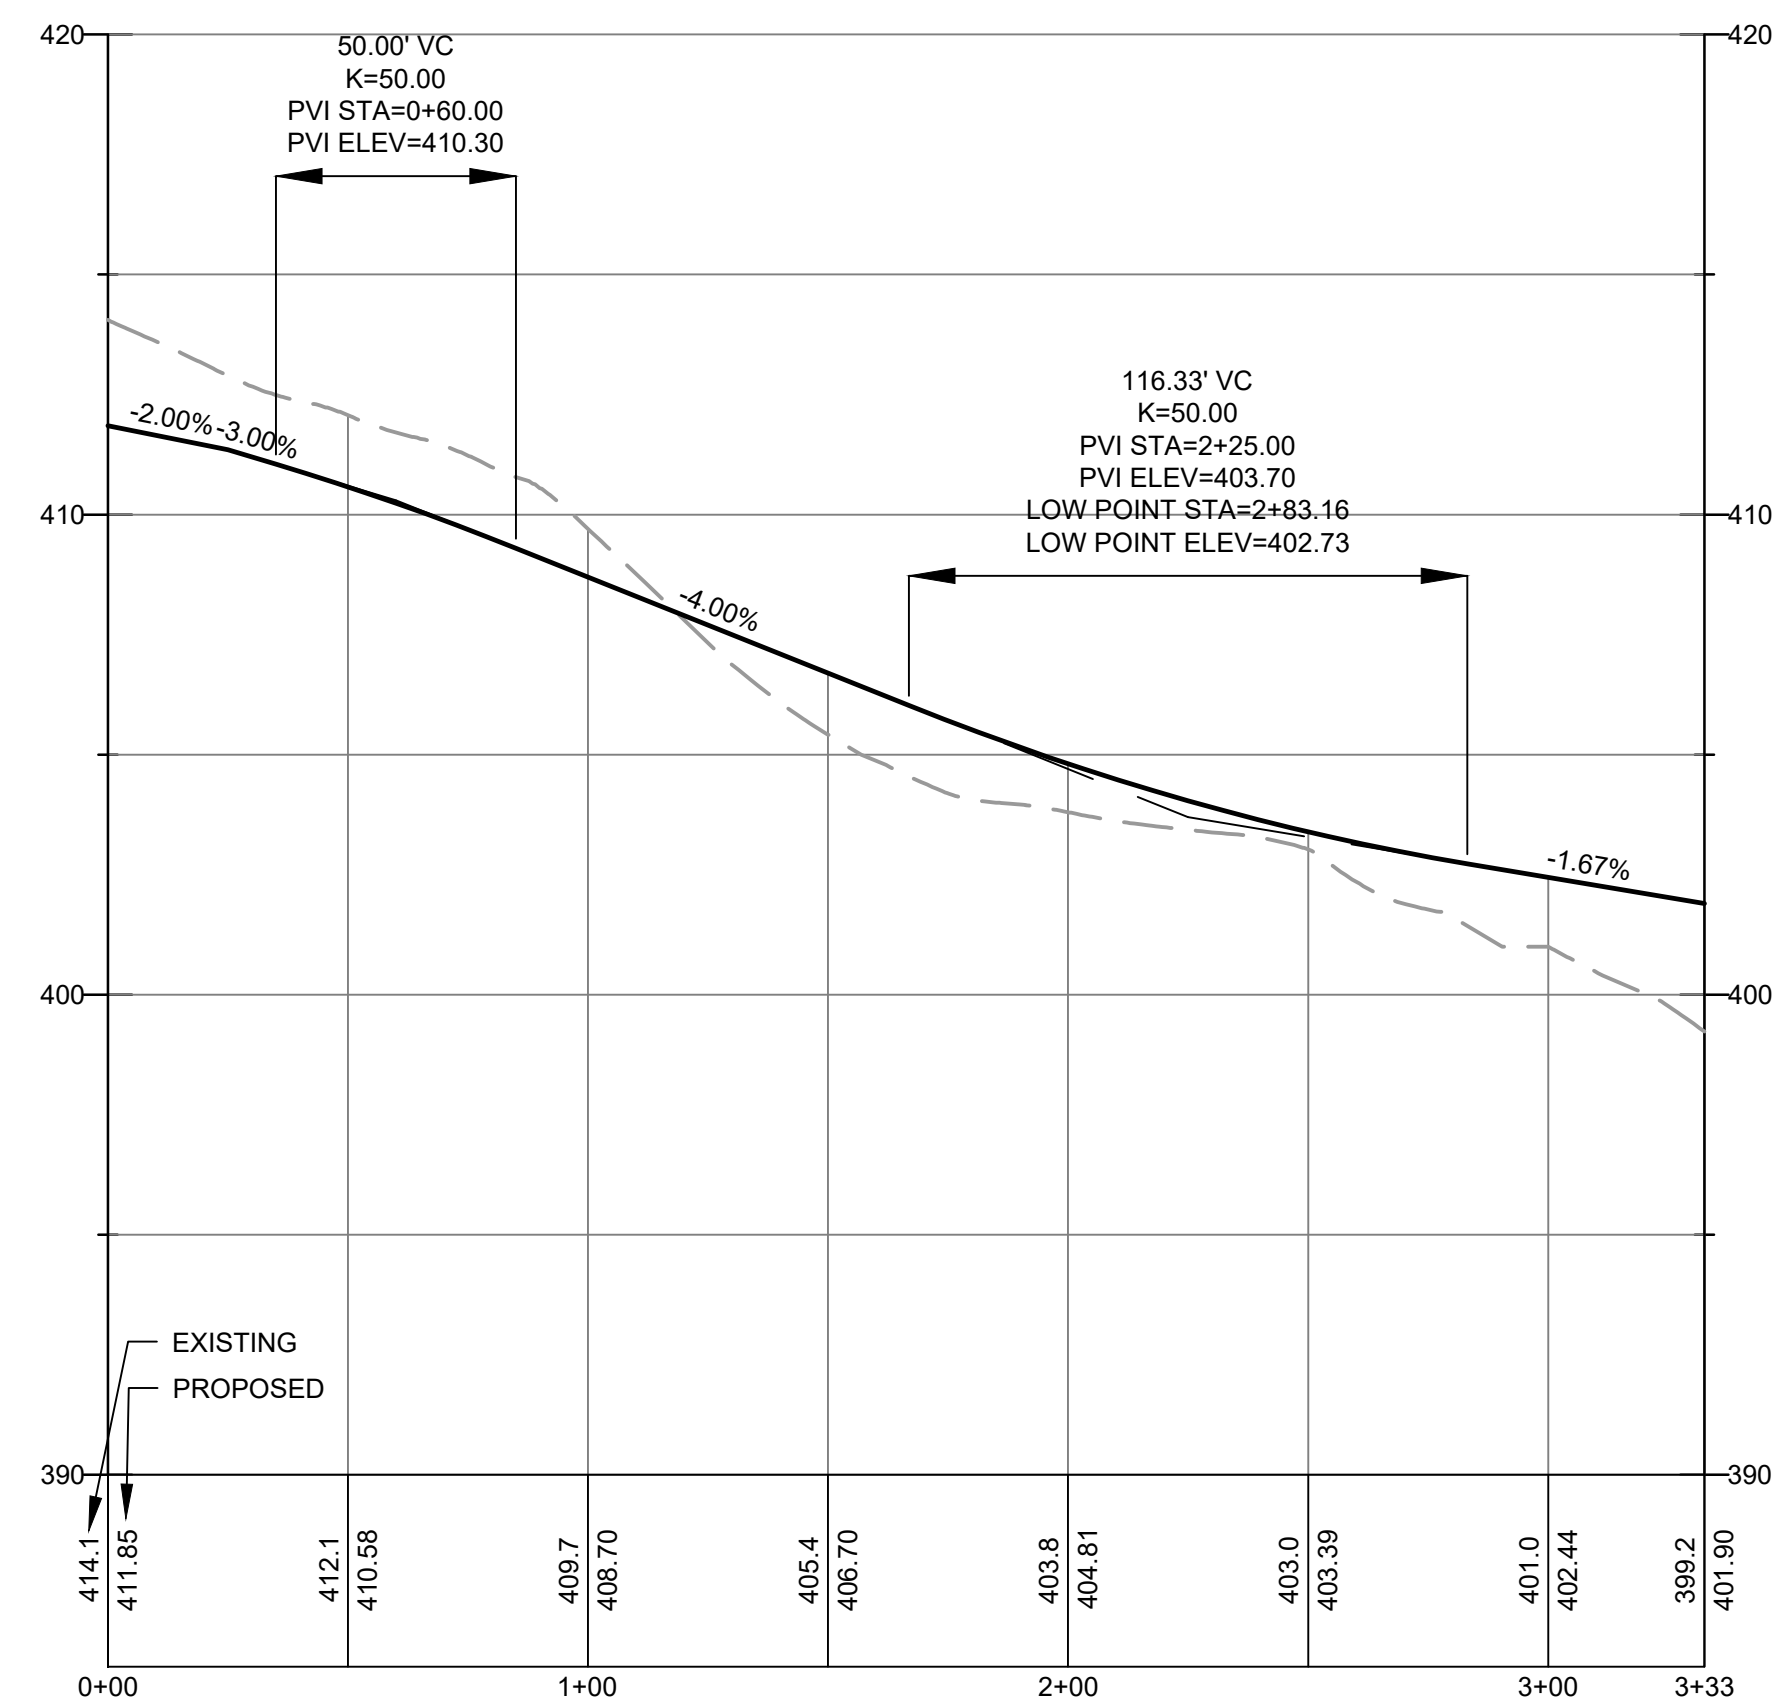


**PROFILE OF JESSE DANIEL DRIVE**

SCALE: 1"=4' HORIZONTAL  
1"=40' VERTICAL

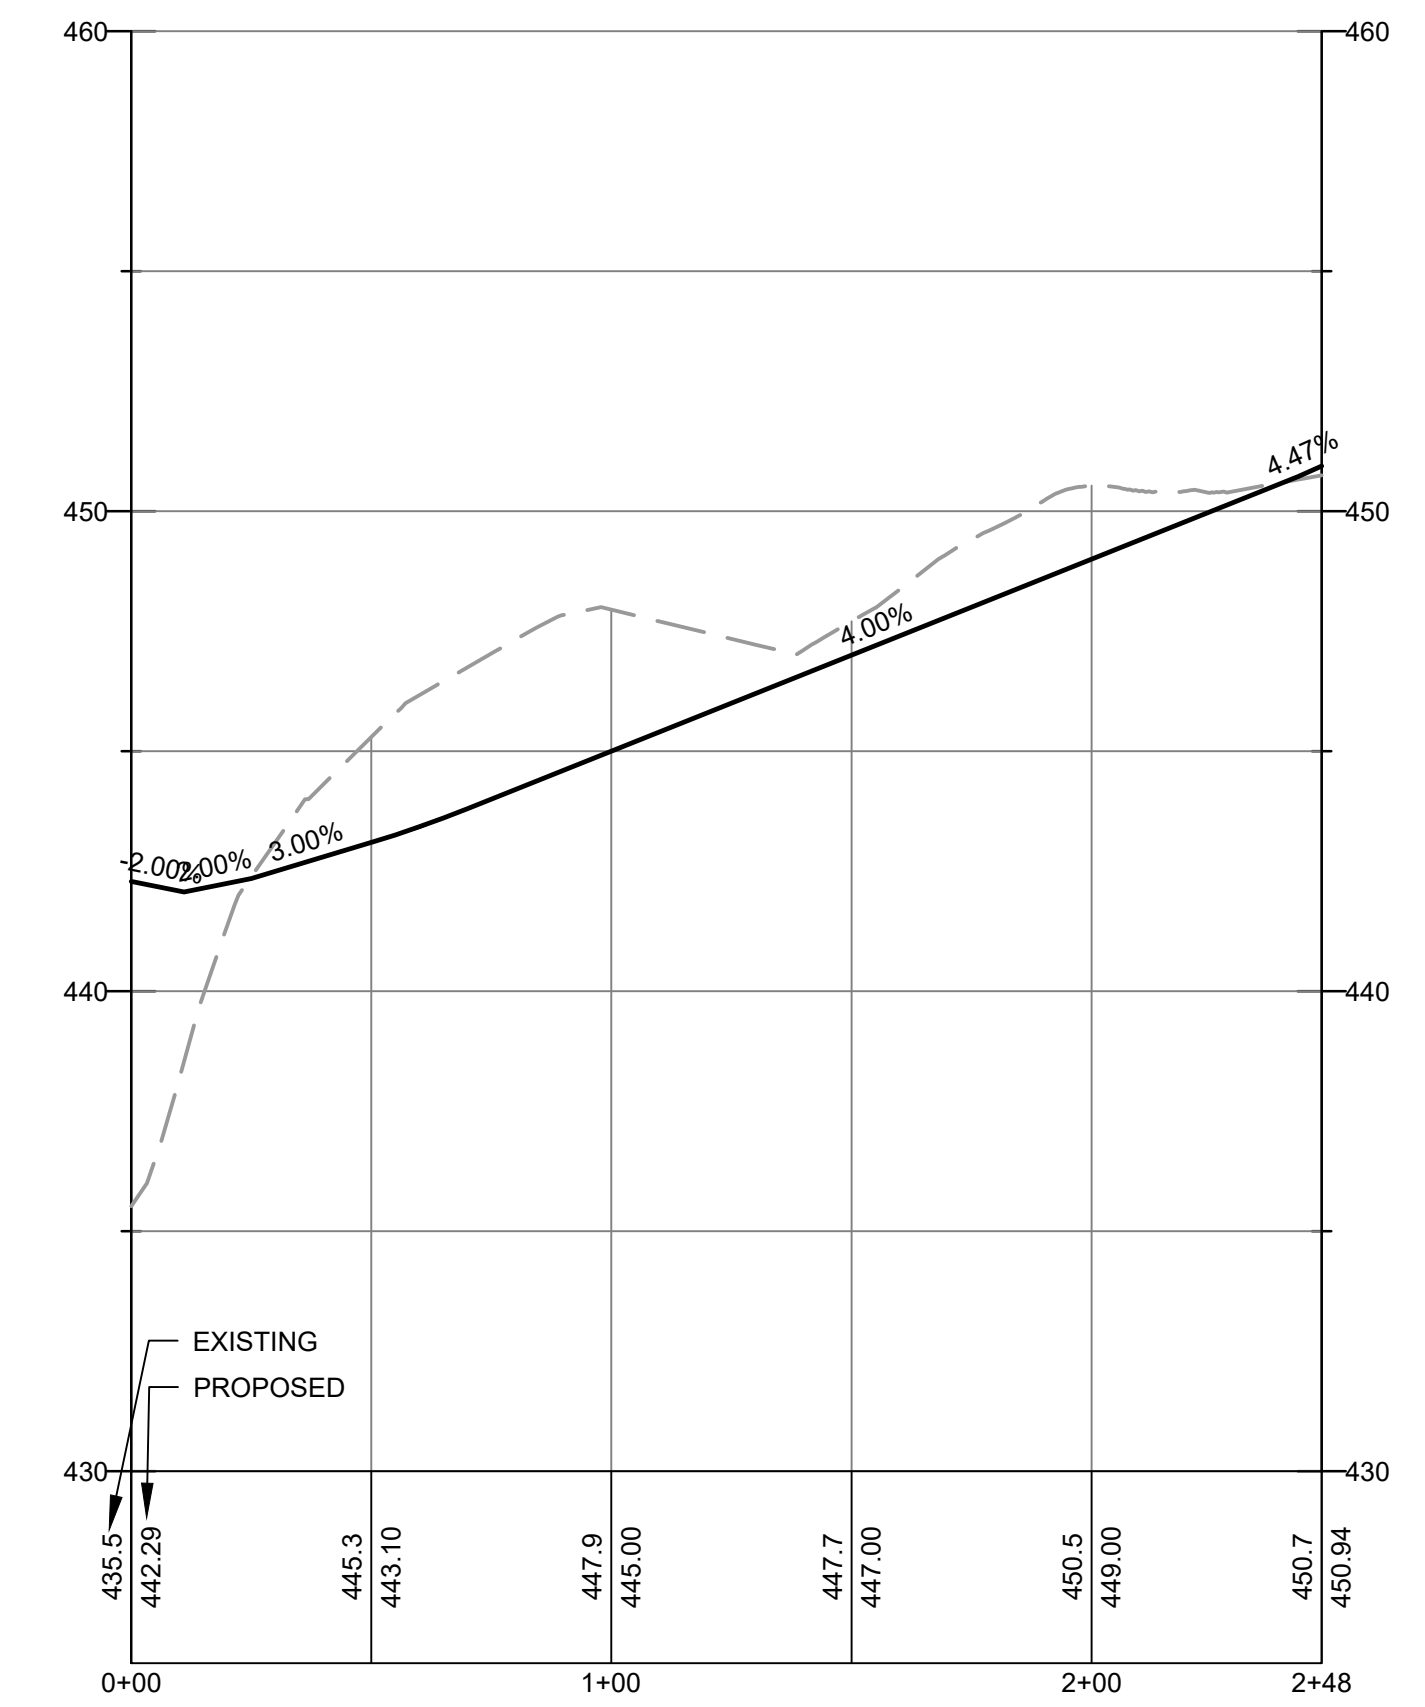


**PROFILE OF STONEHAVEN DRIVE**

SCALE: 1"=4' HORIZONTAL  
1"=40' VERTICAL

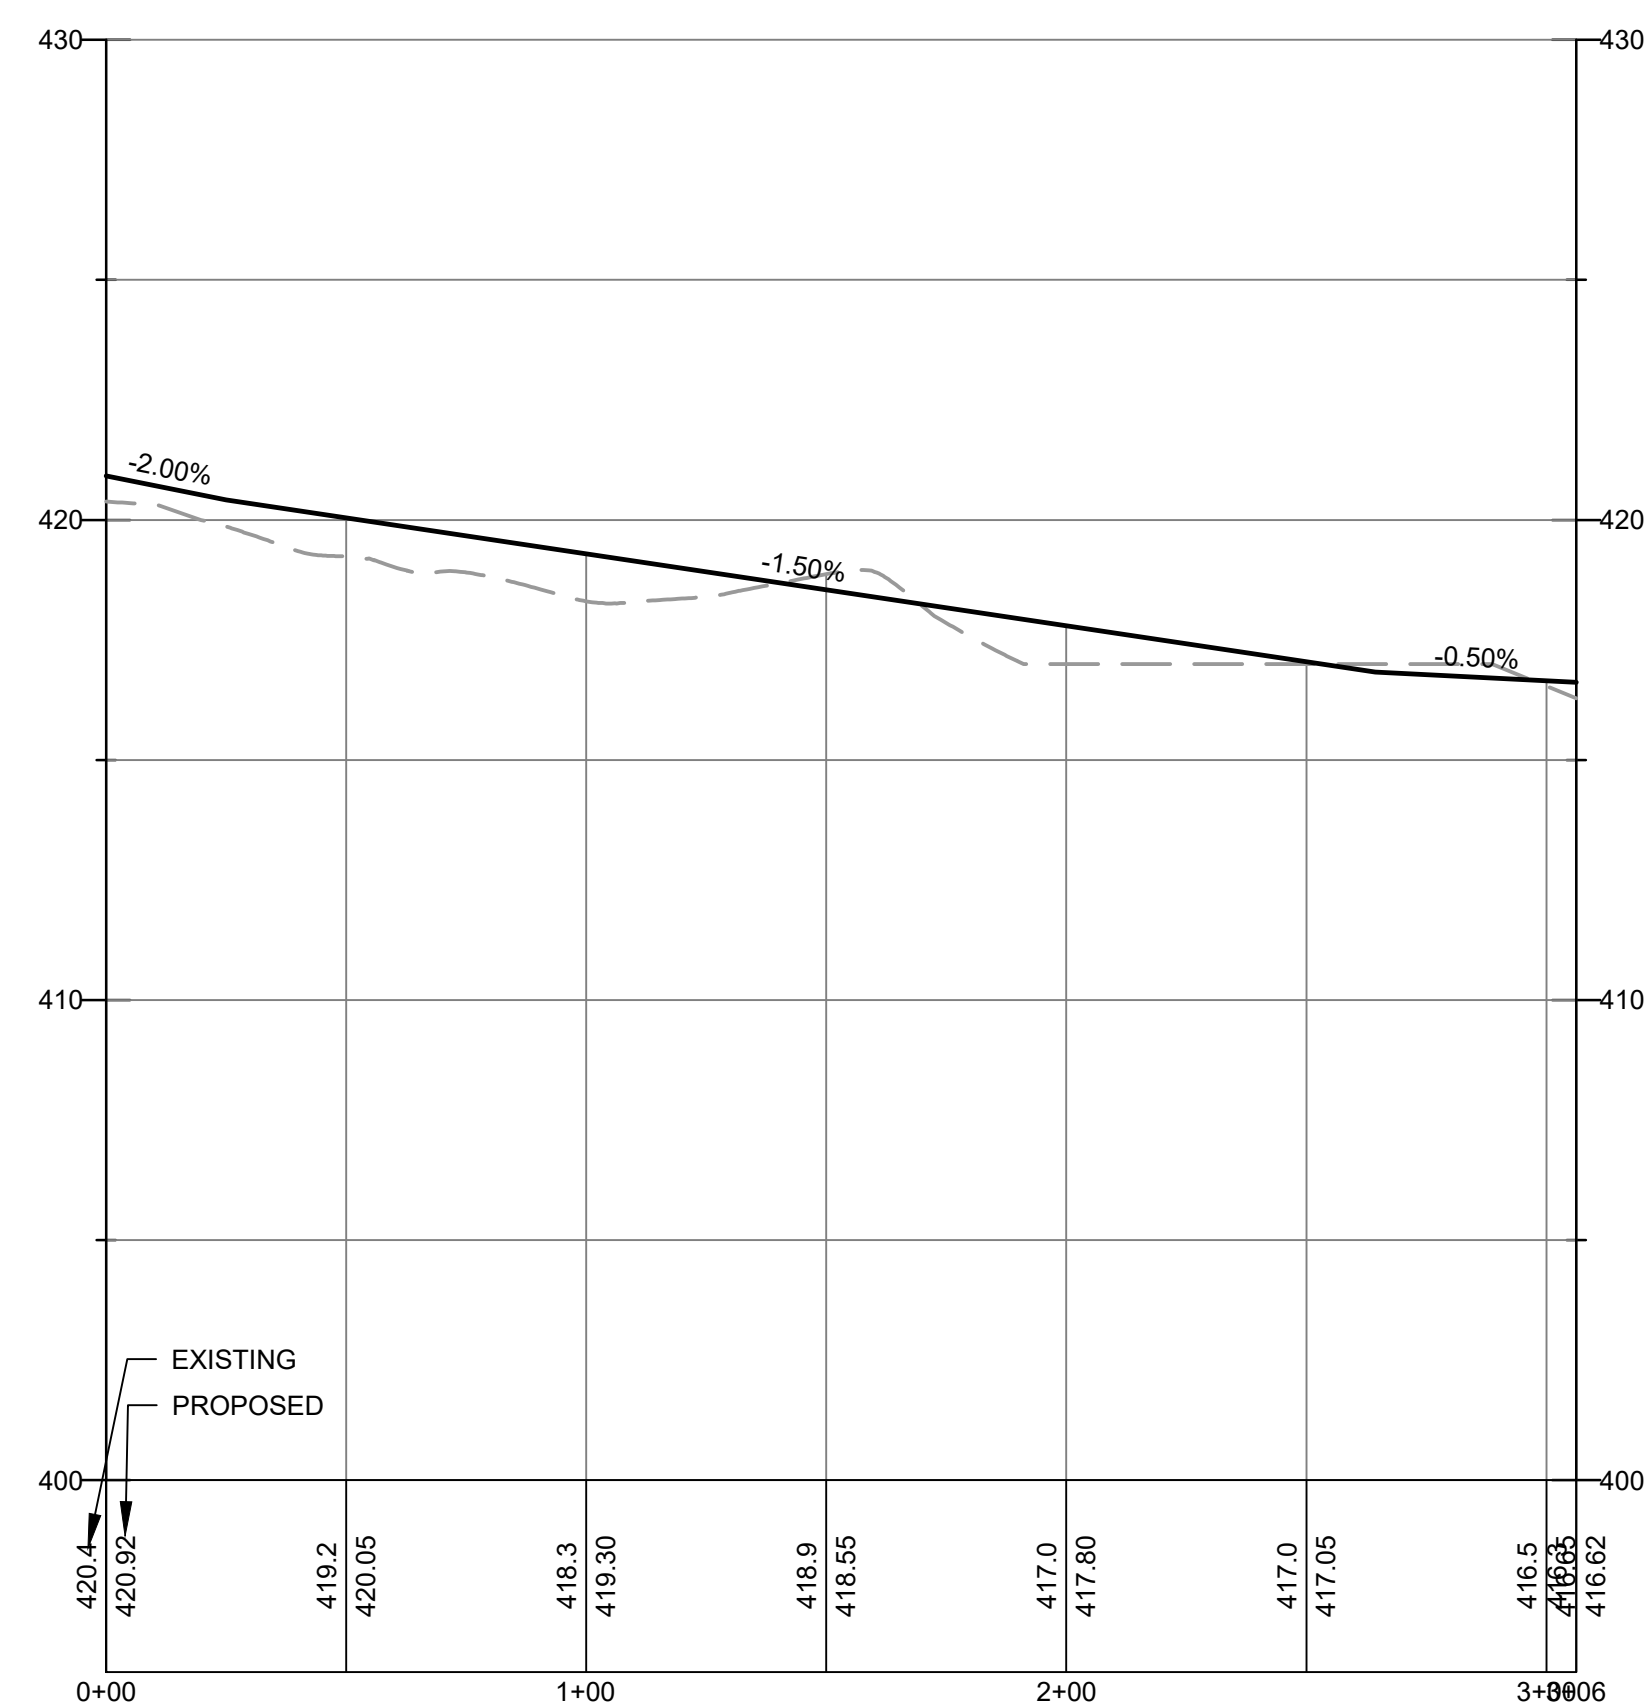


**PROFILE OF WHITNEY DRIVE**

SCALE: 1"=4' HORIZONTAL  
1"=40' VERTICAL

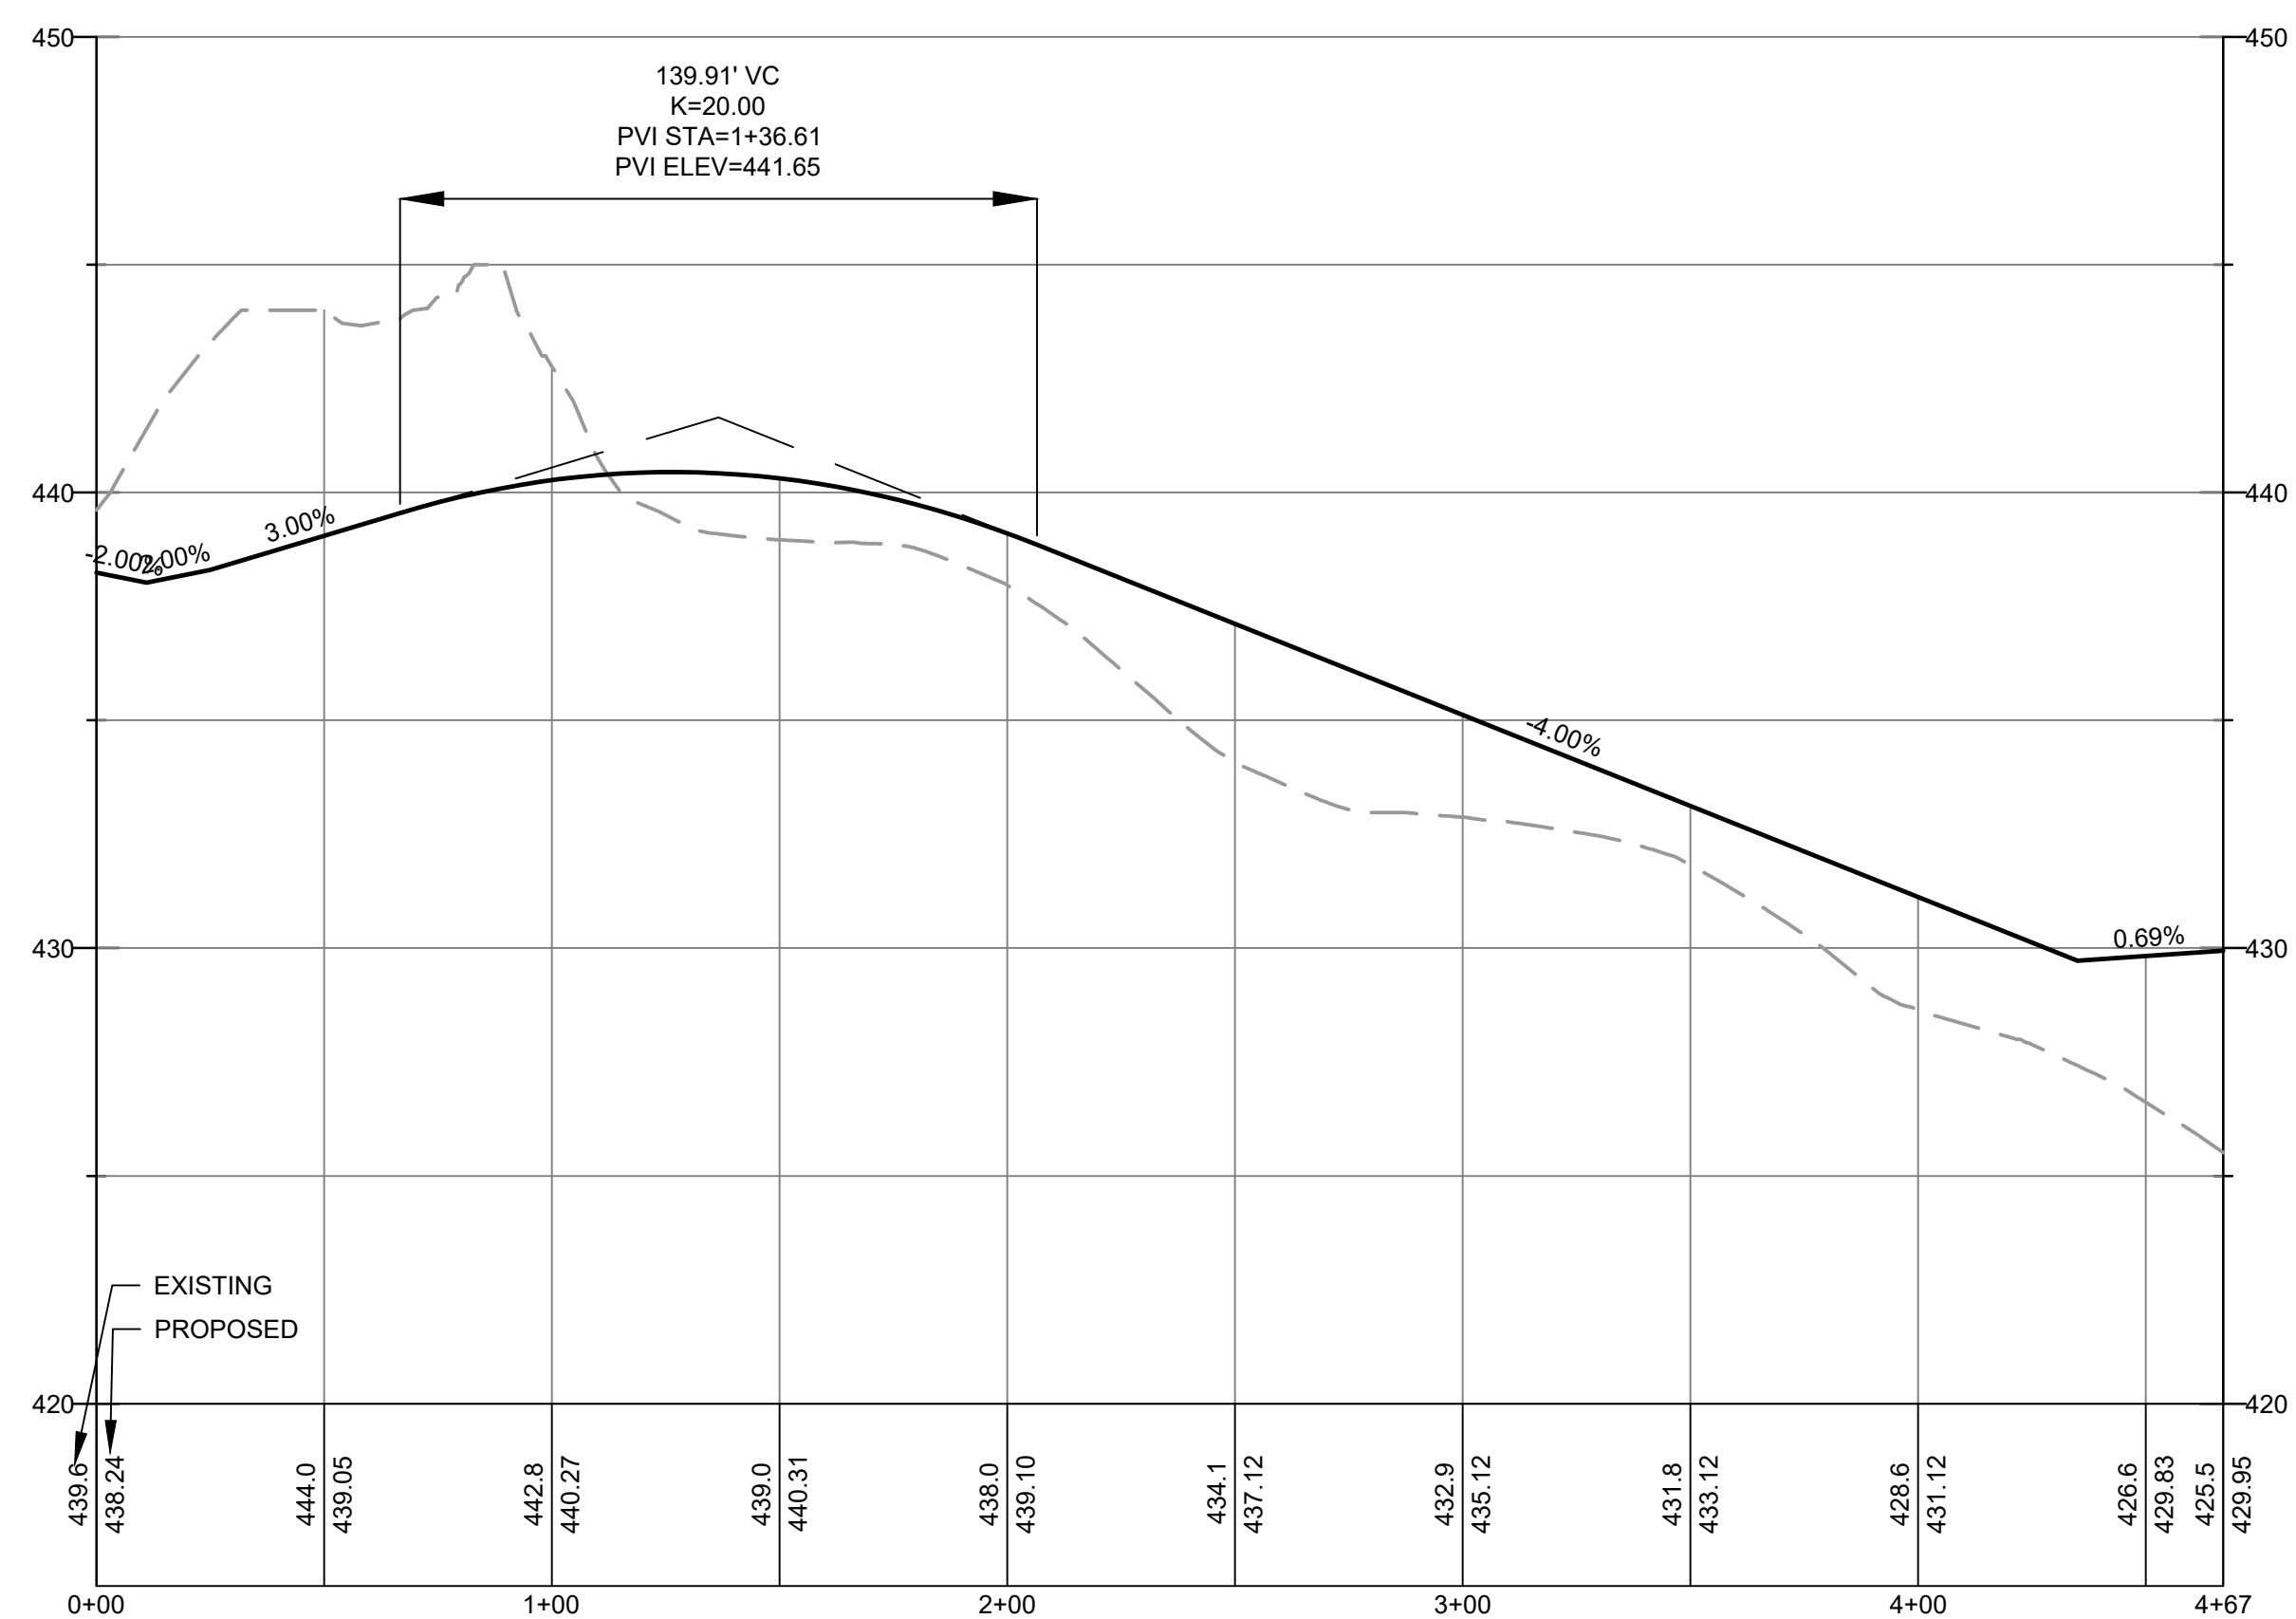

**PROFILE OF INVERNESS DRIVE**

SCALE: 1"=4' HORIZONTAL  
1"=40' VERTICAL

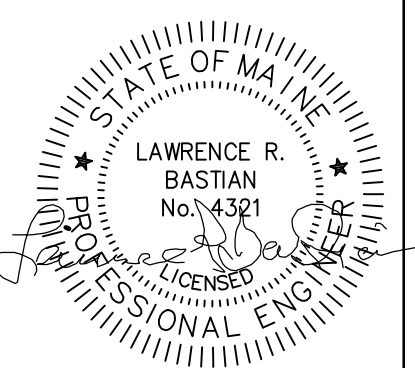

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS	APP'D BY
8	4/15/2020	FINAL REVIEW	
7	3/25/2020	REVISED PER TOWN COMMENTS	
6	2/13/2020	PEER REVIEW COMMENT RESPONSE	
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW	
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS	
3	3/29/2019	MDEP SITE LOCATION APPLICATION	
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN	
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN	

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260



SHEET DESCRIPTION  
**HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
VILLAGE HOUSING ROADWAY PROFILES**  
PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE: 3/15/2019  
SCALE: AS SHOWN  
DESIGNED: JDA  
JOB NO: 1804  
FILE: 1804 S.DWG  
SHEET **C-5.4**













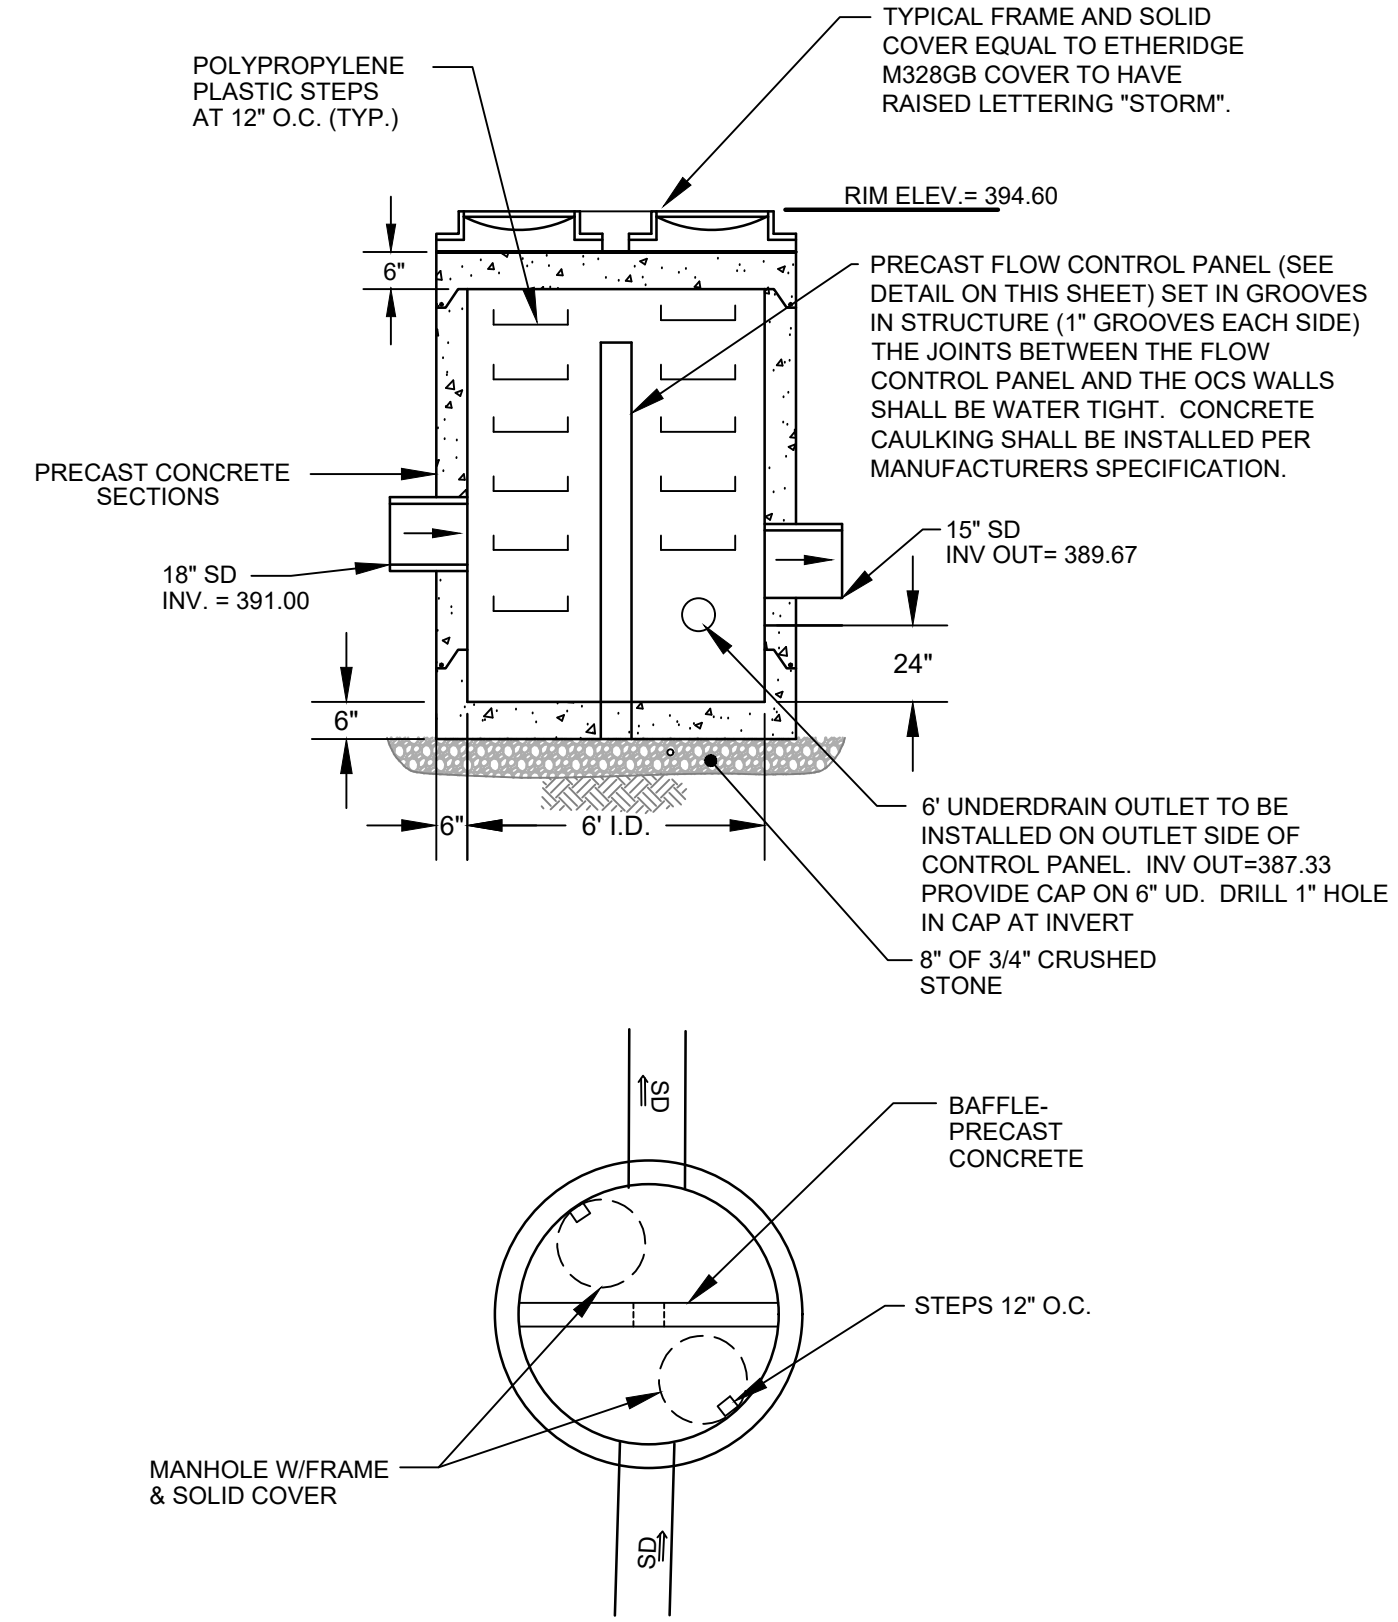


NOTE:  
 1. SUBMIT SHOP DRAWINGS FOR OWNER/ENGINEER APPROVAL.  
 2. STRUCTURE SHALL BE DESIGNED FOR H-20 LOADING.


**OUTLET CONTROL STRUCTURE (OCS)**  
 NOT TO SCALE

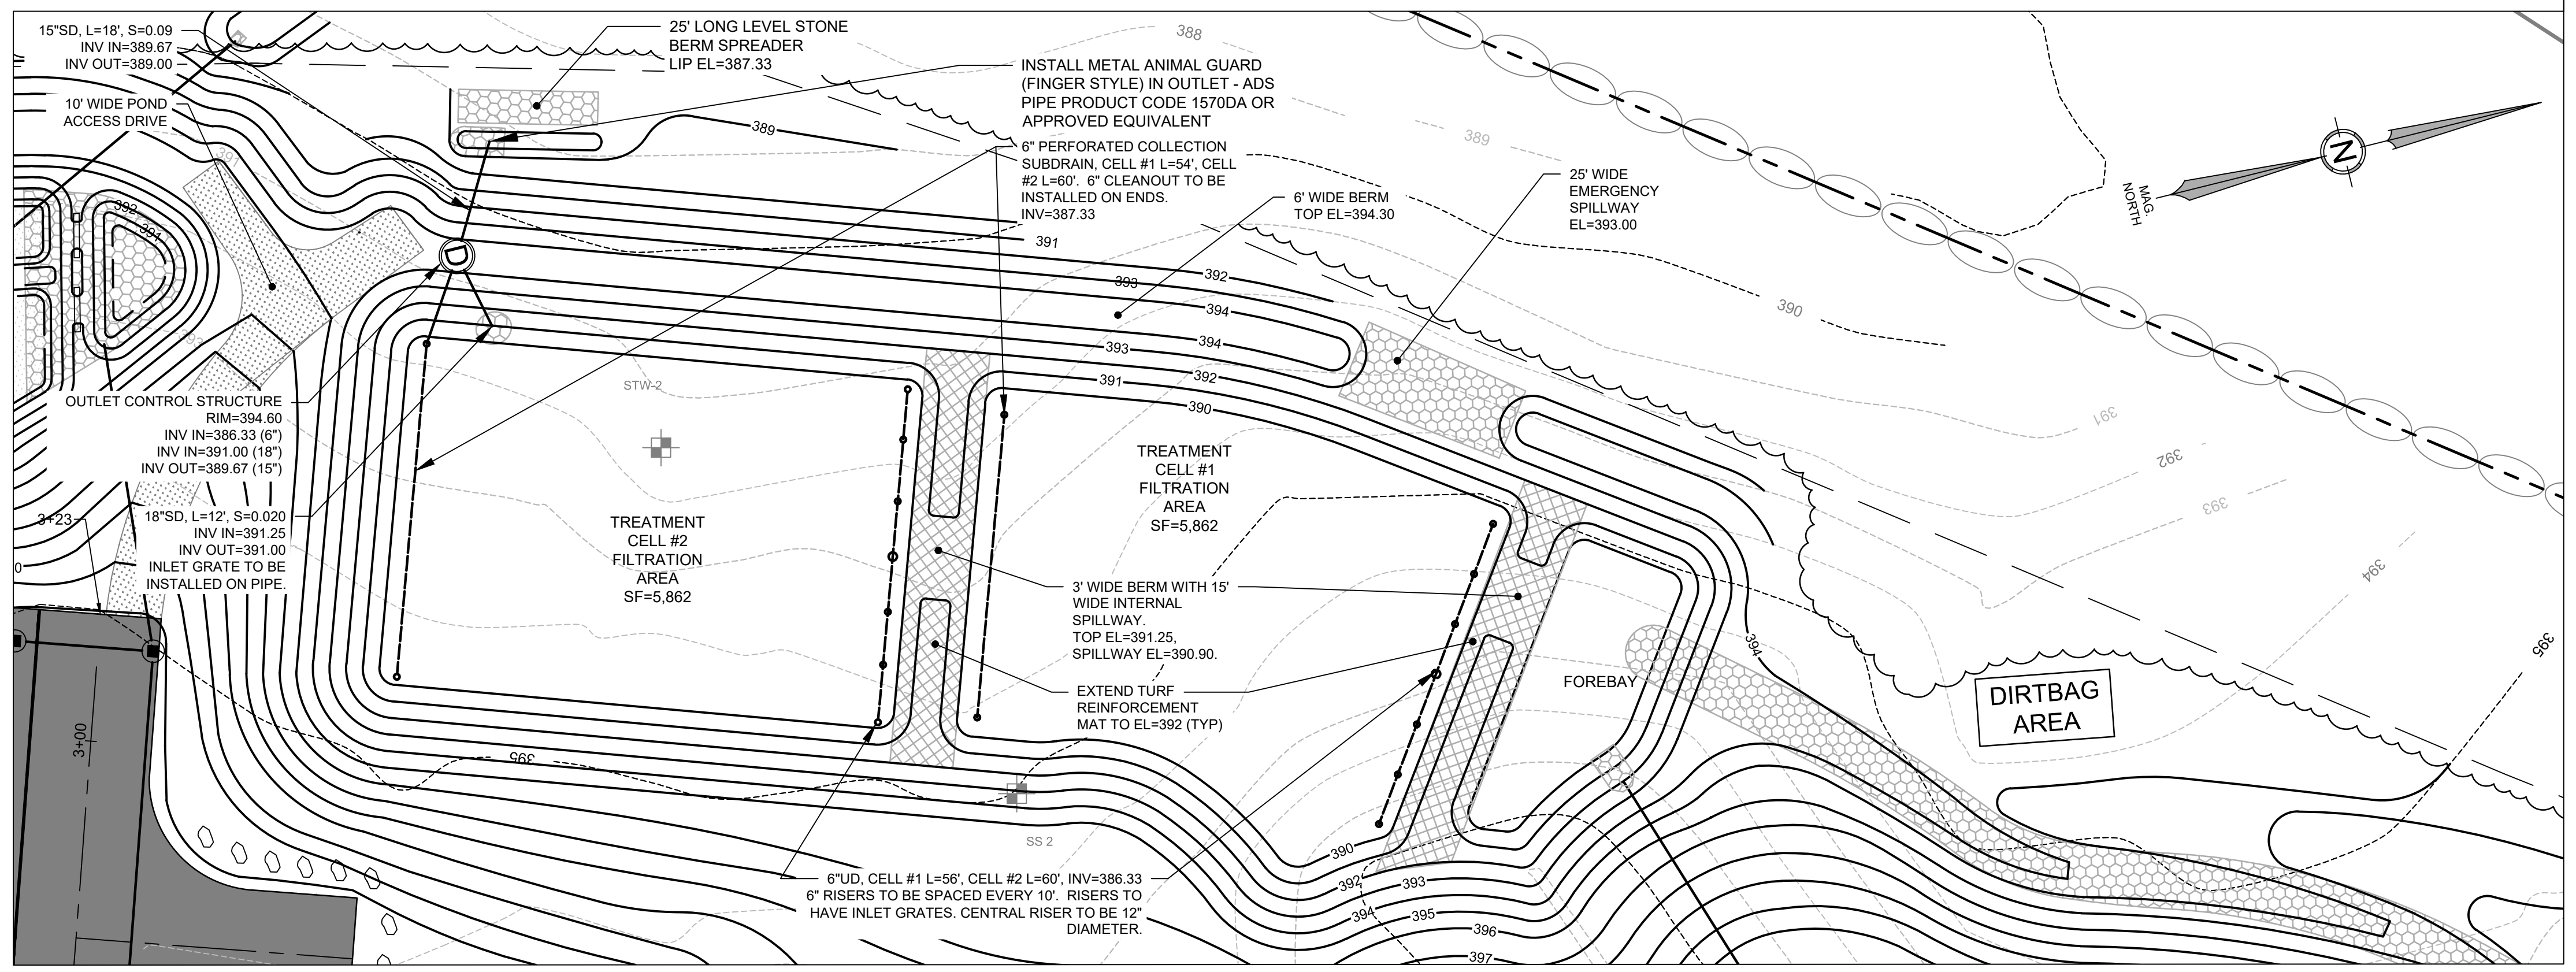


**GRAVEL WETLAND #1 PLAN VIEW**  
 SCALE: 1"=20'

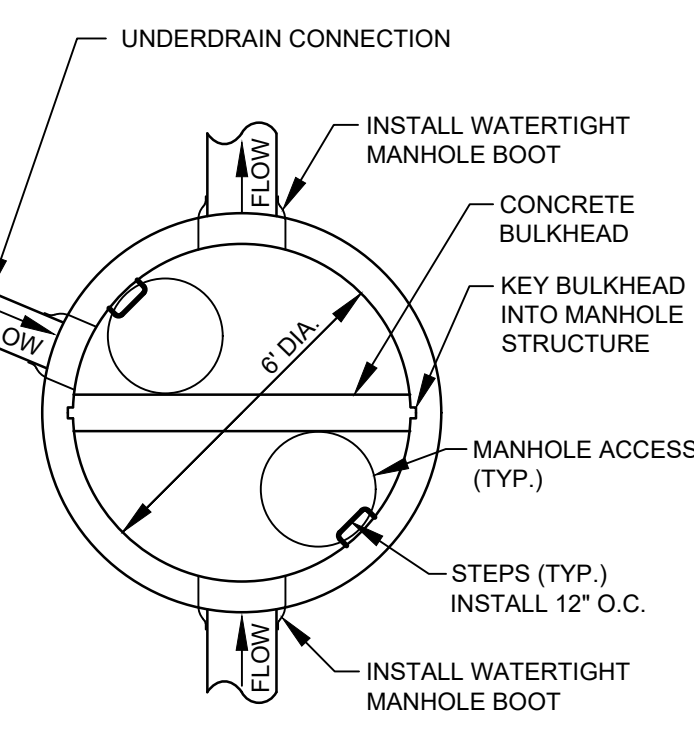

SCHEDULE A OUTLET CONTROL STRUCTURE	
ITEM DESCRIPTION	DIMENSION / ELEVATION
A. TOP OF STRUCTURE	394.80
B. TOP CONCRETE BULKHEAD	391.25
C. BOTTOM OF STRUCTURE	385.33

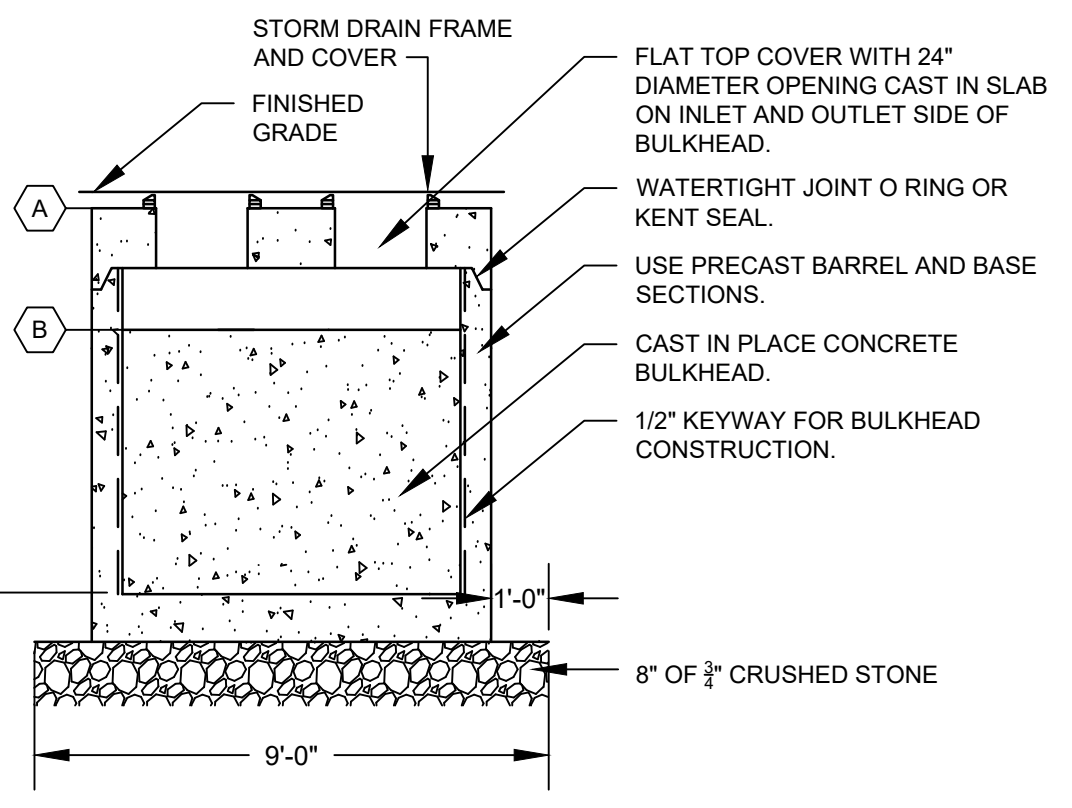


**OUTLET CONTROL STRUCTURE - WEIR WALL**  
 NOT TO SCALE

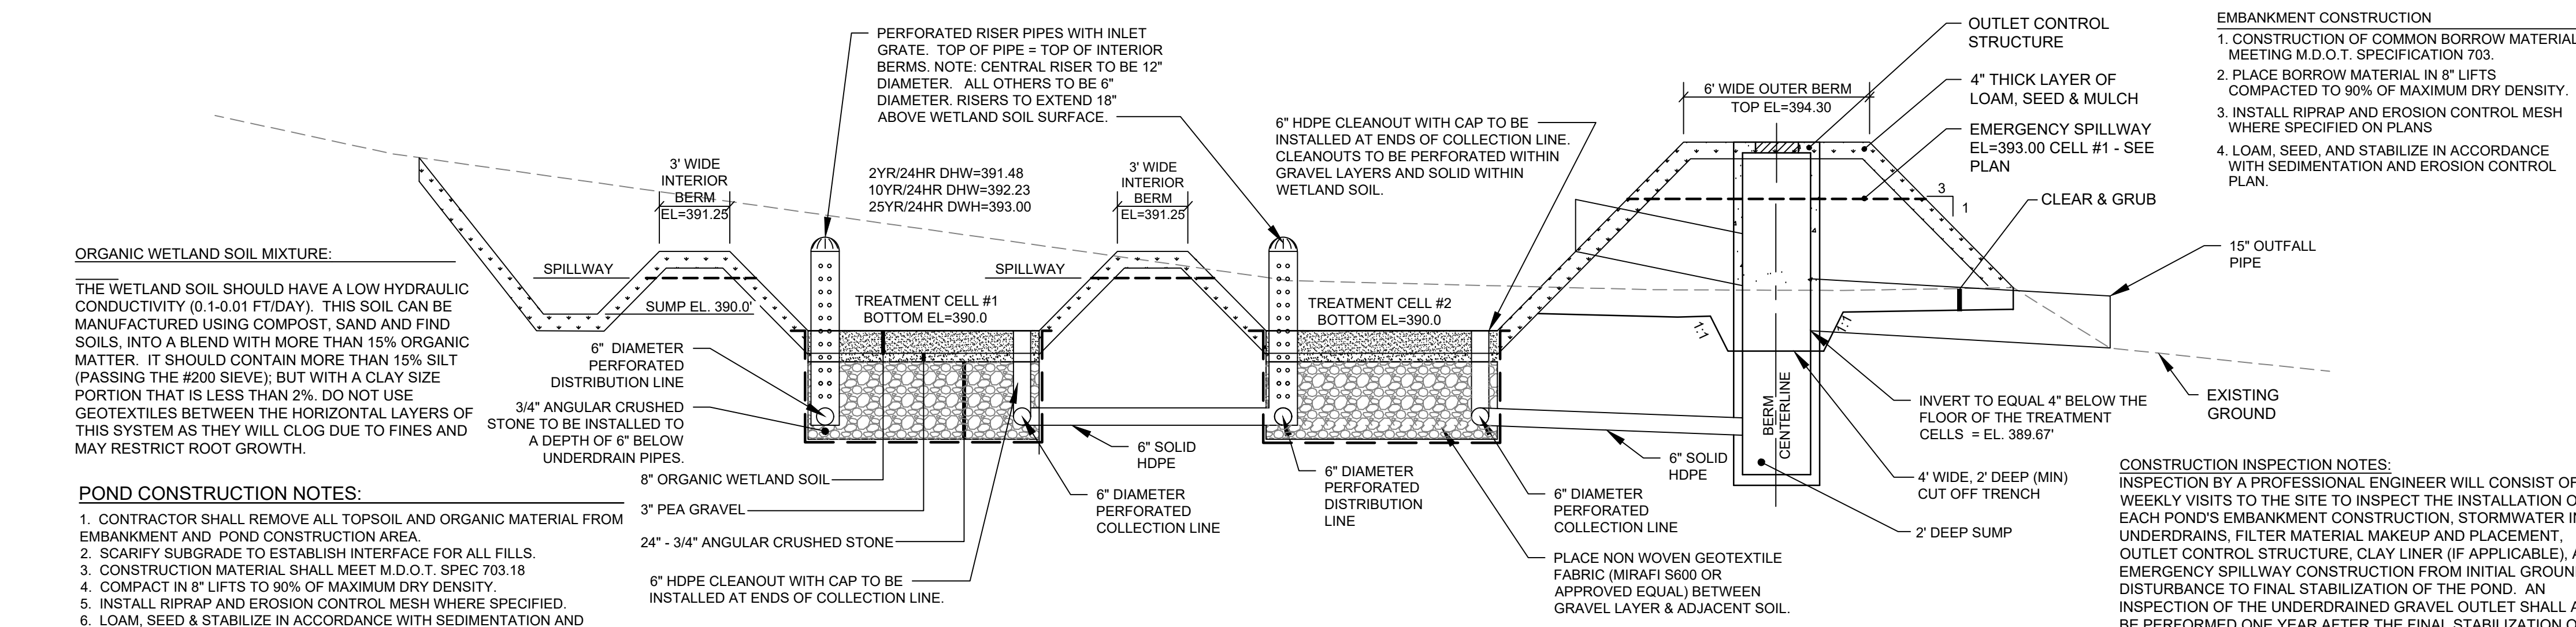


**CROSS SECTION VIEW - GRAVEL WETLAND**  
 NOT TO SCALE

**GRAVEL WETLAND INSTALLATION NOTES:**


- THE MINIMUM SPACING BETWEEN THE SUBSURFACE PERFORATED DISTRIBUTION LINE AND THE SUBSURFACE PERFORATED COLLECTION DRAIN AT EITHER END OF THE GRAVEL IN EACH TREATMENT CELL IS 15 FT.
- THERE SHOULD BE A MINIMUM HORIZONTAL TRAVEL DISTANCE OF 15 FT WITHIN THE GRAVEL LAYER IN EACH CELL.
- VERTICAL PERFORATED OR SLOTTED RISER PIPES DELIVER WATER FROM THE SURFACE DOWN TO THE SUBSURFACE, PERFORATED OR SLOTTED DISTRIBUTION LINES. THESE RISERS SHALL HAVE A MAXIMUM SPACING OF 10 FEET.
- SLOTTED VERTICAL RISERS SHALL HAVE A MINIMUM DIAMETER OF 12" FOR THE CENTRAL RISER AND 6" FOR END RISERS. THE VERTICAL RISERS SHALL NOT BE CAPPED, BUT RATHER COVERED WITH AN INLET GRATE.
- VERTICAL CLEANOUTS CONNECTED TO THE DISTRIBUTION AND COLLECTION SUBDRAINS, AT EACH END, SHALL BE PERFORATED OR SLOTTED ONLY WITHIN THE GRAVEL LAYER, AND SOLID WITHIN THE WETLAND SOIL AND STORAGE AREA ABOVE.
- TREATMENT CELL FLOOR TO BE GRADED FLAT.
- BERMS AND WEIRS SEPARATING THE FOREBAY AND TREATMENT CELLS SHOULD BE CONSTRUCTED WITH CLAY, OR NON-CONDUCTIVE SOILS, AND/OR A FINE GEOTEXTILE, OR SOME COMBINATION THEREOF, TO AVOID WATER SEEPAGE AND SOIL PIPING THROUGH THESE PARTIAL DIVIDERS.
- THE SYSTEM SHOULD BE PLANTED TO ACHIEVE A RIGOROUS ROOT MAT WITH GRASSES, FORBS, AND SHRUBS WITH OBLIGATE AND FACULTATIVE WETLAND SPECIES.
- THE SUBAREA DRAINING TO A CREATED WETLAND MUST BE COMPLETELY STABLE BEFORE RUNOFF IS DIRECTED TO THE BASIN TO PREVENT SEDIMENTATION OF THE DRAINAGE LAYER; OR ALL RUNOFF SHOULD BE RE-DIRECTED UNTIL CONSTRUCTION IS FINALIZED. THE VEGETATION WITHIN THE STRUCTURE IS EQUALLY IMPORTANT AND MUST BE WELL ESTABLISHED BEFORE IT CAN ACCEPT ANY RUNOFF.
- GRAVEL WETLAND STORMWATER AREA TO BE SEEDED WITH "NEW ENGLAND WETMIX" AS DISTRIBUTED BY NEW ENGLAND WETLAND PLANTS, INC., 820 WEST STREET, AMHERST, MA 01002, PHONE 413-548-6000, EMAIL INFO@NEWP.COM, OR APPROVED EQUIVALENT. APPLY AT A RATE OF 1 LB/2,500 SF.
- THE SEEDS WILL NOT GERMINATE UNDER INUNDATED CONDITIONS. IF PLANTED DURING THE FALL MONTHS THE SEED MIX WILL GERMINATE THE FOLLOWING SPRING. DURING THE FIRST SEASON OF GROWTH SEVERAL SPECIES WILL PRODUCE SEEDS WHILE OTHER SPECIES WILL PRODUCE SEEDS AFTER THE SECOND GROWING SEASON. NOT ALL SPECIES WILL GROW IN ALL WETLAND SITUATIONS. THIS MIX IS COMPRISED OF THE WETLAND SPECIES MOST LIKELY TO GROW IN CREATED/RESTORED WETLANDS AND SHOULD PRODUCE MORE THAN 75% GROUND COVER IN TWO FULL GROWING SEASONS.
- THE WETLAND SEEDS IN THIS MIX CAN BE SOWN BY HAND, WITH A HAND-HELD SPREADER, OR HYDRO-SEEDED ON LARGE OR HARD TO REACH SITES. LIGHTLY RAKE TO ENSURE GOOD SEED-TO-SOIL CONTACT. SEEDING CAN TAKE PLACE ON FROZEN SOIL, AS THE FREEZING AND THAWING WEATHER OF LATE FALL AND LATE WINTER WILL WORK THE SEED INTO THE SOIL. IF SPRING CONDITIONS ARE DRIER THAN USUAL, WATERING MAY BE REQUIRED. IF SOWING DURING THE SUMMER MONTHS, SUPPLEMENTAL WATERING WILL LIKELY BE REQUIRED UNTIL GERMINATION. A LIGHT MULCH OF CLEAN, WEED FREE STRAW IS RECOMMENDED.
- THE POND CONSTRUCTION SHOULD BE ONLY CONSTRUCTED UNDER THE SUPERVISION OF THE DESIGN ENGINEER.

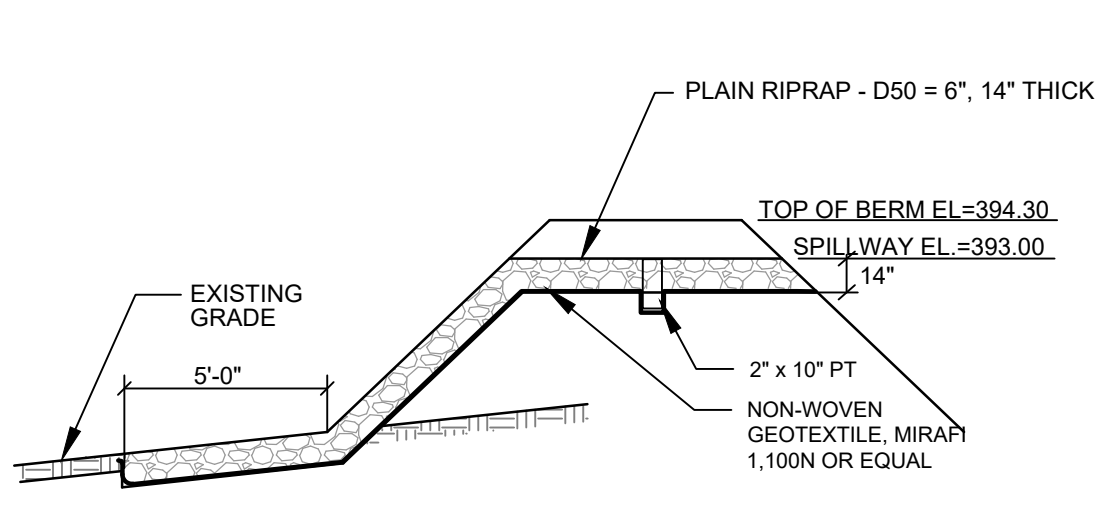


**PRIMARY SPILLWAY EMBANKMENT SECTION**  
 NOT TO SCALE

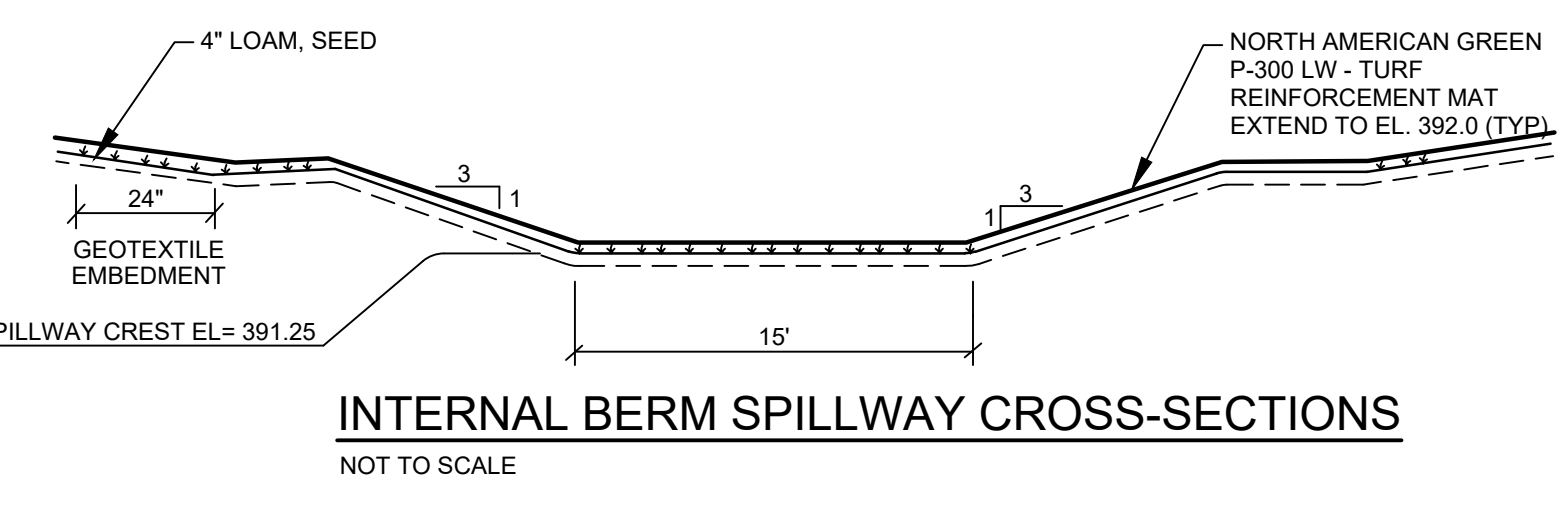

**INTERNAL BERM SPILLWAY CROSS-SECTIONS**  
 NOT TO SCALE

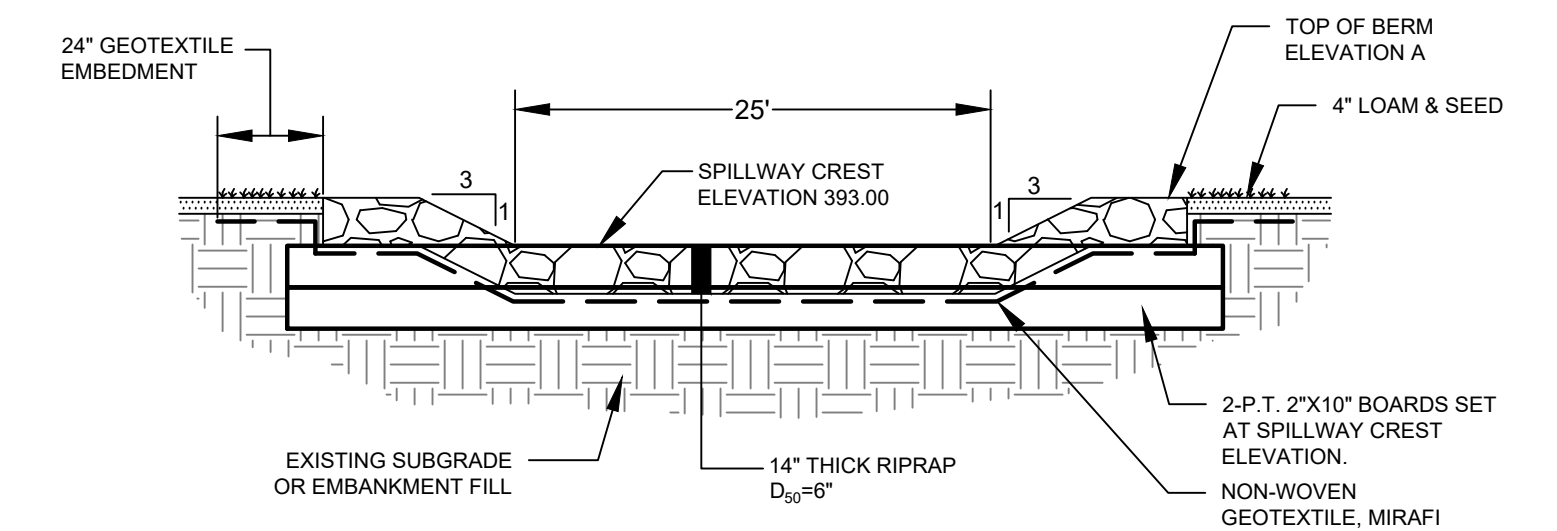

**EMERGENCY SPILLWAY CROSS SECTION**  
 NOT TO SCALE

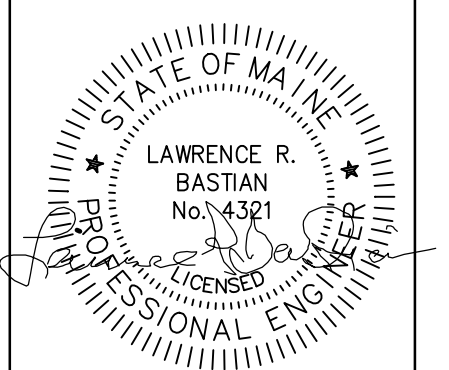

LRB	DATE	REVISIONS
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
3	3/29/2019	PRELIMINARY SUBDIVISION & SITE PLAN
4	11/26/2019	MDP SITE LOCATION APPLICATION
5	11/26/2019	REVISED PER MDP REVIEW COMMENTS
6	11/26/2019	REVISED PER MDP REVIEW COMMENTS
7	2/13/2020	PEER REVIEW COMMENT RESPONSE
8	4/15/2020	FINAL REVIEW

565 CONGRESS STREET  
 SUITE 200  
 PORTLAND, ME 04102

41 CAMPUS DRIVE  
 SUITE 100  
 NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
 www.terradyneconsultants.com

**TERRADYN CONSULTANTS, LLC**

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

**HIGHLANDS SUBDIVISION  
 STANDISH, MAINE  
 GRAVEL WETLAND DETAILS & NOTES**


PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
 P.O. BOX 703  
 STANDISH, MAINE 04084

DATE: 3/15/2019  
 SCALE:  
 DESIGNED: JDA  
 JOB NO: 1804  
 FILE:  
 SHEET **C-6.2**









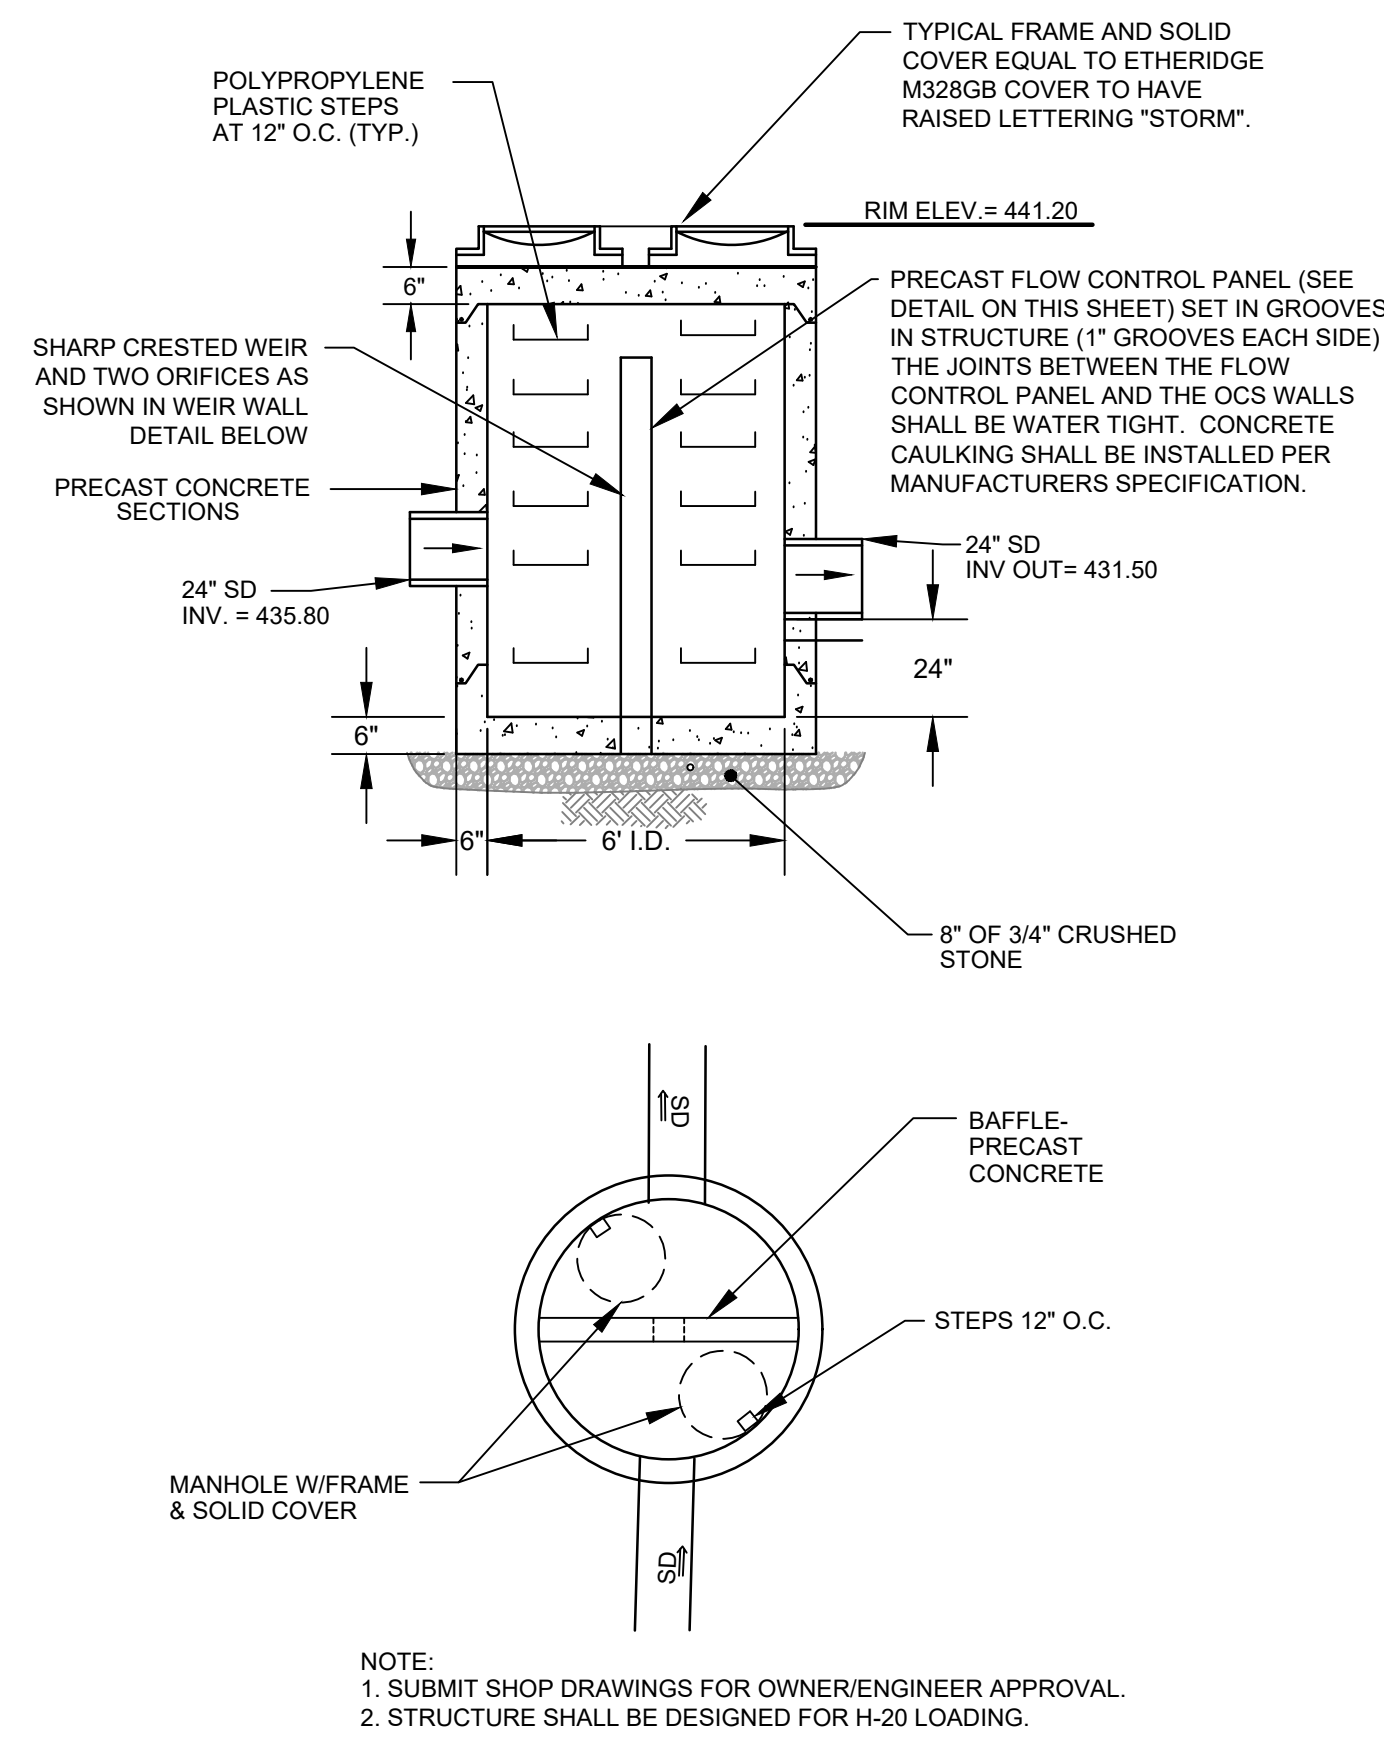


**OUTLET CONTROL STRUCTURE (OCS)**  
NOT TO SCALE

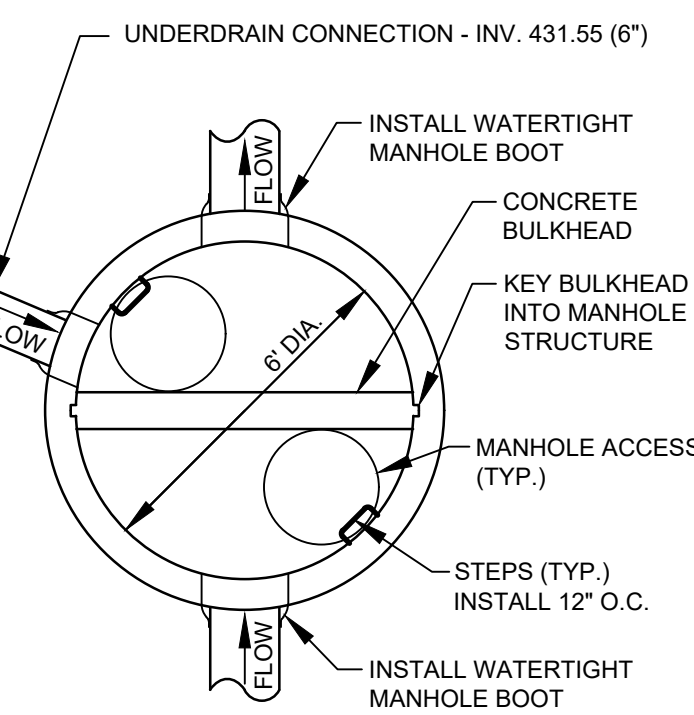

SCHEDULE A OUTLET CONTROL STRUCTURE		
ITEM DESCRIPTION		DIMENSION/ ELEVATION
A. TOP OF STRUCTURE		441.20
B. TOP CONCRETE BULKHEAD		438.50
C. SHARP CRESTED WEIR		437.90
D. ORIFICE INVERT		436.65
E. ORIFICE INVERT		435.90
F. BOTTOM OF STRUCTURE		429.50
G. ORIFICE DIAMETER		12"
H. ORIFICE DIAMETER		7.5"

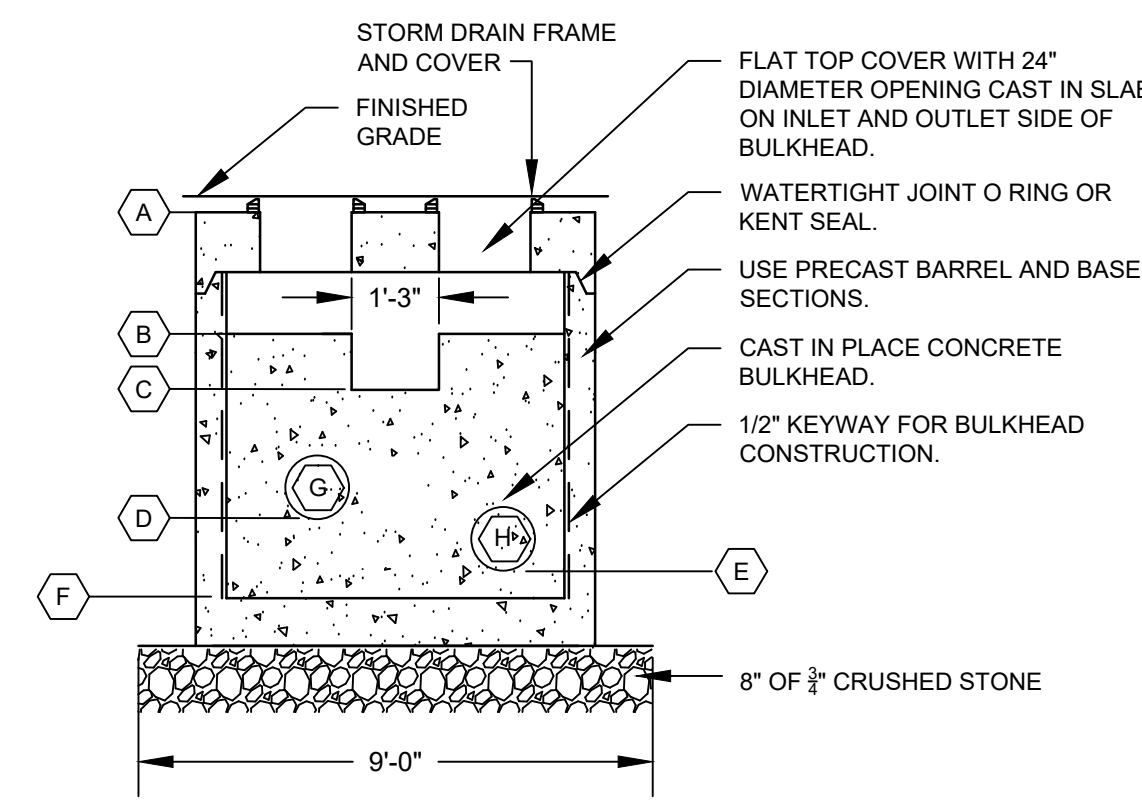


**OUTLET CONTROL STRUCTURE - WEIR WALL**  
NOT TO SCALE

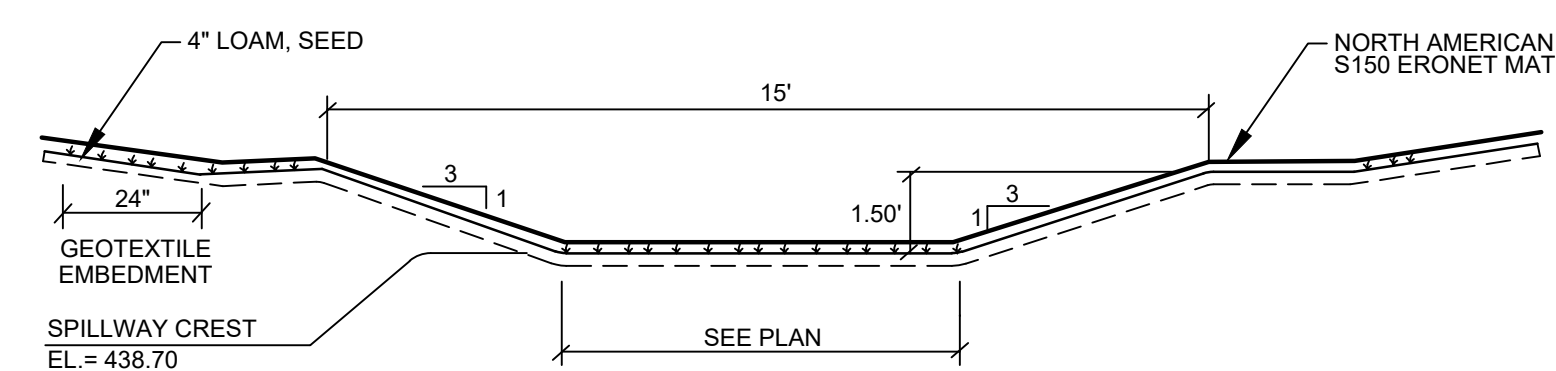

**SPILLWAY CROSS-SECTION - FILTER BASIN**  
NOT TO SCALE

**CONSTRUCTION PHASE NOTES:**  
**CONSTRUCTION SEQUENCE:** THE SOIL FILTER MEDIA AND VEGETATION MUST NOT BE INSTALLED UNTIL THE AREA THAT DRAINS TO THE FILTER HAS BEEN PERMANENTLY STABILIZED WITH PAVEMENT OR OTHER STRUCTURE, 90% VEGETATION COVER, OR OTHER PERMANENT STABILIZATION UNLESS THE RUNOFF FROM THE CONTRIBUTING DRAINAGE AREA IS DIVERTED AROUND THE FILTER UNTIL STABILIZATION IS COMPLETED.  
**PLACEMENT OF SOIL FILTER:** UNDERDRAIN BEDDING MATERIAL MUST BE COMPACTED TO BETWEEN 90% AND 92% STANDARD PROCTOR. THE SOIL BED SHALL BE INSTALLED IN 2 LIFTS OF 9 INCHES TO PREVENT POCKETS OF LOOSE MEDIA, NOT COMPACTED.  
**CONSTRUCTION OVERSIGHT:** INSPECTION BY A PROFESSIONAL ENGINEER WILL OCCUR AT A MINIMUM:  
 • AFTER THE PRELIMINARY CONSTRUCTION OF THE FILTER GRADES AND ONCE THE UNDERDRAIN PIPES ARE INSTALLED BUT NOT BACKFILLED,  
 • AFTER THE DRAINAGE LAYER IS CONSTRUCTED AND PRIOR TO THE INSTALLATION OF THE FILTER MEDIA,  
 • AFTER THE FILTER MEDIA HAS BEEN INSTALLED AND SEEDDED. BIO-RETENTION CELLS MUST BE STABILIZED PER THE PROVIDED PLANTING SCHEME AND DENSITY FOR THE CANOPY COVERAGE OF 30 AND 50%.  
 • AFTER ONE YEAR TO INSPECT HEALTH OF THE VEGETATION AND MAKE CORRECTIONS, AND  
 • ALL THE MATERIAL USED FOR THE CONSTRUCTION OF THE FILTER BASIN MUST BE CONFIRMED AS SUITABLE BY THE DESIGN ENGINEER. TESTING MUST BE DONE BY A CERTIFIED LABORATORY TO SHOW THAT THEY ARE PASSING DEP SPECIFICATIONS.  
**TESTING AND SUBMITTALS:** THE CONTRACTOR SHALL IDENTIFY THE LOCATION OF THE SOURCE OF EACH COMPONENT OF THE FILTER MEDIA. ALL RESULTS OF FIELD AND LABORATORY TESTING SHALL BE SUBMITTED TO THE PROJECT ENGINEER FOR CONFIRMATION. THE CONTRACTOR SHALL:  
 • SELECT SAMPLES FOR SAMPLING OF EACH TYPE OF MATERIAL TO BE BLENDED FOR THE MIXED FILTER MEDIA AND SAMPLES OF THE UNDERDRAIN BEDDING MATERIAL. SAMPLES MUST BE A COMPOSITE OF THREE DIFFERENT LOCATIONS (GRABS) FROM THE STOCKPILE OR PIT FACE. SAMPLE SIZE REQUIRED WILL BE DETERMINED BY THE TESTING LABORATORY.  
 • PERFORM A SIEVE ANALYSIS CONFORMING TO ASTM C136 (STANDARD TEST METHOD FOR SIEVE ANALYSIS OF FINE AND COURSE AGGREGATES 1996A) ON EACH TYPE OF THE SAMPLE MATERIAL. THE RESULTING SOIL FILTER MEDIA MIXTURE MUST HAVE 8% TO 12% BY WEIGHT PASSING THE #200 SIEVE, A CLAY CONTENT OF LESS THAN 2% (DETERMINED HYDROMETER GRAIN SIZE ANALYSIS) AND HAVE 10% DRY WEIGHT OF ORGANIC MATTER.  
 • PERFORM A PERMEABILITY TEST ON THE SOIL FILTER MEDIA MIXTURE CONFORMING TO ASTM D2434 WITH THE MIXTURE COMPACTED TO 90-92% OF MAXIMUM DRY DENSITY BASED ON ASTM D698.

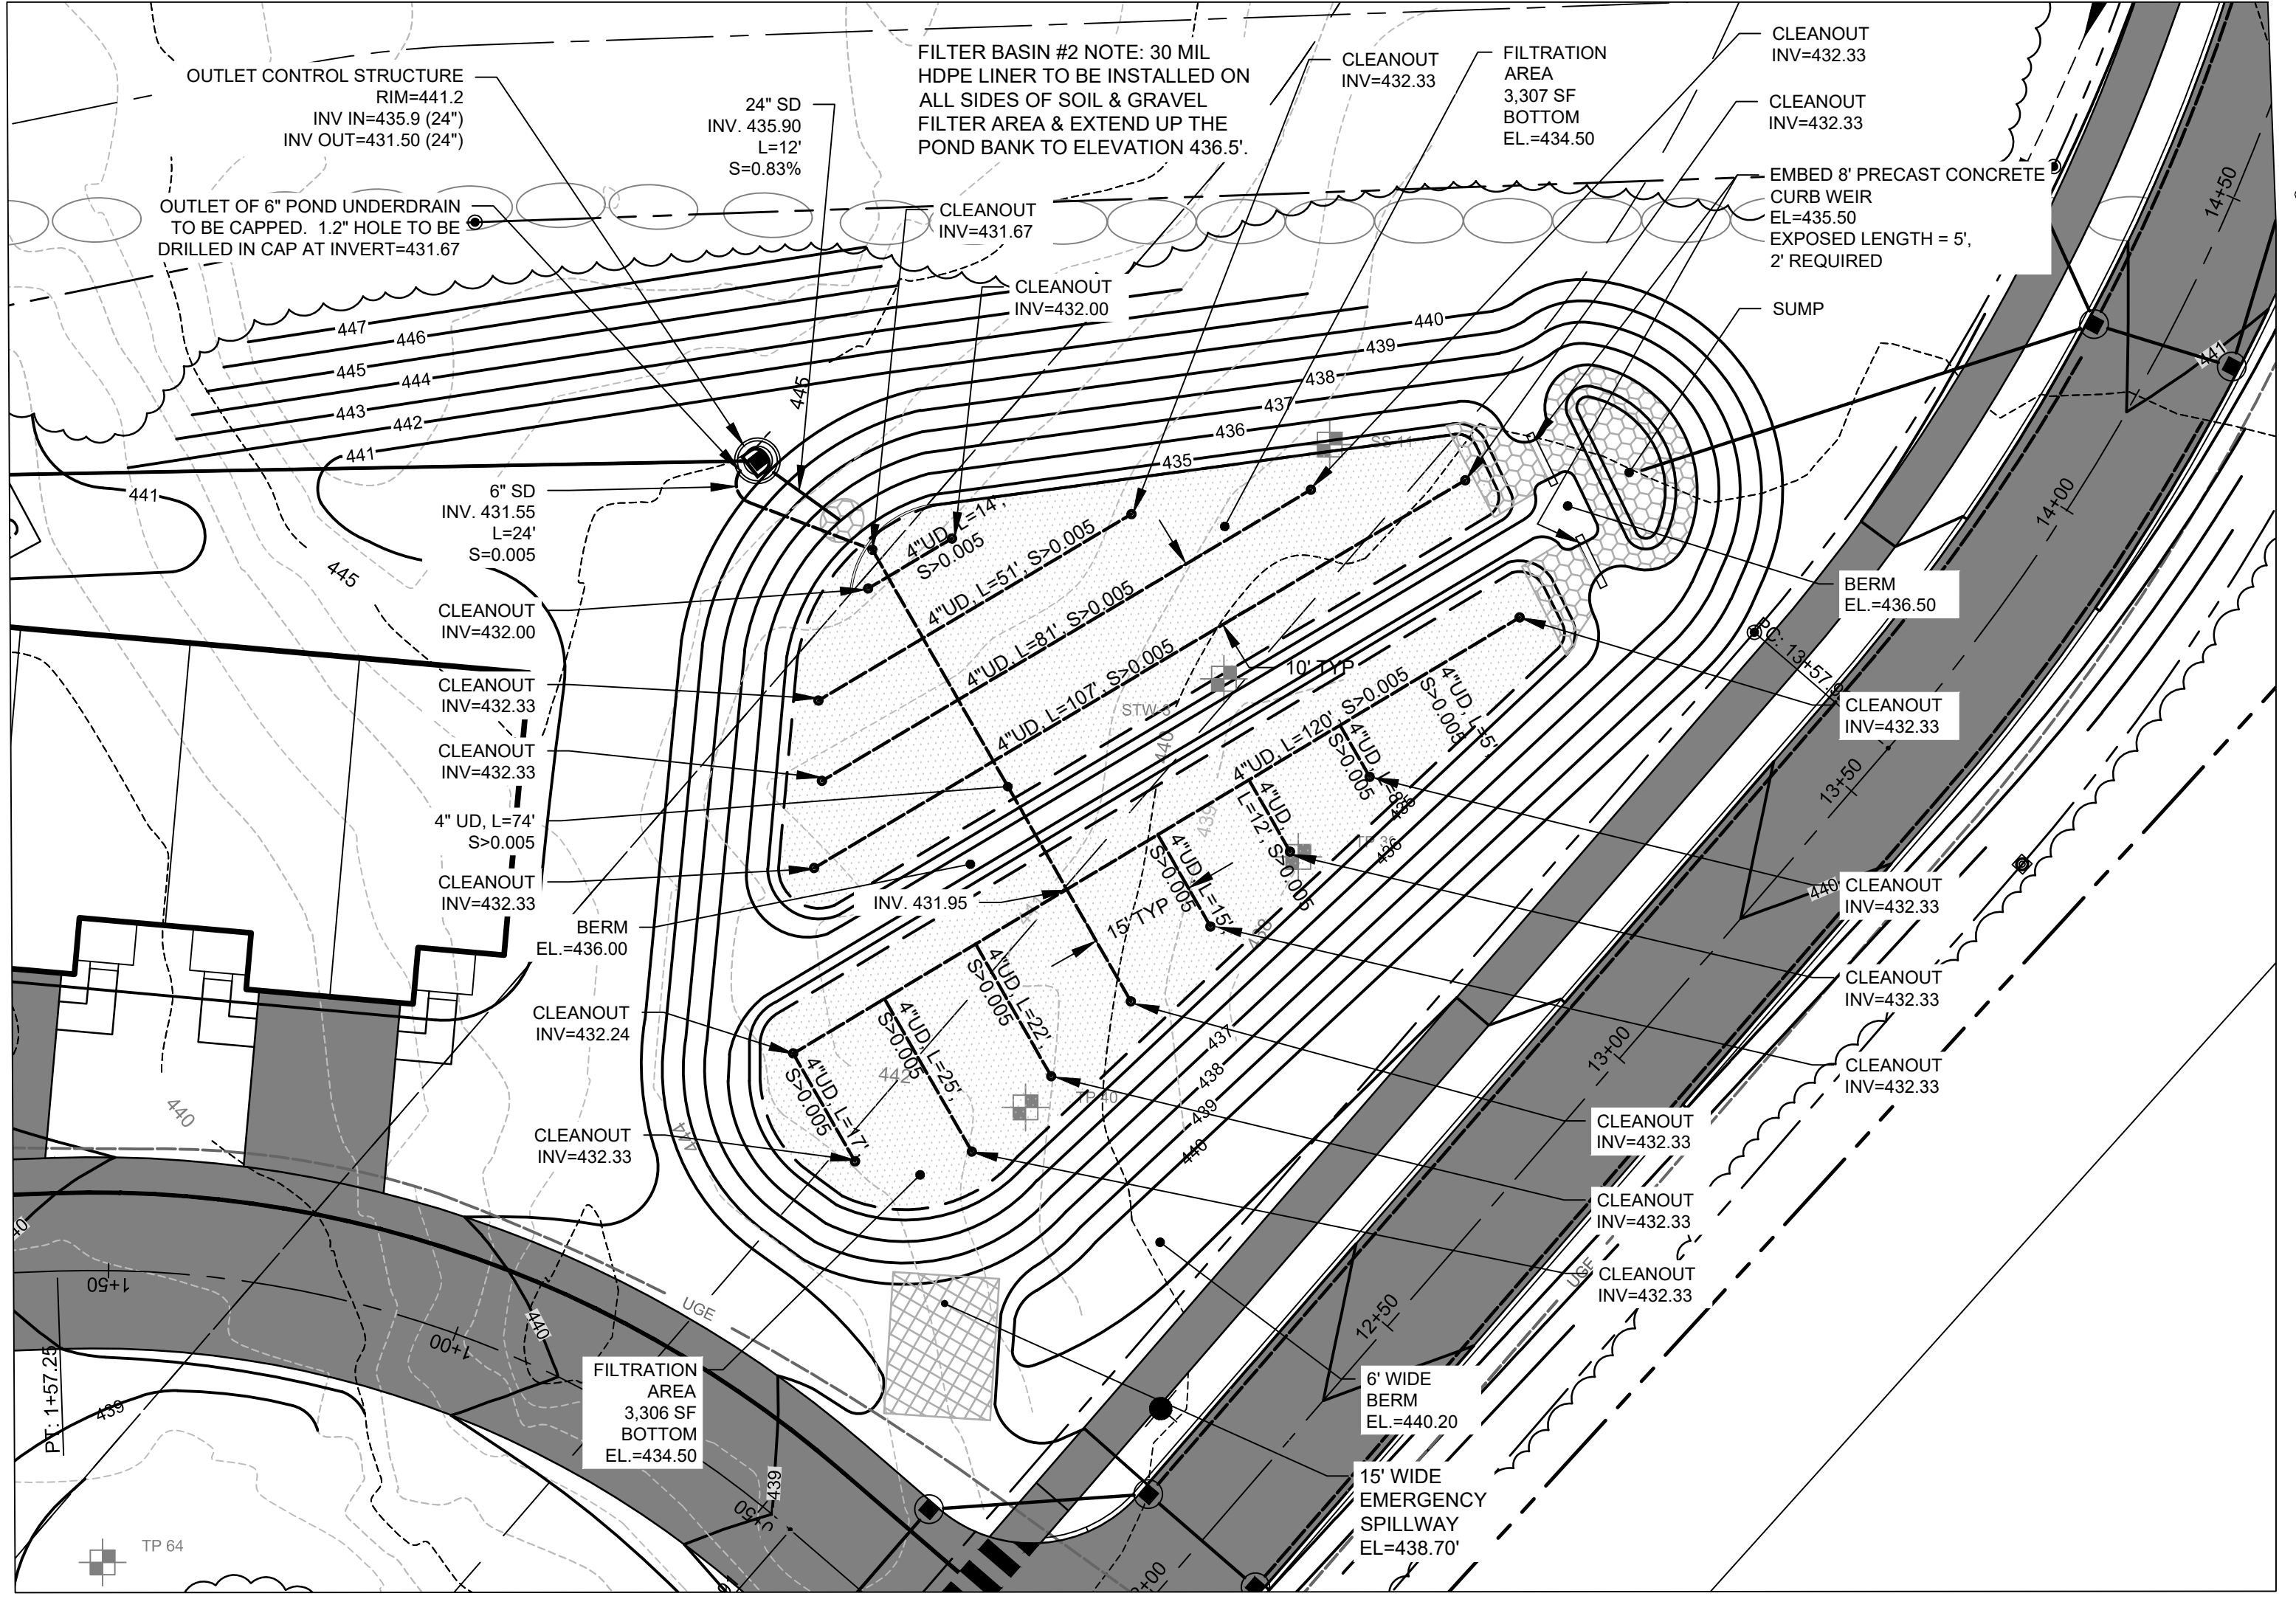



















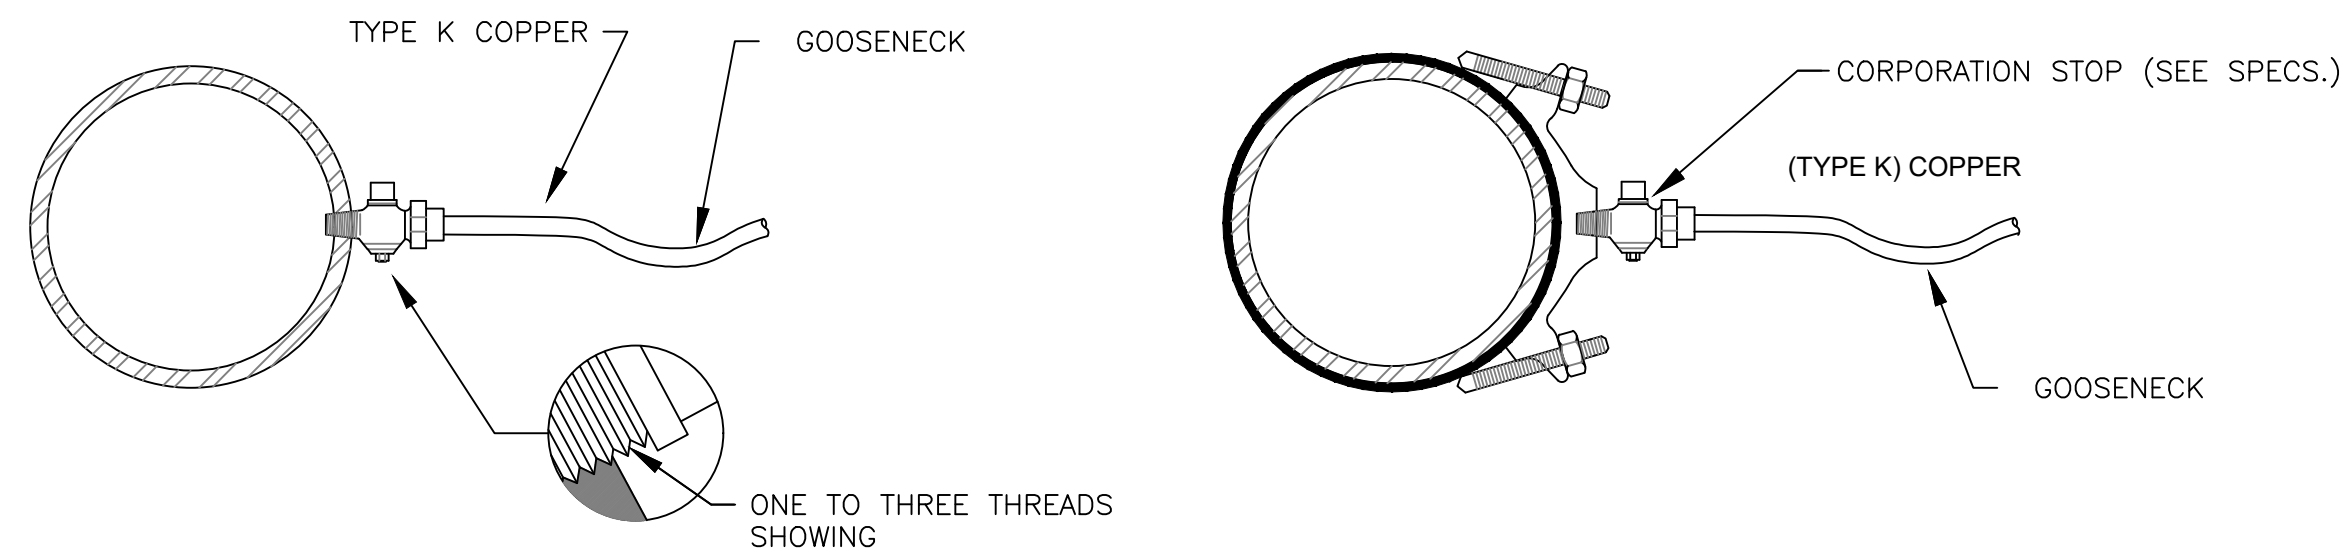


SERVICE TAP  
(3/4" AND 1" C.C. THREAD)

SERVICE SADDLE  
(1-1/2" AND 2" C.C. THREAD)

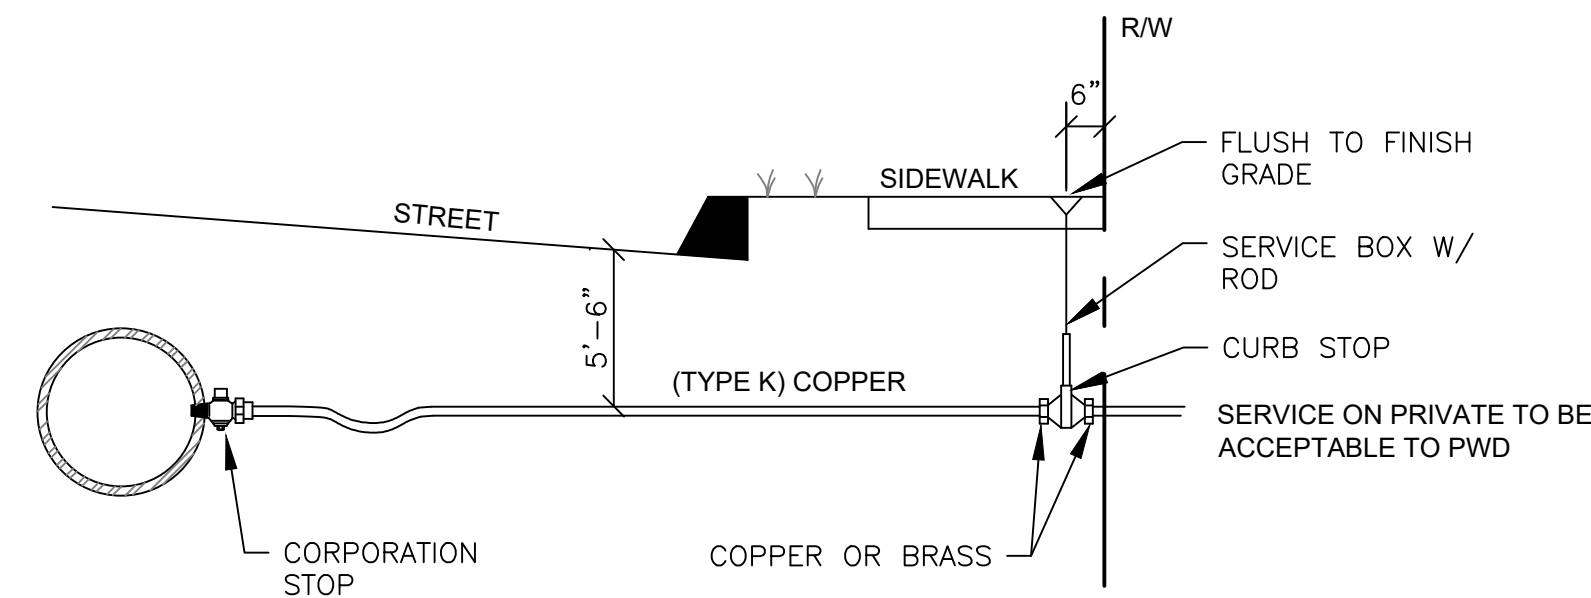


TYPICAL SERVICE CONNECTION

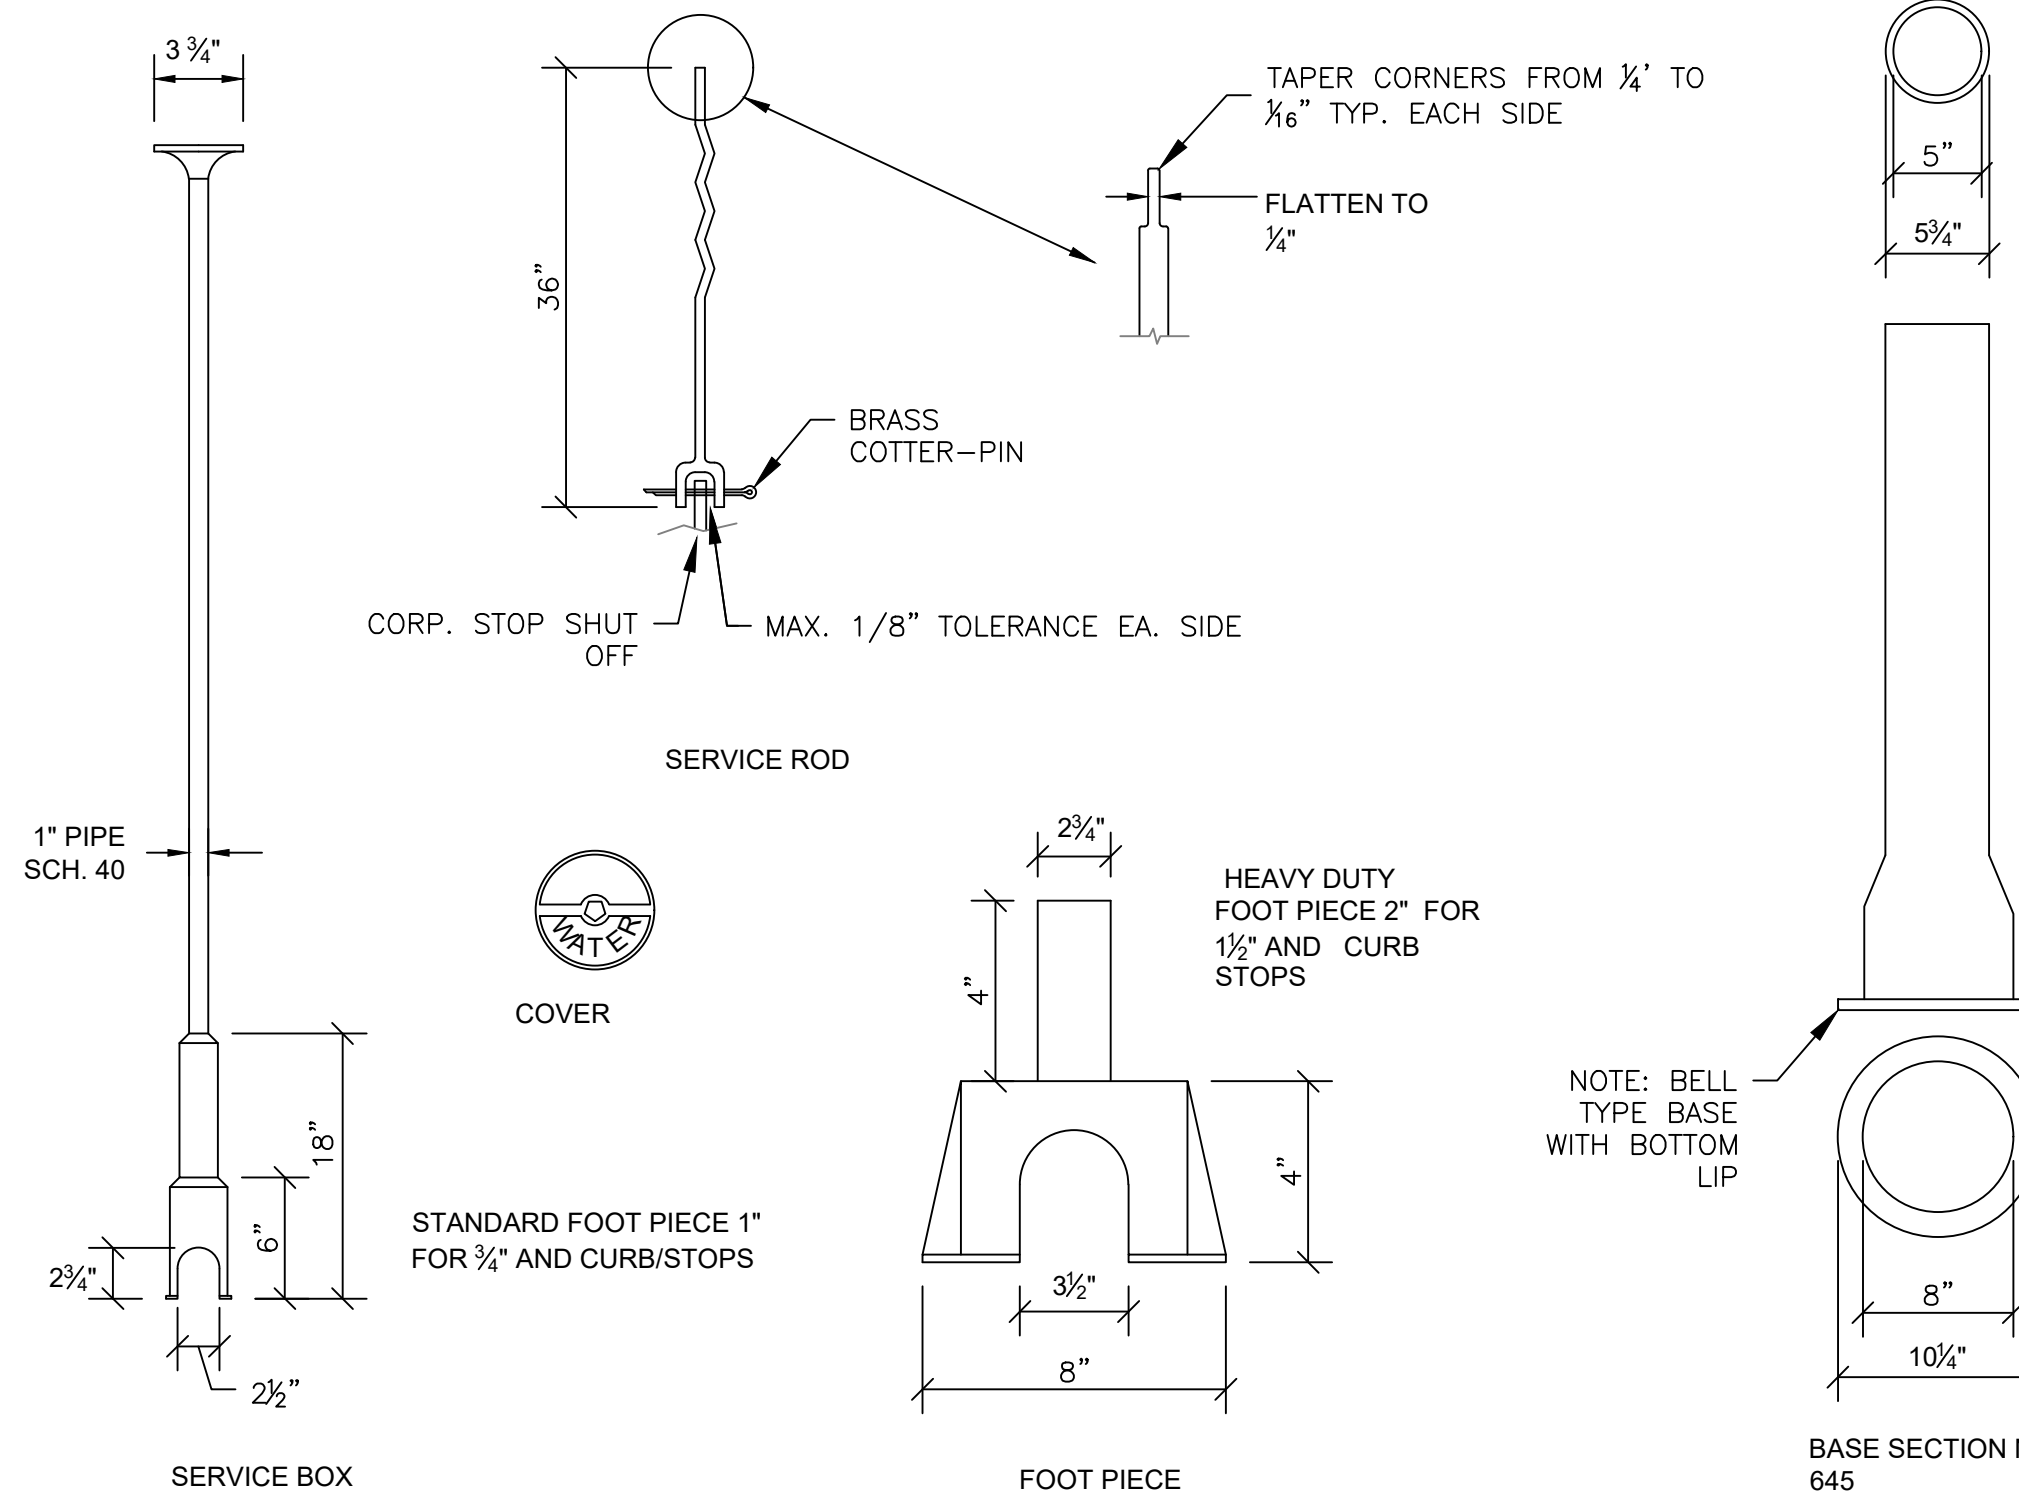

NOTE: ANY EXTENSION OF SERVICE BOX REQUIRES:  
 1. 1" FEMALE IRON PIPE COUPLING  
 2. 1" THREADED PIPE (THIS IS TO BE A NON-WELDED, TWO PIECE ARRANGEMENT. SLIP ON ADAPTERS ARE NOT PERMISSIBLE.)


VALVE BOX COVER

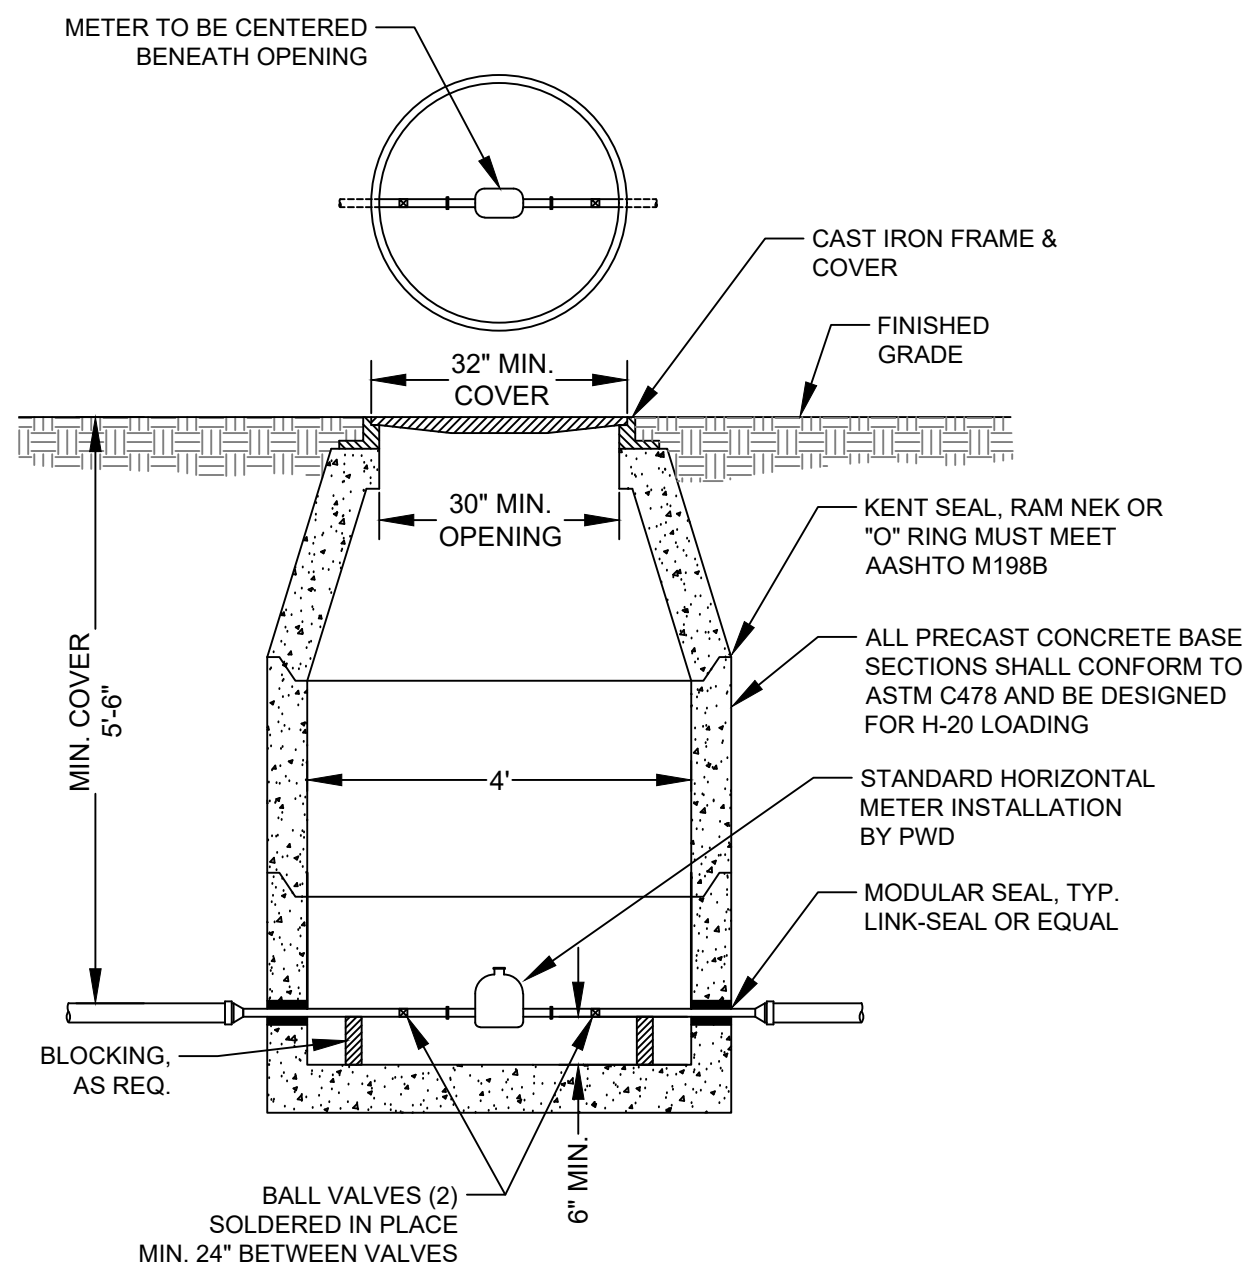

NOTES:

- THE METER PIT SHALL BE LOCATED ON PRIVATE PROPERTY BETWEEN 10' AND 20' FROM THE PROPERTY LINE.
- COVER SHALL HAVE "WATER" CAST IN.
- ALL PIPING INSIDE AND EXTENDING THROUGH THE METER PIT SHALL BE MADE OF COPPER, WITH A MINIMUM OF 6" CLEARANCE FROM THE METER PIT FLOOR. BLOCKING SHALL BE INSTALLED AS NECESSARY TO SUPPORT THE PIPE.
- WALL-MOUNTED LADDER RUNGS SHALL NOT BE INSTALLED.
- ONLY PWD PERSONNEL ARE AUTHORIZED TO INSTALL WATER METERS. PWD PERSONNEL AREA ADDITIONALLY AUTHORIZED TO OPERATE METER VALVES AS NEEDED FOR INSTALLATION AND MAINTENANCE.
- PWD WILL SUPPLY THE WATER METER. ALL OTHER FITTINGS, INCLUDING A METER RESETTER FOR 1" OR SMALLER METERS, SHALL BE SUPPLIED AND INSTALLED BY THE CONTRACTOR.
- FOR 1.5" AND 2" METERS, CONTRACTOR SHALL INSTALL A FLANGED METER SPOOL PIECE, SUPPLIED BY PWD AT NO ADDITIONAL CHARGE. PRIOR TO METER BEING SET, THE METER SPOOL WILL BE MADE AVAILABLE FOR CUSTOMER PICKUP AT PWD CUSTOMER SERVICE, 225 DOUGLASS STREET, PORTLAND, MAINE DURING NORMAL BUSINESS HOURS.
- CONTRACTOR TO INSTALL TWO BALL VALVES AT LEAST 24" APART FOR METER INSTALLATION, ALLOWING FOR THE WATER METER TO BE CENTERED UNDER THE METER PIT OPENING. THE BALL VALVES SHALL BE SOLDERED IN PLACE.
- THE METER PIT MAY HOUSE UP TO TWO 3/4", 1/2", OR 1" METERS WITH PRIOR APPROVAL FROM PWD.

TYPICAL WATER METER PIT (5/8" TO 2" METER)  
NOT TO SCALE

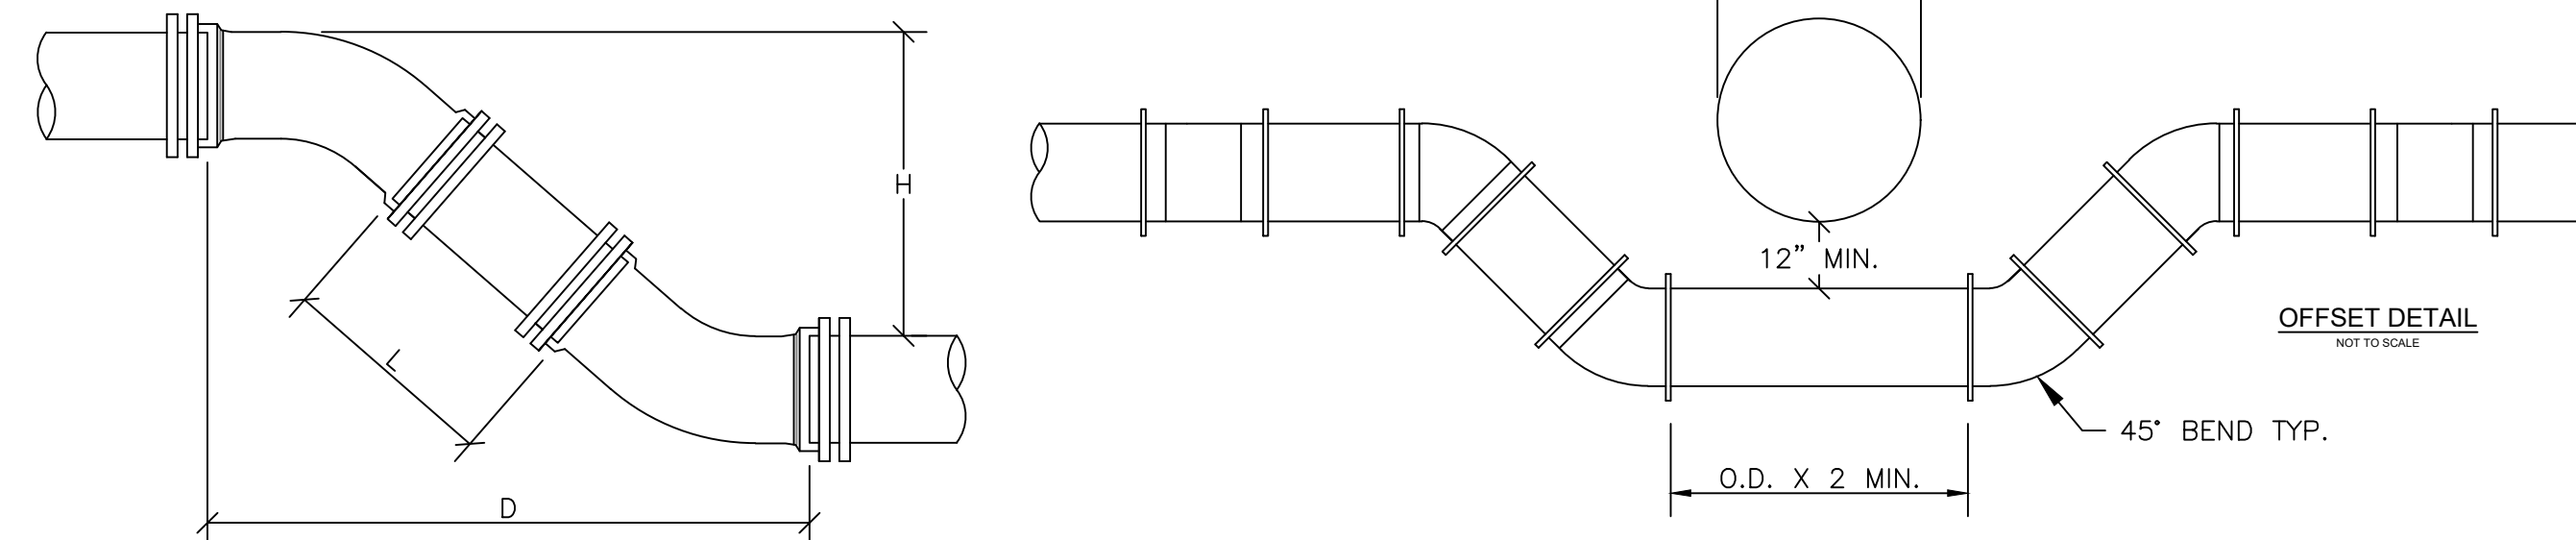


NOTE: DIMENSIONS APPLICABLE FOR SIGMA COMPACT BENDS. FOR TYLER COMPACT BENDS, ADD 1/2" TO "D" DIMENSION AND SUBTRACT 1/2" FROM "L" DIMENSION. FOR OTHER FITTINGS REFER TO MANUFACTURER'S RECOMMENDATIONS.

H	6" PIPE		8" PIPE		12" PIPE	
	D	L	D	L	D	L
12"	1'-6-1/2"	0'-10-1/2"	1'-7-1/2"	0'-9-1/2"	1'-11-1/2"	0'-5-1/2"
13"	1'-7-1/2"	0'-11-7/8"	1'-8-1/2"	0'-10-7/8"	2'-0-1/2"	0'-6-7/8"
14"	1'-8-1/2"	1'-1-5/16"	1'-9-1/2"	1'-0-5/16"	2'-1-1/2"	0'-8-5/16"
15"	1'-9-1/2"	1'-2-11/16"	1'-10-1/2"	1'-1-11/16"	2'-2-1/2"	0'-9-11/16"
16"	1'-10-1/2"	1'-4-1/8"	1'-11-1/2"	1'-3-1/8"	2'-3-1/2"	0'-11-1/8"
17"	1'-11-1/2"	1'-5-9/16"	2'-0-1/2"	1'-4-9/16"	2'-4-1/2"	1'-0-9/16"
18"	2'-0-1/2"	1'-6-15/16"	2'-1-1/2"	1'-5-15/16"	2'-5-1/2"	1'-1-15/16"
19"	2'-1-1/2"	1'-8-3/8"	2'-2-1/2"	1'-7-3/8"	2'-6-1/2"	1'-3-3/8"
20"	2'-2-1/2"	1'-9-13/16"	2'-3-1/2"	1'-8-13/16"	2'-7-1/2"	1'-4-13/16"
21"	2'-3-1/2"	1'-11-3/16"	2'-4-1/2"	1'-10-3/16"	2'-8-1/2"	1'-6-3/16"
22"	2'-4-1/2"	2'-0-3/8"	2'-5-1/2"	1'-11-3/8"	2'-9-1/2"	1'-7-5/8"
23"	2'-5-1/2"	2'-2"	2'-6-1/2"	2'-1"	2'-10-1/2"	1'-9"
24"	2'-6-1/2"	2'-3-7/16"	2'-7-1/2"	2'-2-7/16"	2'-11-1/2"	1'-10-7/16"
25"	2'-7-1/2"	2'-4-7/8"	2'-8-1/2"	2'-3-7/8"	3'-0-1/2"	1'-11-7/8"
26"	2'-8-1/2"	2'-6-1/4"	2'-9-1/2"	2'-5-1/4"	3'-1-1/2"	2'-1-1/4"
27"	2'-9-1/2"	2'-7-11/16"	2'-10-1/2"	2'-6-11/16"	3'-2-1/2"	2'-2-11/16"
28"	2'-10-1/2"	2'-9-1/8"	2'-11-1/2"	2'-8-1/8"	3'-3-1/2"	2'-4-1/8"
29"	2'-11-1/2"	2'-10-1/2"	3'-0-1/2"	2'-9-1/2"	3'-4-1/2"	2'-5-1/2"
30"	3'-0-1/2"	2'-11-15/16"	3'-1-1/2"	2'-10-15/16"	3'-5-1/2"	2'-6-15/16"
31"	3'-1-1/2"	3'-1-5/16"	3'-2-1/2"	3'-0-5/16"	3'-6-1/2"	2'-8-5/16"
32"	3'-2-1/2"	3'-2-3/4"	3'-3-1/2"	3'-1-3/4"	3'-7-1/2"	2'-9-3/4"
33"	3'-3-1/2"	3'-3-3/16"	3'-4-1/2"	3'-3-3/16"	3'-8-1/2"	2'-11-3/16"
34"	3'-4-1/2"	3'-5-9/16"	3'-5-1/2"	3'-4-9/16"	3'-9-1/2"	3'-0-9/16"
35"	3'-5-1/2"	3'-7"	3'-6-1/2"	3'-6"	3'-10-1/2"	3'-2"
36"	3'-6-1/2"	3'-8-7/16"	3'-7-1/2"	3'-7-7/16"	3'-11-1/2"	3'-3-7/16"
37"	3'-7-1/2"	3'-9-13/16"	3'-8-1/2"	3'-8-13/16"	4'-0-1/2"	3'-4-13/16"
38"	3'-8-1/2"	3'-11-1/4"	3'-9-1/2"	3'-9-1/4"	4'-1-1/2"	3'-5-1/4"
39"	3'-9-1/2"	4'-0-11/16"	3'-10-1/2"	3'-11-11/16"	4'-2-1/2"	3'-7-11/16"
40"	3'-10-1/2"	4'-2-1/16"	3'-11-1/2"	4'-1-1/16"	4'-3-1/2"	3'-9-1/16"
41"	3'-11-1/2"	4'-3-1/2"	4'-0-1/2"	4'-2-1/2"	4'-4-1/2"	3'-10-1/2"
42"	4'-0-1/2"	4'-4-7/8"	4'-1-1/2"	4'-3-7/8"	4'-5-1/2"	4'-1-7/8"
43"	4'-1-1/2"	4'-6-5/16"	4'-2-1/2"	4'-5-5/16"	4'-6-1/2"	4'-1-5/16"
44"	4'-2-1/2"	4'-7-3/4"	4'-3-1/2"	4'-6-3/4"	4'-7-1/2"	4'-2-3/4"
45"	4'-3-1/2"	4'-9-1/8"	4'-4-1/2"	4'-8-1/8"	4'-8-1/2"	4'-4-1/8"
46"	4'-4-1/2"	4'-10-9/16"	4'-5-1/2"	4'-9-9/16"	4'-9-1/2"	4'-5-9/16"
47"	4'-5-1/2"	4'-11-15/16"	4'-6-1/2"	4'-10-15/16"	4'-10-1/2"	4'-6-15/16"
48"	4'-6-1/2"	5'-1-3/8"	4'-7-1/2"	5'-0-3/8"	4'-11-1/2"	4'-8-3/8"
49"	4'-7-1/2"	5'-2-13/16"	4'-8-1/2"	5'-1-13/16"	5'-0-1/2"	4'-9-13/16"
50"	4'-8-1/2"	5'-4-3/16"	4'-9-1/2"	5'-3-3/16"	5'-1-1/2"	4'-11-3/16"
51"	4'-9-1/2"	5'-5-5/8"	4'-10-1/2"	5'-4-5/8"	5'-2-1/2"	5'-0-5/8"
52"	4'-10-1/2"	5'-7-1/16"	4'-11-1/2"	5'-6-1/16"	5'-3-1/2"	5'-2-1/16"
53"	4'-11-1/2"	5'-8-7/16"	5'-0-1/2"	5'-7-7/16"	5'-4-1/2"	5'-3-7/16"
54"	5'-0-1/2"	5'-9-7/8"	5'-1-1/2"	5'-8-7/8"	5'-5-1/2"	5'-4-7/8"
55"	5'-1-1/2"	5'-11-5/16"	5'-2-1/2"	5'-10-5/16"	5'-6-1/2"	5'-6-5/16"

TYPICAL MAIN OFFSET

STANDARD WATER DETAILS PROVIDED BY THE PORTLAND WATER DISTRICT

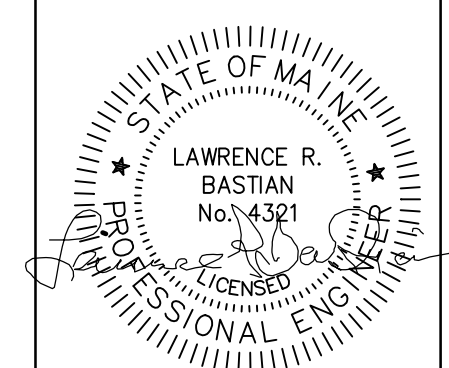

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS	BY
8	4/15/2020	FINAL REVIEW	LRB
7	3/25/2020	REVISED PER TOWN COMMENTS	LRB
6	2/19/2020	PEER REVIEW COMMENT RESPONSE	LRB
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW	LRB
4	1/15/2020	REVISED PER MDEP REVIEW COMMENTS	LRB
3	3/29/2019	MDEP SITE LOCATION APPLICATION	LRB
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN	LRB
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN	LRB
		REVISIONS	APPD
			BY

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04280

OFFICE: (207) 926-5111  
www.terradynconsultants.com

**TERRADYN CONSULTANTS, LLC**



CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
**HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
STANDARD WATER DETAILS**

PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE: 3/15/2019  
SCALE:  
DESIGNED: JDA  
JOB NO.: 1804  
FILE:  
SHEET **C-6.9**

ID	COMMON NAME	LATIN NAME	QUANTITY	SCHEDULED SIZE
AAB	SIENNA GLEN MAPLE	ACER X FREEMANII	19	2 1/2" - 3" CALIPER
TA	LEGEND AMERICAN LINDEN	TILIA AMERICANA LEGEND	32	2 1/2" - 3" CALIPER

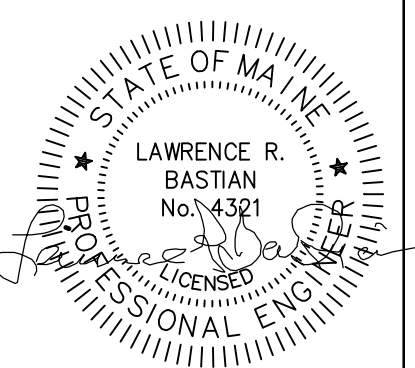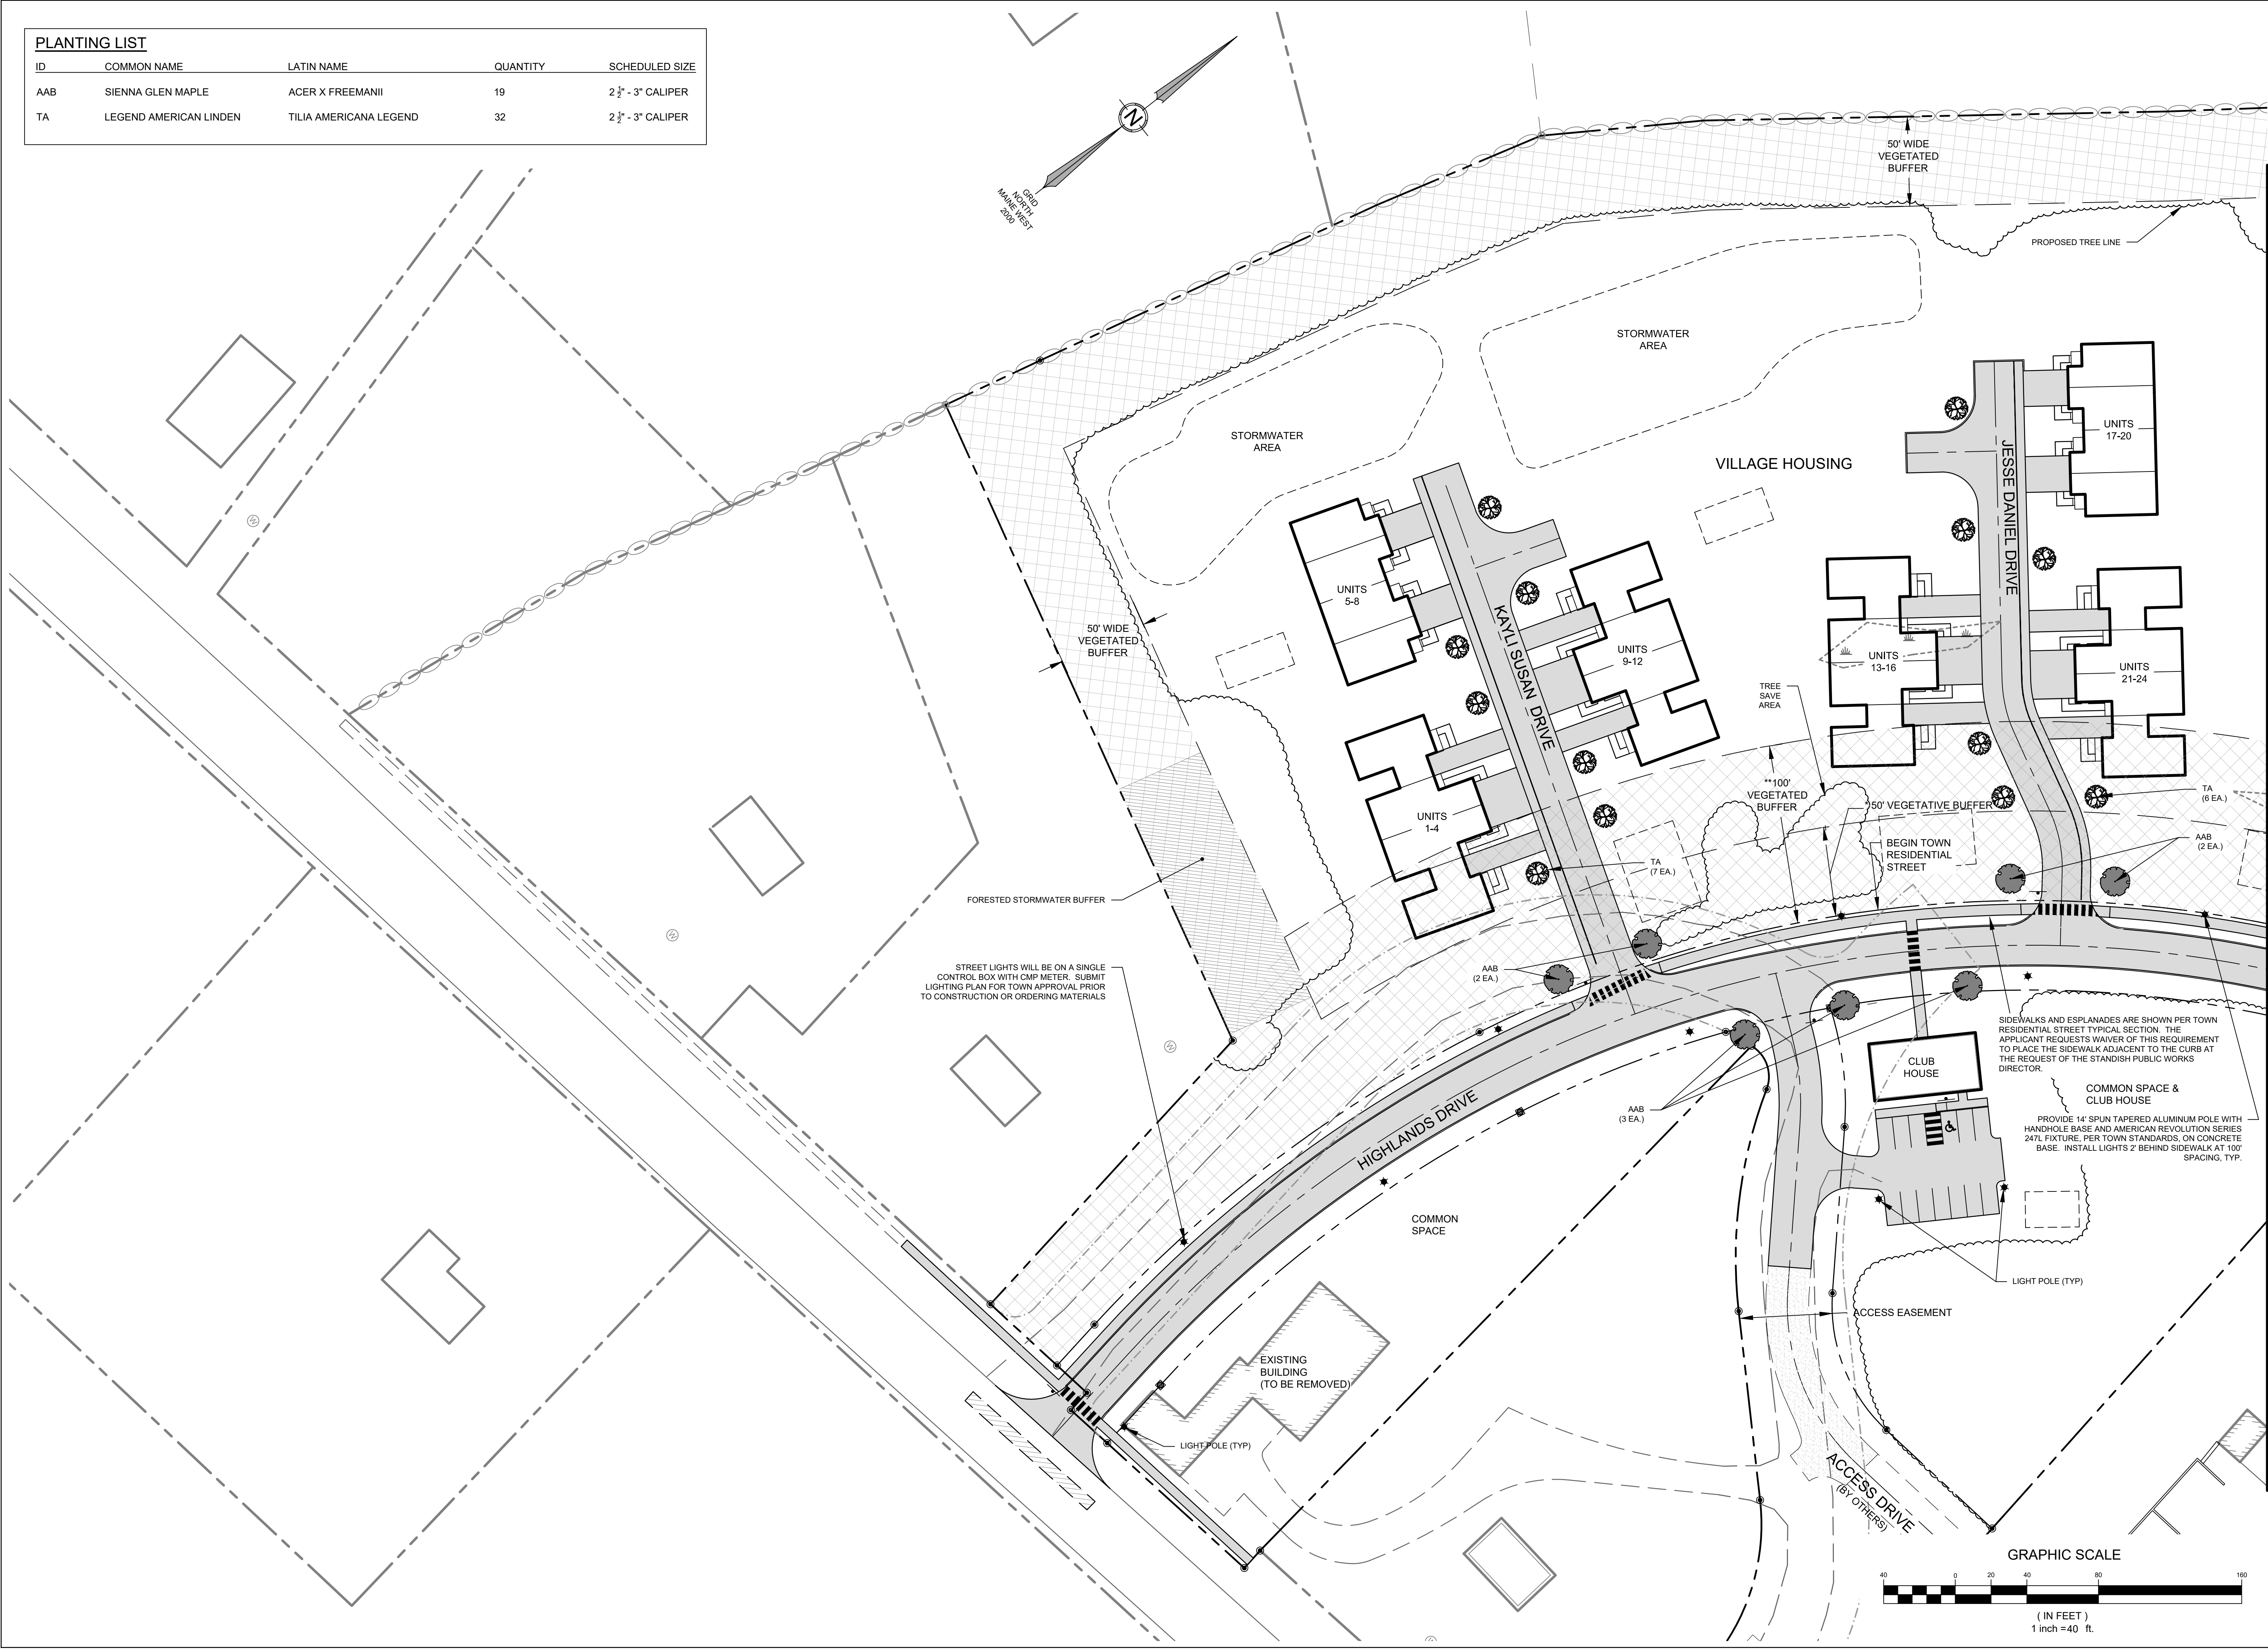

SIGNATURE DATE: 1/15/2020

LRB	DATE	BY	REVISIONS
LRB	4/15/2020	LRB	FINAL REVIEW
LRB	3/25/2020	LRB	REVISED PER TOWN COMMENTS
LRB	2/13/2020	LRB	PEER REVIEW COMMENT RESPONSE
LRB	1/15/2020	LRB	FINAL SUBDIVISION & SITE PLAN REVIEW
LRB	11/26/2019	LRB	REVISED PER MDEP REVIEW COMMENTS
LRB	3/29/2019	LRB	MDEP SITE LOCATION APPLICATION
LRB	1/21/2019	LRB	PRELIMINARY SUBDIVISION & SITE PLAN
LRB	11/13/2018	LRB	PRELIMINARY SUBDIVISION & SITE PLAN
LRB		LRB	APP'D
LRB		LRB	BY

MATCH LINE - SEE SHEET L-1.1

MATCH LINE - SEE SHEET L-1.1

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260


OFFICE: (207) 926-5111  
www.terradynconsultants.com



SHEET DESCRIPTION  
HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
HIGHLANDS DRIVE LANDSCAPING PLAN

PREPARED FOR  
LEAVITT-TOMPSON, LLC  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE:	3/15/2019
SCALE:	1"=40'
DESIGNED:	JDA
JOB NO:	1804
FILE:	1804 S.DWG
SHEET	L-1.0

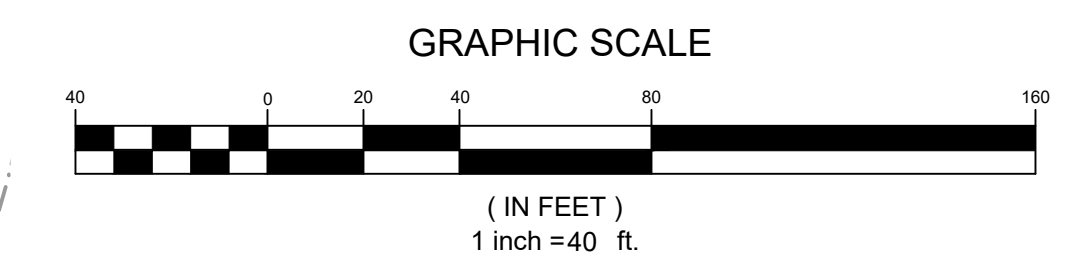

STREET LIGHTS WILL BE ON A SINGLE CONTROL BOX WITH CMP METER. SUBMIT LIGHTING PLAN FOR TOWN APPROVAL PRIOR TO CONSTRUCTION OR ORDERING MATERIALS

SIDEWALKS AND ESPLANADES ARE SHOWN PER TOWN RESIDENTIAL STREET TYPICAL SECTION. THE APPLICANT REQUESTS WAIVER OF THIS REQUIREMENT TO PLACE THE SIDEWALK ADJACENT TO THE CURB AT THE REQUEST OF THE STANDISH PUBLIC WORKS DIRECTOR.




COMMON SPACE & CLUB HOUSE

PROVIDE 14' SPIN TAPERED ALUMINUM POLE WITH HANDHOLE BASE AND AMERICAN REVOLUTION SERIES 247L FIXTURE, PER TOWN STANDARDS, ON CONCRETE BASE. INSTALL LIGHTS 2' BEHIND SIDEWALK AT 100' SPACING, TYP.




MATCH LINE - SEE SHEET L-1.0

MATCH LINE - SEE SHEET L-1.0

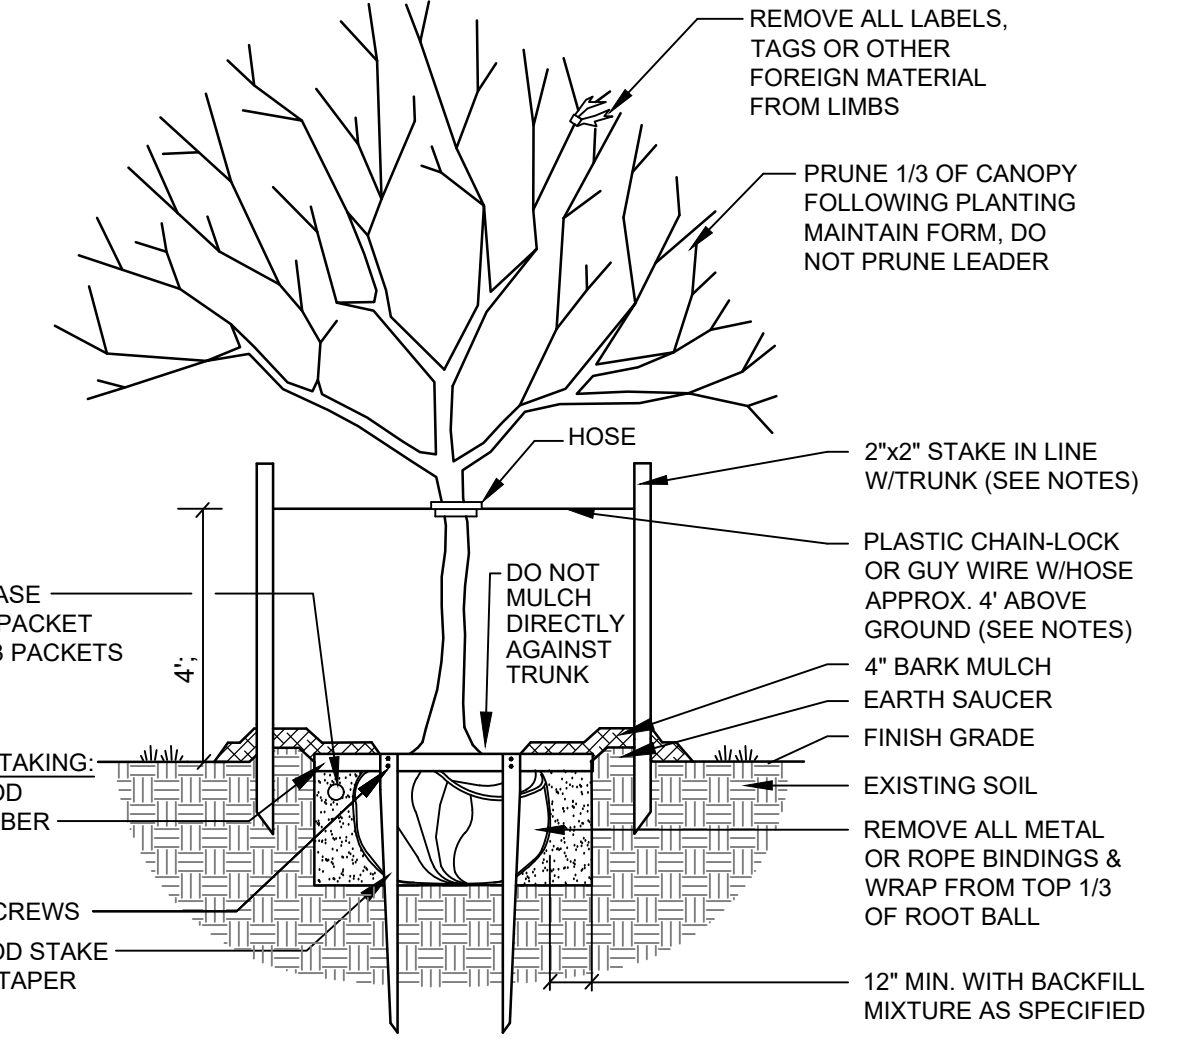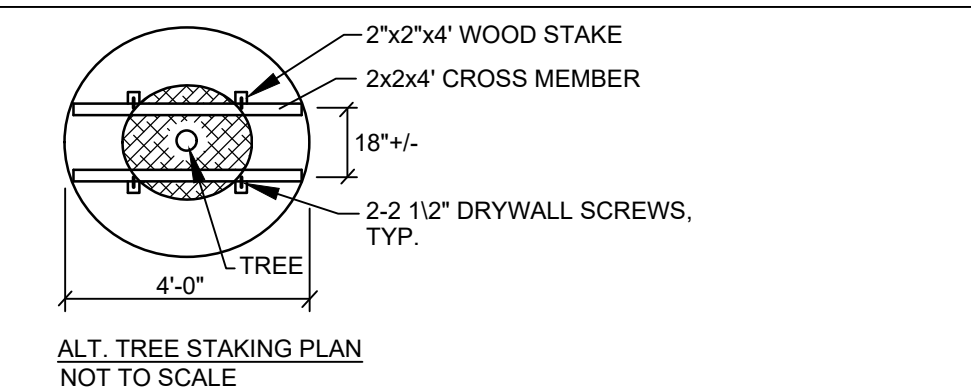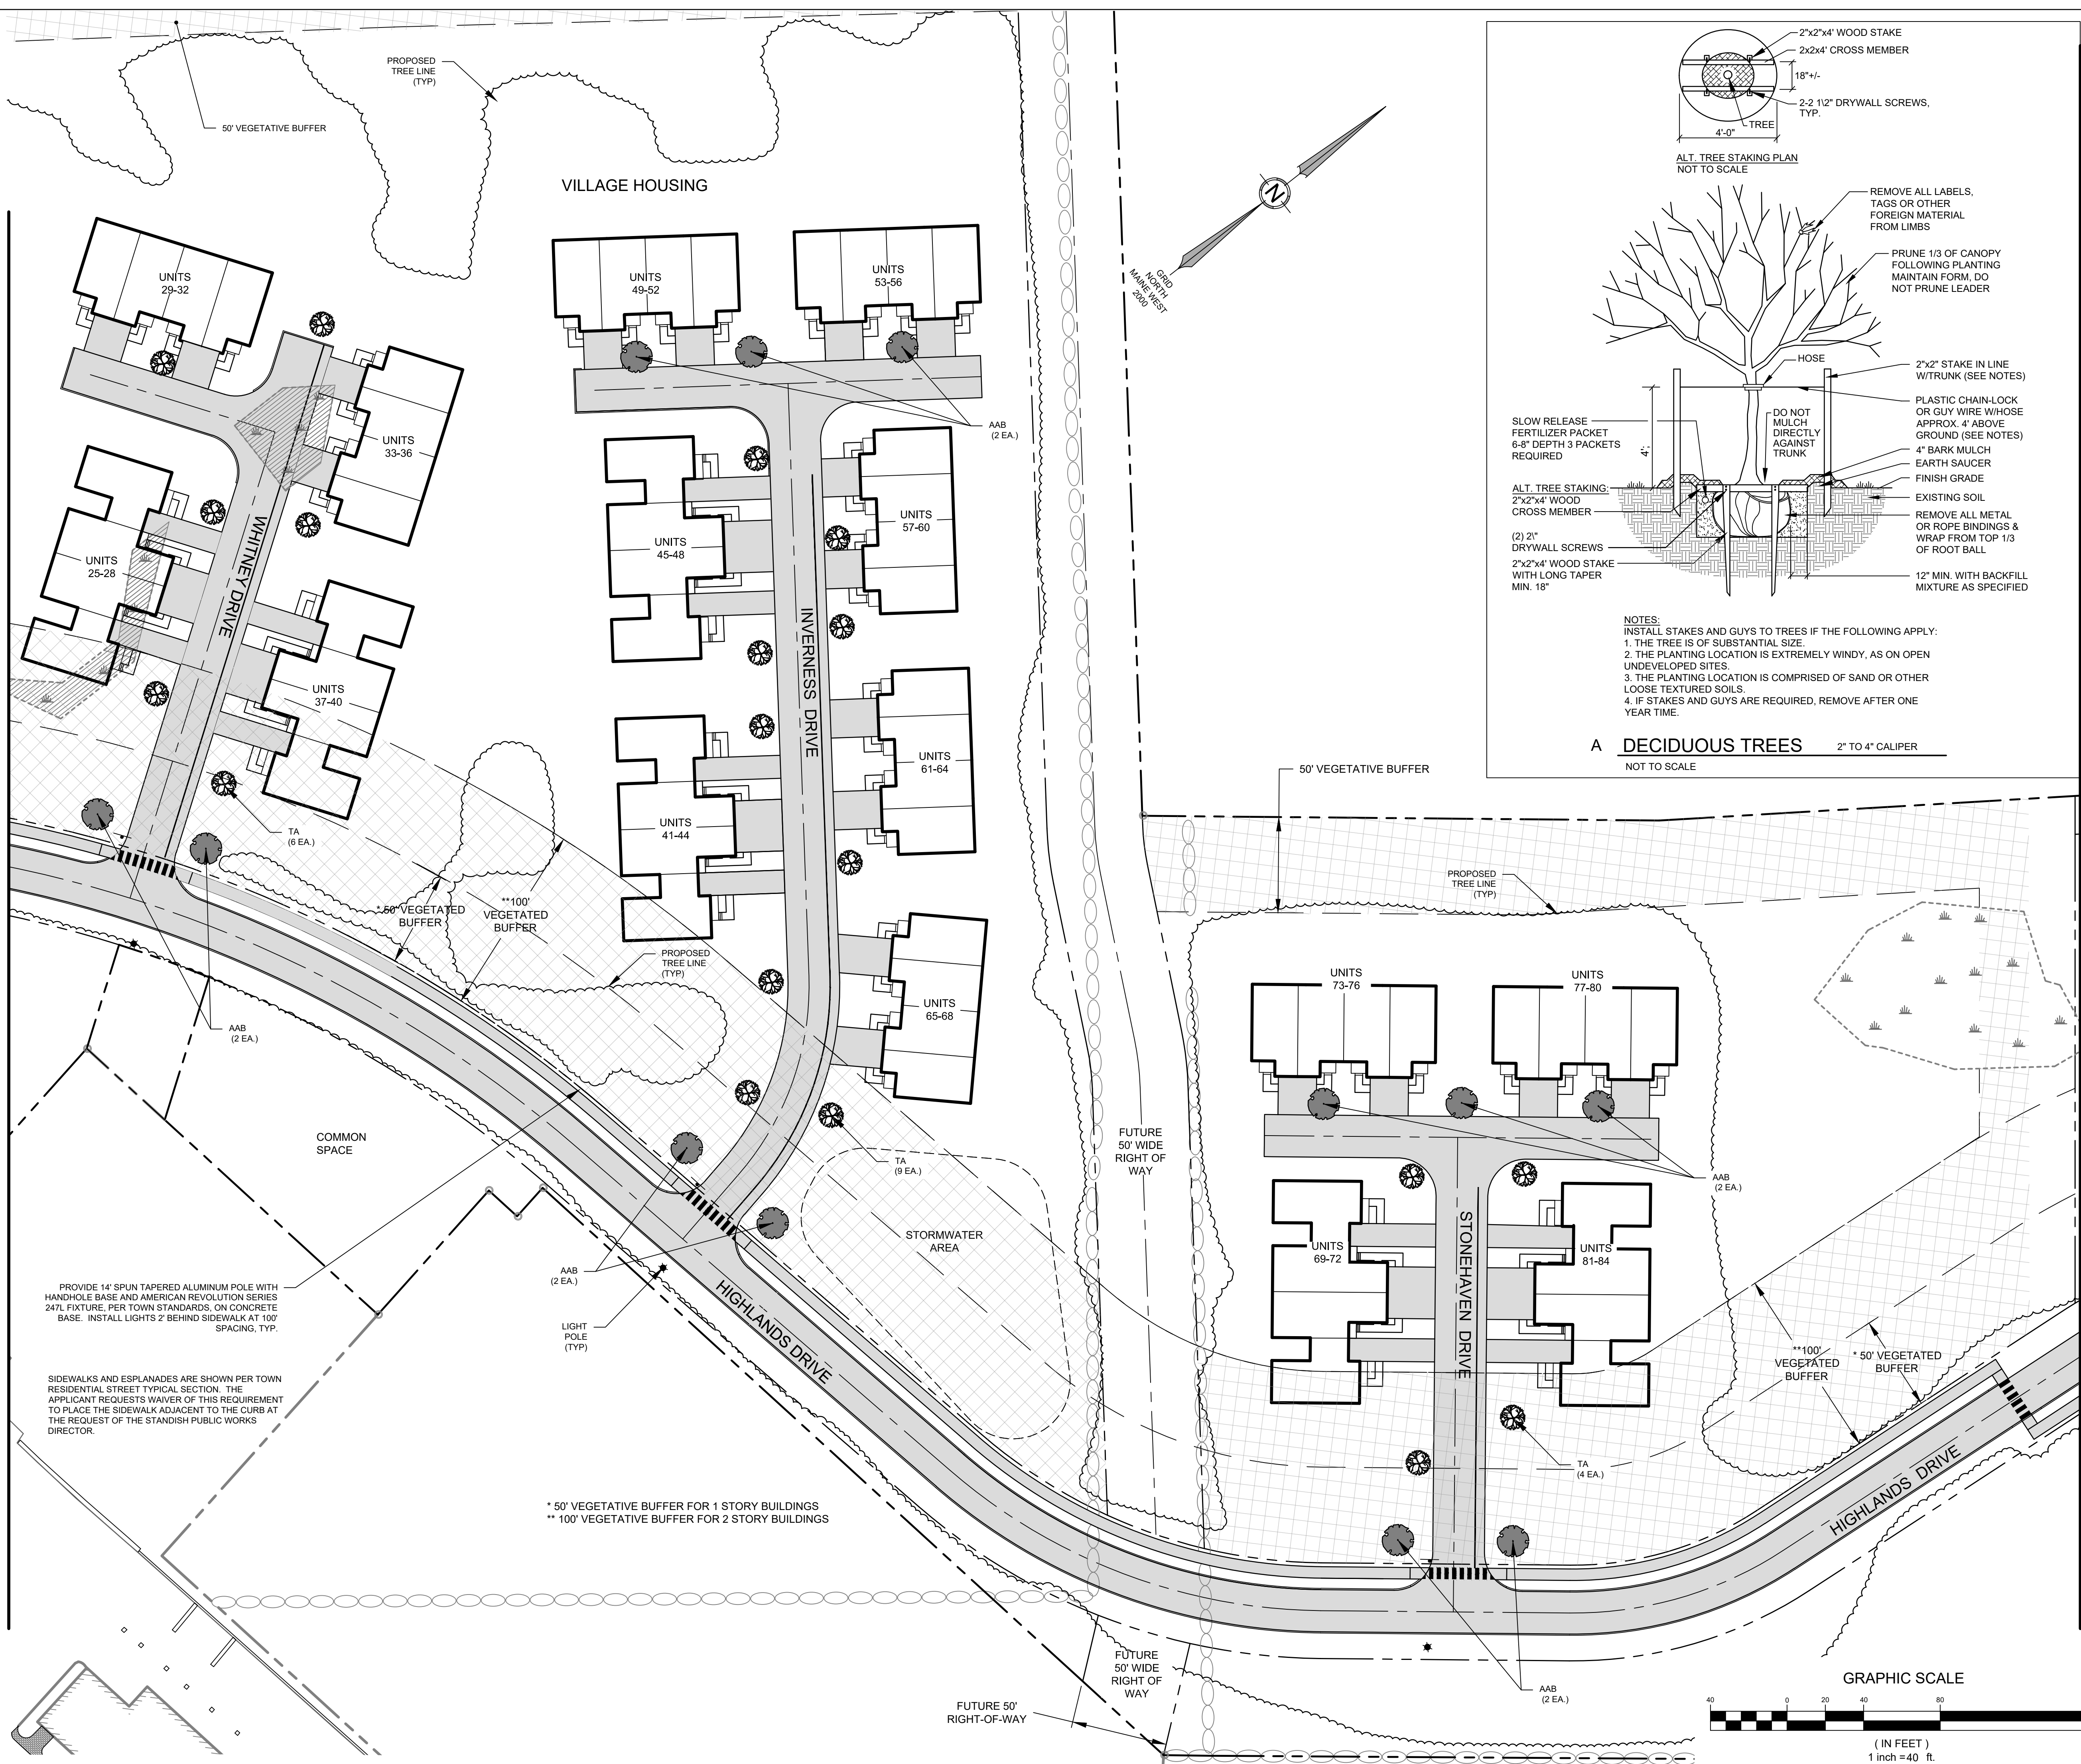

- NOTES:**  
INSTALL STAKES AND GUYS TO TREES IF THE FOLLOWING APPLY:  
1. THE TREE IS OF SUBSTANTIAL SIZE.  
2. THE PLANTING LOCATION IS EXTREMELY WINDY, AS ON OPEN UNDEVELOPED SITES.  
3. THE PLANTING LOCATION IS COMPRISED OF SAND OR OTHER LOOSE TEXTURED SOILS.  
4. IF STAKES AND GUYS ARE REQUIRED, REMOVE AFTER ONE YEAR TIME.

**A DECIDUOUS TREES** 2" TO 4" CALIPER  
NOT TO SCALE

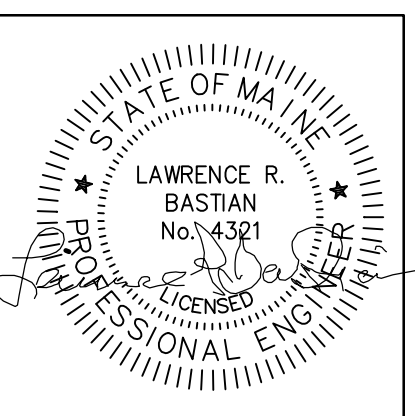

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS	BY
8	4/15/2020	FINAL REVIEW	LRB
7	3/25/2020	REVISED PER TOWN COMMENTS	LRB
6	2/13/2020	PEER REVIEW COMMENT RESPONSE	LRB
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW	LRB
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS	LRB
3	3/29/2019	MDEP SITE LOCATION APPLICATION	LRB
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN	LRB
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN	LRB

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260



**HIGHLANDS SUBDIVISION**  
STANDISH, MAINE  
HIGHLANDS DRIVE LANDSCAPING PLAN

PREPARED FOR:  
**LEAVITT-TOMPSON, LLC**  
P.O. BOX 703  
STANDISH, MAINE 04084



DATE:	3/15/2019
SCALE:	1"=40'
DESIGNED:	JDA
JOB NO.:	1804
FILE:	1804 S.DWG
SHEET:	<b>L-1.1</b>

MATCH LINE - SEE SHEET L-1.2

MATCH LINE - SEE SHEET L-1.2

MATCH LINE - SEE SHEET L-1.1

MATCH LINE - SEE SHEET L-1.1

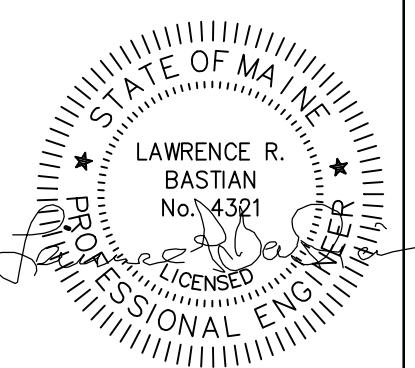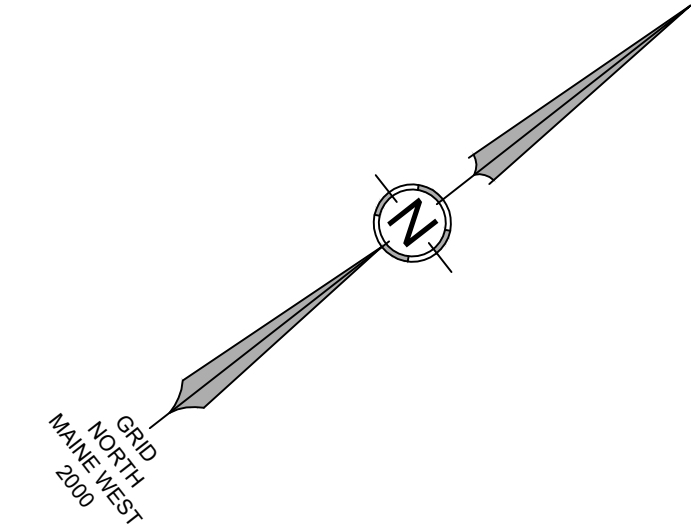

SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260



**TERRADYN**  
CONSULTANTS, LLC

OFFICE: (207) 926-5111  
www.terradynconsultants.com

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
HIGHLANDS DRIVE LANDSCAPING PLAN  
PREPARED FOR  
**LEAVITT-TOMPSON, LLC**  
P.O. BOX 703  
STANDISH, MAINE 04084

SHEET L-1.2

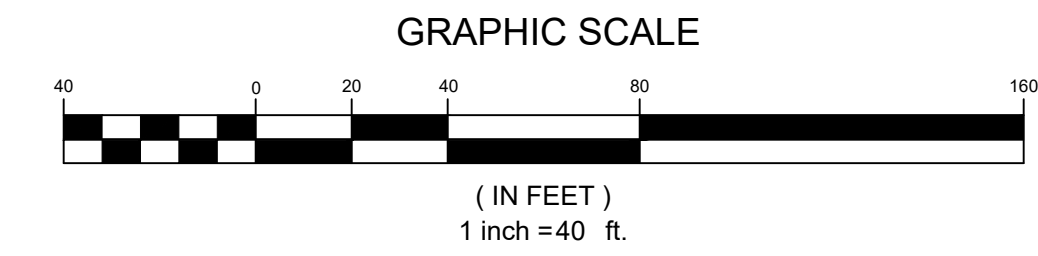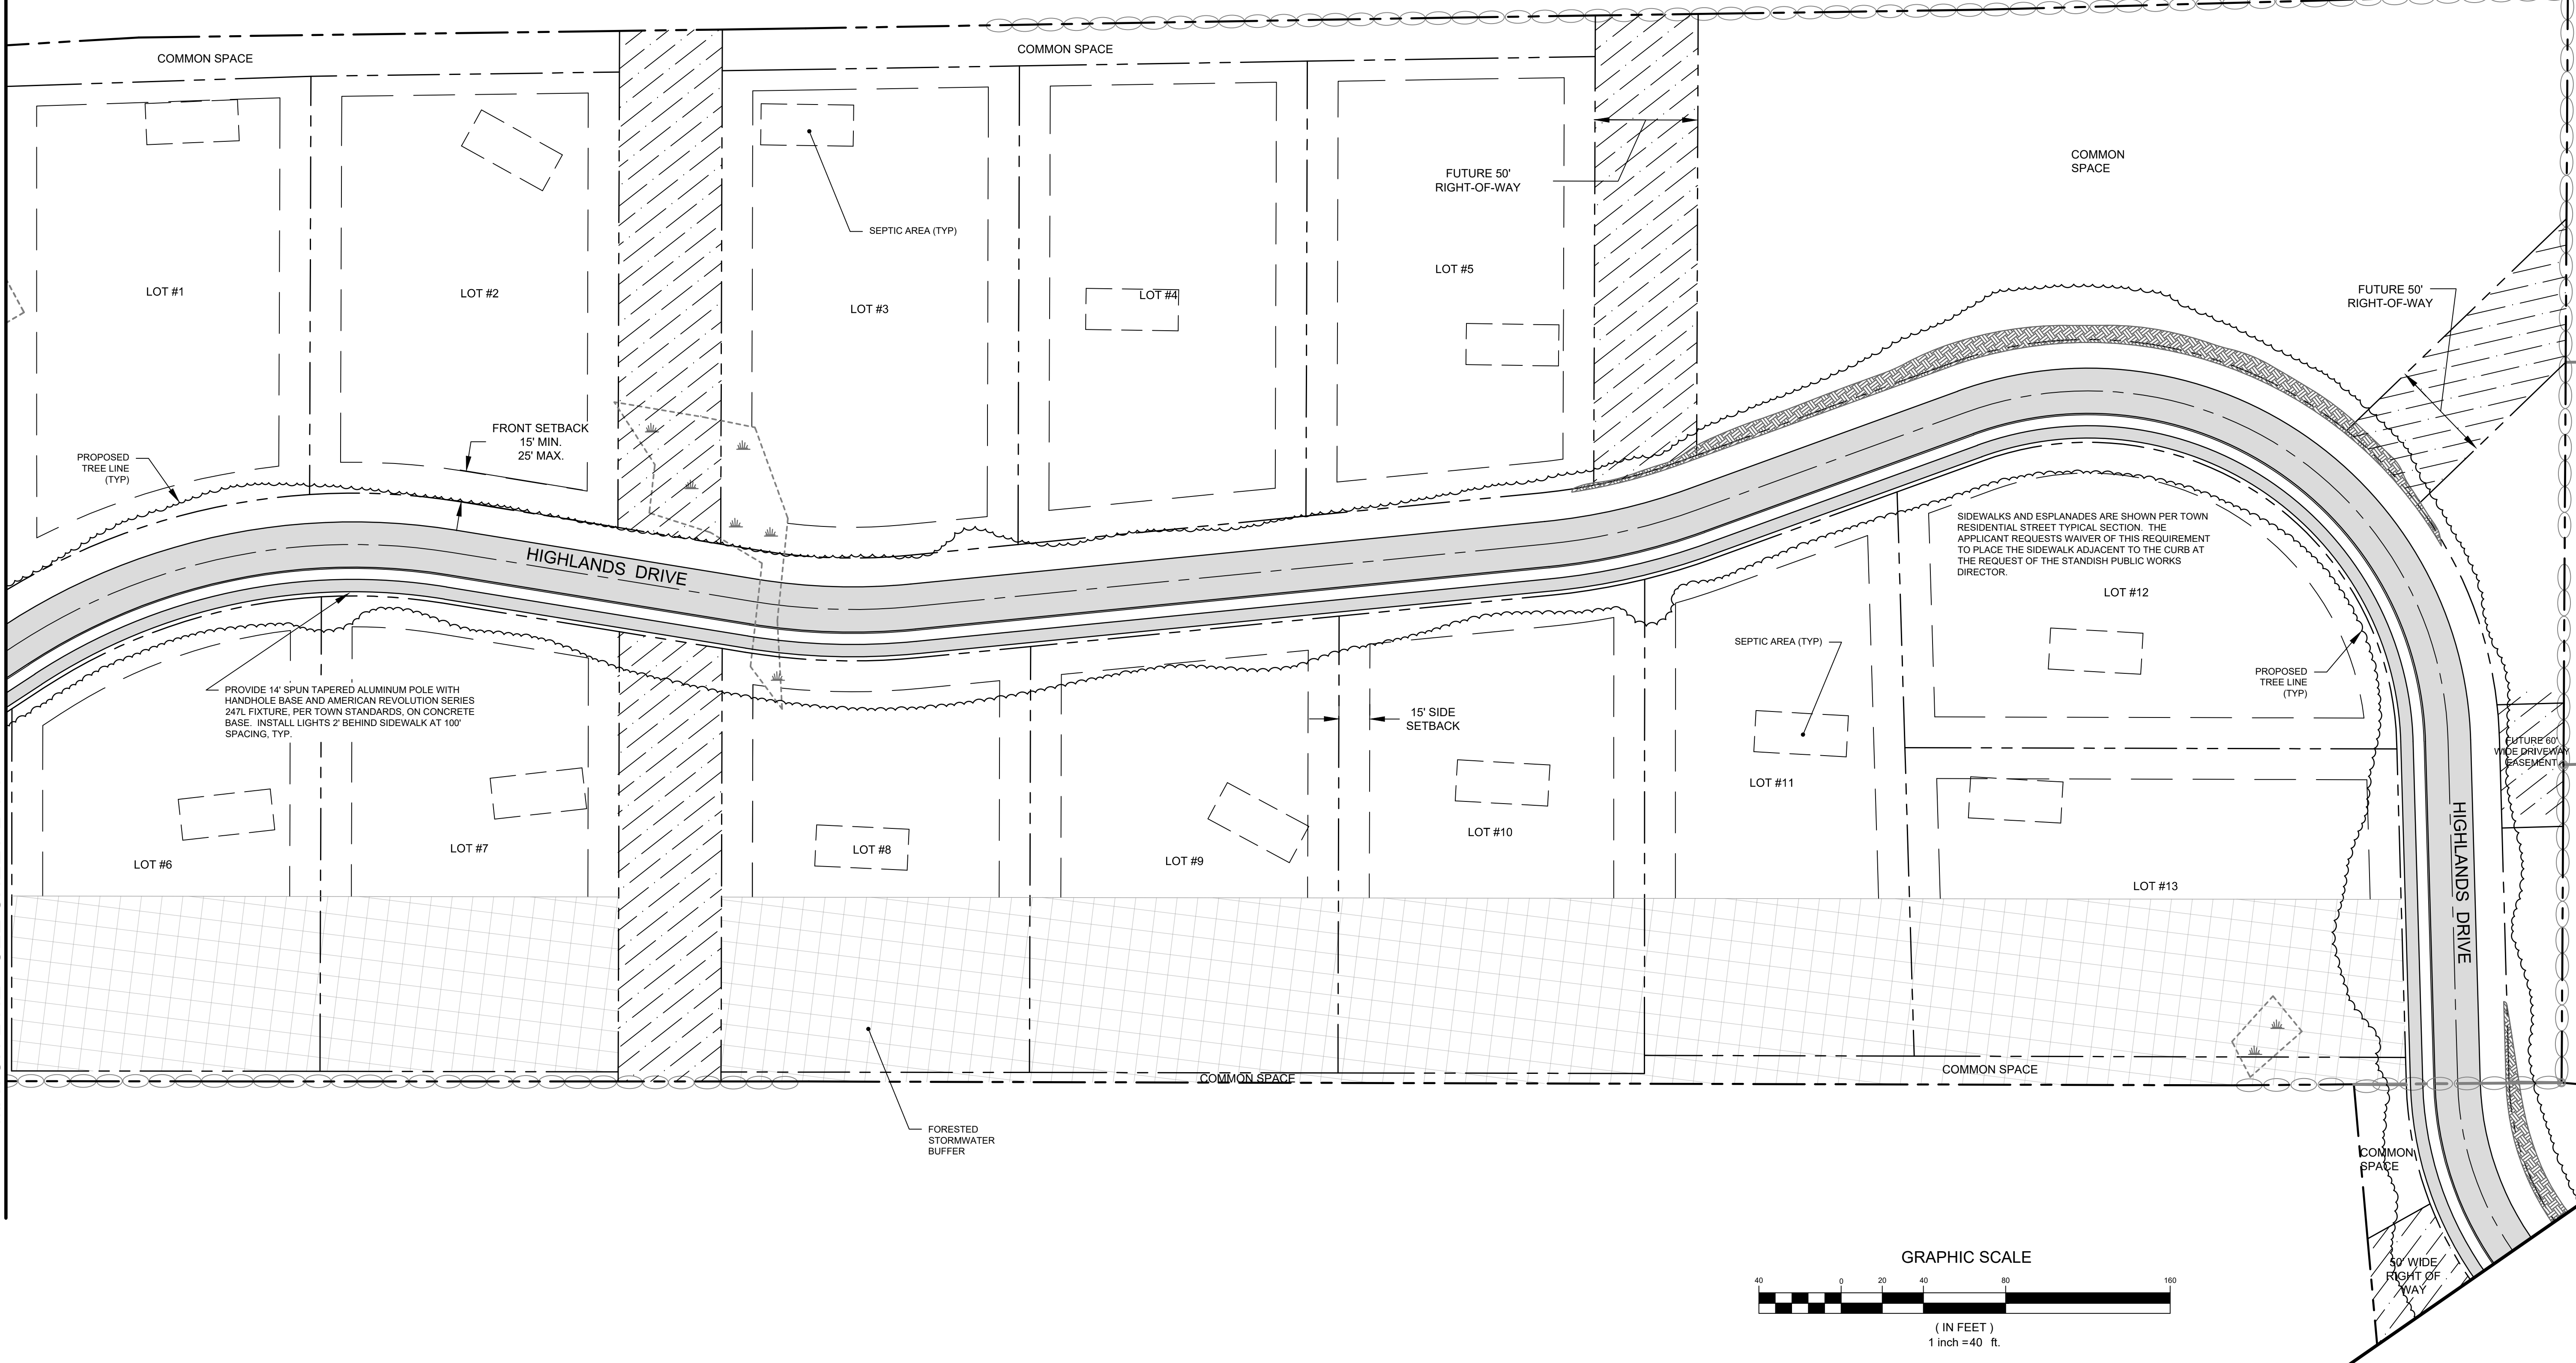



MATCH LINE - SEE SHEET L-1.3

MATCH LINE - SEE SHEET L-1.3



MATCH LINE - SEE SHEET L-1.2

MATCH LINE - SEE SHEET L-1.2

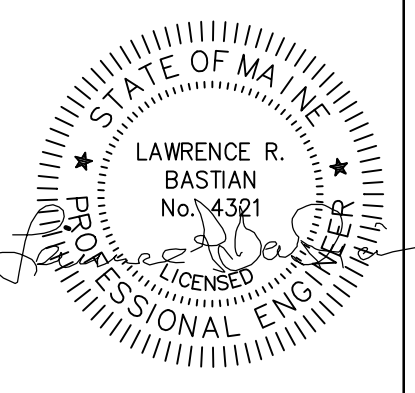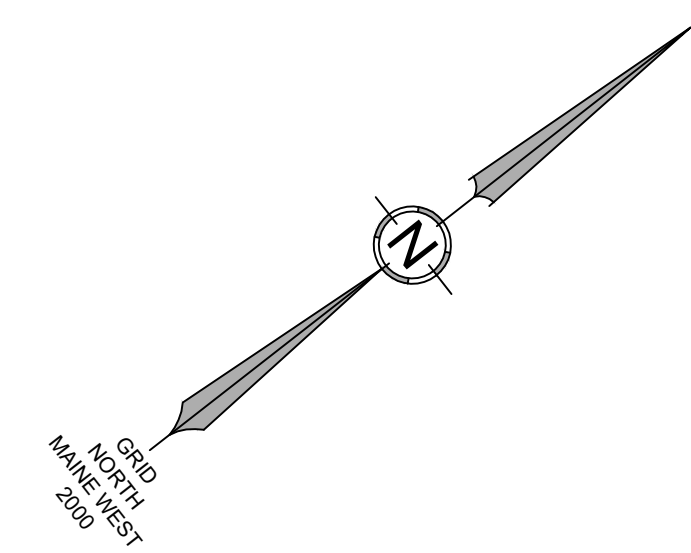


SIGNATURE DATE: 1/15/2020

NO.	DATE	REVISIONS
8	4/15/2020	FINAL REVIEW
7	3/25/2020	REVISED PER TOWN COMMENTS
6	2/13/2020	PEER REVIEW COMMENT RESPONSE
5	1/15/2020	FINAL SUBDIVISION & SITE PLAN REVIEW
4	11/26/2019	REVISED PER MDEP REVIEW COMMENTS
3	3/29/2019	MDEP SITE LOCATION APPLICATION
2	1/21/2019	PRELIMINARY SUBDIVISION & SITE PLAN
1	11/13/2018	PRELIMINARY SUBDIVISION & SITE PLAN

565 CONGRESS STREET  
SUITE 201  
PORTLAND, ME 04102

41 CAMPUS DRIVE  
SUITE 101  
NEW GLOUCESTER, ME 04260

OFFICE: (207) 926-5111  
www.terradynconsultants.com

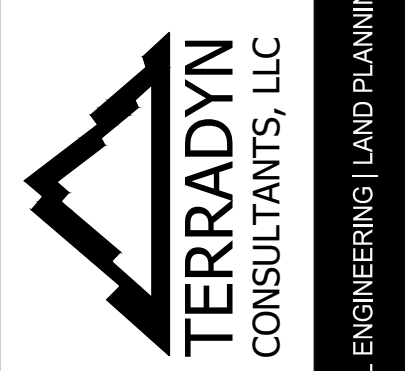

CIVIL ENGINEERING | LAND PLANNING | STORMWATER DESIGN | ENVIRONMENTAL PERMITTING

SHEET DESCRIPTION  
HIGHLANDS SUBDIVISION  
STANDISH, MAINE  
HIGHLANDS DRIVE LANDSCAPING PLAN  
PREPARED FOR  
LEAVITT-TOMPSON, LLC  
P.O. BOX 703  
STANDISH, MAINE 04084

DATE: 3/15/2019  
SCALE: 1"=40'  
DESIGNED: JDA  
JOB NO: 1804  
FILE: 1804 S.DWG  
SHEET

L-1.3

